

# BLUEBOOK

SPECIFICATIONS AND REQUIREMENTS FOR GAS  
INSTALLATIONS

NEW YORK CITY AND  
LONG ISLAND

JULY 2025



## IMPORTANT NOTICE

### **NATIONAL GRID SPECIFICATIONS AND REQUIREMENTS FOR GAS INSTALLATIONS**

These Specifications and Requirements have been designed with great care so that, when followed consistently, they will ensure that a new installation will comply with New York State law, various codes and other safety requirements. Failure to comply may result in a code or safety *violation* and/or a job not being approved. Therefore, delays could result while the contractor corrects the changes at his/her expense.

The specifications, construction standards and other requirements contained in this book represent National Grid's commitment to the contracting community for quality and consistency of service. Any variation from the type of hardware used, connection point of service, service entrance or other details on a construction standard must be approved in advance by National Grid in writing.

We at National Grid are always available to discuss your design concerns and to provide assistance to you. We encourage any questions regarding your problems on specific projects, please be sure to contact us for our input during the *planning* stages to avoid possible additional costs later in the job.

Paul Gugliotta – Manager - Materials & Standards/Gas Engineering

Bob Allgor – Customer Connections

Ray Anderdon - Customer Meter Services

Anthony Azzato – Customer Meter Services

Lance Brailsford - Customer Meter Services

Priya Dasani – Customer Connections

Timothy Dixon – Customer Meter Services

Reginald Durham - Customer Meter Services

Kahliel Marshall - Customer Meter Connections

Kareem McCollin - Customer Connections

John Merrill - Customer Connections

Nicole Merrill - Customer Connections

William Ofori – Atta – Gas Planning and Design Engineering

Tanasia Poke - Customer Connections

Peter Polumbo – Gas Work Methods and Standards

Alberto Rodriguez - Customer Connections

Evan Steffens - Gas Customer Meter Services

Kenneth Stenger - Customer Connections

Richard Verderame - Gas Customer Meter Services

Robert Zabielski - Gas Customer Meter Service

# **Changes to BlueBook:**

## **Section 1.1 Purpose:**

added sections that local coded may supersede NG Codes. Added: Federal and State Installations may be exempt from local municipal Codes/requirements.

## **Section 2: Definitions**

Added definition of Braided Flexible Hose, Draft Sensos, Exhaust Booster, Louver Interlock, Platform, Whisker Switch

## **Section 3.2 Communication**

Clarified NG Contact and information needed

## **Section 3.8 ID of Employees**

Added NG Hired Contractors

## **3.10 Seals and Tampering Devices**

Added jurisdictional piping and Violation of this will result in a Complaint to Department of Building (D.O.B.) or agency having jurisdiction.

## **3.17 Protection when Compressed Air or Oxygen is used**

Revised Section on applicable NFPA Codes

## **4.1.3 General**

Added: The licensed master plumber shall provide a Operator Qualified Task 87 Certification Number

## **4.1.6**

Added: (see Section 8.8 for Underground Piping Certificate Info)

## **4.1.7**

Added: and Gas Authorization / Pressure Test Certificate for meter sets where applicable.

## **4.1.10**

Removed: National Grid will install gas services within 21 days of generation of an authorized work order number or will meet construction due dates established by Customer Connections.

Added: New Gas Main Installation:

All of the buried utility services must be installed prior to National Grid installing the gas main and service.

Added New Gas Service Installation:

National Grid reserves the right to require the Customer to prepare the site (i.e., private property mark out, dig and maintain the trench, protect underground facilities etc.) of the buried utility services must be installed prior to National Grid installing the gas main and service. Trenching installations shall meet all applicable standards i.e. OSHA 1926.652 requirements (requirements for protective systems).

### **Separation of Services:**

Added:

Plastic pipe should be used for services up to and including 12-inch diameter and up to and including 124 psig MAOP, where appropriate materials and fittings are available. 2) Plastic services operating between 100 psig and 124 psig shall meet the following conditions: i. The material shall be PE4710 (except for ½ inch CTS and ¾ inch CTS MDPE noted in Table 5 above) as specified within ASTM D2513 (as described in Part 10.3 of this Title). ii. The pipe size is nominal pipe size 12-inch or less 3) Plastic pipe should not be installed when any of the following conditions exist: i. In NYC, where the service line is within thirty-five (35) feet from an underground steam facility, or in any vault which has a steam facility (NYC Reference Standard 16, Plumbing and Gas Piping). ii. In regions other than NYC, where the service crosses or is within eighteen (18) feet of a steam facility.

Added:

### **CONTAMINATED SOIL**

National Grid reserves the right to require the customer to provide soil testing compliant to Codes such as OSHA 29 CFR 1910.120, Hazardous Waste Operations and Emergency Response.

If contaminated soil is discovered during the installation, the customer shall provide soil environmental sampling and bear the cost of all remediation of the soil and backfill.

### **4.3 RUD and CIPUD Service: added**

**Note:** Clearances to other utilities are specified in Design of Gas Services ENG02001 and Clearances of Gas and Electric in RUD and CIPUD area CNST6015-LI



### **5.3.1 & 5.3.2 Service Entrance**

Added: Split Sleeves are not allowed

### **7.3.1 Installation of Meter Headers;**

**Added:**

(For certain circumstances, residential bypasses can be allowed on Long Island if approved by Technical Lead.)

### **7.5.1 Indoor Meter Locations**

Added: for storage purposes (including chemicals and BBQ propane tanks),

### **7.9.2 Walls to Support Meter Headers**

Remote meter header supporting systems shall not be made of wood. Concrete, Cinder Block, Kindorf, or composite materials is the preferred construction method.

### **7.11.5 Gas Service Regulator and Venting**

Added: Where 2 or more National Grids' regulators are installed, the regulator vent lines must not be manifolded together.


### **7.14.5 Added Purge in and Purge Out tables**

### **9.13 Added: (including generators, fuel cells and co-gens) to Title**

Added: The flexible fuel line shall be installed at the generator fuel inlet located on the frame rail and must exit the generator perpendicular to the fuel rail. No pipe fittings (elbows or swages) are permitted between the flexible fuel line and the generator fuel inlet port.

The flexible fuel line must be as straight as possible. It is designed to isolate the rigid piping system from vibrations on the generator set. It is not intended to correct misaligned pipe sections or to serve as an elbow.

Where motorized fresh air louver(s) are used they must be wired to open automatically during equipment operation. An external end switch/whisker switch shall be mounted on the fresh air louver(s) to prove open position is required and is to be wired into the burner limit circuit(s).

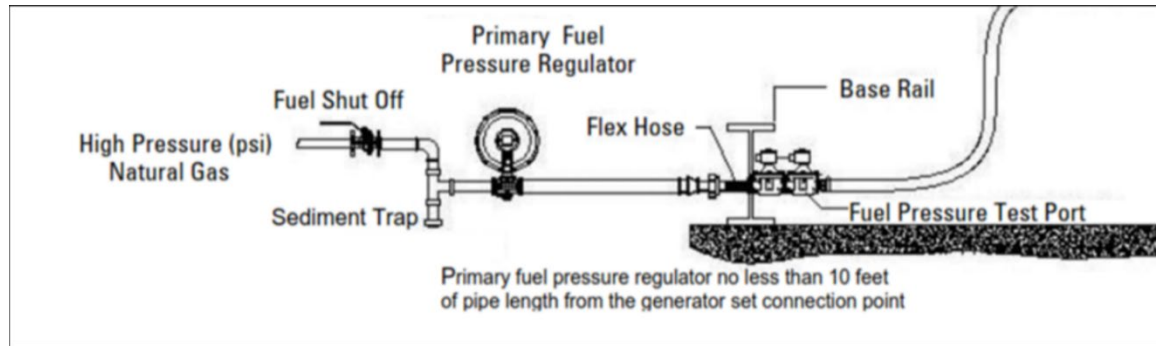

---

**TABLE OF CONTENTS**

1.0	INTRODUCTION 1	
1.1	PURPOSE.....	1
1.2	SCOPE/REFERENCES.....	1
1.3	EXCLUSIONS; RETROACTIVITY.....	2
1.4	ALTERNATE MATERIALS, EQUIPMENT AND PROCEDURES.....	2
1.5	RESPONSIBILITY .....	2
2.0	DEFINITION OF TERMS .....	2-9
3.0	GENERAL .....	10
3.1	AREA/GEOGRAPHICAL CONSIDERATIONS.....	10
3.2	COMMUNICATION/COOPERATION .....	10
3.3	MEANING OF "SHALL" IN THIS BOOK .....	10
3.4	STATE AND LOCAL CODES .....	11
3.5	RESPONSIBILITY FOR CODE APPLICABILITY .....	11
3.6	INSPECTIONS, CERTIFICATES, PERMITS .....	11
3.7	ACCESS TO CUSTOMERS' PREMISES .....	11
3.8	IDENTIFICATION OF EMPLOYEES .....	11
3.9	UNAUTHORIZED CONNECTIONS.....	11
3.10	SEALS AND TAMPERING DEVICES .....	12
3.11	DISCONNECTION OF SERVICE .....	11
3.12	REACTIVATING GAS SERVICE FOLLOWING A WARNING TAG VIOLATION .....	12
3.13	NATIONAL GRID EQUIPMENT ON PRIVATE PROPERTY .....	12
3.14	DEMOLITION .....	12
3.15	INTERCONNECTIONS .....	12
3.16	BACK-PRESSURE AND SUCTION PROTECTION.....	13
3.17	PROTECTION WHEN COMPRESSED AIR OR OXYGEN CAN ENTER GAS PIPING .....	13
3.18	ADEQUACY AND SAFETY .....	13
3.19	CODE COMPLIANCE.....	13
3.20	REVISIONS OF THIS BOOK .....	13
4.0	NEW GAS SERVICE INSTALLATION PROCESS.....	14
4.1	GENERAL.....	14
4.2	REQUIREMENTS FOR HAVING A NEW RESIDENTIAL AND SMALL COMMERCIAL GAS SERVICE INSTALLED .....	21
4.3	RUD AND CIPUD SERVICE.....	22
5.0	GAS SERVICE LINE(S).....	26
5.1	GAS SERVICE LINE(S) TO A BUILDING OR OTHER GAS USAGE .....	26
5.2	LOCATION OF GAS SERVICE LINE(S)/LATERAL(S) .....	26

---

5.3	SERVICE ENTRANCE.....	27
5.4	CONNECTION POINT OF SERVICE, BROOKLYN UNION/CUSTOMER CONNECTION POINT OF GAS SERVICE .....	27
5.5	RESTORATION ON PRIVATE PROPERTY .....	27
5.6	ADDITIONAL METERS OR SERVICES .....	27
6.0	GAS PRESSURE.....	27
6.1	NOMINAL METER OUTLET PRESSURE WHEN SERVED FROM BROOKLYN UNION'S HIGH PRESSURE DISTRIBUTION SYSTEM .....	27
6.2	METER OUTLET PRESSURE WHEN SERVED FROM NATIONAL GRID'S LOW PRESSURE DISTRIBUTION SYSTEM .....	28
6.3	PRESSURE AND CONTRACTOR'S PIPING .....	28
6.4	ELEVATED METER OUTLET PRESSURE ON HIGH PRESSURE DISTRIBUTION SYSTEM .....	28
6.5	ELEVATED METER OUTLET PRESSURE ON LOW PRESSURE DISTRIBUTION SYSTEM .....	30
6.6	LOCAL CODES RELATING TO ELEVATED GAS PRESSURES .....	30
7.0	METERS AND REGULATORS.....	30
7.1	PREREQUISITES AND NOTIFICATIONS FOR NEW GAS METERS.....	30
7.2.	METER SET LOCATION REQUIREMENTS.....	31
7.3	INSTALLATION AND INTERCONNECTION REQUIREMENTS .....	31
7.4	INDOOR METER SET REQUIREMENTS .....	34
7.5	INDOOR METER SET REQUIREMENTS FOR LARGE INSTALLATIONS .....	34
7.6	MULTIPLE METER HEADER REQUIREMENTS .....	35
7.7	METER SET PROTECTION REQUIREMENTS .....	36
7.8	METER HEADER PAD REQUIREMENTS FOR LARGE GAS INSTALLATIONS .....	36
7.9	WALLS TO SUPPORT METER HEADER REQUIREMENTS .....	36
7.10	RELOCATION OF GAS METER SETS .....	36
7.11	GAS SERVICE REGULATOR AND VENTING REQUIREMENTS.....	37
7.12	METER BYPASS REQUIREMENTS.....	38
7.13	TELEMETERING INSTALLATION REQUIREMENTS .....	38
7.14	METER INSTALLATION, PURGING AND RELIGHTING .....	38
7.15	PILOT GAS SUPPLY FOR INTERRUPTIBLE RATE CUSTOMERS .....	39
8.0	CUSTOMER-OWNED GAS PIPING SYSTEMS .....	39
8.1	GENERAL.....	39
8.2	PIPE SIZING .....	40
8.3	PIPING DRAWING .....	41
8.4	GAS PIPING MATERIALS.....	41
8.4.1	GENERAL.....	41
8.4.2	GAS PIPING MATERIALS, INDOORS .....	41
8.4.3	GAS PIPING MATERIALS, OUTDOORS, ABOVE GROUND .....	42
8.4.4	GAS PIPING MATERIALS, BELOW GROUND, GENERAL .....	42
8.4.5	GAS PIPING BELOW GROUND, STEEL PIPE OPTION.....	43
8.4.6	GAS PIPING BELOW GROUND, PLASTIC PIPE OPTION .....	43
8.4.7	GAS "PIPING" BELOW GROUND, COPPER TUBING OPTION .....	44
8.5	VALVES.....	44
8.6	STEEL GAS PIPING, WELDING REQUIREMENTS .....	44

8.6.1	GENERAL.....	44
8.6.2	RESIDENTIAL, COMMERCIAL, INDUSTRIAL, MULTI-FAMILY INSTALLATIONS IN NASSAU AND SUFFOLK COUNTIES .....	44
8.6.3	ALL PUBLIC AND PRIVATE SCHOOL BUILDINGS, INCLUDING COLLEGES.....	46
8.6.4	TESTING REQUIREMENTS OF PIPING AFTER THE METER.....	47
8.6.5	STANDARDS FOR NON MERCURY GAUGE.....	47
8.6.6	WELDER QUALIFICATIONS.....	47
8.7	GAS PIPING (INDOORS AND OUTDOORS) ABOVE GROUND, INSTALLATION REQUIREMENTS, GENERAL .....	48
8.8	GAS PIPING OUTDOORS, BELOW GROUND, INSTALLATION REQUIREMENTS.....	49
8.9	STEEL GAS PIPING , CORROSION PROTECTION REQUIREMENTS, COATING AND WRAPPING .....	51
8.10	STEEL GAS PIPING, CORROSION PROTECTION REQUIREMENTS, INSULATING JOINTS .....	51
8.11	STEEL GAS PIPING, CORROSION PROTECTION REQUIREMENTS, MAGNESIUM ANODES.....	52
8.12	PLASTIC PIPING, INSTALLATION REQUIREMENTS.....	52
8.13	COPPER TUBING INSTALLATION REQUIREMENTS .....	53
8.14	GAS PIPING THROUGH BUILDING WALLS, ABOVE OR BELOW GROUND, INSTALLATION REQUIREMENTS .....	54
8.15	PRESSURE TESTING OF GAS PIPING .....	54
9.0	GAS UTILIZATION EQUIPMENT .....	54
9.1	GENERAL.....	54
9.1.1	APPLIANCES, ACCESSORIES AND EQUIPMENT APPROVAL .....	54
9.1.2	INSTALLING CONTRACTOR'S RESPONSIBILITIES.....	54
9.1.3	CO ALARMS .....	55
9.1.4	ASSEMBLY OF EQUIPMENT .....	55
9.1.5	GAS UTILIZATION EQUIPMENT INSTALLED IN RESIDENTIAL GARAGES.....	55
9.2	NATIONAL GRID <u>"NATURAL GAS PRESSURE, IGNITION &amp; DRAFT TEST"</u> .....	55
9.3	GENERAL REQUIREMENTS, SPACE AND WATER HEATING EQUIPMENT INSTALLATIONS .....	55
9.4	COMBUSTION, DILUTION AND VENTILATION AIR (FRESH AIR) REQUIREMENTS.....	56
9.5	VENTING OF CATEGORY I GAS UTILIZATION EQUIPMENT ONLY .....	56
9.6	VENTING OF GAS UTILIZATION EQUIPMENT - CATEGORIES II, III AND IV .....	57
9.7	CHIMNEYS.....	57
9.8	SPILL SWITCH REQUIREMENTS.....	57
9.9	INSTALLATION OF HEAT PRODUCING EQUIPMENT IN FLAMMABLE OR CORROSIVE ATMOSPHERES .....	57

9.10	GAS CONVERSIONS AND CONVERSION BURNER REQUIREMENTS .....	58
9.11	GAS FIREPLACES (VENTED DECORATIVE GAS APPLIANCES).....	59
9.12	ILLIMINATING DEVICES.....	59
9.13	NATURAL GAS COMBUSTION ENGINES .....	60
9.14	COMPRESSED NATURAL GAS (CNG) STATIONS.....	61
9.15	UNVENTED ROOM HEATERS.....	61
9.16	OTHER EQUIPMEMNT .....	61
9.17	COMBO WATER HEATERS.....	61

## APPENDICES

APPENDIX A	SERVICE REGULATOR VENT PIPING REQUIREMENTS
APPENDIX B	CHOOSING A FURNACE OR BOILER
APPENDIX C	NATIONAL GRID'S NEW METER SET HOTLINE
APPENDIX D	GAS PIPING SYSTEM PRESSURE TESTING REQUIREMENTS AND INSTRUCTIONS
APPENDIX E	CUSTOMER OWNER GAS PIPING INSPECTION CERTIFICATE
APPENDIX F	CORRIGATED ATAINLESS STEEL TUBING
APPENDIX G	NEW YORK STATE CO ALARM LAW RULE
APPENDIX H	PROPERTIES OF NATURAL GAS
APPENDIX I	METER SIZES AND DIMENSIONS
APPENDIX J	FREQUENTLY USED STANDARDS
APPENDIX K	LINKS TO MANUFACTURERS
APPENDIX L	ODOR FADE

## **Blue Book PART II – Temperature Controlled Specifications**

## 1.0 INTRODUCTION

### 1.1 PURPOSE

This book presents specifications and requirements relating to the connection and use of natural gas supplied from the National Grid Gas System. It contains the minimum acceptable standards for gas piping and gas appliance installation necessary to ensure the safe and satisfactory utilization of natural gas by our customers. The information contained herein is intended primarily to assist the installer in the new gas installation process, but it is also intended for use by our customers, by architects and engineers, and finally, by people in various departments at National Grid. It shall be used when a customer's gas installation is new, when a customer is increasing gas usage from a smaller capacity, or when any changes are made from the original installation. It represents a collection of information which will provide for a safe, properly conceived, accurately sized and cost effective installation that will give long lasting, satisfactory service to our customers.

Other Local Codes may supersede National Grid's Codes. Federal and State Installations may be exempt from local municipal Codes/requirements.

The operation of the head of service valve or meter valve is restricted to National Grid's Operator Qualified personnel.

National Grid's jurisdictional ends at the outlet of the National Grid meter.

### 1.2 SCOPE/REFERENCES

The contents of this book apply to installations connecting gas supply system to a customer's premises. We have made it as comprehensive as is practical, within the limits of the intended overview of the subject matter it addresses. The intent of the book is to provide a framework for the subject, not a collection of specific information from various sources. Generally, it refers to several primary documents which form its basis:

- a. The National Fuel Gas Code (NFPA 54/ANSI Z223.1), latest revision, referred to in the book as NFPA 54.  
**(COVERS CUSTOMER OWNED PIPING AFTER THE GAS METER)**
- b. The New York State Codes, Rules and Regulations Title 19 (16 NYCRR 255 and 261), latest revision, referred to in the book as *NYCRR*.  
**(COVERS UTILITY OWNED PIPING BEFORE THE GAS METER)**
- c. Fuel Gas Code of New York State (FGCNYS)  
**(COVERS CUSTOMER OWNED PIPING AFTER THE GAS METER IN NEW YORK STATE)**
- d. Manual of Planning Standards for School Buildings (NYS Board of Regents)  
**(COVERS ALL NY STATE SCHOOLS, EXCEPT NYC)**
- e. International Fuel Gas Code  
**(COVERS CUSTOMER OWNED PIPING AFTER THE GAS METER)**

It is important to note here that **New York City**, towns, villages, counties, etc., frequently have codes to which the owner or his/her plumbing contractor is expected to adhere. It is ***the owner's or installer's responsibility*** to become aware of the requirements of the area in which the installation is to take place. The reference to the latest revision of the National Fuel Gas Code (NFPA54) is intended to be followed in New York City. The reference to the latest revision of the Fuel Gas Code of New York State (FGCNYS) is intended to be followed in areas outside New York City, but within New York State.

National Grid's Long Island Service Territory includes the Rockaway Peninsula. New York City and local plumbing Codes will apply to the Rockaway Peninsula. The references to Long Island in this BlueBook apply to the Rockaway Peninsula.

### 1.3 EXCLUSIONS; RETROACTIVITY

Unless otherwise stated, the provisions of this book shall not be applied **retroactively** to existing installations and/or systems that were in compliance with the Rules and Regulations/Specifications and Requirements in effect at the time of installation. In cases where modifications are being made, those modifications shall be installed to conform to the specifications and requirements of this book.

### 1.4 ALTERNATE MATERIALS, EQUIPMENT AND PROCEDURES

If the contents of this book are not applicable to the equipment to be installed, or if an alternate installation method or alternate usage of material is being considered that is not covered in this book, National Grid shall be contacted for definition or clarification before proceeding with the installation. Sufficient technical documentation, such as a manufacturer's written instruction, must be submitted to substantiate any claims made regarding the safety of such alternatives.

### 1.5 RESPONSIBILITY

Pursuant to Gas Tariff's, notwithstanding any inspection by National Grid of a customer's equipment or equipment installation or any failure by National Grid to reject an equipment installation, National Grid does not provide any warranty, expressed or implied, as to the adequacy, safety or other characteristics of any structures, equipment, wires, pipes appliances or devices owned, installed or maintained by the customer or leased by the customer from third parties.

## 2.0 DEFINITION OF TERMS

The following definitions of terms used in this book have been assembled from various sources, and have been edited to be meaningful for use in this context and in the gas utility business.

**Accessory:** A device or material used to conduct gas or used in conjunction with an "appliance". In this book, some examples of accessories are valves, thermostats, appliance connectors, pressure regulators, draft hoods and interior house piping.

**AGA:** American Gas Association; an organization made up of most American gas utilities, producers and transporters, which sets standards and disseminates information throughout the gas industry in the interest of bettering industry practices and advancing safety.



**Appliance:** A self-contained device, such as a range or boiler, that converts energy into heat or other useful purpose. In this book, appliance usually relates to furnaces, boilers or water heaters.

**Applicant:** A potential customer.

**Booster:** A centrifugal blower selected to increase gas pressure when the pressure in the gas main at the customer's location is insufficient for a customer's requirements. Boosters are usually required only in industrial or commercial applications. A booster is a machine that is designed to operate on a flat pressure vs. flow curve, which enables it to provide variable flow at an essentially constant pressure. Boosters for natural gas service normally are selected to increase pressure to no more than 28" of water column (W.C.), and are normally furnished hermetically sealed.

**Braided Flexible Connection (Braided Flexible hose):** A braided flex hose, also known as a braided flexible hose or braided hose, is a type of flexible tubing that is reinforced with a braided material, typically made of stainless steel or other durable materials. See example:



**BTU, Btu:** Abbreviation for British Thermal Unit. A Btu is a unit of energy defined as the amount of heat required to raise one pound of water one degree on the Fahrenheit scale, normally from 60 degrees F to 61 degrees F.

**BTUH, Btuh:** Abbreviation for British Thermal Units per hour. Also expressed as **Btu/Hr.** A standard measure of energy input and output. Typically used in the gas utility industry as a measure of the total, or capacity, of a gas appliance, such as a boiler or a furnace.

**Building:** A structure that stands alone or is separated from adjoining structures by fire walls with all openings therein protected by approved **fire** doors. In certain applications, a **party** wall may be required instead of a fire wall.

**CFH, cfh:** Abbreviation for cubic feet per hour. A standard measure of gas flow. Generally understood to mean, and often used interchangeably with, **SCFH** or **Scfh**, or standard cubic feet per hour, meaning gas measured at "standard conditions", or 60 degrees Fahrenheit and atmospheric pressure (14.7 psia or 30" mercury absolute). Typically used in the gas utility industry to express gas flow to a customer's premises and through the customer's piping. For gas flowing at the pressures generally used in a customer's premises (about 6" W.C.), flows **expressed in cfh can be assumed**, for use in calculations such as determining pressure drop in piping and valves, **to mean scfh**, with a negligible margin of error. (This assumption is not valid for metering and billing calculations where the pressures are corrected back to 7" W. C., or 0.25 pounds per square inch [PSIG].)

**CIPUD:** Commercial/Industrial Project underground distribution – a National Grid term used to describe a new commercial and industrial development project where all the utilities are

furnished underground in a common trench. See RUD for residential projects and additional information.

**Connection Point of Service:** That point in the gas service line where responsibility ends and the customer's responsibility begins; or that point where gas service **piping** ends and customer-owned piping begins. Also known as Connection Point, Connection Point of Gas Service, National Grid/Customer Connection Point of Gas Service, Point of Delivery, Point of Service and Customer Interface. The Connection Point of Service may be located physically at different points in the piping, depending on the meter header configuration used, as defined on Construction Standards.

**Construction Standard:** A technical instruction, usually a drawing, but often including diagrams and tables, prepared and agreed to within **National Grid** as a standard method of performing a task, and used for the installation of gas facilities. See Project Manager for a copy of the latest job specific Construction Standard.

**Contractor:** A **licensed/qualified** installer of gas utilization equipment and associated piping, ductwork and controls.

**Conversion, Gas Conversion:** An installation where an appliance originally designed for use with a fuel other than natural gas has been modified to use natural gas, without extensive modifications to the original appliance. A typical gas conversion modifies only the burner of the appliance.

**CSA - CSA International** - an organization that tests equipment and accessories to insure it is suitable for use in a specific manner or certified to be listed to a specific Standard.

**Customer:** A user of gas. A customer may be a person, firm, partnership, corporation, association, developer, builder, or governmental agency to whom gas is supplied and billed by National Grid. All National Grid customers are provided, emergency assistance at no charge, covering generic concerns relating to the meter, the gas service, gas odor reports, low or high gas pressure, gas service outages, and other unusual conditions relating to the gas supply.

**Residential Customer:** A customer supplied by National Grid with gas service at premises used as his/her residence, or a landlord's residence, through a separate meter.

**Commercial Customer:** A customer supplied by National Grid with gas service at his/her business premises through a separate meter.

**Multiple Dwelling Customer:** A customer supplied by National Grid with gas service at premises used as his/her residence, but in a multiple dwelling building, normally through a separate meter, but sometimes through a common meter as conditions warrant.

**Interruptible Customer:** A customer supplied by National Grid with gas service at his/her business premises through a separate meter, that may be interrupted at critical times as agreed to by the contract with National Grid. These customers **shall** have the capability of burning a second fuel, when the gas service is interrupted.

**Temperature Controlled Customer:** A customer supplied by National Grid with gas service at his/her business premises through a separate meter, that will be interrupted

at an annually pre defined temperature as agreed to by the contract with National Grid. These customers should have the capability of burning a second fuel, when the gas service is interrupted.

**Transportation Customer:** Residential or commercial customers who purchase natural gas directly from a gas supplier, rather than from a utility. The customer contracts with a gas broker, who arranges monthly with a supplier, a gas pipeline company and National Grid to have quantities of gas transported directly to him/her (the customer). Transportation customers are billed both by the gas broker and by National Grid. The broker's bill reflects the commodity cost, the transportation cost (interstate pipeline) and the broker's commission.

**Customer Owned Piping:** Is defined as all piping above ground and below ground installed after the meter. It is the customer's responsibility to install, test, maintain and keep records of this piping.

**Dekatherm:** A therm multiplied by 10 (10 therms). A commonly used quantity of gas used for billing purposes. Also see *therm*.

**Draft Sensor:** A draft sensor is a device used to measure the presence and intensity of draft or airflow in a specific area, typically in HVAC (Heating, Ventilation, and Air Conditioning) systems, combustion appliances, or industrial processes.

**Elevated Pressure:** Gas supplied to a customer's equipment at pressures greater than 7" W.C. (0.25 PSIG).

**Easement:** Right to pass over, occupy or use another's land for the placement and access of company service facilities.

**Exhaust Booster:** An exhaust booster is a device used in ventilation systems to enhance the exhaust airflow from a space, typically in industrial, commercial, or residential installations.

**Fire Wall:** Similar to a Party Wall in construction, is generally an *internal* wall. However, openings, between adjoining areas, such as fire doors, or extensions of facilities, are permitted in firewalls. Both party walls and firewalls may have different construction requirements and/or different fire ratings, depending on the type of building. Consult state and local codes for further clarifications.

**Gas Business Lead:** The National Grid Gas Marketing and Sales employee who is the prime contact for the customer when a new installation or a conversion is undertaken. The Gas Business Lead provides economic, technical and policy information regarding the use of natural gas for all applications; e.g. heating, water heating, process uses, etc. **New Construction Representatives** handle gas heating for all new home and development construction and **Commercial and Industrial Representatives** handle the commercial **Industrial and Multi family** market. **Key Account Executives** handle large buildings and chain accounts (e.g. schools, hospitals, department stores).

**Gas Distribution System, Low Pressure:** A gas distribution piping system in which the pressure is substantially the same as the standard pressure delivered to the customer and where service regulators are not installed.

**Gas Distribution System, High Pressure:** A gas distribution piping system in which the pressure is nominally higher than the standard pressure delivered to the customer and therefore requires a service regulator. gas distribution system may furnish gas to the customer's service location at several different pressures, depending on the geographical area served. For the purposes of this book, all pressures are referred to as **high pressure**. For information, pressures serving the areas may be: Intermediate - nominally 50" w.c. (2 psig); Medium nominally 10 or 30 psig; or high - 60 psig or higher.

**Gas Service, Gas Service Line:** A gas service, or gas service line, is the pipe that provides gas from a gas main in a public area to a customer's building. The gas service is installed and owned by National Grid in most cases. ***Gas service line means the piping, including associated metering and pressure reducing device(s), that transports gas below grade from a main to the outside of the building foundation wall where the meter is located outside the building. If the meter is located inside the building, the service line terminates at the first accessible fitting inside a wall of the customer's building.*** In some specific cases, because of unique physical conditions, contractor installed, buried, customer-owned piping must be ***treated as a gas service***, and must therefore be installed in strict accordance with Section 8 of this book.

**Gas Technical Lead:** The National Grid person from the Gas Sales Project Management or C.M.S. (Customer Meter Services) who is the technical contact for the customer when a new installation or a conversion is undertaken.

**IAS:** International Approval Service – An organization that tests equipment to insure it is suitable for use in a specific manner.

**Integrated Schedule:** Also National Grid/Builder Integrated Schedule. A preliminary schedule used in RUD projects as well as selected commercial gas-only jobs, that specifies design and construction activities, milestones and commitments agreed to between National Grid and the builder(s).

**Installer:** See Contractor.

**Labeling:** “appliances shall be listed and labeled” (no longer MEA required, OTCR (Office of Technical Certification and Research) created to recognize code-prescribed and alternative materials)

**Listed:** Equipment or material included in a list published by an organization acceptable to National Grid, such as the IAS or Underwriters Laboratories (UL) **MEA**, and concerned with product evaluation that maintains periodic inspection and evaluation of the production of listed equipment or materials. A typical listing states that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

**Louver Interlock:** A louver interlock is a safety mechanism used in HVAC (Heating, Ventilation, and Air Conditioning) systems, particularly in buildings with ventilation systems that include louvers. The interlock ensures that the louvers operate safely and effectively, preventing issues such as backdrafts or improper airflow.

**Low Pressure Service:** Gas supplied to a customer from a low pressure gas main.

**Meter:** The instrument used to measure and indicate and/or record the volume of gas that has been delivered to a customer.

**Meter Bar:** A specialized item of hardware that functions as a connecting device between the gas service line and the gas meter.

**Meter Set:** The term used to describe the meter and its related piping and equipment. Often synonymous with ***meter header, meter installation.***

**Meter Header:** The piping and equipment installed at a customer location relating to and in support of the meter.

**Multiple-Family Building:** A structure, including row houses, enclosed within exterior walls or fire walls, built, erected and framed of component structural parts, and designed to contain five or more individual dwelling units for permanent residential occupancy.

**Multiple Services to a Building - only one service will normally be permitted to a building; a separate building shall consist of either a detached, separate structure, or an attached structure separated from the first structure by a party wall, as defined in the New York State Uniform Fire Prevention and Building Code.**

**Nominal:** The standard pressure at which National Grid furnishes gas to customers. Nominal pressure depends on the pressure of gas main at a given installation. When served from a high pressure main, nominal pressure is **6" W.C.** When served from a low pressure main, nominal pressure can vary from 4.0" W. C. to 9.5" W. C. Nominal pressure is taken to be the pressure measured at the **connection point of service.** See Section 6.0 of this book for more information.

**Party Wall:** A party wall shall contain no openings therein. A party wall shall be continuous from the lowest floor level of the building through the roof membrane, and shall terminate in a two foot parapet (except where properly sealed at the roof level). Party walls shall bear the proper fire rating as per the NY State Code, and shall be smoke tight at the exterior walls. They shall also be capable of supporting either side of the roof assembly in the event of a collapse.

**Platform:** An OSHA approved structure to gain access to National Grid's Equipment provided by Customer/  
*(see examples – other platforms will differ as they are site specific)*



**Project Manager:** National Grid's primary contractor liaison for large volume Non-residential, Commercial and Industrial installations.

**Regulator:** A device used to reduce the pressure of gas from a higher pressure at its inlet to a lower pressure at its outlet, maintaining that pressure essentially constant, while also controlling the flow of gas; usually mounted directly in gas piping.

**Regulator, Line:** A regulator provided by the customer (see definition above) used on elevated pressure installations (pressures greater than the nominal 6" W.C.), that is mounted in the house line between the service regulator and the appliance regulator, and reduces gas pressure from that elevated pressure to the typical nominal house line pressure of 6" W.C. This regulator must provide a bubble tight (dead end lock-up) with full relief capacity.

**Regulator, Service:** A regulator that reduces and controls gas main pressure to the pressure of the customer's house line. Usually set by National Grid to supply gas at 6" W. C., gas at a higher pressure can be furnished if the end-using equipment is specified by the manufacturer to require a higher pressure. This regulator is furnished, installed and maintained by National Grid.

**Regulator, Appliance:** A regulator (see definition above) mounted at the appliance, (normally furnished with the appliance) that reduces the house line pressure to the pressure utilized by the appliance.

**RUD:** Residential Underground Distribution. A National Grid term used to describe a new building project for residential developments of five or more dwelling units where all the utilities are furnished underground in a common trench. Extensive coordination is required within National Grid regarding the electric and gas installations to the development, as well as coordination outside with other utilities, such as telephone and cable television.

**Security Valve:** A control valve, installed on a meter header, usually for a large load, that is set to close automatically upon sensing one or more gas parameters, usually high and low pressure. A meter header using a security valve is normally designed by National Grid.

**Sediment Trap:** "a tee fitting with a capped nipple in the bottom opening of the run of the tee or other device approved as an effective sediment trap – to collect solid foreign particles to prevent such material from entering close-fitting parts or small passageways (e.g., valves and orifices)

**Service Riser: (Sweep el)** That portion of gas service line where the piping comes out of the ground.

**Tariff:** A compilation of written definitions, statements, rates, rules and regulations that together describe basis for doing business, and that have been approved by the New York State Public Service Commission.

**Therm:** A unit of heating value equivalent to 100,000 BTUs. Gas is normally billed by the therm, or by the **decatherm**, which is a therm multiplied by 10 (or 10 therms). A cubic foot of gas is generally equal to 1,000 - 1,060 BTUs as supplied by National Grid .

**UL:** - Underwriters Laboratory - an organization that tests equipment and accessories to insure it is suitable for use in a specific manner or certified to be listed to a specific Standard.



**Warning Tag; Warning Tag Procedure:** A New York State mandated set of detailed safety warning criteria in which gas utilities are required to provide notice to customers upon discovery of potentially unsafe gas piping and appliances. National Grid executes this mandate via a Warning Tag procedure, which serves notice of a problem to customers by leaving a warning tag at the premises. A warning tag is issued when a condition is identified in which a gas appliance or gas piping are deemed to present a hazard to life or property if allowed to operate in the condition found. Conditions requiring the issuance of warning tags fall into three classes:

- Class A: Those conditions that present an immediate hazard and require the gas to be shut off and locked at the meter or effectively isolated in some other manner. A Class A warning tag is generally found to be associated with leaking gas piping, or carbon monoxide.
- Class B: Those conditions that present an immediate hazard and require the gas to be shut off, but not locked at the meter, unless the hazard can be isolated from the rest of the gas system. Class B warning tags are generally found to be applicable to unsafely installed appliances or related equipment.
- Class C: Those conditions that do not present an immediate hazard, but if not corrected may become hazardous. The gas will be left on. A Class C warning tag can be issued for a variety of reasons, most often related to appliances. Examples would be an improperly installed flue pipe or an electrical hazard.

**W.C., w.c.:** Water column; the standard scale of measurement, expressed in *inches of water column*, used in the natural gas industry to measure gas pressure. The units of inches of water column (W.C.) are commonly used for pressures below **1 psig**. 1 psig = 27.8" W.C. Gas customers are typically furnished natural gas at a pressure of 6" W. C. which is about 1/4 **psig**.

**Whisker Switch:** a type or limit (external end switch) that detects the position of the louvers on any appliance (eg. boilers, generators, commercial dryers) that requires fresh air.

### 3.0 GENERAL

#### 3.1 AREA/GEOGRAPHICAL CONSIDERATIONS

The working area of National Grid Gas Business Unit geographically encompasses Nassau and Suffolk Counties as well as those portions of New York City **supplied by National Grid**. National Grid also cover the Albany and Syracuse territory. Therefore, in order to ensure that all installations utilizing National Grid supplied gas are consistent in their usage, but are still in compliance with regulations in these different geographical areas, the book has been designed to apply generically to all of these areas. Where it is appropriate, it addresses needs by specific geographical location. It is the customer/plumbing contractor's responsibility to become familiar with the specific requirements of the area of the installation. The reader is strongly encouraged to check with the village, town, city and county governments applicable to his/her installation, to determine if regulation changes have been made, or to determine if any new regulations have been enacted, since the creation of this document.

#### NOTE

***The knowledge of the existence or absence of regulations within a given jurisdiction is the responsibility of the contractor.***

### 3.2 COMMUNICATION / COOPERATION

It is our goal at National Grid to ensure that all of our customers experience safe, trouble-free and dependable gas service. Achievement of this goal begins early in the process of any gas installation. We believe that this can best be accomplished through close cooperation and communication with our customers and their contractors, to assure a quality job, during all phases of the planning and installation of a gas service. ***Therefore, it is vital that both customer and contractor contact the National Grid Customer Connections Team and provide preliminary information (such as gas application load letter, site plan) as early as is feasible in the development of plans for the installation of a new gas service or an increase in gas load.*** With this information we can ensure that the scheduling of our construction work, meter installation and other service work is appropriate. It will also provide us with an early opportunity to advise customers and contractors if any unique job characteristics exist concerning gas equipment and metering facilities. This kind of communication and cooperation, along with careful adherence to the instructions and specifications in this book, is crucial in preventing delays at any point in a job, and avoids problems that may be difficult to correct later on. We believe that this is the most effective way to ensure complete customer satisfaction with our gas service.

### 3.3 MEANING OF "SHALL" IN THIS BOOK

When used in this book, the word ***shall*** is to be understood to mean that the contractor/customer must comply to the fullest extent with the specification, action or physical requirement described. Failure to comply will result in refusal to provide a meter or connect to our gas system. Where a National Grid First Inspection is concerned, failure to implement these specifications, actions or physical requirements will result in a failed inspection. Other resultant actions could be Class "A" or Class "B", warning tag violations, which require further action by the contractor/customer before National Grid releases the job for final use by the customer, or refusal by National Grid to provide service. The meaning of the term "must" is considered to be the equivalent of the term "shall" in this book.

### 3.4 STATE AND LOCAL CODES

The specifications and requirements in this book are intended to supplement or amplify any State, City, Town or Village code or ordinance. If a conflict exists between a National Grid requirement and a local code requirement, the more stringent shall apply. ***It is the Contractor's responsibility to be aware of the code requirements for the area of his/her installation. National Grid does not assume the obligation of enforcing local code requirements.***

### 3.5 RESPONSIBILITY FOR CODE APPLICABILITY

The use of the information and standards contained in this book by any contractor in no way releases them from the responsibility of becoming aware of and implementing local, state or national codes that may be applicable in the location where the installation is



located, except that the standards and requirements contained herein shall always apply *when they are more stringent*.

### 3.6 INSPECTIONS, CERTIFICATES, PERMITS

If the local jurisdiction where an installation is being planned requires an inspection, a certificate or a permit, it is *the owner/contractor's responsibility* to make the appropriate arrangements.

### 3.7 ACCESS TO CUSTOMERS' PREMISES

National Grid shall have the right of access, at all reasonable times, to all its property installed in or on the customer's premises. This shall include items such as buried service lines and valves, exposed service lines and valves, gas meters, gas regulators, or gas regulator vents. National Grid shall reserve the right to erect, remove, operate, or maintain our facilities, and to read and test our gas meters on the customer's premises.

### 3.8 IDENTIFICATION OF EMPLOYEES

Every National Grid employee or [National Grid hired contractors](#) who are authorized to enter the customer's premises for the purpose of reading or testing meters, investigating odor complaints, or for other purposes, is supplied with an identification card bearing his/her photograph. Employees must, upon request, show their identification cards. If anyone claims to represent the Company and fails to display an identification card upon request, the customer is advised to deny admittance to that individual and to notify both National Grid and the police.

### 3.9 UNAUTHORIZED CONNECTIONS

National Grid and approved operator qualified [National Grid's](#) contractors shall have the sole right to make all gas service connections to its gas distribution system.

### 3.10 SEALS AND TAMPERING DEVICES

No person, except a duly authorized National Grid employee shall be permitted to break or replace a seal or lock on, [jurisdictional piping](#) to alter or change a gas meter or its connections or location, open or alter a meter by-pass valve, or to alter a gas pressure regulator setting. [Violation of this will result in a Complaint to Department of Building \(D.O.B.\) or agency having jurisdiction.](#)

### 3.11 DISCONNECTION OF SERVICE

National Grid possesses the sole right to disconnect, remove or reset gas services and/or meters, and to admit gas to any new system of piping or to any old system of piping from which the use of gas has been temporarily discontinued. When installers find it necessary to operate the head of service valve or any valve on National Grid jurisdictional piping to temporarily shut off the gas, call National Grid to requested a shut off, or turn on the meter and to re-light the appliance.

### 3.12 REACTIVATING GAS SERVICE FOLLOWING A WARNING TAG VIOLATION

- 3.12.1 When National Grid issues a Warning Tag to the customer that involves shutting off the gas supply to an individual appliance and/or a particular section of gas piping due to a hazardous condition, service does not need to be restored by National Grid. Once repaired, gas service may be restored to the effected appliance and/or piping by a licensed qualified contractor.
- 3.12.2 When National Grid issues a Warning Tag that involves the gas supply being shut-off and locked at the meter, the contractor or customer shall notify National Grid that the hazardous condition has been corrected and request that National Grid turn on the gas supply.

### 3.13 NATIONAL GRID EQUIPMENT ON PRIVATE PROPERTY

All National Grid equipment located on the customer's premises, such as the gas service line, meter, regulators, meter piping, etc., remain National Grid property, and may be removed by National Grid in the event such equipment is no longer needed.

### 3.14 DEMOLITION

Prior to any demolition of any existing building where gas and/or electric service is installed, the gas and electric must be shut off and the gas service lateral cut by National Grid at the property line. No building demolition shall be started until gas meters and regulators have been removed and the gas service has been retired (physically disconnected) by National Grid. **Call (833) 359-0645 for Long Island and (718) 643-4050 in Brooklyn, Queens and Staten Island.**

### 3.15 INTERCONNECTIONS

- 3.15.1 When a supplementary fuel supply for stand-by use is connected downstream of a gas meter, an adequate, full-port, three-way valve shall be installed between the meter and the stand-by fuel piping connection. The stand-by fuel piping and the natural gas piping downstream of the three-way valve shall be equipped with shut-off valves. Three-way valves of the type that completely close one port before starting to open the other port shall be used. The three-way valve shall be suitable for use in natural gas service and the supplementary fuel supply used at the site where it is installed.

### 3.16 BACK-PRESSURE, AND SUCTION PROTECTION

- 3.16.1 When the nature of a customer's utilization equipment may induce back-pressure or suction in the piping system carrying gas (such as a gas booster), suitable protection devices shall be installed and maintained by the customer. The contractor is referred to Sections 5.10 of NFPA 54 and Section 414 of the FGCNY. National Grid's project manager should be contacted when this application is to be used.

### 3.17 PROTECTION WHEN COMPRESSED AIR OR OXYGEN CAN ENTER GAS PIPING **(Including torches, jewelry torches)**

- 3.17.1 Protection is required whenever an installation uses compressed air or oxygen that might accidentally, or for other reasons, cause air or oxygen to enter the gas

pipng. The contractor is referred to [Sections 7.12 of NFPA 54](#) and Section 414 of the FGCNY. Protection devices, such as flame arrestors and check valves shall be installed and maintained by the customer, National Grid's should be contacted when this application is to be used.

### 3.18 ADEQUACY AND SAEFTY

#### 3.18.1 *National Grid shall not be required to supply gas service until the customer's installation has been approved by the local authorities having jurisdiction.*

National Grid reserves the right to withhold its service or discontinue its service, whenever an installation or part thereof is deemed by National Grid to be unsafe, inadequate or unsuitable for receiving service or interferes with or impairs the continuity or quality of our service to our customers or to others. An example of a situation where National Grid will refuse service is that in which a piping pressure test shows unacceptable results.

### 3.19 CODE COMPLIANCE

3.19.1 Gas appliances and gas piping installations on the customer's premises shall be installed in compliance with the minimum safety requirements of these standards and the National Fuel Gas Code. These provisions shall be applicable to new installations and to modifications of existing appliances or systems. Any appliance or system found to be in non-compliance with National Grid standards or other applicable codes shall be subject to the provisions of Warning Tag Procedure (see Definitions, Section 2.0).

3.19.2 The NYC Building Codes, Fuel Gas Codes of NY State and applicable State Codes shall be followed in NYC.

### 3.20 REVISIONS OF THIS BOOK

3.20.1 The information in this book will be periodically revised, updated or amended **on-line only** as required by industry developments to protect the mutual interest of the customer and National Grid. The printed versions will no longer be available and shall not be referenced any longer. The on-line version will be the only valid issue of the BlueBook.

## 4.0 NEW GAS SERVICE INSTALLATION PROCESS

### 4.1 GENERAL

4.1.1 To initiate a new gas installation or to advise National Grid of an additional gas load, call ***1-877-MyNGrid (1-877-696-4743)***.

4.1.2 A logical progression of events and requirements for having a new gas service installation is provided in Section 4.2. It is important for contractors and customers to become familiar with this material in order to determine how a new gas service installation or a conversion progresses through the National Grid system.

4.1.3 For any new installation, the customer or his/her contractor shall provide National Grid with a completed [load letter package](#) (or application) identifying all gas equipment and required operating gas pressures. [The licensed master plumber shall provide a Operator Qualified Task 87 Certification Number](#)

- Gas pressure required at service termination point,
- New, existing and future projected loads.

Information provided to National Grid by the customer or his/her contractor regarding a proposed gas installation or an increase in load shall generally be required in writing.

4.1.4 The applicant or customer shall furnish at the premises, at his/her expense, appropriate piping and equipment for gas utilization purposes. Piping shall comply with requirements in Section 5.0, 7.0 and 8.0 of this book. Gas utilization equipment shall comply with Section 9.0 of this book.

4.1.5 Customers already using gas service from National Grid shall advise the company of any addition or substantial change in his/her equipment, such as increasing a boiler size to accommodate a new building wing or adding a swimming pool heater, or generator, **prior to** making such additions or changes. Any requests for equipment requiring pressure greater than 3.5" w.c. must be approved by National Grid before the equipment is purchased. In some instances elevated pressure is not available. (All requests for an increase in service capacity, shall require the customer/contractor to complete the Residential Gas Service Agreement – See appendix C)

4.1.6 For all new installations, the customer shall be expected to provide, at his/her expense, any and all permits or certificates ([see Section 8.8 for Underground Piping Certificate Info](#)) (except street excavation permits) usually issued by public agencies, that are associated with piping and appurtenances downstream of the meter, as part of the requirements in furnishing gas service downstream of the meter. Any easements required for the job shall also be provided by the customer at his/her expense. Plumbing permits shall be obtained by the plumbing contractor. **Customer is responsible to mark out all customers owned buried facilities on private property in vicinity of the proposed gas service.**

4.1.7 National Grid shall not be obligated to begin construction on the gas service or to supply gas to the customer until:

- The applicant furnishes all necessary permits to National Grid, and easements and/or rights of way are granted [and Gas Authorization / Pressure Test Certificate for meter sets where applicable](#).
- The customer's application has been approved by proper officers or duly authorized representatives of the company;
- Necessary payments are made by the applicant;

- A signed contract between the customer/owner and the contractor is provided to National Grid.
- 4.1.8 Prior to the beginning of every job, when National Grid deems appropriate, meetings will be held as required. At these meetings, the design and construction process will be discussed. The meetings will be arranged so that the various contractors and any other relevant representatives will be able to attend.
- 4.1.9 The Appendices contains requirements for construction and other information relating to the construction process. This material is intended to assist in providing a better understanding of needs, thereby allowing for better planning on a job. Although many of the materials and issues covered in this Appendix are relevant to National Grid oriented installations, the information presented is valuable for any installation in terms of understanding construction policies and philosophy.
- 4.1.10 After all of National Grid's preconstruction activities and requirements have been completed and approved, National Grid's installation crew will meet the established, mutually agreed upon construction due date, providing the work area meets all of the requirements contained in this Appendix

It is important to the installation of the gas main and service that a complete and accurate inspection of field conditions is made before commencing construction and installation of National Grid's gas facilities. All new orders for main and service installations will be field-checked by National Grid **before and/or** after receipt of the authorized Work Order. Existing orders will be field-checked within a timely manner as determined by field conditions such as the rate of construction, scheduled installation of other facilities or when the customer, plumber or builder shows that the area of construction is clear of violations and that all is in readiness at the site for National Grid's construction to begin. Note that it is not necessary for the customer to be present for this inspection. For sites where the gas meter will be located indoors, National Grid will not release a job until the inside meter location has been inspected for required clearances and accessibility. An entry key, or other suitable means of access, shall be arranged so that National Grid can gain access to the building.

National Grid shall apply for road opening permits before excavating in the roadway. National Grid will not install or excavate without receiving the proper permits from the municipality or town where the installation is located. The time required for issuance of permits will vary according to the municipality, i.e., town, **city**, county, state, **village** having jurisdiction. National Grid will not be responsible for delays incurred in the permit process due to internal municipality delays.

Before the actual start of construction for large installations of mains and services, or as deemed necessary by National Grid, a site meeting may be required.

The purpose of this meeting is to effectively communicate the scope of work, site status, job progress and other work items to all concerned parties. During this meeting, the following shall be discussed:

- Finalization of the integrated construction schedule

- Review of approved drawings
- Identification of key contact people
- Identification of below-grade facilities in vicinity of work area
- Site readiness

National Grid requires that this pre-construction meeting take place at least two weeks before the schedule date of construction activities. National Grid representative will coordinate the scheduling of the meeting with the contractor.

**CAUTION!**  
**BEFORE YOU DIG - [CALL 811!](#)**

*All excavators shall be familiar with 16 NYCRR Part 753, "Protection of Underground Facilities". Contractors are advised to exercise extreme caution when breaking ground. Before you dig, drill or excavate, be sure that your work area is clear of buried gas pipes or electric cables. An accidental break of these facilities can be dangerous! Telephone the One Call Center at least (3) three working days before you start work. The location of any existing PSE&G, Con-Ed buried cable or National Grid buried pipe will be marked along with telephone, water and cable.. **The utility will not mark customer-owned buried facilities on private property.** Contractors shall not begin any excavation work until all call-backs are made from utility operators contacted as a result of the One Call Center telephone call. If facilities are not marked **DO NOT ASSUME** that there are not facilities present in the area. **Note that the customer and/or contractor are responsible for marking facilities on private property.** If sub-contractors are hired, please remind them that they are obligated to call the One Call Center before they do any excavating work*

In areas where property lines have not been established, or where curbs are not installed, ***the customer or contractor shall provide National Grid with accurate information as to buried items, such as underground mains and services, drainage, sewers, oil tanks, cesspools, etc.*** Before National Grid begins work on a main or service, curbs shall be installed. Property lines and grades are especially important in developments where roads are cut to a rough-grade that may be as much as 3 feet below or above sub-grade. Determination of sub-grade facilities and their locations are very important as our mains and service installation depends on accurate fixed points to decide proper depth of a trench. National Grid will only begin work where it has been validated that the existing grade is within 6" of final grade.

National Grid will expedite the gas piping main and service installation by establishing communications with the customer, builder, plumber or project superintendent by informing them of existing violations that would prevent the installation of gas facilities.

**NEW GAS MAIN INSTALLATIONS REQUIREMENTS**

Before the installation of any **new gas main**, the customer shall have the construction area free of any violations within their control. All violations shall be cleared before the National Grid work order for the gas main installation can be released for construction. [All of the buried utility services must be installed prior to National Grid installing the gas main and service.](#) For National Grid construction activities to take place, the following requirements shall be adhered to:

### **PROPERTY LINE**

For new building developments, curbs shall be installed before National Grid will install a gas main. **Exceptions to having curbs installed may give** if it is not intended to install curbs, the customer/contractor shall inform National Grid accordingly, and provide reasonable assurance that the grade level is within 6" of final grade. Gas mains are normally installed on public property (roadways), however, their location may deviate due to varying terrain, heavy growth, large trees, catch basins or, due to a request of municipal authorities. National Grid will not install a gas main when curbs have not been installed and property lines have not identified.

### **GRADING PREPARATION**

To ensure proper earth cover for the proposed gas main, National Grid will talk with the customer or builder to determine the present and future grade of the road. This is essential where the original grade stakes have been torn up or buried. National Grid requires a **36-inch cover** over its gas mains, and a minimum of a **6-inch separation** between other facilities and materials.

**For Nassau & Suffolk County** the **National Grid** Construction Standard Number CNST-6125 shall be consulted.

### **DRAINAGE**

National Grid will not release the Work Order for a gas main installation until all drainage facilities have been installed and, if existing, their locations identified by the customer, installer or the authority having jurisdiction. When drainage locations are known, National Grid can offset or place the new gas main above or below the existing drainage facility to lessen the risk of damage to the pipeline. **In certain situations the work package can be released based upon the discretion of the National Grid Field Engineer.**

### **WATER MAINS AND SERVICE STUBS**

Since water mains are installed at a greater depth than gas mains, National Grid will not install a gas main until the water main and service stub are installed and properly marked out. Water mains and services shall be installed before the gas main installation to prevent interference between the two piping systems and to eliminate the possibility of the gas main being damaged when a water main is installed.

### **OTHER OBSTRUCTIONS**

On the day that National Grid is scheduled to install the gas main, the contractor shall remove all obstructions such as dirt piles, building materials, equipment or



vehicles that will prevent National Grid from installing a gas main. The area, when the new gas main is to be installed, shall be cleared before trenching of the new gas main begins.

### **NEW GAS SERVICE INSTALLATION REQUIREMENTS**

Before installation of a **new gas service**, the customer/contractor shall have the construction area free of any violations. All violations shall be cleared before any gas service Work Order is released for construction. National Grid reserves the right to require the Customer to prepare the site (i.e., private property mark out, dig and maintain the trench, protect underground facilities etc.) of the buried utility services must be installed prior to National Grid installing the gas main and service. Trenching installations shall meet all applicable standards i.e. OSHA 1926.652 requirements (requirements for protective systems). For National Grid construction activities to take place, the following requirements shall be adhered to:

### **GRADE, COVER**

It is important that the grade be as close to the proposed finished minimum grade of 6" below final grade before National Grid releases the service to be worked. This is to ensure that proper earth cover exists for the proposed service. The depth of **cover required** for a gas service is **24 inches** for public property and a minimum of 18 inches for services on private property. **For RUD (Common Trench) Applications, the Electric Utility's Construction Standard's** shall be consulted for further details.

### **WATER SERVICE**

Often, water services are installed on the opposite side of the building away from the gas service. If the water service is installed in close proximity to the proposed gas service, National Grid requires that the **water service** be installed **before the gas installation**. This is required since the water service is installed at a depth below National Grid's gas service. Therefore, the **water service must be installed** to prevent the gas service pipe from being damaged by the water service construction. A water service shall be kept a minimum of 3 feet away from a gas service measured in any direction.

### **CESSPOOLS & SEPTIC TANKS**

If cesspools or septic tanks are to be constructed in proximity to a proposed gas service, that construction and back filling shall be completed first before National Grid will install a gas service. Experience has shown that equipment used for excavating cesspools or septic tanks have often torn up National Grid's piping when the gas service is installed before the installation of a cesspool or septic tank.

### **BUILDING MATERIALS**

Building material, such as lumber, sheetrock, pallets, scaffolding, dumpsters, bricks, etc. located in the path of the gas service, will cause delays in the installation of the gas service. The customer and/or builder shall maintain a clear area or path so that trenching or missiling for the new gas service can be accomplished.



**DIRT PILES**

Dirt piles of a size requiring additional work in excess of normal trenching or missiling operations shall be removed by the customer or builder before the release of the job.

**FOUNDATION ONLY**

Gas services shall not be installed where only a building foundation exists.

**STRUCTURES NOT BUILT YET**

National Grid will not run gas services or stub to any proposed buildings or other structures, or run services beyond the property line. If deemed necessary by National Grid, we will install a service stub/main to the property line for any proposed building.

**TRENCHES**

Contractors electing to provide their own trenching for National Grid's facilities shall adhere to the following requirements. Contractors shall trench only on private property. **IN NYC, trenching is allowed in the public right-away if mutually agreed upon by all parties.**

**COVER**

Trenches for facilities shall meet the following minimum cover requirements:

- 36" for Gas Mains
- 24" for Gas Services on Public Property
- 18" for Gas Services on Private Property

PSE&G Construction Standard shall be consulted for further details, when working on Long Island.

**TRENCH BOTTOMS**

**National Grid and NYC Specifications and Standards shall be consulted for work performed in NYC.** Trench bottoms shall be smooth and free of rocks or debris that could damage plastic mains or services, or could damage protective wrapping on steel mains or services **when trenching in Nassau and Suffolk counties.**

**SPOILS**

All spoils shall be placed a minimum of 24" from the edge of the trench.

**RUD/SEPARATION, GAS VS. ELECTRIC/TELEPHONE/CABLE**

If trenching is to be accomplished for placement of facilities in a common trench (RUD), trench must be wide enough to allow for a 6" minimum separation between buried gas facilities and buried electric, telephone and cable facilities. PSE&G's Construction Standard shall be consulted for further details. National Grid will not place facilities into trenches unless the requirements for proper separation are met, as defined below.

**3-PHASE PRIMARY LATERAL WITH GAS**

If trenching is to be accomplished for installation of gas facilities along with a 3-phase primary lateral service, a minimum of 12" separation must be provided between electric lines, and a minimum of 6" separation must be provided between gas and electric lines. PSE&G's Construction Standard shall be consulted for further details.

**SEPARATION OF FACILITIES**

If trenching is to be accomplished for installation of gas and electric services on private property, the minimum cover on gas and secondary electric is 24" with a minimum of 6" separation between the two services. If the service is primary, it may be placed in a conduit at 24" cover; if it is direct-buried, it must have a minimum of 30" cover. In Long Island, PSE&G's Construction Standard shall be consulted for further details. Plastic pipe should be used for services up to and including 12-inch diameter and up to and including 124 psig MAOP, where appropriate materials and fittings are available. 2) Plastic services operating between 100 psig and 124 psig shall meet the following conditions: i. The material shall be PE4710 (except for ½ inch CTS and ¾ inch CTS MDPE noted in Table 5 above) as specified within ASTM D2513 (as described in Part 10.3 of this Title). ii. The pipe size is nominal pipe size 12-inch or less 3) Plastic pipe should not be installed when any of the following conditions exist: i. In NYC, where the service line is within thirty-five (35) feet from an underground steam facility, or in any vault which has a steam facility (NYC Reference Standard 16, Plumbing and Gas Piping). ii. In regions other than NYC, where the service crosses or is within eighteen (18) feet of a steam facility.

**BACKFILL AND PERMANENT RESTORATION**

When contractors provide trenching on private property, backfilling of the trench along with the temporary and permanent restoration of the work area shall be the responsibility of the customer/contractor and shall be completed in accordance with CNST01003. When National Grid trenches on private property, National Grid will provide temporary restoration of terrain of pavement.

**CONTAMINATED SOIL**

National Grid reserves the right to require the customer to provide soil testing compliant to Codes such as OSHA 29 CFR 1910.120, Hazardous Waste Operations and Emergency Response.

If contaminated soil is discovered during the installation, the customer shall provide soil environmental sampling and bear the cost of all remediation of the soil and backfill.

#### 4.2 REQUIREMENTS FOR HAVING A NEW RESIDENTIAL AND SMALL COMMERCIAL GAS SERVICE INSTALLED

- 4.2.1 Upon contacting the National Grid Representative, advise if the installation is a residential, commercial or industrial building, and, if you are a builder, if it is a RUD project. The National Grid Representative will determine if gas is available at your location. If gas is available, the National Grid Representative will assign the job to the appropriate sales representative or Gas Business Lead, who will then identify the proper application forms and send them to you along with a packet of relevant information. Residential applicants may initiate the application process by telephone. Commercial and industrial customers are required to initiate their applications in writing. Additional information for RUD and CIPUD projects is provided in Section 4.3.

Please note that if gas is not immediately available in your area, the information in the following sections is not necessarily applicable. The National Grid Representative will explain the process to be used.

- 4.2.2 The National Grid Representative assigned to you will help determine the Rate and Service Classification most favorable to your current requirements. National Grid does not warrant that the choice will be most favorable to all possible future requirements of any applicant or customer.
- 4.2.3 The customer is advised that a search will be made regarding the gas history of the premises with National Grid, as well as the history of the individual applicant. If any credit arrears are reported or meter tampering or theft of service is found, it is possible that service could be denied.
- 4.2.4 Following receipt of the application, the National Grid Representative may schedule a field visit to the location if required and if the job requires a service only, will determine the preferred meter location with the customer.
- 4.2.5 For installations requiring a service only, the National Grid Representative will cosign an application with the customer. In addition, National Grid must see a **signed contract** between the customer/owner and the contractor before National Grid will begin work. No exceptions will be made to this requirement.
- 4.2.6 National Grid will install the required facilities in accordance with a mutually agreed upon Customer/National Grid Agreement Date. National Grid will track the installation with the contractor and customer for a timely completion and meter set, assuming all permits have been properly obtained.
- 4.2.7 It is the contractor's responsibility to obtain any necessary certificates or permits from governing authorities to ensure that a meter is set on the agreed upon date. In addition, it is the contractor's responsibility to arrange for pressure tests.

*Note:*

***It is the contractor's responsibility to arrange a pressure test with the authority having jurisdiction to ensure that a meter is set by the agreed upon date. Pressure tests on commercial and industrial installations shall be witnessed by the local agency when required in accordance with Appendix D of this manual.***

#### 4.3 RUD AND CIPUD SERVICE (where applicable)

**Note:** Clearances to other utilities are specified in Design of Gas Services **ENG02001** and Clearances of Gas and Electric in RUD and CIPUD area **CNST6015-LI**

- 4.3.1 The following requirements apply to builders who construct homes and to land developers.
- 4.3.2 In order to initiate RUD service, the following items shall be prepared by the builder or land developer and be available prior to filing the application:
- A completed Request for National Grid Underground Installation, available at each divisional location
  - A completed National Grid Gas Request Form
  - Six copies of an approved site plan of the subdivision, showing the location of each lot, sidewalk, roadway/curbline, storm drains/sewers, water main and grade changes. The site plan must be approved by all governmental authorities having jurisdiction. In addition, an AutoCad file is requested, if possible.
  - A completed National Grid Request for Easement Information form
  - Relevant load information for non-residential structures
  - A copy of the preliminary construction schedule

***Note:***

***The builder/developer may elect to perform the trenching necessary for the installation of the buried facilities in any given sub-division. The credit per trench foot for service laterals and distribution is based on filed tariff costs provided all work is performed in accordance with National Grid specifications and schedules. This option may be discussed with the Business Lead upon initial contact.***

- 4.3.3. For RUD and CIPUD jobs involving gas and electric, builders and land developers are advised to contact **1-877-MyNGrid (1-877-696-4743)** to initiate gas service according to Section 4.2.1 of this book. Advise the National Grid Representative that the job is RUD or CIPUD. A Business Lead will be assigned and the contractor will be given further instructions on the RUD/CIPUD process, including the following:
- Builder or land developer performance payments
  - National Grid scope of work and other associated charges

- National Grid Energy's Integrated Project Schedule
- Trenching considerations
- Joint Parity Agreement with the telecommunications utility, if applicable to the contractor

4.3.4 The builder of a subdivision must pay National Grid, in advance of construction, a nonrefundable charge for any main or service footage required in excess of the gas allowances. The allowances provide up to 100 feet of gas main and up to 100 feet of gas service line for each residential heating customer. This is based on National Grid's currently filed Tariff PSC No. 4, Gas, and is subject to change. Should additional lengths of main and service be required, National Grid may justify waiving these excess footage costs by performing an analysis of the customer's adjusted gas revenues.

4.3.5 Gas refundable charges may be allowed. The gas refundable charge will be equal to the total of National Grid's free gas allowance portion of the installation. This charge will be refundable in whole or in part upon commencement of gas service. In lieu of the gas refundable charge, to cover the costs of such installation, National Grid may offer the builder the option of entering into a Gas Waiver Agreement with National Grid. This arrangement provides for National Grid to waive the requirement for the advance gas refundable charges. In consideration of such waiver, the builder agrees that if buyers of fewer than 90% of the homes choose full gas service for space heating, the builder will pay National Grid a percentage of the refundable charge for each home without gas heating service.

4.3.6 Table 4.1 lists RUD/CIPUD Milestones for builders' and land developers' information.

**TABLE 4.1**  
**RUD/CIPUD PRE-CONSTRUCTION MILESTONES**

DESCRIPTION
National Grid Business Lead/Builder contact established
Builder submits Design Package including: Application, site maps and or ACAD File, request for easement form, Underground Electric installation form
National Grid completes Preliminary Distribution Facility Design Layout (Redline/Greenline Stage)
National Grid notifies Builder of Payment Schedule
National Grid /Builder agree to Project and Integrated Construction Schedule
Builder signs Gas Waiver Agreement/National Grid receives First Payment (Design Payment)
Land Developer submits 100% payment
National Grid proceeds with Final Design/Permits/Schedule

National Grid /Builder review Final Design/Integrated Schedule
National Grid receives Second Payment (Materials Payment)
National Grid procures Materials and finalizes Easement Agreement
Builder submits Refundable and/or Non-refundable gas payment if the Gas Waiver Agreement is applicable
Builder submits copies of Sales Contracts including Performance Payment schedule and final payment
National Grid sets up Construction Meeting at Job-Site – See Appendix D
National Grid coordinates Construction Activities with Telephone and Cable Companies
National Grid Construction Activities commence

- 4.3.7 Contractors, builders and land developers are advised to seek additional information and requirements concerning National Grid Energy's construction process by becoming familiar with Appendix J of this book.
- 4.3.8 Additional information regarding RUD and CIPUD installations may be obtained, by consulting PSE&G's Rules and Regulations for Electric Installations, also known as the “Red” Book.
- 4.3.9 Table 4.2 lists some common causes of design/construction delays in the hope that by identifying them here, contractors, builders and land developers will be able to avoid and minimize construction delays:

**TABLE 4.2****CONSTRUCTION DELAYS/REMEDIES**

<b>TYPE OF DELAY</b>	<b>REMEDY</b>
Incomplete information from builder	Builder to follow the guidelines as stated in the pre-construction requirements
Awaiting payment of charges	Send payment for all charges associated with the subdivision in accordance with the pre-construction requirements
Design Change	Builder to notify National Grid in advance of any potential project revisions
No street opening permit	Allow National Grid three to four weeks prior to the start of installation of facilities to obtain necessary road opening permits
Proper grade not established	Established grade in the roadway area should be within six inches of final grade to ensure installation of facilities at the proper depth
Property line not clearly marked	Place stakes and/or spray paint property lines at curbs to ensure proper installation of facilities
Prolonged periods of inclement weather	Builder to allow sufficient time in the work schedule for potential weather related delays. National Grid's

	rules and work methods prohibit the installation of electric/gas facilities under non-emergency conditions during inclement weather.
--	--

4.3.10 Table 4.3 is a checklist that the Builder/Land Developer can use to ensure that all requirements necessary for the design and construction of the RUD subdivision have been submitted to National Grid. Use of this list will help to avoid problems identified in Section 4.3.9.

**TABLE 4.3  
RUD CHECKLIST**

	REQUIREMENTS COMPLETED	DATE
1	Submitted completed "Request for PSE&G UNDERGROUND ELECTRIC INSTALLATION" form.	
2	Submitted completed "National Grid Gas Request" form, if applicable.	
3	Submitted six copies of an approved subdivision map to National Grid Energy.	
4	Submitted completed "National Grid REQUEST FOR EASEMENT INFORMATION" form.	
5	Submitted payment for additions charges associated with relocation of National Grid facilities, if applicable.	
6	Submitted 10% design payment (builder only).	
7	Submitted the signed Gas Waiver Agreement if applicable.	
8	Submitted 40% material payment (builder only).	
9	Submitted 50% construction payment (builder only).	
10	Submitted 100% payment (land developer only).	
11	Submitted subdivision easement, notarized and signed by the property owner.	
12	Notified National Grid of the installation of curbs and all other proposed underground facilities.	
13	Notified National Grid that a clear unobstructed easement route of right-of-way, graded to within six inches of final grade has been provided.	
14	Submitted a completed Application Card for each home/dwelling unit requiring gas and/or electric service or (one completed application card with a complete listing of all units including lot numbers and street names) along with a completed Temporary Electrical Inspection Certificate and Gas Inspection Certificate, if applicable.	

## 5.0 GAS SERVICE LINE(S)

### 5.1 GAS SERVICE LINE(S) TO A BUILDING OR OTHER GAS USAGE

- 5.1.1 National Grid will normally provide only one gas service to a building, unless the need for more than one service is deemed necessary by National Grid. Depending on the locality, more than one service to a building may require approval from the local authority. See 5.1.3.
- 5.1.2 If National Grid determines that more than one gas service is required to supply gas to a building, the local codes may require that the structure be built using party walls to isolate each area served by a gas service.
- 5.1.3 When more than one gas service is installed in a building or on a property, a permanent, weather resistant placard shall be prominently placed at each meter location to identify the number of services to the fire department when isolation of the gas service is required. It is the contractor's responsibility to provide for the installation of, and the customer's responsibility to maintain, the placard.

## 5.2 LOCATION OF GAS SERVICE LINE(S)/LATERAL(S)

- 5.2.1 For new construction, National Grid will install gas service piping in areas free of paved driveways or other paved areas. If it becomes necessary to locate a gas service line where it will be under a driveway or walk, the contractor shall not pave the driveway or walk until the gas service line has been installed. Alternately, the customer may opt to install a sleeve a minimum of 18" below grade in the area to be paved through which the gas service can be installed after the paving installation. This should first be discussed with National Grid who will advise the correct size sleeve and location, and obtain approval for the installation.
- 5.2.2 The contractor shall notify National Grid as early as possible of any such paving as indicated in Section 5.3.1.
- 5.2.3 A **new** gas service line **should** not be installed under or through buildings, unless no other feasible option exists. Where it is deemed prudent to install a gas service under a building (e.g., an enclosed porch, or similar enclosed areas occupied by people), National Grid shall install the service through a continuous steel sleeve, extending one foot on either side of the enclosure above it. The sleeve shall be sealed against water intrusion and vented to the atmosphere.
- 5.2.4 National Grid shall designate the exact location of the meter and service riser.
- 5.2.5 Any change requested by the customer to the location of an existing service line, if approved by National Grid, ***shall be made at the expense of the customer.*** The customer shall be responsible for hiring a contractor to install gas house line piping, meter header, regulator vent piping and/or interconnections with facilities.

## 5.3 SERVICE ENTRANCE TO EXISTING BUILDINGS

- 5.3.1 Where the service enters the building underground through a poured concrete wall, a sleeve for the gas service shall be installed by the builder during construction. **Split Sleeves are not allowed.** **National Grid Representative** shall



designate the size and location of the sleeve. For further information, see **National Grid** Construction Standard SERV6215.

- 5.3.2 Service Entry to Existing Buildings - Where an inside meter location has been selected, the gas service entry point below grade shall be enclosed in a protective pipe sleeve following specification. [Split Sleeves are not allowed](#)

#### 5.4 SERVICE TERMINATION POINT

- 5.4.1 The connection point of service (that point where National Grid responsibility ends and the customer's responsibility begins) shall be defined **physically** according to the applicable Construction Standard.

#### 5.5 RESTORATION ON PRIVATE PROPERTY

- 5.5.1 For private property an agreement will be made before work begins on the restoration of the property. The amount of restoration performed by National Grid will be determined on a case by case basis.

#### 5.6 ADDITIONAL METERS OR SERVICES

- 5.6.1 Contractors and customers are advised that **in NYC, and** some towns and other local jurisdictions require, by law, that they be notified in writing of the addition of any gas meters or new gas services to any property. It is the contractor's responsibility to become aware of these concerns and requirements.

### 6.0 GAS PRESSURE

#### 6.1 NOMINAL METER OUTLET PRESSURE WHEN SERVED FROM HIGH PRESSURE DISTRIBUTION SYSTEM

- 6.1.1 On the high pressure portion of its distribution systems, where a service regulator is installed in conjunction with the gas meter, National Grid provides gas to customers at a nominal pressure of 6" W.C. The nominal pressure is measured immediately downstream of gas meter or service regulator, whichever is further downstream.
- 6.1.2 **Operating/Running** pressure at the meter or regulator outlet typically can be as high as 7" W.C. or as low as 5" W. C. and can vary slightly for each installation depending on load diversity, pressure drops through the meter set piping, service regulator performance, and pressure drop through the gas meter.
- 6.1.3 When purchasing gas utilization equipment to operate on gas from high pressure distribution system, it is recommended that equipment be chosen to function effectively based on nominal pressure of 6" W. C. at the outlet of the meter or service regulator, whichever is further downstream.
- 6.1.4 On elevated delivery pressure systems of pressures over 14" w.c., all appliance regulators must be vented outside the building to atmosphere. Per NFPA 54, Section 5.8.5.1(b), a regulator with vent limiting means combination listed as complying to ANSI Z21.80/CSA 6.22, Line Pressure Regulators, shall be permitted to be used without a vent to the outdoors.

## 6.2 METER OUTLET PRESSURE WHEN SERVED FROM NATIONAL GRID LOW PRESSURE DISTRIBUTION SYSTEM

- 6.2.1 On the low pressure portion of its distribution systems, where no service regulator is installed, National Grid provides gas to customers at the front wall (point of entry) of pressure that can vary between 4" and 9.5" W. C. When purchasing gas utilization equipment to operate on gas from low pressure distribution system, it is recommended that the equipment be chosen which requires no more than 3.5 W.C. manifold pressure at the burner.

## 6.3 PRESSURE AND CONTRACTOR

- 6.3.1 The contractor shall ensure that the customer's house line and all associated interconnecting piping into system are properly sized to prevent excessive pressure losses at the gas utilization equipment. The contractor must also ensure that the customer's installed gas utilization equipment is compatible with available nominal gas pressure.

## 6.4 ELEVATED METER OUTLET PRESSURE ON HIGH PRESSURE DISTRIBUTION SYSTEM

- 6.4.1 In certain instances, such as with industrial processing or commercial equipment, there may be a need for gas pressure higher than nominal 6" W.C. at the meter outlet.

**Elevated pressures are not available throughout the entire service territory, thus all requests for elevated pressure must be approved in advance by National Grid.**

- If a customer or customer's contractor requires elevated pressure because of gas utilization equipment requirements, the customer or customer's contractor shall provide the appropriate documentation to National Grid to support the elevated pressure request.
- Customers or customer's contractors requesting elevated pressure for the sole purpose of downsizing the houseline size should be informed that it is policy to deliver the minimum meter outlet pressure to meet the requirements of the customer's gas utilization equipment to ensure safe, efficient operation of all properly adjusted appliances.
- National Grid recognizes that there may be unusual circumstances (such as very large industrial and commercial installations i.e. Home Depot) where a customer or customer's contractor requests elevated pressure when the appliances clearly do not require it. These cases should be referred to and reviewed by a team that includes Customer Meter Services, Gas Engineering and Gas Connections.

---

### **NOTE:**

*It is policy, whenever practicable, to deliver the minimum meter outlet pressure to meet the requirements of the customer's gas utilization equipment to ensure safe, efficient operation of all properly adjusted appliances. In all cases, National Grid has the sole responsibility for the determination of which gas distribution system, low*

***pressure or high pressure, will supply the approved load and what gas pressure can be supplied.***

- 6.4.2 If elevated pressure is requested, National Grid will normally supply gas pressures of 1/2 PSIG or more in increments of 1/2 PSIG for commercial and industrial customers. National Grid will supply elevated pressure to a customer on a case by case basis. Please note that special permission may be required from local authority having jurisdiction in certain situations.
- Fixed factor metering will be used up to 2 psig for diaphragm meters 250 to 1000 class and 1 PSIG for rotary metering applications. Refer to national Grid Policy [CMS04005 – Elevated Pressure Metering Policy](#)
  - Pressures 1 PSIG or greater for rotary meters will require volume correcting instrumentation.
  - Metering set assemblies up to 1 PSIG may utilize threaded piping and fittings.
  - Welded Meter headers that are welded by National Grid will be at the Customer's expense (Long Island Only).
- 6.4.3 Along with the customer's application, the customer shall provide National Grid with the manufacturer's specifications for the gas utilization equipment. The literature furnished shall provide an explanation of the need for elevated gas pressure requirements. Upon verification of the equipment pressure requirement, if the above acceptance criteria are met and the National Grid gas system at the location can supply the elevated pressure, National Grid will furnish gas to accommodate the higher pressure need.
- 6.4.4 The customer shall be responsible to pay for any additional costs associated with the fabrication and installation of National Grid supplied welded meter headers (LI Only).
- 6.4.5 The minimum design pressure in high pressure distribution system varies depending on differing loads and weather conditions, as well as normal periodic maintenance within system. These factors can cause occasional periods of low gas pressure in the customer's houseline. Therefore, it is policy to supply gas at the meter outlet or regulator of a value no greater than the ***minimum*** pressure of high pressure gas main serving that area.

***NOTE***

***Customers, Owners and/or Contractors shall contact National Grid if they are planning to make any additions or modifications to a gas piping system so that National Grid may provide a safety review of your plans.***

- 6.4.6 Under certain conditions where the customer's load requirements and gas utilization equipment qualify, National Grid will discuss with the customer the availability of supplying line pressure where there is no service regulator at the meter header. In these cases, the customer is advised that the gas pressure would vary nominally with any variations in the high pressure gas distribution system.

## 6.5 ELEVATED METER OUTLET PRESSURE ON LOW PRESSURE DISTRIBUTION SYSTEM

- 6.5.1 In certain geographical locations, only low pressure gas is available via gas distribution system. In these areas, if elevated meter outlet pressure is required, a gas booster may be necessary. Contact National Grid for details.

## 6.6 LOCAL CODES RELATING TO ELEVATED GAS PRESSURES

- 6.6.1 When gas pressure greater than the nominal 6" W.C. is required, the code requirements of the prevailing jurisdiction shall also be met. Contractors shall be familiar with these codes and obtain any necessary approvals from regulating agencies before submitting the application to National Grid.

## 7.0 METERS AND REGULATORS

### 7.1 PREREQUISITES AND NOTIFICATIONS FOR NEW GAS METERS

- 7.1.1 At least one gas appliance, properly installed and connected to the gas piping system, is required as a prerequisite before National Grid will install a new meter and turn on the gas supply to the customer.
- 7.1.2 For all commercial, industrial and multi-family installations (3 families or more), contact must be made to the **National Grid Customer Gas Connections Team** as early as possible in the job process prior to commencement of work. The purpose of this contact is to:
- Review construction schedule and to fix commitment dates.
  - Review the service installation construction requirements.
  - Review meter header location site and meter set construction specifications
  - Review inspection requirements.
  - Review with contractor National Grid supplied construction items.
  - If applicable, review TC2020 Requirements for Installation of Automatic Dual Fuel Burners and Equipment at Temperature Controlled (TC) Sites (**Blue Book Part 2 of this book**).

### 7.2. METER SET LOCATION REQUIREMENTS

- 7.2.1 **Per NY State PSC Code 255.353, All meter sets shall be located on the outside of any building unless it is impractical or unsafe.**
- 7.2.2 All meter sets shall be installed following the clearance requirements indicated in **the appropriate Construction Standard. For information on distances of electric meters from gas meters, refer to [020013-CS](#).**

- 7.2.3 Outside and inside gas shut-off valves shall be readily accessible at all times to National Grid and emergency service personnel and shall not be covered or obstructed.
- 7.2.4 The installation of meter sets in driveways, under windows, under building overhangs or near fresh air intakes ***should be avoided*** where practical. In those cases where the regulator vent cannot be located to meet clearance requirements, the contractor shall be responsible for installing regulator vent piping according to [020013-CS](#).
- 7.2.5 Meter set locations shall be sufficiently removed or separated from the bottom termination of a stairway so as not to constitute a hazard. When required distances cannot be maintained, such as for buildings with limited width, the contractor shall be required to provide suitable protection.
- 7.2.6 Outdoor and indoor meter set locations that may be exposed to vehicular or other equipment damage shall be avoided unless no other feasible location exists. If one or more of the criteria in Section 7.7 of this book are met, protection posts shall be required. National Grid, or the contractor installing the service shall provide protection posts protecting the service at the time the riser is installed. The customer will supply and install all protection posts to protect all piping downstream of the riser. Protection posts are in be installed per **National Grid Construction Standard** [MTRS-6060](#).
- 7.2.7 Meter sets shall not be installed below ground in **vaults without National Grid approval**.
- 7.2.8 The metering of large quantities of gas or the installation of meter sets and regulators in schools, commercial buildings or industrial buildings, including multiple meter headers, may require meter rooms, or special construction or piping. Consultants and installers of such facilities are advised to consult with **National Grid**.
- 7.2.9 Although it is not desirable and should be avoided, gas meters may be placed under windows provided that the following conditions are met: See [020013-CS](#)
- No other suitable location is available
  - Proper regulator venting is provided

#### INSTALLATION OF METER HEADERS

- 7.3.1 The meter header shall be installed according to the **National Grid** construction standard.

**NOTE: BYPASSES WILL NOT BE ALLOWED ON SINGLE FAMILY RESIDENTIAL METER SETS REGARDLESS OF METER SIZE** (For certain circumstances, residential bypasses can be allowed on Long Island if approved by Technical Lead.) **ON LONG ISLAND, NATIONAL GRID'S POLICY is to install bypasses on all multi-family outside set residential installations with 3 families or more.**

**NOTE**

*To avoid delays and possible repeat visits to the site, it is critical that the contractor adhere to the space dimensions specified between meter connections. Consult the appropriate Construction Standard for these dimensions prior to the start of construction.*

**7.3.2 FOR NYC:**

The fabrication of meter headers will be the responsibility of the contractor regardless of customer's downstream utilization pressure. National Grid will be responsible to supply the plumber or contractor with the materials detailed in National Grid Construction Standards. A review of the material list in the Construction Standards will indicate the items supplied by National Grid and those materials to be purchased by the Plumber/Contractor. The contractor will be responsible to supply the labor to fabricate the meter header on site.

Meter Headers for NYC Schools will follow Section 8.6.3 of this book regarding welding requirements.

**FOR LONG ISLAND:**

The fabrication of meter headers is as follows – **Note The customer is not permitted to perform the welding on meter headers.** Under special circumstances it may be allowed pending National Grid's approval.

For typical 250/400/630 single family Residential Sets, National Grid will install the piping up to the meter bar.

For multi-meter and large volume residential sets, National Grid will install up to the gas regulator for high pressure main sets and up to the riser valve for low pressure main sets.

**For Commercial Meter Set Headers:** there are three designs which may be considered:

**1. High pressure main/low pressure metering:**

Gas will come off a high pressure main and a regulator will reduce the pressure usually to 7" w.c.

For this installation, National Grid will install the piping up to the gas regulator. The Customer will install all the piping after the regulator. Once the piping is completed, National Grid will set the meter.

If pressures are needed at 14" w.c. – 1 psig, the same process will be used, but the meter will be fixed factor.

Any header piping 4" diameter and smaller after the regulator can be threaded if the pressure is less than 1 psig. Once the header piping after the regulator is greater than 4" in diameter or pressures are greater than 1 psig, it must be welded by the National Grid and paid for by the customer.

**2. High Pressure Main/High Pressure metering:**

In these cases, National Grid will choose to meter at the main pressure because of the large volume of gas or the customer is requiring elevated pressure.

National Grid will generally install the piping up to the gas regulator. The cost of this header will be paid for by the customer. Pricing will be determined by the size of the gas header. The piping after the regulator will be installed by the customer.

### 3. Low Pressure Mains/Low Pressure Metering

Any header piping 4" diameter and smaller can be threaded.

- 7.3.3 National Grid will supply and install, at the time of meter installation, the meter swivels, nuts, bolts, and gaskets required to connect the meter to the meter header.
- 7.3.4 On all meter headers, the contractor shall be responsible for houseline interconnections with facilities and the installation of the regulator vent and/or relief valve vent piping. Houseline interconnection to the meter set and the installation of service regulator or relief valve venting shall be performed according to National Grid specifications as provided in the appropriate **National Grid** construction standard(s).
- 7.3.5 Construction Standards contain a Bill of Material and a Notes section identifying the responsibilities for furnishing various components as well as other specific requirements. Dimensions shown on the drawings shall be maintained, unless a unique installation problem develops. Exceptions to the approved construction standards shall be reviewed and approved. Contractors are advised to review all applicable **National Grid's Standards** before the start of construction.
- 7.3.6 In certain installations, usually for horizontal meter headers or very large volume customers where standard construction drawings do not exist, the meter header will be custom designed by National Grid. Site specific drawings will be furnished for that particular installation by **National Grid**.
- 7.3.7 Piping and fittings used on outside meter sets shall be galvanized iron, welded and painted steel pipe, or screwed and painted black pipe. See Section 8.0 of this book for piping requirements regarding materials, coatings and construction. Galvanized is the preferred method on Long Island and also may be required by certain municipalities.
- 7.3.8 The customer's pipe connecting to the meter header shall be installed and supported following the **National Grid** Construction Standards, NFPA 54 FGCNYS and/or NYCFGC requirements, and the requirements identified in Section 8.0 of this book.
- 7.3.9 Prior to requesting a meter installation, the contractor shall be responsible for the installation of plugs or caps on any open ended pipe or fittings on the meter header or customer house line to prevent entry of dirt and debris ensuring the integrity of the gas piping system.

## 7.4. INDOOR METER SET REQUIREMENTS

- 7.4.1 **Per NY State Codes PSC 255.343**, meter sets shall be approved for indoor installation only when, in judgement, an outdoor installation is impractical or unsafe.
- 7.4.2 Indoor meters shall be installed according to the **National Grid** Construction Standards and written specifications provided by **National Grid**. **In all indoors meter sets, the meter and regulator must be a minimum of 36" from a source of ignition. For information on distances from gas and electric meters, refer to National Grid Standard 020013-CS**

**NOTE**

***In cases where the service regulator must be installed inside the building, the service regulator and meter shall be located immediately downstream of the exposed service line valve.***

**7.5 INDOOR METER SET REQUIREMENTS FOR LARGE INSTALLATIONS**

- 7.5.1 For Buildings of Public Assembly, apartment buildings, or for construction within an apartment, industrial or commercial complex, each with a capacity of seventy-five or more persons, the following specifications shall apply when meters/regulators are installed indoors:
- Where practicable, the regulator, valves and other gas equipment shall be installed within a separate room that is designed for two-hour fire resistance and effectively sealed from the remaining space in the building. These meter rooms shall also meet all code requirements.
  - The customer shall post a notice prohibiting unauthorized persons from entering the meter room to prevent tampering. A conspicuous and permanent notice shall be posted on doors or access leading to the specific installation indicating the actions to be taken, and the telephone number of the proper person to be called, in the event a gas odor is detected. The lettering shall be of bold type, at least one inch in height, properly spaced to provide good legibility and contrast with background.
  - Gas meter rooms shall be properly ventilated, lighted, and kept free of trash and rubbish at all times. Outside air for ventilation of a meter room shall be furnished as a separate supply, and shall not be shared with any other room.
  - Meter rooms shall **not** be used **for storage purposes (including chemicals and BBQ propane tanks)**, including building materials or equipment.
  - Meter rooms shall **not** be used in the volume calculation in determining the combustion and ventilation air available for gas utilization equipment.
- 7.5.2 For multifamily dwellings in New York City, gas meters shall not be located in the following places:
- A boiler room (other than a replacement of an existing gas meter) or other room or space containing a heating boiler;



- Any stairwell;
- Any public hall above the basement or above the lowest story if there is no basement;

7.5.3 For a retrofit or expansion in a multifamily dwelling in New York City, where a gas meter is already installed in a boiler room, one additional gas meter may be installed provided the additional meter is:

- Installed adjacent to the existing gas meter;
- Is used in conjunction with the supply of gas for a gas fired heating boiler or a gas fired water heater used as a central source of supply heat or hot water for tenants.

## 7.6 MULTIPLE METER HEADER REQUIREMENT

7.6.1 Gas meters, along with associated customer owned piping at multiple meter locations, shall be plainly identified by the installing contractor using a metal tag or other permanent means. These **markings** shall clearly identify the building or part of the building being supplied by the piping on each meter. These **markings** shall be completed by *the* contractor before National Grid will install the gas meter and turn on the gas supply.

7.6.2 The meter header piping shall be adequately sized and shall be properly supported according to the **National Grid** Construction Standard identified and furnished to the contractor.

### ***NOTE***

***Contractors are advised to ensure that the following additional information is known and approved by National Grid prior to the start of the meter set construction:***

1. *Piping manifold size*
2. *Number and size of meters*
3. *Meter by-pass requirements (prohibited in NYC)*
4. *Specific National Grid Construction Standard*

## 7.7 METER SET PROTECTION REQUIREMENT

7.7.1 When a customer cannot provide either an indoor or outdoor location for meters, regulators and associated piping that is free from the possibility of vehicular, equipment or other physical damage, the Customer will provide protection posts according to **National Grid** Construction Standard [MTRS-6060](#). The Customer is responsible for the installation of these posts. Such instances include locations near vehicles, or materials in motion, driveways, parking areas, storage rooms, or other similar situations. National Grid will not install the meter until this

requirement is completed. National Grid will install any posts required to protect the gas riser.

- 7.7.2 In areas where vandalism might be anticipated, a protected meter area may be required, or meters may need to be protected by a suitable wire fence if specified by National Grid. Specified protection shall be installed according to the **National Grid** Construction Standard [MTRS-6525](#).

## 7.8 METER HEADER PAD REQUIREMENTS FOR LARGE GAS INSTALLATIONS

- 7.8.1 The customer shall be responsible for the installation of a concrete gas meter pad for all rotary and turbine meter installations where a meter pad is required. Meter pads are required to support the weight of the meter and its associated gas header piping, valves and in some cases the weight of gas house line interconnection piping.

## 7.9 WALLS TO SUPPORT LARGE VOLUME METER HEADER REQUIREMENTS

- 7.9.1 Vertical meter headers may not require a wall to support the piping, meter, and regulator.
- 7.9.2 In cases where **National Grid** Construction Standards shows meter set piping supported by a wall, a wall shall be constructed to support the meter set if one does not already exist. In some cases, where a wall does not exist, a horizontal meter set may be specified instead if space requirements are adequate. [Remote meter header supporting systems shall not be made of wood. Concrete, Cinder Block, Kindorf, or composite materials is the preferred construction method.](#)

## 7.10 RELOCATION OF GAS METER SETS AND SERVICE LINES

- 7.10.1 Gas meter or service line relocation, such as moving a meter from one outdoor location to another outdoor location, or from an inside location to an outdoor location, shall be performed at the customer's expense. It is National Grid policy to avoid moving any inside meter to another inside location.
- 7.10.2 To request meter relocation, contact National Grid for Long Island at **631-348-6150** and **718-270-0220** for NY City. *A representative* will schedule a field visit by National Grid who oversees the design, policy requirements, field measurements and scheduling.
- 7.10.3 Contractors performing the relocation of the customer owned-piping shall be responsible for:
- - Interconnection of piping with the [National Grid piping at the connection point of service](#)
  - Fabricate new meter header
  - Providing proper meter header protection, if needed;
  - Obtaining necessary piping permits from local authorities.

## 7.11 GAS SERVICE REGULATOR AND VENTING REQUIREMENTS

- 7.11.1 National Grid will select, furnish or install, and adjust all service regulators when the gas is supplied by high pressure gas distribution system. All questions related to regulator and relief valve set points shall be referred to National Grid
- 7.11.2 All service regulator vent piping and related components shall be installed according to NFPA-54, FGCNYS or the NYCFGC. Contractors shall be responsible for piping the regulator vent; service regulator.
- 7.11.3 **OUTSIDE METER SETS:**  
Service regulator vent piping shall be sized according to Appendix A of this book. On all large jobs the contractor shall not size or determine the termination locations of regulator and relief valve vents without the assistance of National Grid's Project Manager or Gas Technician.
- 7.11.4 **INDOOR METER SETS:**  
All service regulators and relief valves installed indoors shall have the vent piped to the outdoors by the contractor. All regulator vent installations shall be in compliance with the **National Grid** Construction Standard Number [020013-CS](#) **National Grid** Construction Standards and other unique requirements applicable to a particular installation shall be strictly followed by the contractor.
- 7.11.5 All vent lines on indoor or outdoor installations shall have an insulating **fitting** installed as close to the service regulator, security valve or relief valve as practical. [Where 2 or more National Grids' regulators are installed, the regulator vent lines must not be manifolded together.](#)
- 7.11.6 All vent lines on indoor or outdoor installations shall be equipped with an approved insect and rain resistant cap on the terminal end.
- 7.11.7 Service regulator vents shall not be covered over, plugged up, or otherwise obstructed.
- 7.11.8 Termination locations of regulator or relief valve vents shall be protected from damage caused by submergence in areas where flooding or ice accumulation may occur. National Grid will advise the contractor of vent terminus requirements for all locations that deviate from established requirements in the construction standards. In areas where frequent flooding occurs, the vent **shall** terminate above the high-water mark.
- 7.11.9 The lengths of vent run and number of fittings shall be kept to a minimum. It will be necessary to increase the pipe size of the vent piping when long runs cannot be avoided. Appendix A shall be consulted to decide appropriate vent sizes and other information on service regulator venting.

## 7.12 METER BYPASS REQUIREMENTS

- 7.12.1 National Grid will specify a meter bypass piping arrangement as part of the applicable construction standard design. See Section 7.3.1.

### 7.13 TELEMETERING INSTALLATION REQUIREMENTS

- 7.13.1 Customers with TC & Interruptible rate classification shall be remotely monitored using telemetering equipment. This requirement may result in additional cost to the customer.
- 7.13.2 The customer shall be responsible for the installation of a dedicated phone line or cellular service (where required) routed to a location designated by National Grid, terminating with an appropriate network interface.
- 7.13.3 The customer shall be responsible for any trenching, drilling, conduits, restoration, supports, etc. that may be required to reach the National Grid telemetering device.
- 7.13.4 National Grid will install the interconnecting cable between the customer-provided interface and the telemetering device.

### 7.14 METER INSTALLATION, PURGING AND RELIGHTING

- 7.14.1 For commercial, industrial and multi-meter installations that add loads requiring increased meter or regulator size where National Grid is required to shut down the existing gas service, the contractor may be required to purge air from the system upon reconnection, and to relight all gas utilization equipment affected **by the shutdown.**
- 7.14.2 For all commercial new meter sets, the installing contractor shall be responsible for purging the house line and for starting up the equipment.
- 7.14.3 For residential new meter sets, National Grid will purge the gas piping system and light all operating gas appliances at the time of the new meter set. Appliances that are not ready for operation at the time of the meter set shall be started up by the installing contractor.
- 7.14.4 Where the gas service is turned off for Company purposes, National Grid will be responsible for the turning off all affected appliances, performing an integrity test of the gas piping system prior to the turning on and gassing in, and relighting all affected appliances.
- 7.14.5 For new meter sets serving large input gas utilization equipment, the burner installer shall be responsible for purging **as per NFPA 54, FGCNYS or the NYCFGC instructions.**

#### **PURGE IN TABLES**

<b>Table 1. Length of Piping Requiring Purging Before Being Placed in Operation</b>	
<b>Nominal Pipe Size (in.)</b>	<b>Minimum Length of Piping Requiring Purging (ft)</b>
3	30
4	15
6	10
8 or larger	Any length

**PURGE OUT TABLES**

<b>Table 2. Length of Gas Line Requiring Purging for Servicing or Modification</b>	
<b>Nominal Pipe Size (in.)</b>	<b>Minimum Length of Piping Requiring Purging (ft)</b>
2.5	50
3	30
4	15
6	10
8 or larger	Any length

- 7.14.6 Long runs of newly installed customer owned piping may result in odor fade. For odor conditioning of the piping refer to Appendix L

**7.15 PILOT GAS SUPPLY FOR INTERRUPTIBLE RATE CUSTOMERS**

- 7.15.1 TC & Interruptible customers who do not have an existing firm rate meter supplying a gas pilot may not be required to have a separate firm rate meter for the purpose of supplying the pilot as long as National Grid determines that installing a separate pilot gas supply line is impractical. The pilot gas supply may be taken off the interruptible gas meter supply line.
- 7.15.2 For new installations requiring a separate gas pilot supply line, the pilot gas supply shall be supplied by a low-pressure firm rate gas meter.

**8.0 CUSTOMER-OWNED GAS PIPING SYSTEMS**

**National Grid's jurisdictional ends at the outlet of the National Grid meter. All piping after the meter shall be maintained by the Customer.**

**8.1 GENERAL**

- 8.1.1 Before proceeding with the design and installation of gas piping systems, contractors are advised to refer to the National Fuel Gas Code (NFPA 54), FGCNYS or the NYCFCG. It is strongly recommended that a review of the local plumbing requirements also be performed to ensure that the proposed installation is in compliance with local codes.
- 8.1.2 When a new appliance or other gas load is added to an existing gas piping system, the contractor/customer shall verify the capacity of the existing piping for adequacy according to the capacity table(s) in NFPA 54, FGCNYS or the NYCFCG or equivalent. If necessary, existing gas piping shall be replaced with larger piping or additional piping installed that also conforms to the NFPA 54, FGCNYS or NYCFCG capacity tables.
- 8.1.3 The customer shall not be permitted to use an abandoned service line as a houseline.
- 8.1.4 For Long Island installations, the licensed plumber is required to complete the Installation's integrity test by completing the form in Appendix E (This Affidavit only applies to Towns without plumbing inspectors). This completed form, along with diagram of any buried piping, will be required at the site prior to the installation of the gas meter by National Grid personnel. It is the Contractor's responsibility to install customer owned piping to all National Grid's

requirements and to Federal, State and Local Codes. Failure to comply with these Codes, may delay the gassing in of the installation. National Grid will reserve the right to request and witness pressure tests for commercial installations where Town Inspectors are unavailable and the installation would classify as a “Building of Public assembly being 75 persons or more”.

- 8.1.5 For customer-owned gas piping installations ***that meet the definition of a gas service***, the contractor shall perform an acceptance test to verify the condition of the cathodic protection measures installed, where the type of piping warrants such protection. This test, which shall be performed after installation of the pipe and prior to setting of the meter, only indicates the condition of the cathodic protection at the time of testing. Any corrective action required by virtue of the test results shall be the contractor's responsibility. National Grid reserves the right to perform a cathodic protection acceptance test on any given installation.
- 8.1.6 Gas Pipe Bonding: “Each above ground portion of a gas piping system that is likely to become energized shall be electrically continuous and bonded to an effective ground fault current path. Gas piping shall be considered to be bonded where it is connected to gas utilization equipment that is connected to the equipment grounding conductor of the current supplying that equipment”.

## 8.2 PIPE SIZING

- 8.2.1 All gas piping, including trunk and branch lines, shall be adequately sized according to the National Fuel Gas Code (NFPA 54), NYCFCG or the NYCFCGS. Gas Ranges shall have a minimum pipe size of 3/4” nominal size.
- 8.2.2 A diversity factor (for cooking loads) shall be used to determine the maximum gas consumption for commercial and industrial establishments and in multiple tenant buildings where several appliances or loads are supplied from a common gas pipe line. In these cases, using a diversity factor in sizing the piping can result in significant savings in houseline and meter header costs. These factors can involve some complexity. For example, surveys have shown that different usages affect the load patterns where ranges are used, but range usage does not affect heating load patterns. Diversity factors for generators and pool heaters may be taken into consideration on a case by case basis – depending on the specific operations of these appliances. See [C-14-03 Generators and Pool Heaters](#).
- 8.2.3 For special cases (such as the standard residential combination of a boiler, a water heater and a range), a valid indication of whether the house piping system is sized properly is a series of pressure measurements taken immediately upstream of each appliance with ***all*** appliances operating. ***If each appliance delivers its rated input, and the minimum inlet pressure required by the manufacturer is maintained, this piping will be accepted by the National Grid representative.***

For multiple appliance or load situations, such as apartment buildings or industrial complexes with many different loads, this criterion will not hold true because of the effect of diversity factors.

***NOTE: The gas piping after National Grid's gas regulator must be immediately expanded to the customer's houseline. In addition, no elbows or valves shall be installed within 7 pipe diameters of the regulator. Failure to follow this requirement may result in pulsation, vibrations and/or pressure problems of the gas supply***

### 8.3 PIPING DRAWING

- 8.3.1 For buried customer-owned piping installations, where the supply line is defined as a service, such as a remote meter location, it is mandatory that a piping drawing or plan be provided to National Grid for review and approval prior to starting work on a job. This drawing shall indicate the proposed location, sizes of each branch, the various loads, connection point or service, cathodic protection measures, piping material and joining methods. It is especially important that the piping location information provided be accurate. At the end of the job, an as-built version of this drawing shall be submitted to National Grid prior to acceptance of the job.

### 8.4 GAS PIPING MATERIALS

#### 8.4.1 GENERAL

Materials used for gas piping shall be selected according to the provisions of NFPA 54, FGCNYS or the NYCFCG, local codes and the requirements listed in the following sections.

#### 8.4.2 GAS PIPING MATERIALS, INDOORS

For indoor gas piping, materials used shall be one or a combination of the following, complying with the latest ANSI standards for steel pipe, ANSI B36.10:

- Steel pipe must be standard weight (Schedule 40) with screwed or welded joints. ASTM A53 or ASTM 106 shall be used as a minimum.

***NOTE: On Long Island 1-1/2" diameter pipe piping cannot be used on meter headers.***

- Galvanized pipe, of standard weight (Schedule 40), ASTM A53, with screwed joints.
- Threaded gas fittings for steel shall be 150 pound, malleable iron, forged steel, black iron or galvanized steel.
- **Copper** tubing of any type is **prohibited** for indoor use.
- **Plastic** pipe of any type is **prohibited** for indoor use.
- **Cast iron** pipe is **not permitted** under any circumstances.



- **Corrugated Stainless Steel Tubing**: For natural gas piping inside and outside buildings, a recently developed system of piping Corrugated Stainless Steel Tubing (CSST) has been recognized by the National Fuel Gas Code since 1988, and is becoming more popular outside our service territory. Corrugated Stainless Steel tubing provides another option for gas piping in addition to steel. It is to be used where permitted by local codes. **(Currently prohibited in NYC). See Appendix F for CSST piping in all other areas of New York State**

**NOTE**

*Contractors are advised to exercise extreme caution when choosing to use CSST on an installation since some jurisdictions may not have approved this piping option. Contractors and builders interested in learning more about this economically favorable alternative are strongly encouraged to review the relevant sections in NFPA-54, FGCNYS or the NYCFCG.*

**8.4.3 GAS PIPING MATERIALS, OUTDOORS, ABOVE GROUND**

- For piping outdoors, above ground, including regulator vent piping, galvanized pipe or **properly coated black steel pipe** with screwed joints shall be used. **On Long Island galvanized pipe and fittings are strongly preferred on gas piping and vent lines and are a requirement in some towns.**
- Where welded joints are required, ASTM A53 continuous weld pipe shall be used as a minimum, but ASTM A106 is recommended.
- **Cast iron** pipe *is not permitted* under any circumstances.

**8.4.4 GAS PIPING MATERIALS, BELOW GROUND, GENERAL**

For buried customer-owned gas piping applications, only three materials, properly installed according to the specifications in the **book**, are acceptable. These materials are:

- Coated steel pipe with a cathodic protection system to prevent corrosion. Steel pipe construction may be either welded or threaded. See Section 8.4.5 for details.
- Polyethylene (PE) plastic piping. Plastic piping is the material of choice for gas utilities because it is low in cost, easy to handle and install, and is noncorrosive underground. See Section 8.4.6 for details.
- Copper tubing with brazed or flared joints for ***only certain specific small load applications only***, such as gas grills and gas lights. See Section 8.4.7 for details. **(Not approved for use in NYC service territory).**
- ***Cast iron pipe is not permitted*** under any circumstances.

**8.4.5 GAS PIPING, BELOW GROUND, STEEL PIPE OPTION**



- Steel pipe shall meet the requirements of ASTM A106 or API 1104, with a minimum of schedule 40 wall thickness. This piping is commercially available with factory-applied protective coatings for buried applications (mill wrapped). Piping may be installed either by welding or by use of field threading techniques and threaded couplings. All bare sections of piping and fittings, welded or threaded, shall be field coated and wrapped according to the coating and wrapping techniques of Section 8.10 of this book.

In addition, a cathodically protected system shall be required for steel pipe installed below ground to be fully effective in preventing corrosion.

**Uncoated steel pipe shall not be permitted below ground.**

*Installation requirements and details for steel piping* installed below ground are provided in Sections 8.10 through 8.11.

8.4.6 **GAS PIPING BELOW GROUND, PLASTIC PIPE OPTION**

Polyethylene (PE) pipe or tubing PE 2406 (medium density yellow) or PE 3408 (high density black) conforming to ASTM D2513, Specifications for Thermoplastic Gas Pressure Pipe Systems, shall be used.

PE plastic pipe may **not** be used for gas piping inside or beneath buildings (unless approved by National Grid) or for venting gas pressure regulators.

The following specifications shall be used for PE fittings:

- ASTM D2683 Specification for Socket Type Polyethylene Fittings for Outside Diameter Controlled PE Pipe and Tubing
- ASTM D3261 Specification for Butt Fusion Polyethylene (PE) Plastic Fittings for Polyethylene (PE) Plastic Pipe and Tubing
- ASTM F1055 Standard Specification for Electrofusion Type PE Fittings for Outside Diameter Controlled PE Pipe and Tubing

**NOTE:**

*All PE pipe, tubing and fittings are normally marked by the manufacturers with the appropriate ASTM code-indicating conformance to the specified standards.*

*Installation requirements and details for plastic piping are provided in Section 8.12*

**TABLE 8.1**  
**PLASTIC PIPE SDR RATINGS AND WALL THICKNESSES**

SIZE	SDR RATING	WALL THICKNESS
½"CTS	SDR 7	.090"
1" CTS	SDR 11.5	.099"
1 ¼"	SDR 10	.166"
2"	SDR 11	.216"

#### 8.4.7 GAS PIPING BELOW GROUND, COPPER TUBING OPTION

Minimum wall thickness when using copper shall be as specified for type "K" or "L" tubing, according to ASTM B88, soft copper.

- Fittings for copper tubing shall be wrought copper. Cast fittings are not permitted. See Section 8.13 for copper installations.

**NOTE**

***Copper tubing shall not be used above or below ground from the meter outlet to the building foundation, such as from remote meter pad locations, under the building foundation, or through the building wall. Installation requirements and details for copper tubing installed below ground are provided in Section 8.13.***

#### 8.5 VALVES

- 8.5.1 Listed, design-certified manual shut-off valves shall be used as isolation valve for gas appliance installations according to the requirements in NFPA-54, FGCNYS, or the NYCFGC **and local codes**.

**CAUTION**

***NEVER - FOR ANY REASON - remove the core nut from a gas valve, or attempt to disassemble a valve stem when the gas pressure is on.***

#### 8.6 STEEL GAS PIPING, WELDING REQUIREMENTS

##### 8.6.1 GENERAL

When welded construction is used, above or below ground, indoors or outdoors, welders shall be certified by recognized certification and testing agencies for pipeline welding in accordance with API 1104 or ASME Section IX. Written welding procedures shall be followed to ensure the acceptability of field welds. Welders' certifications shall be available at the construction site.

- 8.6.2 Houeline welding and pipe size guidelines are listed below. Note: Long Island and New York City have different requirements. Schools in New York have additional requirements.

8.6.2a LONG ISLAND:  
HOUSELINE PIPING FOR RESIDENTIAL, COMMERCIAL, INDUSTRIAL,  
MULTI-FAMILY INSTALLATIONS IN NASSAU AND SUFFOLK  
COUNTIES

ON LONG ISLAND per NFPA 54 and NY State Fuel Gas Code:

This applies to all houseline piping downstream of the National Grid Meter Headers.

The maximum design/operating pressure for gas piping systems located inside or outside buildings shall not exceed **5 psig** unless:

1. Approved by National Grid. 2. The piping system is welded *and one or more* of the following *conditions* are met:

- The pipe is welded
- The pipe joints are flanged and pipe-flange connections are made by welding
- The piping is located in a ventilated chase or otherwise enclosed for protection against accidental gas accumulation.
- The piping is located inside buildings or separate areas of buildings used exclusively for:
  - Industrial processing or heating,
  - Research,
  - Warehousing, or
  - Boiler or mechanical equipment rooms.
- The piping is a temporary installation for buildings under construction.
- The piping serves appliances or equipment used for agricultural purposes.

**NOTE: ALL HOUSELINE PIPING GREATER THAN 4 INCH IN DIAMETER SHALL BE WELDED.**

**ALL HOUSELINE PIPING GRATER THAN 5 PSIG MUST ME WELDED**

8.6.2b NEW YORK CITY  
HOUSELINE PIPING FOR RESIDENTIAL, COMMERCIAL, INDUSTRIAL,  
MULTI-FAMILY INSTALLATIONS IN NEW YORK CITY (except schools):

No gas distribution piping containing gas at a pressure in excess of 1/2 psig shall be run within a building, except that pressure not exceeding three (3) psig is permitted for the following uses: (a) commercial use, (b) industrial use; (c) other

large volume use in which fuel requirements for boiler room equipment exceed 4000 cubic feet per hour and such large volume use is supplied through separate gas distribution piping to the boiler room. Gas pressure not exceeding 15 psig is permitted for boiler room equipment in excess of 100,000 cubic feet per hour provided the gas distribution piping is installed as provided for in Section 404 of the New York State Fuel Gas Code. The use of pressure in excess of 15 psig shall be permitted for distribution piping provided all of the requirements of Section 406 (NY City Fuel Gas Code) are met.

- Gas distribution piping operating at a pressure of over ½ psig (3.5 kPa gauge) to 3 psig (20 kPa gauge) and size 4 inches (102 mm) or larger shall be welded.
- All gas distribution piping operating at a pressure above 3 psig (20 kPa gauge) shall be welded.
- All welding of gas distribution piping shall be subject to controlled inspection as set forth in Section 406.
- All piping 4 inches and greater operating at pressure exceeding 3 psig (20 kPa gauge) must be butt welded, subject to special inspection and radiographed.
- Threaded piping may be used up to 4 inches at pressure no greater than ½ psig (3.5 kPa gauge).

#### 8.6.3 SCHOLS IN NEW YORK STATE

**For New York State Schools (except in New York City), the the Manual of Planning Standards Section S709 F no longer applies as the Schools will revert to NY State Fuel Gas Code Section 403.10.5 regarding piping and welding requirements:**

See link:

<https://codes.iccsafe.org/content/NYSFGC2020P1/chapter-4-gas-piping-installations>

**For New York City owned Schools, refer to the NY City School Construction Authority, Section 15416 – Plumbing and Drainage Section 15416. Excerpt of 15416**

1. Gas pressure in the utility's street piping network is 1/2 psig (14" w.c.) or less (inclusive of system being provided with a gas booster pump):
  - a. 4"(inches) pipe dia. and smaller . Threaded or welded
  - b. Over 4" (inches) pipe dia. . . . Welded
2. Gas pressure in the utility's street piping network is greater than 1/2 psig but less than 15 psig (inclusive of the utility company providing a service regulator to reduce the incoming pressure to 1/2 psig):
  - a. Under 3" (inches) pipe dia. . . . Threaded or Welded
  - b. 3"(inches) and larger pipe dia. . Welded
3. Piping over 15 psig
  - a. All piping Welded

<http://www.nycsca.org/Business/WorkingWithTheSCA/Design/Pages/Specifications.aspx>

8.6.4 FOR PRESSURE TEST REQUIREMENTS REFER TO **APPENDIX D**

8.6.5 STANDARDS FOR NON-MERCURY GAUGE

The rules in this section establish the minimum standards for non-mercury gauges to test gas piping, drainage and vent systems.

Minimum requirements – Each gauge shall meet the following requirements:

- a) The gauge shall be manufactured and used in accordance with the ASMEB40.100-2013 Standard for Pressure Gauges and Gauge Attachments, which incorporates ASME B40.1-2013 and ASME B40.7-2013, and the manufacturer shall provide with the gauge a written statement that the gauge is manufactured in accordance with such ASME standard:
- b) For test pressures for 3 to 5 psig, a 15 psi gauge with ½ psig increments shall be used. Minimum dial size shall be 3” in diameter.
- c) For test pressures greater than 5 psig, a 100 psi gauge with 2 psig increments shall be used. Minimum dial size shall be 3-1/2” diameter.
- d) The gauge shall be labeled with the name of the manufacturer;
- e) The units of measurement “psi” shall appear on the face of the gauge
- f) The gauge shall be kept in good working order and properly stored. All gauges tested annually, certified/calibrated or replaced.

8.6.6 WELDER QUALIFICATIONS in NEW YORK CITY

- a) Welder’s qualifications. Welders installing gas piping within buildings at any pressure shall be qualified for all pipe sizes, wall thicknesses and all positions in accordance with ASME Boiler and Pressure Vessel Code, and re-qualified on an annual basis. The qualification testing shall be performed by an approved agency and the inspector shall have a minimum radiography qualification of Level II in accordance with the American Society of Non-Destructive Testing Recommended Practice Document No. SNT-TC-1A, Supplement A. Copies of the certified welder qualification reports shall be maintained by the responsible welding contractor and shall be made available to the department of buildings upon request.
- b) Welding requirements. All welded gas distribution and meter piping main and branch supplies to customer equipment operating in excess of 3 psig inside buildings shall be butt welded; and shall be subject to special inspection in accordance with Chapter 17 of the New York City Building Code.
- c) Radiography shall be performed on all butt welds in gas meter and gas distribution piping operating at pressures exceeding 3 psig, within buildings, in accordance with ASME Boiler and Pressure Vessel Code Section IX.

8.7 GAS PIPING (INDOORS AND OUTDOORS) ABOVE GROUND, INSTALLATION REQUIREMENTS, GENERAL

- 8.7.1 Gas piping in concealed locations shall be installed according to the requirements in NFPA-54, FGCNYS, NYCFGC **or local codes**. If it is desired to locate concealed gas piping in partitions, piping shall be located in hollow partitions, such as in ventilated chases. Concealed piping in solid partitions is prohibited.
- 8.7.2 Gas piping inside or outside of any building shall not be run in or through an air-duct, clothing chute, chimney or flue, ventilating duct, dumb waiter or elevator shaft.
- 8.7.3 No other piping or wiring shall be located in a casing containing a gas line.
- 8.7.4 Gas lines passing through concrete or masonry walls, floors or slabs shall be enclosed by a sleeve or thimble.
- 8.7.5 Gas piping extending through foundation walls shall be sleeved and sealed according to the requirements in NFPA-54, FGCNYS, **NYCFGC and local codes**
- 8.7.6 The use of gas piping as a grounding electrode is prohibited per NFPA 54.
- 8.7.7 Sediment traps (drip leg) for gas piping shall be installed according to the requirements in NFPA-54, FGCNYS, NYCFGC **and local codes**. When not incorporated as part of the equipment, a sediment trap shall be installed downstream of the equipment shutoff valve (exception: dryers, ranges, outdoor grills and illuminating appliances)
- 8.7.8 Where a branch outlet is placed on a main supply line before it is known what size pipe will be connected to it, the outlet shall be of the same size as the line that supplies it.
- 8.7.9 Shutoff valves controlling several gas piping systems shall be accessible for operation and shall be installed so as to be protected from any physical damage. Gas shutoff valves shall be plainly marked with a metal tag by the installer so that each piping system supplied by the valve can be readily identified.
- 8.7.10 Gas piping shall not be supported by other piping but shall be supported directly by the building structure itself with pipe hooks, metal straps, bands, or hangers suitable for the size of the pipe, and of proper strength and quality at proper intervals so that the piping cannot be jarred or displaced accidentally from its original position.
- 8.7.11 Listed and approved flexible connectors shall be used for final connections to gas appliances provided the flexible connectors are used on moveable equipment such as gas dryers and gas ranges only, and are placed on the appliance side of the appliance shut-off valve. Certain manufacturers of selected equipment supply flexible connectors for permanent mounted gas utilization equipment. In those cases, the manufacturer's specified flexible connectors shall be installed according to the manufacturer's installation instructions **and local codes**.

- 8.7.12 Flexible connectors shall not pass through floors or partitions.
- 8.7.13 For steel gas piping installed outdoors above ground, piping shall be protected with a suitable oil based painting system, or by use of one of the coating systems identified in Section 8.9 of this book. If galvanized pipe is used, painting is not required, but it is recommended that the exposed threads be painted.

## 8.8 GAS PIPING OUTDOORS, BELOW GROUND, INSTALLATION REQUIREMENTS

All buried customer owned house piping shall be made accessible for inspection by National Grid prior to backfilling.

NOTE: New York State Fuel Gas Code Section 404.11.2 has **newly added requirements** see below:

PROTECTION METHOD: Underground piping shall comply with one or more of the following:

1. The piping shall be made of corrosion-resistant material that is suitable for the environment in which it will be installed
2. Pipe shall have a factory-applied, electrically-insulating coating. Fittings and joints between sections of coated pipe shall be coated in accordance with the coating manufacturer's instructions.
3. The piping shall have a cathodic protection system installed and the system shall be monitored and maintained in accordance with an approved program.

NOTE: per this requirement, it is not permitted to run bare steel underground piping and then field coat it. In addition, anodes will need to be installed with a test station.

- 8.8.1 New York State's Public Service Commission Regulations require that buried gas piping meet their requirements. These concerns are critical because underground conditions promote corrosion. In order to comply with these laws, the materials and rules in the following sections are provided to ensure that gas piping meets the required standards.
- 8.8.2 For underground piping, mark-out procedures shall be strictly followed during construction according to the provisions of 16 NYCRR part 753. Prior to excavation, National Grid or its representative will mark out all gas facilities in the public right-of-way. The customer is responsible to mark out all Customer Owned gas and other utilities located on their private property. The number to call to get the facilities marked out is **811**.
- 8.8.3 Only personnel qualified to perform the specific pipe-joining processes used for any given installation, such as welding for steel and heat fusion for plastic, shall perform this work.
- 8.8.4 Remote meters are normally limited to commercial and industrial facilities where multiple buildings are supplied gas from a single meter set location. There are, however, some applications where National Grid requires that a meter be installed remotely from a building due to the inability to locate the meter inside or directly near the building. For these cases, the meter sets are, where practical, installed as close to buildings as possible.

These installations, where the piping must be treated as a gas service, require special attention and piping specifications, and are addressed accordingly in Sections 8.9 through 8.14 of this book.

- 8.8.5 When buried piping downstream of the meter is required, the piping shall be designed and installed according to NFPA 54, FGCNYC and NYCFGs specifications. Where the National Grid Construction Standards (CS) are applicable, those drawings shall be used. When a specific Construction Standard or Construction Detail Drawing is required, the direction will come from National Grid.
- 8.8.6 For buildings where the gas pressure exceeds 1 psig at the point where the service line enters the building, all exterior wall openings that are both below grade and within 10 feet of the gas service line entry point shall be made gas tight. Where such openings are provided for gas service lines, the gas pipes shall be protected from damage by settlement or corrosion i.e. a steel sleeve.
- 8.8.7 **Customer-owned gas piping shall enter buildings above grade per International Fuel Gas Code 2018, Section 404.6**
- 8.8.8 Where the installation of underground utility-owned gas piping beneath buildings or portions of buildings is unavoidable, the piping shall be encased in a conduit. The conduit shall extend into a normally usable and accessible portion of the building, and at the point where the conduit terminates in the building, the space between the conduit and the gas piping shall be sealed to prevent the possible entrance of any gas leakage. The conduit shall extend at least 4 inches outside the building, be vented above grade to the outside, and be installed in such a way as to prevent the entrance of water. **National Grid** should be contacted for any questions or clarifications.
- 8.8.9 All piping below ground shall be installed with a minimum of 18 inches of ground cover (24" depth of cover in NYC) and clearance of 6 inches from other sub-surface facilities or materials. Where other subsurface facilities prevent the installation of gas piping at this minimum depth, the area with less cover shall be protected by a steel schedule 40 pipe casing two pipe sizes larger than the gas pipe or a 1/4" thick steel plate that extends 12" horizontally each side beyond the limits of the gas piping.
- 8.8.10 Where steel pipe is used, below grade piping and fittings shall be **factory** coated and cathodically protected according to National Grid Specifications as defined in Sections 8.9 through 8.11 of this book, and the National Grid Construction Standard.
- 8.8.11 Back fill around pipe shall consist of loose dirt or sand, must be free of rocks, building materials or other debris.
- 8.8.12 Where plastic pipe is used (**where code permits**), connections between metallic and plastic pipe shall be made (below grade) only with fittings approved by the pipe manufacturer. Information concerning these fittings can be obtained by contacting National Grid. The recommended ways to make this transition connection are: **See Section 8.12 for plastic pipe installations.**



Use of an approved service riser assembly;

- Use of an approved transition fitting. These fittings are couplings that have been tested and approved by National Grid based on their ability to resist longitudinal pullout forces.

8.8.13 For all underground piping customer/plumber/contractor shall fill out the “Customer Owned Gas Piping Certificate” form in Appendix E. The form shall be submitted to National Grid at the time the meter is delivered. This as-built drawing of the piping shall be submitted regardless of 3<sup>rd</sup> party inspection.

8.8.14 *All* piping shall be pressure tested according to Appendix D of this book prior to acceptance by National Grid.

## 8.9 STEEL GAS PIPING, CORROSION PROTECTION REQUIREMENTS, COATING AND WRAPPING

8.9.1 For steel pipe, below ground piping shall be **factory coated** per *NY State Fuel gas Code Section 404.11.2* If bare steel pipe is used above ground, it must be primed or painted, or galvanized.

8.9.2 For the fittings and joints of steel underground piping, it shall be given a primer coating and then wrapped with a tape suitable for underground use. Do not use Electrical Tape. See National Grid Construction Standards COR02001 and 030031-CS. The pipe surface shall be clean and free of rust prior to applying the primer coat. Tape wrapping shall be spirally wound with a half overlap on each turn **it is recommended that the exposed threads be painted.**

8.9.3 The following materials are acceptable for coating and wrapping steel pipe:

- Polyken Technologies Pipeline Primer #1027 or equal, in conjunction with Polyken Tape #936 or equal, or Polyken Gas Utility Tape or equal.
- Tapecoat Company CT Coldprime or equal in conjunction with Tapecoat Pipe Tape H-30 or H-50 or equal.

## 8.10 STEEL GAS PIPING, CORROSION PROTECTION REQUIREMENTS, INSULATING JOINTS

8.10.1 Insulating couplings or fittings shall be used to electrically separate the underground portion of steel piping from the above-ground piping or the piping in a building. The insulators shall be located on the above ground portion of a riser and on the pipe immediately after entering a building wall. No other connections shall be made to the underground portion of piping that could result in an electrical ground to the piping, since this will cause the insulators to be ineffective. Insulating unions, threaded or insulating couplings, or insulating flanges are typically used for these connections.

8.11 STEEL GAS PIPING, CORROSION PROTECTION REQUIREMENTS, MAGNESIUM ANODES

- 8.11.1 Magnesium anodes shall be electrically attached to the underground steel piping. These anodes are available in 3 pound and 17 pound ingot sizes with a wire connection lead attached.
- 8.11.2 One 3-pound anode shall be installed where the total underground piping length is 10 feet or less. When the total length of underground pipe is greater than 10 feet, install one 17-pound magnesium anode for every 100 feet of underground piping. ***Note: Always bury an anode with the container it comes in. Do not remove it from the cardboard box!***
- 8.11.3 The anode ingot shall be buried in the soil approximately 2 feet to the side and below the level of the piping at a location near the center of the section pipe being protected.
- 8.11.4 The wire lead shall be attached to a bare steel area of the pipe using a thermite weld kit or pipe clamp, using a #15 Green Cap cartridge specifically manufactured for attachment to schedule 40 pipe. After attaching, the coating in the thermite-welded area shall be restored (re-coated) so that no bare metal remains.

8.12 PLASTIC PIPING, INSTALLATION REQUIREMENTS (Where allowed by Code)

- 8.12.1 New York state code requires that plastic pipe and fittings shall be installed by qualified personnel according to the manufacturer's written installation instructions.
- 8.12.2 Before using materials, visually inspect for damage such as gouges, scratches and kinks, and discard any damaged materials.
- 8.12.3 PE pipe and tubing must be laid on undisturbed or well-compacted soil or other continuous support. Suitable rock-free back-fill shall always be placed around the pipe or tubing.
- 8.12.4 In addition to the minimum depth of coverage (18"), consideration must be given to future loading and activity above and around the piping to determine if encasing the pipe in a steel sleeve is necessary.
- 8.12.5 Pneumatic or mechanical tamping shall not be used within 12" of the plastic piping.
- 8.12.6 Pipe or tubing must be free of cuts and scratches deeper than 10% of the wall thickness. Defects in pipe, tubing or fittings cannot be repaired. Therefore, the damaged pipe, tubing or fittings must be replaced. PE pipe shall not be used inside buildings or above ground.

- 8.12.7 PE pipe and tubing shall be joined by heat fusion or by mechanical fittings (mechanical service head adapters). **Per CFR Part 192, as of January 22, 2019 all mechanical fittings connecting plastic to steel shall be Category 1.**
- 8.12.8 Mechanical fittings shall not be used where pressure exceeds 5 psi or pipe size is greater than 4" diameter, except in certain instances where a customer-owned piping system qualifies. The preferred joining method is an all fused plastic system (electrofusion or butt fusion). PE mechanical stab and full restrained (locking) compression fittings (made for natural gas) are permitted as approved by National Grid. If a metallic mechanical fitting is used as a last resort, the mechanical coupling shall be cathodically protected from corrosion by industry approved field coating and the installation of a 3# anode.
- 8.12.9 Heat fusion joints shall be made according to the manufacturer's recommended heat fusion procedures.
- 8.12.10 Miter joints are not permitted.
- 8.12.11 Joints shall not be located in pipe bends.
- 8.12.12 See the pipe manufacturer's requirements for minimum bending radius of plastic pipe.
- 8.12.13 ***Heat fusion joints shall be performed only by personnel qualified in the appropriate joining techniques.***
- 8.12.14 A #14 AWG, minimum, insulated solid copper wire shall be installed alongside but not touching the plastic pipe to facilitate locating with a pipe locator. Tracer wires shall terminate in an accessible location above ground so that a pipe locator can be connected.
- 8.12.15 A bright-colored plastic warning tape shall be buried approximately 12" below final grade to mark the location of the pipe and to warn future excavators.
- 8.12.16 Insulating couplings, insulating flanges or unions shall be used to electrically separate the underground portion of plastic piping from the above-ground steel piping or the piping in a building. This is necessary to protect the gas riser, and also is necessary for anode less, pre-coated riser.
- 8.12.17 Plastic Fuel Gas Piping installations shall be performed by trained, qualified and certified personnel by National Grid.
- 8.13 **COPPER TUBING INSTALLATION REQUIREMENTS (Where allowed by Code)**
- The sizing of copper tubing shall be selected based upon the maximum capacity of natural gas in cubic feet per hour as specified in NFPA-54, FGCNYS or NYCFCG.
- 8.13.1 **Fittings for copper tubing shall be wrought copper. Cast fittings are not permitted.**

- 8.13.2 Copper tubing shall not be used above or below ground from the meter outlet to the building foundation, such as from remote meter pad locations, under the building foundation, or through the building wall.
- 8.13.3 *Soft solder joints (sweated joints) shall not be permissible.*
- 8.13.4 When mechanical joints are necessary for joining copper tubing standard SAE flared fittings shall be used.
- 8.13.5 *Threading of copper tubing shall not be permissible.*
- 8.13.6 Insulating couplings or fittings shall be used to isolate transitions from copper to other metal piping and to electrically separate the underground portion of copper tubing with the tubing above ground or the tubing in a building.

#### 8.14 GAS PIPING THROUGH BUILDING WALLS, ABOVE OR BELOW GROUND, INSTALLATION REQUIREMENTS

- 8.14.1 That portion of customer-owned outdoor steel gas piping, **above** ground that runs through an external building wall (the wall piece) shall be coated or wrapped using one of the coating and taping systems listed in Section 8.9.3 of this book. This requirement shall be applicable to all steel pipe, including black pipe, and to piping above ground that runs through walls. **PVC tape is not acceptable for wrapping pipe for this purpose.** If galvanized pipe is used, taping of the pipe is not required, but it is recommended that the exposed threads be painted.
- 8.14.2 **Per International Fuel Gas Code 2018, Section 404.6. Customer owned gas piping shall not penetrate building foundation walls at any point below grade. Gas piping shall enter and exit a building at any point above grade and the annular space between the pipe and the wall shall be sealed.**

#### 8.15 PRESSURE TESTING OF GAS PIPING

- 8.15.1 All pressure testing of gas piping shall be performed according to the procedure in **Appendix D** of this book.

### 9.0 GAS UTILIZATION EQUIPMENT

#### 9.1 GENERAL

##### 9.1.1 APPLIANCES- ACCESSORIES AND EQUIPMENT APPROVAL

All of the gas appliances and accessories referred to in this book shall be design-certified by a nationally recognized testing and/or listing agency, such as **CSA** or Underwriters Laboratories, **M.E.A.**, to comply with the applicable American National Standard.

##### 9.1.2 INSTALLING CONTRACTOR'S RESPONSIBILITIES

The work performed by the contractor shall comply with the applicable Building Code of Nassau or Suffolk County, or the City of New York, and all departments

and bureaus having jurisdiction over the installation. The contractor shall obtain all necessary permits and certifications that may be required for the job.

Requirements for gas utilization equipment, collected together in the following sections, are intended to supplement or amplify, but not substitute for, any applicable State, City, Town or Village codes, regulations or ordinances. If there is a conflict between the National Grid requirement and the municipal requirement, ***the more stringent requirement will govern.***

In all cases, it is the installer's responsibility to comply with all local municipal requirements. National Grid does not assume the obligation of enforcing or inspecting for compliance with municipal code requirements.

#### 9.1.3 Carbon Monoxide (CO) ALARMS

Carbon Monoxide (CO) is a highly toxic gas. It is the product of incomplete combustion of fossil fuels such as oil, natural gas, propane, gasoline, wood and coal. CO is very dangerous because it is colorless, odorless and tasteless.

National Grid recommends the installation of CO Alarms in accordance with applicable codes and recommends annual maintenance of the heating system.

For the correct location of CO Alarms and for the full text of the NYC and NYS CO Alarm Law, see Appendix G.

#### 9.1.4 ASSEMBLY OF EQUIPMENT

The installing contractor shall assemble the equipment according to the installation instructions of the manufacturer.

#### 9.1.5 GAS UTILIZATION EQUIPMENT INSTALLED IN RESIDENTIAL GARAGES

Gas utilization equipment installed in residential garages and in adjacent spaces that open to the garage and are not part of the living space or dwelling unit, shall be installed so that all burners and burner ignition devices are located at a minimum of 18" above the floor unless the equipment is listed as "Flammable Vapor Ignition Resistant" per NFPA-54.

#### 9.2 NATIONAL GRID "NATURAL GAS PRESSURE, IGNITION & DRAFT TEST"

On new gas meter installations National Grid will perform a natural gas pressure test (lock up & run), ignition, combustion, venting / ventilation and draft test on new natural gas utilization equipment; however, it is up to the installing contractor to insure the equipment meets the manufacturer's installation guidelines.

#### 9.3 GENERAL REQUIREMENTS, SPACE AND WATER HEATING EQUIPMENT INSTALLATIONS

9.3.1 Certified Rating plates shall be securely fastened to the appliance.

- 9.3.2 A complete set of manufacturer's operating, installation and maintenance instructions shall be made available.

9.4 COMBUSTION, DILUTION AND VENTILATION AIR (FRESH AIR) REQUIREMENTS

- 9.4.1 Air for combustion, dilution and ventilation air installed in any size room shall be installed according to the requirements of NFPA-54, FGCNYS or NYCFCG.

9.5 VENTING OF CATEGORY I GAS UTILIZATION EQUIPMENT ONLY

- 9.5.1 Venting of all equipment shall be provided according to the latest version of the National Fuel Gas code, NFPA 54, FGCNYS or NYCFCG.

- 9.5.2 For Long Island, refer to the Fuel Gas Code of New York State, Section 503.6 and NYC, refer to the New York City Fuel Gas Code for multi-story venting installations. Gas vents serving equipment on more than one floor, a single or common gas vent shall be permitted in multistory installations to vent Category I equipment located on more than one floor level, provided the venting system is designed and installed in accordance with this section and approved engineering methods.

Equipment separation. "All equipment connected to the common vent shall be located in \*rooms that do not communicate with occupiable and/or habitable spaces.

(\*rooms with outdoor access only)

- 9.5.3 Use of "Wye" connectors are recommended in all Category I venting systems. Use of a standard tee at any point in a venting system **is also acceptable**. When using either type of fitting, the body of the wye or tee shall be the same full size as the common vent. For example, in a case where two appliances are to be commonly vented, each of which require a 4" separate vent connector, and the common vent required is 6" (arrived at by using the vent tables), a 6 x 6 x 6 wye or tee using reducing collars on the two inlets is acceptable. A 4 x 4 x 4 wye or tee with a reducing collar on the common outlet is not acceptable.

- 9.5.3.1 A 6 x 6 x 4 tee, where the 4" size (typical for use in venting a water heater) is the bull of the tee, which allows for the main body of the tee to be the same size as the common vent, or 6" ) a 4" reducing collar would also be required on the inlet leg of the tee); or

- 9.5.3.2 A 6 x 6 x 4 wye, where the side connection entering at an angle is 4", but the main body of the wye is 6" (also required a 4" reducing collar on the other inlet of the wye.

- 9.5.4 **Use of draft hoods on gas designed equipment shall not be altered.**

## 9.6 VENTING OF GAS UTILIZATION EQUIPMENT - CATEGORIES II, III AND IV

- 9.6.1 Venting for Category II, III and IV equipment (as defined in NFPA 54, FGCNYS or the NYCFGC) shall be installed according to the manufacturer's installation instructions.

## 9.7 CHIMNEYS

- 9.7.1 **The contractor shall perform an inspection on the chimney venting system to ensure it confirms to nationally recognized standards.** The contractor shall not install a flue connector into a chimney breech opening that is smaller than the connector, or extend the breaching beyond the chimney lining. Under no circumstances shall this rule be violated.
- 9.7.2 For the proper sizing of vents connected into Type B Double Wall Vents, Interior and Exterior Masonry Chimneys, please follow the Venting tables listed in NFPA-54, FGCNYS or the NYCFGC. Special care must be taken when venting new equipment into an existing exterior masonry chimney. For additional information on Venting and Combustion Air, please refer to: "Choosing a Furnace or Boiler" in Appendix B.

## 9.8 SPILL SWITCH REQUIREMENTS

- 9.8.1 A manual reset thermal cut-off device (spill switch), UL tested and approved, shall be required on all natural-draft, gas-fired equipment used for space heating; i.e., all boilers, furnaces and conversion burners. This device shall shut off the gas to the burner in the event of chimney blockage or continued back draft. It is important to note that, as of January 1, 1991, boiler manufacturers are **required** by Federal law to provide both a **spill switch and flame roll out switch** on all **new** atmospheric gas boilers and furnaces having a rating of 300,000 Btuh or less. Interpretation of this ruling is to expand the requirement for spill switches to all natural draft appliances regardless of vent size, or whether or not the appliance is installed in a residential, commercial, industrial or multi-family establishment. For gas **conversion burners** that are installed in residences and other occupancies that utilize masonry chimneys or gas vents, a manual-reset thermal spill switch is also required. Add-on spill switches shall also be UL tested and approved.

In New York City, when multiple gas appliances having inputs above 300,000 BTU's (300 CFH) are connected to a common vent/chimney, each individual Spill Switch must be electrically wired in series with each other.

## 9.9 INSTALLATION OF HEAT PRODUCING EQUIPMENT IN FLAMMABLE OR CORROSIVE ATMOSPHERES

- 9.9.1 In operations where there is use of flammable liquids or agents, or aerosol sprays using halogenated hydrocarbons such as carbon tetrachloride, special care shall be taken in the installation of heat-producing equipment. Flammable liquids clearly must be kept a significant distance away from gas burning flames for safety reasons. Not so apparent, however, halogenated hydrocarbons tend to break down in temperatures above 500 degrees F and form toxic fumes. These

fumes are extremely corrosive and will accelerate damage to heat-producing equipment, flues and exposed metal surfaces.

- 9.9.2 It is imperative that all air for combustion come from out-of-doors in environments of this nature, unless the equipment can be isolated from the contaminated atmosphere.

**NOTE**

***NATIONAL GRID REQUESTS THAT ANY CUSTOMER WHO PLANS INSTALLATIONS IN THIS TYPE OF ATMOSPHERE CONTACT EQUIPMENT MANUFACTURER FOR TECHNICAL SUPPORT***

**CAUTION**

***The contractor is advised to become fully aware of the boiler control requirements as provided for in the latest revisions of ASME CSD-1 and New York State Code Rule 4. These documents may require additional safety controls over and above those required by this book or as furnished standard from the manufacturer for selected commercial, industrial and multi-family establishments.***

**9.10 GAS CONVERSIONS AND CONVERSION BURNER REQUIREMENTS**

- 9.10.1 Conversion burners and associated equipment for gas conversions shall be installed according to the burner manufacturer's installation instructions, NFPA-54, FGCNYS or the NYCFGC and ANSI Z21.8.
- 9.10.2 When installing conversion equipment, the combustion chamber and flue passage ways of the existing appliance shall be thoroughly cleaned.
- 9.10.3 Conversion burner nozzle shall not extend into combustion chamber.
- 9.10.4 Combustion chamber shall be installed on dry-base boiler if upshot gas burner is not used.
- 9.10.5 Burners shall be adequately supported, i.e., burner legs shall be required, or burner shall be resting on a firm and level foundation, where applicable.
- 9.10.6 Burners shall be properly attached to boiler flange.
- 9.10.7 Unit shall be inspected and tested for gas tightness. All openings around the boiler base at floor level, doors and at gun entrance shall be properly sealed with masonry cement or equivalent to prevent air leakage into the boiler. Clean outs and burner blast tube, except fire door, shall be sealed with non-asbestos type furnace cement.
- 9.10.8 Unless otherwise specified by the burner manufacturer, always install a gas designed ***double-acting*** barometric draft regulator in the vent connector. Gas



designed barometric draft regulators shall be installed according to manufacturer's installation instructions (power burner only).

A manual reset or single use type thermally actuated spill switch shall be installed on the double-acting barometric draft regulator. This switch is wired into the burner circuit to shut the gas off in case of a sustained back draft or blocked chimney condition.

- 9.10.10 Stack switches or stack aquastats shall be removed from electric circuit so they do not function as operating gas controls.
- 9.10.11 Base of chimney shall be cleaned, and the chimney wire brushed from top to bottom. If not properly cleaned, oil residue left on the gas vent will dry out over time, flake off, and drop downward, possibly building up to cause a blocked chimney condition.
- 9.10.12 Vent connector shall be properly sized. Check the existing vent connector size against the proposed firing rate of the gas burner to determine if the vent connector is too big or small. Replace the vent connector if its size does not correspond with the vent tables in NFPA-54, FGCNYS or the NYCFGC.
- 9.10.13 Contractors are advised that gas conversion burners are not delivered adjusted for proper input and combustion air. Therefore, appropriate adjustments ***shall be made*** to ensure proper draft, proper CO readings and other items necessary for safe operation.

#### 9.11 GAS FIREPLACES (VENTED DECORATIVE GAS APPLIANCES)

- 9.11.1 In all cases, these appliances shall be installed according to applicable state codes, the manufacturer's installation instructions and other specific conditions of approval. Within New York City, the appliance shall be approved for use in the City of New York.
- 9.11.2 Existing masonry fireplace flues must first be investigated and determined to be adequate, unobstructed, and with no upper-story openings or connections. All applicable clearances, air for combustion and ventilation requirements shall be observed.
- 9.11.3 Approved factory-built fireplaces, where installed indoors, must be vented through an approved Type B vent or lined chimney. All applicable clearances, air for combustion and ventilation requirements shall be observed.

#### 9.12 ILLUMINATING DEVICES

- 9.12.1 All gas lights shall be listed by the **IAS, CSA, UL** or other qualified technical listing organization. Gas lights shall be installed according to their listings, all local codes, National Grid requirements and the manufacturer's installation instructions.
- 9.12.2 Gas pressure regulators shall be installed for all illuminating appliances.

- 9.12.3 Gas lamps designed for post mounting shall be securely and rigidly attached to a post.
- 9.12.4 Adequate concrete shall be used around the base of the supporting lamp post and underground piping shall not be embedded in post concrete.
- 9.12.5 A shutoff valve shall be installed on the line to the gas light at the point where it connects to the house riser and shall be in an accessible location.
- 9.12.6 Where permitted by local authorities having jurisdiction, outdoor gas torches, used to symbolize some event or to adorn landmarks, entrances, etc., may be installed. These devices often require high gas inputs, and therefore, the contractor/customer shall proceed with caution. National Grid shall be consulted on all such installations.
- 9.12.7 New pedestals for gas torches shall be supported by an adequate concrete base. Gas pipe shall not be embedded in this base. Existing columns, which are used to support gas torches, may encase inlet gas piping subject to approval of the manner of connection by National Grid.
- 9.12.8 No gas torch flame shall be less than 7' above the immediate ground level.


9.13 NATURAL GAS COMBUSTION ENGINES (including generators, fuel cells and co-gens)

Natural gas-fired combustion engines are generally utilized for engine-driven air conditioning, cogeneration, heat pump, generators and other gas engine driven applications. National Grid is to be consulted regarding any proposed installations. All installations shall be performed according to the manufacturer's installation instructions, New York State and City Codes and NFPA-37. National Grid shall be consulted prior to proceeding with any plans to install natural gas combustion engines.

The flexible fuel line shall be installed at the generator fuel inlet located on the frame rail and must exit the generator perpendicular to the fuel rail. No pipe fittings (elbows or swages) are permitted between the flexible fuel line and the generator fuel inlet port.

The flexible fuel line must be as straight as possible. It is designed to isolate the rigid piping system from vibrations on the generator set. It is not intended to correct misaligned pipe sections or to serve as an elbow.

Where motorized fresh air louver(s) are used they must be wired to open automatically during equipment operation. An external end switch/whisker switch shall be mounted on the fresh air louver(s) to prove open position is required and is to be wired into the burner limit circuit(s).

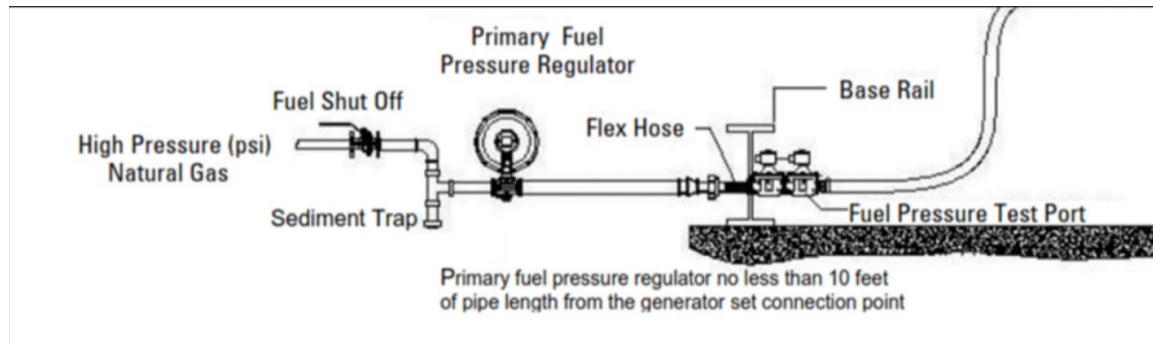

#### 9.14 COMPRESSED NATURAL GAS (CNG,) STATIONS

Compressed Natural Gas (CNG) stations shall not be planned without consultation with National Grid.

#### 9.15 UNVENTED ROOM HEATERS

Unvented room heaters shall be tested in accordance with ANSI Z21.11.2 and shall be installed in accordance with NFPA 54, FGCNYS, NYCFCG and the manufacturer's installation instructions. They may not be used as the primary heat source. Unvented room heaters must be equipped with an oxygen depletion sensor safety shutoff system. Unvented room heaters are currently prohibited in New York City.

#### 9.16 OTHER EQUIPMENT

Any gas utilization equipment not covered in this manual shall be installed according to the National Fuel Gas Code, FGCNYS, NYCFCG **and local codes**. National Grid shall be consulted for further guidance on any equipment not covered in this book.

#### 9.17 COMBO WATER HEATERS

Water heaters utilized both to supply potable hot water and provide hot water for space heating applications shall be listed and labeled for such applications by the manufacturer and shall be installed in accordance with the manufacturers installation instructions (in New York City installed in accordance with the New York City Plumbing Code

# APPENDIX A

**APPENDIX A****SERVICE REGULATOR VENT PIPING REQUIREMENTS**

- 1.0 Contractors shall size and lay out service regulator vent piping in accordance with the following requirements: **Vent lines shall be gas tight and should be installed with properly sized wrenches and pipe doped threads.**
- 1.1 Vent lines for gas pressure service regulators shall be piped using rigid steel Schedule 40 pipe, sized in accordance with Tables 2 through 7 of this Appendix, and installed in accordance with the National Grid Construction Standard 020013-CS and the instructions contained in this Appendix. All service regulator vent lines shall be located such that, should venting to the atmosphere occur, a hazard is not created.
- 1.2 Vent piping installed outdoors shall be galvanized or primed and painted with screwed ends. For those cases where vent pipe is installed with welded end connections, the pipe shall be primed and coated with a painting system suitable for outdoor applications. Vent piping installed through outside walls shall be protected against corrosion in accordance with the requirements contained in Section 8.0 of this book.
- 1.3 Where there is more than one service regulator or relief valve at a meter header location, each regulator shall have its own separate vent line to the outdoors. Manifolding of vent lines shall not be permitted.
- 1.4 Regulators shall not be vented commonly with external relief valves or devices requiring atmospheric air pressure to balance a diaphragm.
- 1.5 National Grid will provide size and termination location, as part of the installation design when vent lines are required. The contractor shall furnish the labor, materials and the layout for the installation of the regulator vent line.
- 1.6 The size of service regulator vent lines shall not be less than the size of the connection on the regulator vent.
- 1.7 All vent lines shall have an insulating union installed as close to the regulator as possible.
- 1.8 Vent line termination points shall be provided with approved rain caps and insect-resistant screens. National Grid shall furnish the contractor with these combination rain caps and insect-resistant screen devices at the construction site meeting with the installing contractor. The contractor shall provide the labor to install the devices. Combination vent caps are available for the following pipe sizes as shown in Table 1.

TABLE 1

**NATIONAL GRID COMBINATION VENT CAPS**

NATIONAL GRID ITEM ID	VENT PIPE DIAMETER
9358637	3/4"
9315859	1"
9358638	1-1/4"
9310355	2"

- 1.9 Vent line piping shall contain a minimum number of bends and elbows. Each fitting offers resistance to gas flow, that can be expressed as an **equivalent length** of pipe. Equivalent lengths for elbows are given underneath each table in Tables 2 through 7 of this Appendix. The equivalent length of the fittings shall be **added to the actual length of piping** when selecting vent pipe size.
- 1.10 Where vent pipe size in the tables is larger than the regulator vent outlet, a pipe reducer (increaser) shall be installed as close to the regulator vent as possible, preferably immediately at the regulator vent outlet.
- 1.11 Vent piping is not permitted to be installed below-grade. If it penetrates a building foundation wall above ground, the piping shall meet the same requirements as buried gas piping regarding corrosion protection, i.e., coating, wrapping, cathodic protection, etc. in accordance with the Section 8.0 of this book. Vent piping that penetrates concrete or masonry walls shall be sleeved with the annular space sealed.
- 1.12 Regulator vent piping for outdoor regulators shall only be required to clear a building overhang or to provide the required clearances above the ground, or away from building openings or windows. Clearance for a given installation shall be as specified in the National Grid construction standards.
- 1.13 For Tables 2 through 7 which follow, the maximum length of vent pipe and number of fittings allowed in each case **shall not be exceeded under any circumstances.**

**RECOMMENDED VENT LINE SIZING CHARTS**

If length exceed the lengths on the chart, contact National Grid's technical lead.

**TABLE 2**

For regulators with 3/4" screwed end connections and 3/4" regulator vent opening, that reduce pressure in mains operating at pressures between 99 psi and 124 psi.

<b>3/4" Regulator Vent Pipe</b>			
Max. Length	12'	10'	8'
Number of 90° Elbows *	1	2	3

\* Each elbow equivalent length = 2.0'

**TABLE 3**

For regulators with 3/4" x 3/4" or 3/4" x 1" screwed end connections and 3/4" or 1" regulator vent opening, that reduce pressure in mains operating at pressures between 99 psi and 124 psi.

<b>1 1/4" Regulator Vent Pipe</b>			
Max. Length	20'	17'	13'
Number of 90° Elbows *	1	2	3

\* Each elbow equivalent length = 3.5'

**GAS SERVICE REGULATOR VENT SIZING CHARTS****TABLE 4**

For regulators with 3/4" x 3/4" or 3/4" x 1" screwed end connections and 3/4" or 1" regulator vent opening, that reduce pressure in mains operating at pressures between 99 psi and 124 psi.

<b>1" Regulator Vent Pipe</b>			
Max. Length	15'	12'	10'
Number of 90° Elbows *	1	2	3

\* Each elbow equivalent length = 2.6'

**TABLE 5**

For regulators with 3/4" screwed end connections and 3/4" regulator vent opening, that reduce pressure in mains operating at pressures of 60 psi or less.

<b>3/4" Regulator Vent Pipe</b>			
Max. Length	29'	27'	25'
Number of 90° Elbows *	1	2	3

\* Each elbow equivalent length = 2.0'



**GAS SERVICE REGULATOR VENT SIZING CHARTS****TABLE 6**

For regulators with 1 1/4" body size and 3/4" regulator vent opening, that reduce pressure in mains operating at pressures of 60 psi or less.

<b>1 1/4" Regulator Vent Pipe</b>	<b>2" Regulator Vent Pipe</b>
Maximum Length = 43'	Maximum Length = 60'
Number of Elbows* = 3	Number of Elbows* = 3

\* Each elbow equivalent length = 3.5'

***NOTE***

***1-1/4" Regulators with 1-1/4" bodies and 3/4" vent openings shall have 1-1/4" size vent lines as a minimum***

**TABLE 7**

For regulators with 2" body size 1" regulator vent opening that reduce pressure in mains operating at pressures between 60 psi and 124psi.

<b>2" Regulator Vent Pipe</b>
Maximum Length = 23'
Number of Elbows = 1

\* Each elbow equivalent length = 5.2'

# APPENDIX B

## APPENDIX B

### CHOOSING A FURNACE OR BOILER

#### Higher Efficiency. Its Advantages and Disadvantages

Since the energy crisis of the 1970's consumers have been motivated to demand higher efficiency furnaces and boilers, and to increase the thermal insulation and tightness of their homes. As a result, manufacturers have responded with the higher efficiency heating units which are widely in use today, and builders have responded with the increase in tighter construction methods for homes now equally widely used. As a result of these new trends, a significant amount of attention has been focused on certain technical topics in the heating business which have traditionally been accepted as cut and dried, but recently have caused some controversy. It was discovered, to the dismay of many, that these long-accepted ways of installing heating appliances are no longer valid. The changes faced by today's furnace and boiler installers include increased efficiency, reduced dilution air, increased air contamination and decreased heating loads. It has been common to discover that new installations are deficient because of improper combustion, dilution and ventilation air, and even improperly selected boiler or furnace sizes. Therefore, the following information is provided to help ensure that new installations and conversions are properly designed and installed. The correct place to begin is for to selecting a furnace or boiler for your installation.

#### Increased Thermal Efficiency Proper Venting

Increased thermal efficiency of newer units means, among other things, that for a given retrofit installation in a building that has not been modified using insulation and/or caulking, a smaller capacity unit will often do the same job as the older unit did. But it is possible that the older unit may not have been sized correctly! Indeed, many older units were oversized. Therefore, it can be problematic to simply substitute a new unit of the same input as the older one., Increased efficiency of abeating unit typically means a lower flue gas temperature, since most higher efficiency units wring out more Btu's from the flue gases in their heat exchangers. This lower outlet temperature means that the flue gases start their trip out the vent much closer to their dewpoint. Thus, condensate will be produced in the vent earlier in the on-cycle, and more condensate per total unit volume of flue gases will be produced in the new units than in the older, less efficient units. This means that the "wet time" in the vent will be longer, during which time the condensate stays in the stack without being vaporized by flue gases.

Since many Category I, mid-efficiency units are fan-assisted, the draft hood is eliminated, thereby essentially eliminating dilution air to the vent, reducing the total vent flow. Combining this characteristic with the use of vent dampers, off cycle loss of gases through the vent is reduced drastically. As a result, no dilution air can be relied on during the off cycle to help dry the stack. In addition, these characteristics combine to leave a vent pipe even colder during the off-cycle than in older less efficient units, requiring a longer time to heat up during the on-cycle.

In summary, comparing a newer, more efficient unit to an older less efficient unit of the same input, a smaller volume of flue gases will flow in the new unit at a lower temperature through a colder vent, which must be relied upon to remove essentially the same amount of water vapor as was produced in the old unit. The capacity of these gases to vaporize the moisture is significantly less in the new unit as compared to the old. The result is longer wet time in the new unit's vent, a condition which promotes corrosion very quickly, especially if chlorine from indoor air condition is absorbed into the condensate, producing hydrochloric acid. A corroded vent can release deadly carbon monoxide into the living space. An equally deadly scenario is the deterioration that takes place in a masonry chimney, where the mortar disintegrates, the lining collapses, and the chimney becomes blocked, also spilling flue gases into the living space.

**Special care must be taken when replacing older heating equipment that will be vented into an existing exterior masonry chimney. Please follow the Venting tables listed in NFPA-54 or the FGCNYS.**

#### Tighter Buildings: Combustion Air

If the building has been upgraded with new insulation, thermal-pane and tightly sealed windows, along with caulking and wrapping, the thermal characteristics of the building have been altered to make it more thermally efficient. The increased thermal efficiency of a building means the heating load is lower. The tightness of the building means the infiltration losses have been decreased, but the combustion air requirements, which formerly depended on a certain amount of infiltration, must be closely re-examined. If infiltration, and therefore some of the source of combustion air, has been drastically reduced, the reduction can increase spillage of combustion products upon start-up of a draft hood appliance. Secondly, the lowered rate of air change means that any source of combustion air contamination, such as chlorides from hairsprays, etc. will remain at an elevated concentration rather than be diluted. Contaminants containing chlorine have been shown to greatly increase the corrosivity of flue gas condensate, forming hydrochloric acid.

All of these characteristics taken together require that a vent be sized as carefully as possible, with special attention not to over-size the vent. In the past, gas furnaces and boilers released more than 25 % of their input energy into their vents. This generous amount of heat flowing through the vent made vents much more forgiving of design errors. Now, proper venting of higher efficiency furnaces and boilers requires more knowledge and greater care on the part of the installer.

### A Case of Improper Venting

Clearly, a great deal of attention must be paid to venting of modern boilers/furnaces. Take as an example, a typical situation where a person installs a new boiler to replace an aging, less efficient one. In assessing the situation, it is determined that a newer, Category I, mid efficiency, fan assisted unit is a sound, economical choice. It seems logical that a unit of the same input rating should be selected. A contractor is hired, and installs most things properly, but vents the unit to the same outside chimney used for the older unit. After a period of time, the consumer calls National Grid to trouble-shoot a "leak" in his newly installed boiler. He is dismayed to discover that there is no real leak, but that his chimney is condensing. He decides that this is not a real problem, and that there is no need for further action. Soon his chimney tiles begin to collapse inside, and begin to block the vent gases to the point where the unit shuts down on high pressure. Now he has a very large repair bill on his hands to rectify his collapsed chimney. All of this could have been prevented by selecting the correct venting arrangement. In this case, an approved, listed chimney liner system, properly sized and installed, would have saved a large sum of money and many headaches.

### Pre-Sale Inspection

The heating contractor seeking to sell a furnace should begin approaching a job by first carefully assessing the heating load of the structure, the suitability of the existing system vent, and the environment into which the unit will be placed. It is also important that sales and installation personnel understand the venting characteristics of the different types of appliances available on the market, as well as the differences in combustion, dilution and ventilation air requirements of the newer, higher efficiency units. Computer heat loss programs exist in the market today that make this tedious task less demanding.

### **Special care must be taken when replacing older heating equipment that will be vented into an existing exterior masonry chimney**

Retrofit furnaces or boilers should not be recommended to the consumer on the basis of rules-of-thumb regarding the heat load, nor should it be assumed that the existing venting system can be used without modification. It is imperative that the selection and sales process include a pre-sale inspection of the existing furnace or boiler, the venting system, and the building. It is important to recognize that every furnace or boiler is not equally well suited to every installation. The inspection will help the seller to accurately determine which furnace or boiler can be recommended to the consumer, and will avoid problems for all parties involved.

### CO ALARMS

In New York City, Local Law 7, requires the installation of CO (carbon monoxide) Alarms in all new and existing 1 and 2 family houses, apartment buildings, hotels dormitories, nursing homes and schools, where fossil fuel burning furnaces or boilers are installed.

In New York State, Part 1225.2 of Title 19, requires the installation of CO Alarms in newly constructed dwelling units and in dwellings units offered for sale.

The heating contractor should be familiar with the NYC and NYS CO Alarm Law and should determine if a working CO Alarm is installed at the location and should discuss the CO Alarm Laws with the customer.

For full text of the NYC and NYS CO Alarm Law, see appendix G

Please note: National Grid recommends the installation of CO Alarms in all areas and recommends annual maintenance of the heating system.

# APPENDIX C

**APPENDIX C**  
**NATIONAL GRID**  
**NEW METER SET HOTLINE**

NATIONAL GRID  
Long Island/Rockaway Peninsula  
1-877-597-0426\*  
175 E. Old Country Road  
Hicksville, N.Y. 11801

\* For non project managed jobs. For projected managed jobs the responsible project manager should be contacted.

New York City Call Center  
Metrotech  
Brooklyn  
1-718-643-4050\*





The power of action.<sup>SM</sup>



## ***Ensuring a Successful Gas Meter Set***

- ✓ Gas Meter Header has been kept plumb and square
- ✓ Final grade has a minimum clearance of 6" to the bottom of the meter
- ✓ Gas regulator vent maintains 18" minimum height from grade
- ✓ Gas regulator vent meets 18" clearance requirements from windows, doors, other openings into the building
- ✓ Gas regulator vent maintains a minimum of 10' from any mechanical air intakes
- ✓ Gas regulator vent terminus maintains 3' from any source of ignition
- ✓ Gas regulator vent and meter header maintains a minimum of 12" horizontally from any electric meter pans or electric meters
- ✓ Electric meters meet clearance requirements and are not installed directly above the gas regulator or meter header
- ✓ Electric meter has been installed and the dwelling is powered up
- ✓ Customer owned piping has been sleeved or properly cold wrapped for protection if going through a masonry wall
- ✓ Multiple meter header has been properly secured to the wall
- ✓ Multiple meter headers have had ID tags installed identifying the units locations
- ✓ Protection posts shall be installed to code if required to prevent vehicular damage
- ✓ Make up air requirements meet combustion needs
- ✓ If underground customer owned piping is used the *Customer Owned Piping Certificate* has been filled out with sketch completed and left on the jobsite in "Long Island / NYC"
- ✓ City, State, Town, Village or National Grid pressure test affidavit has been left on site
- ✓ In NYC "BIS" number has been established with NYC building department
- ✓ All customer owned piping is installed to National Grids Blue Book requirements and meets City, State, Local, IFGC and / or NFPA Fuel Codes  
*Check with the authority having jurisdiction to verify which code they are following*
- ✓ National Grid has access to the dwelling to install meter and fire one piece of equipment to obtain Lock Up and Running Pressures

# APPENDIX D

## **APPENDIX D**

# **CUSTOMER OWNED GAS PIPING SYSTEM PRESSURE TESTING REQUIREMENTS AND INSTRUCTIONS**

### **1.0 PURPOSE**

- 1.1 This Appendix provides information and instructions for the contractor regarding National Grid requirements for pressure testing a customer owned gas piping system.

### **2.0 SCOPE**

- 2.1 This document provides information concerning the following:
1. When a pressure test is required to be witnessed by National Grid;
  2. The test pressure and test duration (time interval) shall be used for the test;
  3. What equipment and/or instrumentation is required for the test;
  4. How to conduct the test; and
  5. How to report the test results.

### **3.0 DEFINITIONS**

- 3.1 ***Meter Dial Test:*** A test in which a piping system is proven to be free of leaks that can only be administered after the meter has been installed. The test is conducted by checking movement of that dial on the gas meter that registers the smallest amount of gas. The slightest movement of that dial shall be construed to mean that a leak is present in the system. (reference National Grid Procedure CMS04003)
- 3.2 ***Leak Test:*** A test in which a piping system is proven to be free of leaks by **pressurizing the system with natural gas** to its operating pressure and applying a leak-test solution, such as a solution of soap suds, to all the joints in the system.
- 3.3 **Manomter Test:** A test in which a piping system is proven to be free by observing lock up pressure on a manometer at utilization pressure.
- 3.4 ***Pressure Test:*** A test in which a piping system is proven to be free of leaks and capable of operating safely by:

- a. Isolating the system from its normal connections. This shall be accomplished by disconnecting the system from its gas source and capping or plugging the disconnected ends.
- b. Raising the internal pressure of the gas piping system (usually a multiple of its normal operating pressure) for a specified period of time (time duration or time interval) using air or an inert gas.
- c. Monitoring its pressure over the specified period of time to assure that the pressure does not decrease over that time.

3.4 **Minor Alterations; Minor Installation:** An installation in which additional piping is added to an existing piping system already connected to a gas meter. Examples are:

- a. Relocation of a gas meter;
- b. Addition or replacement of a gas appliance.

#### 4.0 **GENERAL**

- 4.1 The owner, contractor shall first determine if a local jurisdictional pressure test is required.

It is the **contractor's responsibility** to determine whether or not the need exists in the geographical area of the installation for a gas piping system pressure test and what the specific test requirements are for a given authority having jurisdiction.

- 4.2 For Long Island installations, the licensed plumber is required to self certify the installation's integrity by completing the form in Appendix E (This self certification form only applies to Towns without plumbing inspectors). This completed form, along with diagram of any buried piping, will be required at the site, prior to the installation of the gas meter by National Grid personnel. It is the Contractor responsibility to install customer owned piping to all National Grid's requirements and to Federal, State and local Codes. Failure to comply with these Codes, may delay the gassing in on the installation. For commercial installations with Class 800 meters and larger, National Grid may witness the pressure test in those town without plumbing inspectors.

#### 5.0 **GAS DISTRIBUTION PIPING (AFTER THE GAS METER)**

Piping after the meter that enters a building is considered a service and shall be tested at 1.5 times the MAOP but not less than 90 psig for 30 minutes. For pressure testing requirements after the meter to an outdoor appliance shall follows as below:

- 5.1 All installations and testing of gas piping shall conform to the applicable code e.g., NYC Administrative Code, NFPA-54, FGCNY, NYCFG Section 406.4, State Codes, Local Codes). **Note: All Customer Owned piping in NYC shall be steel.**

## FOR LONG ISLAND AND NEW YORK

- 5.2 For piping with a maximum operating pressure of 125 psig or greater, contact National Grid's Engineering Area for welding and pressure test requirements.
- 5.3 Testing material and all anchoring and support of pipe shall satisfy applicable minimum National Grid requirements. Plastic pipe, tubing and fittings shall not be used. For information, consult the appropriate National Grid Customer Connections Area.
- 5.4 For Buried Plastic or Above Ground Concealed Piping:
- A. All buried plastic, galvanized steel or concealed piping that is above ground, must be installed and tested per National Grid requirements. All completed work must include inspection criteria (ie. caution tape, anodes) prior to backfilling or closing in of the piping. **All buried pipe must be inspected by National Grid prior to backfilling.**
  - B. All steel and plastic pipe (on commercial and industrial installations) regardless of being buried or above ground, that is painted, coated or wrapped shall be pressure tested at a minimum of 90 psig for the following times:
    - Less than 2" diameter; - 1 hour
    - 2" – 12" diameter - 4 hours

**(Note: Only painted or galvanized pipe is permitted above grade)**
  - C. Screwed fittings shall not be used in concrete.
- All piping installed in the ground shall comply with applicable sections of National Grid specifications for underground pipe.

## 5.5 Pressure Test Requirements Summary

**PRESSURE TEST REQUIREMENTS**

<b>OPERATING PRESSURE</b>	<b>TEST PRESSURE AND DURATION</b>	
	<b>NEW YORK steel pipe only</b> <b>Per N.Y.C. Building Code</b> <b>sect. 403.1 and 406.4</b>	<b>LONG ISLAND</b> <b>See note 1</b>
LP to 14" W.C.	3 PSIG / 30 MINUTES	3 PSIG / 30 MINUTES
> 14" W.C. - 5 PSIG	50 PSIG / 30 MINUTES	50 PSIG / 30 MINUTES
> 3 PSIG – 15 PSIG	100 PSIG / 1 HOUR	100 PSIG / 1 HOUR
>15 PSIG – 125 PSIG	2X MAOP, BUT NOT LESS THAN 100 PSIG / 1 HOUR	2X MAOP, BUT NOT LESS THAN 100 PSIG / 1 HOUR

Note 1: On Long Island, the test duration in the above chart is for 500 cubic feet of pipe being tested. For volumes > 500 cubic feet, add an additional ½ hour to the pressure test for every additional 500 cubic feet of pipe being tested. The duration of the test shall not be required to exceed 24 hours (NFPA-54)

<b>OPERATING PRESSURE</b>	<b>TEST PRESSURE AND DURATION</b>	
	<b>NEW YORK</b>	<b>LONG ISLAND</b>
COMMERCIAL/INDUSTTRIAL PLASTIC PIPE (BELOW GRADE) OR ANY STEEL PIPE THAT IS PAINTED, COATED OR WRAPPED (ABOVE GROUND OR BELOW GROUND)		
LP – 60 PSIG	90 PSIG  LESS THAN 2" DIA. – 1 HOUR  2"-12" DIAMETER – 4 HOURS	90 PSIG  LESS THAN 2" DIA. – 1 HOUR  2"-12" DIAMETER – 4 HOURS
EXCEPT WHERE USED AS A SERVICE - BURIED PLASTIC PIPING IN RESIDENTIAL APPLICATIONS	3 PSIG / 30 MINUTES	3 PSIG / 30 MINUTES

## 6.0 **INSTRUCTIONS**

- 6.1 The gas meter, relief valve, service regulator and appliance gas train components and manual shut-off valves shall be physically disconnected or blind flanged/pancake from the gas supply system for the pressure test of the customer-owned gas piping system.

When a local town/municipality requires the test, the form for recording the test results will vary depending on the local government. If contractors require a copy, the contractor shall make arrangements through the local governmental jurisdictional office. If copies of pressure test certificates are desired, the necessary arrangements to obtain copies shall be made by the contractor. National Grid requires the **original** certificate before the activation of gas or Approved **NYC Gas Authorization Number**.

# APPENDIX E



July 2025

**RE: Customer Owner Gas Piping Inspection Certificate**

Attached is the new **Customer Owner Gas Piping Inspection Certificate** form which is to be used in the Long Island territories whenever buried gas piping is installed downstream of the gas meter. This form cannot be substituted in lieu of the inspection certificate issued by the jurisdictional town inspector. However, in those jurisdictions where third party town inspections are not being performed, the licensed plumber is required to self certify the installation integrity by completing this form. This form will be required at the site prior to the installation of the gas meter by National Grid personnel.

Additional copies of this form can be obtained on-line.

If there are any questions pertaining to the information requested on the form, please do not hesitate to contact your National Grid representative.



This document **MUST** be completed and signed by the Installer prior to your natural gas service being turned on by National Grid. We appreciate your cooperation.

## CUSTOMER OWNED GAS PIPING INSPECTION CERTIFICATE

The undersigned installation contractor hereby represents and warrants that all gas piping and related appliances, appurtenances and equipment installed at the premises described herein have been installed in accordance with all applicable codes, regulations and standards in effect as of the date of this Certificate including, but not limited to, the **Fuel Gas Code of New York State**, the **National Fuel Gas Code**, the **National Grid Blue Book** and the original equipment manufacturer's specifications, guidelines and installation instructions.

The undersigned installation contractor further represents and warrants that all gas piping installed at the premises described herein has been subjected to and passed the pressure test requirements as outlined in the **Fuel Gas Code of New York State** and **National Grid Specifications and Requirements for Gas Installations** as written in the Blue Book. The installation contractor **MUST** include a historical sketch of the underground piping location as required per the Blue Book, Section 8.4 with this Certificate.

The undersigned installation contractor acknowledges that National Grid is relying upon the installation contractor's representation and warranties, as well as the accuracy of the information contained in this Certificate, as a condition to turning on the natural gas services at the premises described herein.

Customer Name _____ (Please print)	Service _____
Location _____ (Street - City)	
Daytime Phone _____	Evening Phone _____ Cell Phone _____

Contractor Name _____ (Please print)	_____ (Authorized Signature)
Business Location _____ (Street - City)	
Daytime Phone _____	Cell Phone _____ License # _____ County: <input type="checkbox"/> Suffolk <input type="checkbox"/> Nassau

The installation contractor **MUST** check and complete the following information for all underground gas piping that has been installed at the subject premises in accordance with this Certificate. Please include the name of the pipe manufacturer, lot number of the pipe installed and the size of the pipe installed.

Installed Pipe Size _____	Pipe Installed at Minimum Depth of 18"? <input type="checkbox"/> Yes <input type="checkbox"/> No
<b>Plastic:</b> Pipe Manufacturer _____	Lot Number _____ SDR _____
Mechanical Fittings Used? <input type="checkbox"/> Yes <input type="checkbox"/> No	Plastic Fusions? <input type="checkbox"/> Yes <input type="checkbox"/> No # Made _____
Tracer Wire Installed? <input type="checkbox"/> Yes <input type="checkbox"/> No	Metallic Caution Tape? <input type="checkbox"/> Yes <input type="checkbox"/> No
Non-Metallic Caution Tape? <input type="checkbox"/> Yes <input type="checkbox"/> No	


Pressure Test @ _____ p.s.i.	Duration Time _____ (Hrs/Min)	Historical Sketch Provided? <input type="checkbox"/> Yes <input type="checkbox"/> No
(Refer to Blue Book Appendix D, Section 5.0)		
Local Municipality/Town Pressure Test Certificate Provided? <input type="checkbox"/> Yes <input type="checkbox"/> No	Plumbing Permit # _____	

<b>Coated Steel:</b> Anode(s) - Number/Weight _____	Cadweld <input type="checkbox"/> Yes <input type="checkbox"/> No
---	--

### Equipment / Appliances Installed:

Generator <input type="checkbox"/> Yes <input type="checkbox"/> No	Pool Heater <input type="checkbox"/> Yes <input type="checkbox"/> No	House Heat <input type="checkbox"/> Yes <input type="checkbox"/> No
Barbecues <input type="checkbox"/> Yes <input type="checkbox"/> No	Water Heater <input type="checkbox"/> Yes <input type="checkbox"/> No	Meter Header <input type="checkbox"/> Yes <input type="checkbox"/> No
Other (Specify) _____		

NATIONAL GRID USE ONLY	
Technician/Responder _____ (Employee Name/Number)	Meter Number _____
Turned On _____ (Date)	Grid # _____ <input type="checkbox"/> Residential <input type="checkbox"/> Non-Residential



**SHOW NORTH  
ARROW**

**ADDRESS**

---

---

---


**CPR #** \_\_\_\_\_

**STREET NAME** \_\_\_\_\_

**INSTRUCTIONS:**

1. SHOW METER IN RELATION TO BUILDING. **M**
2. SHOW UNDERGROUND PIPING AND INDICATED DIMENSIONS AND PIPING ROUTE.
3. SHOW LOCATION AND TYPE OF REMOTE APPLIANCE (GENERATOR, POOL, HEATER, ETC.)
4. INDICATE NORTH ARROW.
5. INDICATE STREET & ADDRESS.

**EXAMPLE**

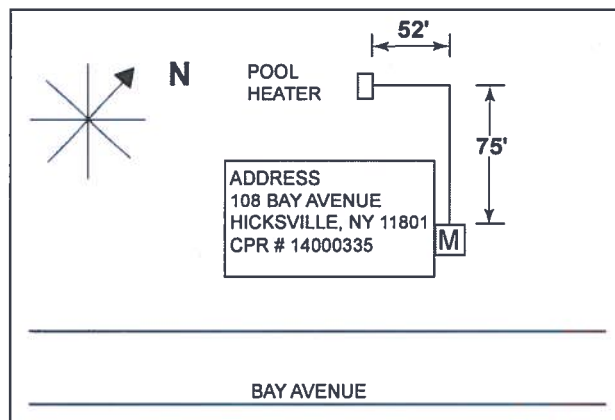

# APPENDIX F

## **Corrugated Stainless Steel Tubing (CSST)**

**At its meeting held on September 10, 2008, the State Fire Prevention and Building Code Council determined that adopting this rule on an emergency basis is necessary to preserve public safety by clarifying requirements for electrical bonding of gas piping, clarifying requirements for protection of gas piping against physical damage, and adding new requirements for installation of gas piping made of corrugated stainless steel tubing (CSST), which will increase protection against fires caused by lightning strikes in the vicinity of buildings equipped with CSST gas piping and fires caused by accidental punctures of CSST gas piping.**

**EFFECTIVE September 25, 2008**

**Subdivision (d) of section 1220.1 of title 19 NYCRR is amended by adding new paragraphs (9), (10), (11), and (12) to read as follows:**

**(9) 2007 RCNYS Section G2411.1. For the purposes of applying the 2007 RCNYS in this State, the text of Section G2411.1 in Chapter 24 of the 2007 RCNYS shall be deemed to be amended and restated in its entirety to read as follows:**

**“G2411.1 (310.1) Gas pipe bonding - systems that contain no CSST. In the case of a gas piping system that contains no corrugated stainless steel tubing (CSST), each above-ground portion of the gas piping system that is likely to become energized shall be electrically continuous and bonded to an effective ground-fault current path. Gas piping shall be considered to be likely to become energized if any gas utilization equipment is connected to any portion of the gas piping system and to any electrical circuit(s). For the purposes of this Section G2411.1, gas piping shall be considered to be bonded to an effective ground-fault current path if such gas piping is connected to gas utilization equipment that is connected to the equipment grounding conductor of the circuit supplying that equipment. Nothing in this Section G2411.1 shall prohibit the bonding a gas piping system that contains no CSST in any manner described in Section E3509.7 of this code. (10) 2007 RCNYS Section G2411.2.”**

**(10) For the purposes of applying the 2007 RCNYS in this State, a new Section G2411.2 (to include sections G2411.2, G2411.2.1, G2411.2.2, and G2411.2.3) shall be deemed to be added to Chapter 24 of the 2007 RCNYS, immediately following Section G2411.1, said new Section G2411.2 to read as follows:**

**“G2411.2 (310.2) Gas pipe bonding - systems that contain CSST. A gas piping system that contains any corrugated stainless steel tubing (CSST) shall be electrically continuous and shall be bonded to the electrical service grounding electrode system at the point where the gas service enters the building or structure. No portion of the gas piping system shall be used as or considered to be a grounding**

electrode or a grounding electrode conductor. CSST shall be installed and bonded in accordance with this section G2411.2, and the stricter of: (a) the requirements set forth in the CSST manufacturer's installation instructions, or (b) the requirements set forth in Sections G2411.2.1, G2411.2.2, G2411.2.3, and G2415.5.

**“G2411.2.1 Bonding jumper.** Where the electric service for the individual installation is 200 amperes or less, the bonding jumper shall not be smaller than 6 AWG copper wire or 4 AWG aluminum or copper-clad aluminum wire, and shall be permanently connected to the grounding electrode system. Where the electric service for the individual installation is more than 200 amperes, the bonding jumper size shall be determined in accordance with Table E 3503.1, and shall be permanently connected to the grounding electrode system.

**“G2411.2.2 Bonding clamp.** The bonding jumper shall be connected to the gas piping system with a bonding clamp that is listed for the material of the bonding jumper and for the material of the component of the gas piping system to which the bonding clamp is attached. The bonding clamp shall be attached to the gas piping system at a point which is inside the building or structure in which the gas piping is installed, on the downstream side of the gas meter or regulator, in an unconcealed and readily accessible space, and as close as practicable to the point where the gas service enters the building or structure. The bonding clamp shall be attached to a segment of metallic fuel gas pipe which (a) is a component of the gas piping system, (b) is electrically continuous with all CSST components of the gas piping system, (c) is made of steel or wrought-iron, (d) complies with Section G2414.4.2 of this code and with all other applicable provisions of Section G2414 of this code, and (e) is not less than 3 inches (76 mm) in length. Neither the CSST nor the brass hexagonal nut on the CSST fitting shall be used as an attachment point for the bonding clamp.

**“G2411.2.3 Prohibited uses.** CSST shall not be supported on or by other electrically conductive systems including copper water pipe, electric power cables, air conditioning and heating ducts, communication cables and structural steel beams. Electrical wiring, including the bonding jumper, shall be supported and secured independently of the CSST so that it does not come in contact with the CSST.”

**(11) 2007 RCNYS Section G2415.5.** For the purposes of applying the 2007 RCNYS in this State, the text of Section G2415.5 in Chapter 24 of the 2007 RCNYS shall be deemed to be amended and restated in its entirety, to include sections G2415.5 and G2415.5.1 and to read as follows:

**“G2415.5 (404.5) Protection against physical damage.** In concealed locations, where piping other than black or galvanized steel is installed through holes or notches in wood studs, joists, rafters or similar members less than 1.75 inches (44.45 mm) from the nearest edge of the member, the pipe shall be protected by shield plates. Such

shield plates shall comply with the requirements of Section G2415.5.1, shall cover the area of the pipe where the member is notched or bored, and shall extend a minimum of 4 inches (102 mm) above sole plates, below top plates and to each side of a stud, joist or rafter. The movement of piping made of corrugated stainless steel tubing (CSST) shall not be otherwise constrained by straps, clips or other support devices. In addition, where CSST is installed in a concealed location and parallel to any stud, joist, rafter, or similar member, the CSST shall be protected by shield plates in any area where the CSST is not (a) physically supported in a manner that ensures the CSST will always be at least 1.75 inches (44.45 mm) away from the nearest edge of any member or (b) encased in a protective metal pipe made of schedule 40 steel or iron pipe or in a protective pipe sleeve made of a material approved by the code enforcement official as the equivalent of schedule 40 steel or iron pipe. Such shield plates shall comply with the requirements of Section G2415.5.1, shall cover the area the CSST is located, and shall extend a minimum of 4 inches (102 mm) to each side of the CSST.

**“G2415.5.1. Shield plates. In all cases, shield plates shall be certified or listed as complying with ANSI LC-1. In addition, in the case of piping made of CSST, shield plates shall be listed for use with the manufacturer’s CSST system.”**

**(12) 2007 RCNYS Section E3509.7. For the purposes of applying the 2007 RCNYS in this State, the text of Section E3509.7 in Chapter 35 of the 2007 RCNYS shall be deemed to be amended and restated in its entirety to read as follows:**

**“E3509.7 Bonding other metal piping. Where installed in or attached to a building or structure, metal piping systems likely to become energized shall be bonded to the service equipment enclosure, the grounded conductor at the service, the grounding electrode conductor where of sufficient size, or to the one or more grounding electrodes used. A piping system shall be considered to be likely to become energized if any equipment or appliance is connected to any portion of the piping system and to any electrical circuit(s). The bonding jumper shall be sized in accordance with Table E3808.12 using the rating of the circuit capable of energizing the piping. The equipment grounding conductor for the circuit that is capable of energizing the piping shall be permitted to serve as the bonding means. The points of attachment of the bonding jumper(s) shall be accessible.**

**“EXCEPTIONS:**

**“1. Interior metal water piping systems shall be bonded in accordance with Section E3509.6 of this code.**

**“2. Gas piping systems that contain no corrugated stainless steel tubing (CSST) shall be bonded in accordance with Section G2411.1 of this code.**

**“3. Gas piping systems that contain CSST shall be installed and bonded in accordance with Section G2411.2 of this code.”**

Subdivision (b) of section 1224.1 of title 19 NYCRR is amended to read as follows:

**(b) Referenced standards.** Certain published standards are denoted in the 2007 FGCNYS as incorporated by reference into 19 NYCRR Part 1222. Such standards are incorporated by reference into this Part 1224. Such standards are identified in the 2007 FGCNYS, and the names and addresses of the publishers of such standards from which copies of such standards may be obtained are specified in the 2007 FGCNYS. Such standards are available for public inspection and copying at the office of the New York State Department of State specified in subdivision (a) of this section. In addition, the 2005 edition of standard NFPA 70, entitled “National Electrical Code” (said standard being hereinafter referred to as NFPA 70-2005) shall be deemed to be one of the standards incorporated by reference into this Part 1224. The name and address of the publisher of NFPA 70-2005 from which copies of said standard may be obtained are:  
National Fire Protection Association  
Batterymarch Park  
Quincy, MA 02269.  
NFPA 70-2005 is available for public inspection and copying at the office of the New York State Department of State specified in subdivision (a) of this section.

Subdivision (c) of 1224.1 of Title 19 NYCRR is amended by adding new paragraphs (2), (3), and (4), to read as follows:

**(2) 2007 FGCNYS Section 310.1.** For the purposes of applying the 2007 FGCNYS in this State, Section 310.1 in Chapter 3 of the 2007 FGCNYS shall be deemed to be amended and restated in its entirety to read as follows:

**“310.1 Gas pipe bonding - systems that contain no CSST. In the case of a gas piping system that contains no corrugated stainless steel tubing (CSST), each above-ground portion of the gas piping system that is likely to become energized shall be electrically continuous and bonded to an effective ground-fault current path. Gas piping shall be considered to be likely to become energized if any gas utilization equipment is connected to any portion of the gas piping system and to any electrical circuit(s). For the purposes of this Section 310.1, gas piping shall be considered to be bonded to an effective ground-fault current path if such gas piping is connected to gas utilization equipment that is connected to the equipment grounding conductor of the circuit supplying that equipment. Nothing in this Section 310.1 shall prohibit the bonding a gas piping system that contains no CSST in any manner described in Section 250.104(B) of NFPA 70-2005.”**

**(3) 2007 FGCNYS Section 310.2.** For the purposes of applying the 2007 FGCNYS in this State, a new Section 310.2 (to include sections 310.2, 310.2.1, 310.2.2, and 310.2.3) shall be deemed to be added to Chapter 3 of the 2007 FGCNYS, immediately following Section 310.1, said new Section 310.2 to read as follows:



**“310.2 Gas pipe bonding - systems that contain CSST. A gas piping system that contains any corrugated stainless steel tubing (CSST) shall be electrically continuous and shall be bonded to the electrical service grounding electrode system at the point where the gas service enters the building or structure. No portion of the gas piping system shall be used as or considered to be a grounding electrode or a grounding electrode conductor. CSST shall be installed and bonded in accordance with this section 310.2, and the stricter of: (a) the requirements set forth in the CSST manufacturer’s installation instructions, or (b) the requirements set forth in Sections 310.2.1, 310.2.2, 310.2.3, and 404.5 of this code.**

**“310.2.1 Bonding jumper. Where the electric service for the individual installation is 200 amperes or less, the bonding jumper shall not be smaller than 6 AWG copper wire or 4 AWG aluminum or copper-clad aluminum wire, and shall be permanently connected to the grounding electrode system. Where the electric service for the individual installation is more than 200 amperes, the bonding jumper size shall be determined in accordance with Table 250.66 and Sections 250.66(A) through 250.66(C) of NFPA 70-2005, and shall be permanently connected to the grounding electrode system.**

**“310.2.2 Bonding clamp. The bonding jumper shall be connected to the gas piping system with a bonding clamp that is listed for the material of the bonding jumper and for the material of the component of the gas piping system to which the bonding clamp is attached. The bonding clamp shall be attached to the gas piping system at a point which is inside the building or structure in which the gas piping is installed, on the downstream side of the gas meter or regulator, in an unconcealed and readily accessible space, and as close as practicable to the point where the gas service enters the building or structure. The bonding clamp shall be attached to a segment of metallic fuel gas pipe which (a) is a component of the gas piping system, (b) is electrically continuous with all CSST components of the gas piping system, (c) is made of steel, wrought-iron, copper (if permitted by Section 403.4.3 of this code), or brass (if permitted by Section 403.4.3 of this code), or aluminum, (d) complies with the applicable provisions of Section 403.4 of this code and with all other applicable provisions of Section 403 of this code, and (e) is not less than 3 inches (76 mm) in length. Neither the CSST nor the brass hexagonal nut on the CSST fitting shall be used as an attachment point for the bonding clamp.**

**“310.2.3 Prohibited uses. CSST shall not be supported on or by other electrically conductive systems including copper water pipe, electric power cables, air conditioning and heating ducts, communication cables and structural steel beams. Electrical wiring, including the bonding conductor, shall be supported and secured independently of the CSST so that it does not come in contact with the CSST.”**

**(4) 2007 FGCNYS Section 404.5. For the purposes of applying the 2007 FGCNYS in this State, Section 404.5 in Chapter 4 of the 2007 FGCNYS shall be deemed to be amended and restated in its entirety, to include sections 404.5 and 404.5.1 and to read as follows:**

**“404.5 Protection against physical damage. In concealed locations, where piping other than black or galvanized steel is installed through holes or notches in wood studs, joists, rafters or similar members less than 1.75 inches (44.45 mm) from the nearest edge of the member, the pipe shall be protected by shield plates. Such shield plates shall comply with the requirements of Section 405.5.1, shall cover the area of the pipe where the member is notched or bored, and shall extend a minimum of 4 inches (102 mm) above sole plates, below top plates and to each side of a stud, joist or rafter. The movement of piping made of corrugated stainless steel tubing (CSST) shall not be otherwise constrained by straps, clips or other support devices. In addition, where CSST is installed in a concealed location and parallel to any stud, joist, rafter, or similar member, the CSST shall be protected by shield plates in any area where the CSST is not (a) physically supported in a manner that ensures the CSST will always be at least 1.75 inches (44.45 mm) away from the nearest edge of any member or (b) encased in a protective metal pipe made of schedule 40 steel or iron pipe or in a protective pipe sleeve made of a material approved by the code enforcement official as the equivalent of schedule 40 steel or iron pipe. Such shield plates shall comply with the requirements of Section 405.5.1, shall cover the area the CSST is located, and shall extend a minimum of 4 inches (102 mm) to each side of the CSST.**

**“405.5.1. Shield plates. In all cases, shield plates shall be certified or listed as complying with ANSI LC-1. In addition, in the case of piping made of CSST, shield plates shall be listed for use with the manufacturer’s CSST system.”**

---

**EFFECTIVE September 25, 2008**



This document **MUST** be completed and signed by the Installer prior to your natural gas service being turned on by National Grid. We appreciate your cooperation.

### ***CUSTOMER OWNED GAS PIPING INSPECTION CERTIFICATE***

The undersigned installation contractor hereby represents and warrants that all gas piping and related appliances, appurtenances and equipment installed at the premises described herein have been installed in accordance with all applicable codes, regulations and standards in effect as of the date of this Certificate including, but not limited to, the **Fuel Gas Code of New York State**, the **National Fuel Gas Code**, the **National Grid Blue Book** and the original equipment manufacturer's specifications, guidelines and installation instructions.

The undersigned installation contractor further represents and warrants that all gas piping installed at the premises described herein has been subjected to and passed the pressure test requirements as outlined in the **Fuel Gas Code of New York State** and **National Grid Specifications and Requirements for Gas Installations** as written in the Blue Book. The installation contractor MUST include a historical sketch of the underground piping location as required per the Blue Book, Section 8.4 with this Certificate

The undersigned installation contractor acknowledge that **National Grid's** relying upon the installation contractor's representation and warranties, as well as the accuracy of the information contained in this Certificate, as a condition to turning on the natural gas services at the premises described herein.

Customer Name \_\_\_\_\_  
(Please Print)

Service Location \_\_\_\_\_  
(Street - City)

Daytime Phone \_\_\_\_\_ Evening Phone \_\_\_\_\_ Cell Phone \_\_\_\_\_

Contractor Name \_\_\_\_\_  
(Please Print) (Authorized Signature)

Business Location \_\_\_\_\_  
(Street - City)

Daytime Phone \_\_\_\_\_ Cell Phone \_\_\_\_\_ License # \_\_\_\_\_

Pressure Test @ \_\_\_\_\_ P.S.I. Duration Time \_\_\_\_\_ (Hrs/Min) Historical Sketch Provided? Y \_\_\_\_\_ N \_\_\_\_\_

**(Refer to Blue Book for Test Pressures Required and Time Durations)**

Local Municipality/Town Pressure Test Certificate Provided? Y \_\_\_\_\_ N \_\_\_\_\_ Plumbing Permit # \_\_\_\_\_

Piping being tested? Header Y \_\_\_\_\_ N \_\_\_\_\_ Houeline Y \_\_\_\_\_ N \_\_\_\_\_ CSST Piping Bonded and Grounded Y \_\_\_\_\_ N \_\_\_\_\_

#### ***Equipment / Appliances Installed -***

Generator Y _____ N _____	Pool Heater Y _____ N _____	House Heat Y _____ N _____
Barbeques Y _____ N _____	Water Heater Y _____ N _____	Meter Header Y _____ N _____
Commercial Appliances Y _____ N _____	How Many? _____	Other (Specify) _____

Installing contractors, **MUST** check and complete the following information for all **Customer Owned Underground Gas Piping** that has been installed at the subject premises in accordance with this Certificate. Please include the name of the pipe manufacturer, lot number of the pipe installed and the size of the pipe installed.

Installed Pipe Size \_\_\_\_\_ Pipe Installed @ Minimum Depth of 18"? Y \_\_\_\_\_ N \_\_\_\_\_

<b>Plastic</b> - Pipe Manufacturer _____	Lot Number _____	SDR _____
Mechanical Fittings Used? Y _____ N _____	Plastic Fussions? Y _____ N _____	# Made _____
Tracer Wire Installed? Y _____ N _____	Metallic Caution Tape? Y _____ N _____	
Non-Metallic Caution Tape? Y _____ N _____		

**Coated Steel** - Anode(s) - Number/Weight \_\_\_\_\_ Cadweld Y \_\_\_\_\_ N \_\_\_\_\_

#### **National Grid Use Only**

Technician/ Responder \_\_\_\_\_ Meter Number \_\_\_\_\_  
(Employee Name / Number)

Turned On \_\_\_\_\_ Grid # \_\_\_\_\_ Residential \_\_\_\_\_ Non-Residential \_\_\_\_\_  
(Date)

# APPENDIX G

## *APPENDIX G*

### *New York State CO Alarm Law*

#### **Amanda's Law**

#### **Carbon monoxide alarm requirements to go into effect February 22, 2010**

As the result of legislation, Amanda's Law will go into effect February 22, 2010. It requires essentially all residences, both new and existing, to have carbon monoxide alarms installed. The specific requirements differ for new and existing residences and also on when the buildings were built and subcategories of occupancy groups. Existing one and two family residences will be required to have one carbon monoxide alarm installed on the lowest story having a sleeping area.

*Subdivision (d) of section 1220.1 in Part 1220 of Title 19 NYCRR is amended by adding a new paragraph (13) to read as follows:*

*(13) 2007 RCNYS section RR313.4. For the purposes of applying the 2007 RCNYS in this State, the text of section RR313.4 in chapter R3 of the 2007 RCNYS shall be deemed to be amended and restated in its entirety to read as follows:*

**“RR313.4 Carbon monoxide alarms.** This section covers the installation, performance and maintenance of carbon monoxide alarms and their components in new and existing buildings. The requirements of this section shall apply to all new and all existing buildings, without regard to the date of construction of the building and without regard to whether such building shall or shall not have been offered for sale.

**“Exception:** Compliance with this section is not required where no carbon monoxide source is located within or attached to the structure. However, compliance with this section is required if any carbon monoxide source is subsequently located within or attached to the structure.

*“For the purposes of this section RR313.4, the following terms will have the following meanings:*

**“The term ‘carbon monoxide source’** includes fuel fired appliances, equipment, devices and systems; solid fuel burning appliances, equipment, devices and systems; all other appliances, equipment, devices and systems that may emit carbon monoxide; fireplaces; garages; and all other motor vehicle-related occupancies.

**“The term ‘dwelling unit’** means a single unit providing complete, independent living facilities for one or more persons, including permanent provisions for living, sleeping, eating, cooking and sanitation.

“The term ‘**sleeping area**’ means a room or space in which people sleep.

“The term ‘**sleeping unit**’ means a room or space in which people sleep, which can also include permanent provisions for living, eating, and either sanitation or kitchen facilities but not both. Such rooms and spaces that are also part of a dwelling unit are not sleeping units.

“In the case of a building constructed on or after January 1, 2008, a carbon monoxide alarm shall be installed in each of the following locations:

“1. Within each dwelling unit or sleeping unit, on each story having a sleeping area.

“2. Within each dwelling unit or sleeping unit, on each story where a carbon monoxide source is located.

“One carbon monoxide alarm installed on a story of a dwelling unit or sleeping unit having both a sleeping area and a carbon monoxide source shall suffice for that story within that dwelling unit or sleeping unit.

“In the case of a building constructed before January 1, 2008, a carbon monoxide alarm shall be installed in each of the following locations:

“1. Within each dwelling unit or sleeping unit, on the lowest story having a sleeping area.

“When more than one carbon monoxide alarm is required to be installed within an individual dwelling unit, the alarms shall be interconnected in such a manner that the actuation of one alarm will activate all of the alarms in the individual unit. The alarm shall be clearly audible in all sleeping areas over background noise levels with all intervening doors close.

“**Exception:** Interconnection is not required where carbon monoxide alarms are permitted to be battery operated in accordance with section RR313.4.2.

“All carbon monoxide alarms shall be listed and labeled as complying with UL 2034 or CAN/CSA 6.19, and shall be installed in accordance with the manufacturer's installation instructions and this code.

“RR313.4.1 **Prohibited locations.** Carbon monoxide alarms shall not be located within or near the openings to garages, bathrooms or furnace rooms. Carbon monoxide alarms shall also not be located in or near locations specified as ‘prohibited,’ ‘not recommended’ or the like in the manufacturer’s installation instructions.

“RR313.4.2 **Power source.** The required carbon monoxide alarms shall receive their primary power from the building wiring when such wiring is served from a commercial source or an on-site electrical power system, and when primary power is interrupted,

shall receive power from a battery. Wiring shall be permanent and without a disconnecting switch other than those required for overcurrent protection.

**“Exception.** Carbon monoxide alarms shall be permitted to be battery operated when installed in buildings without commercial power or an on-site electrical power system or in buildings constructed before January 1, 2008.

**“RR313.4.3 Maintenance.** Carbon monoxide alarms shall be maintained in an operative condition at all times, shall be replaced or repaired where defective, and shall be replaced when they cease to operate as intended.

**“RR313.4.4 Disabling of alarms.** Carbon monoxide alarms shall not be removed or disabled, except for service or repair purposes.

**“RR313.4.5 One-family dwellings converted to bed and breakfast dwellings.** One-family dwellings converted to bed and breakfast dwellings shall have carbon monoxide alarms installed in accordance with the requirements of section F611 of the Fire Code of New York State.

**“RR313.4.6 Buildings under custody, licensure, supervision or jurisdiction of a department or agency of the State of New York.** A building which is under the custody, licensure, supervision or jurisdiction of a department or agency of the State of New York and which is regulated as a one-or two-family dwelling or multiple single-family dwelling (townhouse), in accordance with established laws or regulations of such department or agency, shall have carbon monoxide alarms installed in accordance with the stricter of the requirements of this section or the requirements of section F611 of the Fire Code of New York State.”

*Subdivision (d) of section 1225.1 in Part 1220 of Title 19 NYCRR is amended by adding a new paragraph (3) to read as follows:*

*(3) 2007 FCNYS section F611. For the purposes of applying the 2007 FCNYS in this State, the text of section F611 in chapter F6 of the 2007 FCNYS shall be deemed to be amended and restated in its entirety to read as follows:*

## **“F611 CARBON MONOXIDE ALARMS**

**“F611.1 General.** This section covers the application, installation, performance and maintenance of carbon monoxide alarms and their components in new and existing buildings and structures. The requirements of this section shall apply to all new buildings and structures and to all existing buildings and structures, without regard to the date of construction of the building or structure and without regard to whether such building or structure shall or shall not have been offered for sale.

**“F611.1.1 Definitions.** For the purposes of this §F611, the following terms shall have the following meanings:

**“Carbon monoxide source.** The term ‘carbon monoxide source’ includes fuel fired appliances, equipment, devices and systems; solid fuel burning appliances, equipment, devices and systems; all other appliances, equipment, devices and systems that may emit carbon monoxide; fireplaces; garages; and all other motor vehicle-related occupancies.

**“Dwelling unit.** The term ‘dwelling unit’ means a single unit providing complete, independent living facilities for one or more persons, including permanent provisions for living, sleeping, eating, cooking and sanitation.

**“Existing buildings and structures.** The term ‘existing buildings and structures’ means buildings and structures constructed before January 1, 2008.

**“Multiple dwelling.** The term ‘multiple dwelling’ means a dwelling which is either rented, leased, let or hired out, to be occupied, or is occupied as the temporary or permanent residence or home of three or more families living independently of each other, including but not limited to the following: a tenement, flat house, maisonette apartment, apartment house, apartment hotel, tourist house, bachelor apartment, studio apartment, duplex apartment, kitchenette apartment, hotel, lodging house, rooming house, boarding house, boarding and nursery school, furnished room house, club, sorority house, fraternity house, college and school dormitory, convalescent, old age or nursing homes or residences, and a dwelling, two or more stories in height, and with five or more boarders, roomers or lodgers residing with any one family.

**“New buildings and structures.** The term ‘new buildings and structures’ means buildings and structures constructed after December 31, 2007.

**“The term ‘sleeping area’** means a room or space in which people sleep.

**“The term ‘sleeping unit’** means a room or space in which people sleep, which can also include permanent provisions for living, eating, and either sanitation or kitchen facilities but not both. Such rooms and spaces that are also part of a dwelling unit are not sleeping units.

**“F611.2 Equipment.** Carbon monoxide alarms shall be listed and labeled as complying with UL 2034 or CAN/CSA 6.19, and shall be installed in accordance with the manufacturer's installation instructions and this section.

**“F611.2.1 Combination smoke and carbon monoxide alarms.** Combination smoke and carbon monoxide alarms are permitted, provided the alarm is listed for such use. Combination smoke and carbon monoxide alarms shall have distinctly different alarm signals for smoke or carbon monoxide alarm activation.

**“F611.3 Where required.** Single and multiple station carbon monoxide alarms shall be provided in the locations described in this section.

**“Exception:** Compliance with this section is not required where no carbon monoxide source is located within or attached to the structure. However, compliance with



this section is required if any carbon monoxide source is subsequently located within or attached to the structure.

“F611.3.1 New buildings and structures: one-and two-family dwellings, multiple single-family dwellings (townhouses), and buildings owned as a condominium or cooperative and containing dwelling accommodations. A carbon monoxide alarm shall be installed in each of the following locations:

“1. Within each dwelling unit or sleeping unit, on each story having a sleeping area.

“2. Within each dwelling unit or sleeping unit, on each story where a carbon monoxide source is located.

“One carbon monoxide alarm installed on a story of a dwelling unit or sleeping unit having both a sleeping area and a carbon monoxide source shall suffice for that story within that dwelling unit or sleeping unit.

“F611.3.2 New buildings and structures: Group I-1 occupancies. A carbon monoxide alarm shall be installed in the each of following locations:

“1. On each story having a sleeping area.

“2. On each story where a carbon monoxide source is located.

“One carbon monoxide alarm installed on a story having both a sleeping area and a carbon monoxide source shall suffice for that story.

“F611.3.3 New buildings and structures: Group R occupancies not covered by section F611.3.1 or section F611.3.2, nursery schools (with sleeping units) not covered by section F611.3.1 or §F611.3.2, bed and breakfast uses not covered by section F611.3.1 or section F611.3.2, and multiple dwellings not covered by section F611.3.1 or section F611.3.2. A carbon monoxide alarm shall be installed in each of the following locations:

“1. In each dwelling unit or sleeping unit where a carbon monoxide source is located. In a multiple-story dwelling unit or sleeping unit, a carbon monoxide alarm shall be installed on each story having a sleeping area and on each story where a carbon monoxide source is located. One carbon monoxide alarm installed on a story having both a sleeping area and a carbon monoxide source shall suffice for that story.

“2. In each dwelling unit or sleeping unit that is on the same story as a carbon monoxide source.

“F611.3.4 Existing buildings and structures: one-and two-family dwellings, multiple single-family dwellings (townhouses), and buildings owned as a condominium or cooperative and containing dwelling accommodations. A carbon monoxide alarm shall be installed within each dwelling unit or sleeping unit on the lowest story having a sleeping area.

“F611.3.5 Existing buildings and structures: Group I-1 occupancies. A carbon monoxide alarms shall be installed on each story having a sleeping area.

“F611.3.6 Existing buildings and structures: Group R occupancies not covered by section F611.3.4 or section F611.3.5, nursery schools (with sleeping units) not covered by section F611.3.4 or section F611.3.5, bed and breakfast uses not covered by section F611.3.4 or section F611.3.5, and multiple dwellings not covered by section F611.3.4 or section F611.3.5. A carbon monoxide alarm shall be installed in each of the following locations:

“1. In each dwelling unit or sleeping unit where a carbon monoxide source is located. In a multiple-story dwelling unit or sleeping unit, a carbon monoxide alarm shall be installed on the lowest story having a sleeping area.

“2. In each dwelling unit or sleeping unit that is on the same story as a carbon monoxide source.

“F611.3.7 **Work completed** within one-and two-family dwellings, multiple single-family dwellings (townhouses), buildings owned as a condominium or cooperative and containing dwelling accommodations, Group R occupancies, bed and breakfast uses not covered by section F611.3.8, and multiple dwellings not covered by section F611.3.8. Where work includes the addition or installation of a carbon monoxide source, the construction of a chimney, or the connection of the building to a garage or to any other motor vehicle-related occupancy, a carbon monoxide alarm shall be installed within each dwelling unit or sleeping unit on the lowest story having a sleeping area.

“F611.3.8 **Work completed within Group I-1 occupancy.** Where work includes the addition or installation of a carbon monoxide source, the construction of a chimney, or the connection of the building to a garage or to any other motor vehicle-related occupancy, a carbon monoxide alarm shall be installed on each story having a sleeping area.

“F611.4 **Prohibited locations.** Carbon monoxide alarms shall not be located within or near the openings to garages, bathrooms, or furnace rooms. Carbon monoxide alarms shall also not be located in or near locations specified as ‘prohibited,’ ‘not recommended’ or the like in the manufacturer’s installation instructions.

“F611.5 **Power source.** When the building wiring is served from a commercial or on-site power source, carbon monoxide alarms shall receive their primary power from the building wiring and, when primary power is interrupted, shall receive power from a battery. Wiring shall be permanent and without a disconnecting switch other than those required for overcurrent protection.

“**Exceptions:**

“1. Carbon monoxide alarms installed in buildings without a commercial or on-site power source shall be permitted to be battery operated.

“2. In existing buildings and structures, cord-type, direct plug, or battery-operated carbon monoxide alarms shall be permitted.

“F611.6 **Interconnection.** When more than one carbon monoxide alarm is required to be installed within an individual dwelling unit or sleeping unit, the alarms shall be interconnected.

“**Exception:** Interconnection is not required where cord-type, direct plug, or battery-operated carbon monoxide alarms are permitted.

“F611.7 **Maintenance.** Carbon monoxide alarms shall be maintained in an operative condition at all times, shall be replaced or repaired where defective, and shall be replaced when they cease to operate as intended.

“F611.8 **Disabling of alarms.** Carbon monoxide alarms shall not be removed or disabled, except for service or repair purposes.”

# APPENDIX H

## **Properties & General Combustion Characteristics of Natural Gas**

Pipeline natural gas is one of the most popular fuel choices today. It is called “natural gas” because it is found in the earth as a natural material generated as a result of decaying organic matter. Most pipeline natural gas is called “associated gas” because it is a co-product associated with the oil recovery process. However, other sources of supply include coal bed methane, landfill methane, non-associated gas directly recovered from gas drilling operations, imported re-gasified liquefied natural gas (LNG) and refinery gases. Pipeline natural gas varies in composition depending on the geographic location the gas is being utilized. In fact, one of the many positive attributes of pipeline natural gas is that it can be mixed and blended from various sources and delivered through the interstate pipeline system as a “combined product” sufficient for most end use applications.

However, if the composition of natural gas supplied within a distribution system varies significantly, adjustments to appliances and other devices may be required. Other adjustments that must be considered, although not an issue for most areas served by National Grid, is the effect of elevation on combustion as appliances are certified and tested at sea level and do not take into account the effects elevation has on measured gas / air density. Fortunately, in most cases, after the original installation and adjustment, further adjustments are not necessary if the appliance is installed and maintained properly in accordance with the Manufacturers recommendations and standard good industry practices.

Most pipeline natural gas supplied in commerce is composed of 80-95% methane which is the principal constitute of natural gas. Methane is the same substance produced via decay of organic matter in some swamps, sewers and landfills however, unlike gas from these sources pipeline natural gas contains other hydrocarbon and non-hydrocarbon constituents including:

- Ethane
- Propane
- Butane(s)
- Pentane(s)
- Hexane(s)
- Trace hydrocarbon constituents
- Carbon Dioxide
- Nitrogen
- Trace Sulfur Compounds including gas odorants
- Moisture

Important parameters that describe the combustion characteristics of pipeline gas that are calculated from the composition constituents include:

**Gross Heating Value (also called the “higher heating value” or “heat content”)** – the amount of energy per standard cubic foot of gas transferred as heat from the complete, ideal combustion of the gas with air, at standard temperature, where all the water formed by the combustion reaction condenses to liquid.

**Relative Density (ideal specific gravity)** – the ratio of the specific weight of a gas to the specific weight of dry air at the same conditions of pressure and temperature. It is simply the average molecular weight of the gas divided by the average molecular weight of the gas.

**Wobbe Index (also called the interchangeability factor)** – a numerical value that is determined by dividing the square root of the relative density (a key orifice flow parameter) into the heat content (or Btu per standard cubic foot) of the gas. Basically, the Wobbe Index indicates the relative amount of energy that would flow through a small burner orifice jet.)

It should be noted that pipeline natural gas is non-toxic although sometimes listed as a “hazardous material” due to its flammability. Pipeline natural gas is also typically 40% lighter than air (if air is assumed to have a specific gravity of 1, natural gas would then have a specific gravity of approximately .6 depending on the composition as stated above).

Generally speaking, typical pipeline natural gas distributed in National Grid’s service territory can have heating values in the 1010 – 1060 Btu/scf range with a specific gravity ranging from .58 to .62. This can result in a Wobbe Index range of approximately 1321 – 1360. It should be noted that gas compositional changes may occur and typically should not result in Wobbe Index variations in excess of +/- 4% of the typical adjustment gas, or historical supply at the time of installation. It is anticipated that delivered compositions will not vary above a maximum Wobbe Index of 1,400 and a heating value of 1,110 Btu/scf.

Due to possible variations in composition and resulting combustion parameters, it is important to follow the Manufacturers instructions for properly adjusting burners and setting appliances “on rate”. Failure to do so may result in an over firing condition, combustion problems and lost efficiency. It is the responsibility of the installer to ensure appliances are installed correctly and properly adjusted for the gas received at the time of installation.

Pipeline natural gas used for combustion processes other than household appliances should consult and follow engineering & installation guidelines as to setting combustion devices “on-rate”. Other applications including refueling stations, vehicle and stationary engines also need to consider the above mentioned potential variations in fuel composition and resulting combustion parameters.


**It is important to note that all combustion devices should be maintained in proper working order and inspected regularly to ensure continued safe and efficient operation.**

# APPENDIX I

# HARD CASE DIAPHRAM METERS




(For Indoor and Outdoor Applications)

Meter Class	METER TYPE	Manuf	A	B	C	D	E 1	E 2	REF DRAWING	WALL-CNTR OF SWIVL	SWIVL SIZE	PIPE SIZE
250	Metris 250TC	Sprague	7 3/4	11 1/8	6	7 3/4	-	-	A	7	20 LT	1 1/4
	AC250TC	American	6	13 7/8	8 1/2	9 5/8	-	-	A	7	20 LT	1 1/4
	R275TC	Rockwell	6	13 7/8	8 1/2	9 5/8	-	-	A	7	20 LT	1 1/4
400	400ATC (30-Lt)	Sprague	8 1/4	17 1/16	10 3/4	12 1/8	-	-	A	7	45 LT	1 1/4
	AL425TC (30-Lt)	American	8 1/4	14 7/8	10	10 3/4	-	-	A	7	45 LT	1 1/4
	R415TC (30-Lt)	Rockwell	8 1/4	14 7/8	9 3/8	11 1/8	-	-	A	8	45 LT	1 1/4
400	400ATC (45-Lt)	Sprague	8 1/4	17 1/16	10 3/4	12 1/8	-	-	A	7	45 LT	1 1/4
	AL425TC (45-Lt)	American	8 1/4	14 7/8	10	10 3/4	-	-	A	7	45 LT	1 1/4
	R415TC (45-Lt)	Rockwell	8 1/4	14 7/8	9 3/8	11 1/8	-	-	A	8	45 LT	1 1/4
600	AC630TC	American	8 1/4	15	10	10 1/2	-	-	A	7	45 LT	1 1/4
800	800ATC	Sprague	11	26 5/16	13 1/4	14 1/8	23 1/2	-	B	9	45 LT	1 1/2
	AL800TC	American	11	27	14 5/8	17 1/4	24 3/16	-	B	10	45 LT	1 1/2
	R750TC	Rockwell	11	27	14 5/8	17 1/4	24 3/16	-	B	10	45 LT	1 1/2
1000	1000ATC	Sprague	11	26 5/16	16 3/8	18	25	-	B	11	2 "	2"
	AL1000TC	American	11	27	13 3/8	14 1/4	23 1/2	-	B	9	2 "	2"
	R1000TC	Rockwell	11	27	14	14/34	23 3/4	-	B	10	2"	2"
NOTE: Meter class "400": NYC has 30-Lt connections Long Island has 45-Lt connections												

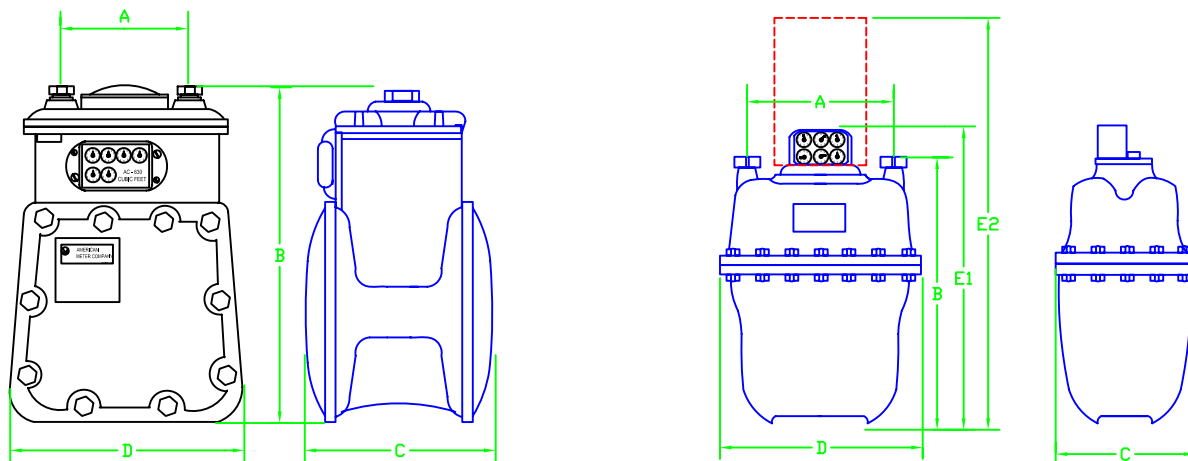




Meter Type	Mfg	A	B 1	B 2	C 1	C 2	Pipe Size
8CTC (non-ID)	Dresser	6 3/4	6 31/32	-	-	19 1/4	2
11CTC (non-ID)	Dresser	6 3/4	6 31/32	-	-	19 3/4	2
15CTC (non-ID)	Dresser	6 3/4	6 31/32	-	-	20 11/16	2
2MTC (non-ID)	Dresser	6 3/4	6 31/32	-	-	20 13/32	2
3MTC (non-ID)	Dresser	6 3/4	6 31/32	-	-	21 5/8	2
5MTC (non-ID)	Dresser	6 3/4	6 31/32	-	-	24 1/2	3
7MTC (non-ID)	Dresser	9 1/2	8 7/8	-	-	24 3/16	3
11MTC (non-ID)	Dresser	9 1/2	8 7/8	-	-	27 3/4	4
16MTC (non-ID)	Dresser	9 1/2	8 7/8	-	-	32 7/16	4
8C-ID (TC or nonTC)	Dresser	6 3/4	6 31/32	-	-	19 1/4	2
11C-ID (TC or nonTC)	Dresser	6 3/4	6 31/32	-	-	19 3/4	2
15C-ID (TC or nonTC)	Dresser	6 3/4	6 31/32	-	-	20 11/16	2
2M-ID (TC or nonTC)	Dresser	6 3/4	6 31/32	-	-	20 13/32	2
3M-ID (TC or nonTC)	Dresser	6 3/4	6 31/32	-	-	21 5/8	2
5M-ID (TC or nonTC)	Dresser	6 3/4	6 31/32	-	-	24 1/2	3
7M-ID (TC or nonTC)	Dresser	9 1/2	8 7/8	-	-	24 3/16	3
11M-ID (TC or nonTC)	Dresser	9 1/2	8 7/8	-	-	27 3/4	4
16M-ID (TC or nonTC)	Dresser	9 1/2	8 7/8	-	-	32 7/16	4
23M-ID (line mounted)	Dresser	9 1/2	8 7/8	-	-	32 3/16	4
38 M- ID	Dresser	18	18	-	-	36 3/4	6
56 M-ID	Dresser	21	18	-	-	40	8
9C - CMTC	American	6 3/4	6 31/32	-	-	19 1/4	2
1.5M - CMTC	American	6 3/4	6 31/32	-	-	20 13/32	2
3.5M - CMTC	American	6 3/4	6 31/32	-	-	21 5/8	2
7M - CMTC	American	9 1/2	8 7/8	-	-	24 3/16	3
11M - CMTC	American	9 1/2	8 7/8	-	-	27 3/4	4
Meters may be installed in a horizontal or vertical position. Vertical (top inlet) is preferred. Check for "Arrow" to indicating proper flow direction If applicable, a restricting orifice should be installed at least 2 or 4 pipe diameters downstream of the meter. Before installing, remove plastic end caps and check for free rotation of impellers. Do not put meter under strain at inlet and outlet flange connections and apply no more than 80 FT-LBS of torque when tightening flange bolts. Add oil to all 3 oil reservoirs to the center of the oil level indicator. "Do Not Overfill"							

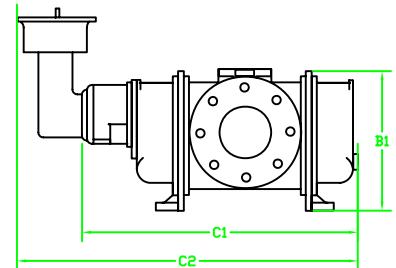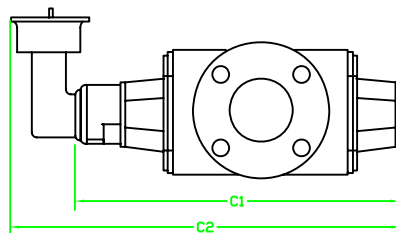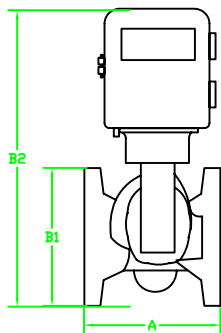

# SENSUS/ROCKWELL TURBINE METERS

Meter					Inlet
Size/Type	A	B1	B2	C	Pipe Size
		Dimensions (inches)			
4" AAT18	9	14 3/16	23 11/16	14	4
4" AAT27	9	14 3/16	23 11/16	14	4
6" AAT35	11	14 3/16	22 1/2	16	6
6" AAT57	11	14 3/16	22 1/2	16	6
8" AAT60	13 1/2	19 11/16	29 3/16	21	8
8" AAT90	11	17 3/16	26 11/16	16	8
12" AAT140	13 1/2	19 11/16	29 3/16	21	12
12" AAT230	19	25 3/16	37 11/16	30	12
4" AAT18 (720#)	10 3/4	12 11/16	23 11/16	14	4
4" AAT27 (720#)	10 3/4	12 11/16	23 11/16	14	4
6" AAT35 (720#)	14	15 1/8	26 11/16	22 1/2	6
6" AAT57 (720#)	14	15 1/8	26 11/16	22 1/2	6
8" AAT60 (720#)	13 1/2	19 11/16	29 3/16	27 1/4	8
8" AAT90 (720#)	11	17 3/16	26 11/16	27 1/4	8
12" AAT140 (720#)	13 1/2	19 11/16	29 3/16	32 1/2	12
12" AAT230 (720#)	19	25 3/16	37 11/16	32 1/2	12

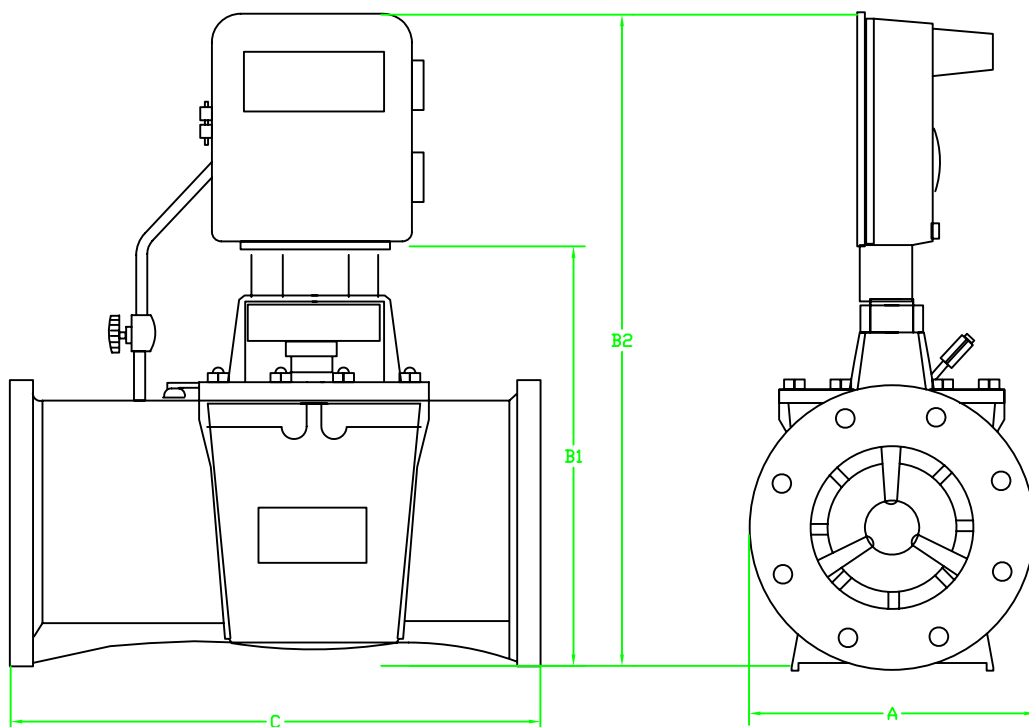

# APPENDIX J


**INDEX OF MOST FREQUENTLY USED STANDARDS: NOTE “-LI” ARE FOR LONG ISLAND AND THE ROCKAWAYS ONLY, “...-NYC” ARE FOR BOTH TERRITORIES**

<a href="#">CS-MET013-NYC</a>	PRESSURE SWITCH FOR BOOSTERS
<a href="#">CS-MET016-LI-NYC</a>	RESIDENTIAL OUTSIDE METER SUPPORTS FOR CLASS 250-1000 METERS
<a href="#">MTRS-6060-LI-MA-NH-NYC</a>	INSTALLATION OF PROTECTION POSTS
<a href="#">MTRS-6070-NYC</a>	TYPICAL INSIDE METER INSTALLATION 250/425 METERS
<a href="#">MTRS-6071-NYC</a>	MULTI-METER INSIDE SET LOW PRESSURE 350/425V METERS
<a href="#">MTRS-6075-LI</a>	MULTIMETER INSTALLATION OF HARD CASE METERS
<a href="#">MTRS-6080-NYC</a>	PARALLEL INSIDE METER 250/425
<a href="#">MTRS-6085-LI</a>	TYPICAL MULTIMETER CONFIGURATION FOR 250, 400, 800 & 1000 METERS
<a href="#">MTRS-6095-LI</a>	OUTDOOR MULTIPLE METER HEADERS FOR CLASS 250 METERS
<a href="#">MTRS6115</a>	TYPICAL MULTIMETER CONFIGURATION FOR 250, 400, 800 1000 METERS
<a href="#">MTRS-6130-NYC</a>	HIGH PRESSURE ROAARY METER SETS 776/1550 SCFH
<a href="#">MTRS-6135-LI</a>	LP MAIN/LP METERING FOR 3M OR 7M METER
<a href="#">MTRS-6140-LI-NYC</a>	SINGLE METER AND REGULATOR FOR OUTSIDE SET 15-124 PSIG INLETS, 250 & 400 METERS ½" AND ¾" DIAMETER SERVICES
<a href="#">MTRS-6142-LI-NYC</a>	SINGLE METER AND REGULATOR FOR OUTSIDE SET 15-124 PSIG INLETS, 250 & 400 METERS 1" AND 1-1/4" DIAMETER SERVICES
<a href="#">MTRS-6144-LI-NYC</a>	SINGLE METER AND REGULATOR INSTALL WITH ITRON OWR-GRD DEVICE
<a href="#">MTRS-6145-LI</a>	LP MAIN/LP METERING FOR 3M AND 7M HORIZONTAL ROTARY GAS METER – OUTSIDE LOCATIONS
<a href="#">MTRS-6150-NYC</a>	LOW PRESSURE SINF=GLE METER INSTALLATION 0-425 SCFH
<a href="#">MTRS-6155-LI</a>	LOW PRESSURE 11M AND 16M METERS OFF LP MAIN - VERTICAL
<a href="#">MTRS-6165-LI</a>	LP MAIN/LP METERING 11M & 16M HORIZONTAL
<a href="#">MTRS-6180-NYC</a>	SINGLE METER WITHOUTSIDE REGULATOR 250/400 METER
<a href="#">MTRS-6185-LI</a>	OUTDOOR METER SETS CLASS 800/1000, LP-124 PSIG INLET SERVICES – LP AND ½ PSIG DELIVERY PRESSURE
<a href="#">MTRS-6215-LI</a>	TYPICAL MULTIMETER CONFIGURATIONS FOR CLASS 250, 400, 800 AND 1000 METERS WITH SINGLE REGULATOR
<a href="#">MTRS-6255-LI</a>	HP MAIN/LP, ½ PSIG AND 1 PSIG METERING FOR 8C, 1.5M, 3M OR 7M VERTICAL ROTARY GAS METER
<a href="#">MTRS-6265-LI</a>	HP MAIN/LP, ½ PSIG AND 1 PSIG METERING FOR 8C, 1.5M, 3M OR 7M HORIZONTAL ROTARY GAS METER
<a href="#">MTRS-6335-LI</a>	OUTDOOR GAS METER CLASS 250/400 WITH BYPASS
<a href="#">MTRS-6385-LI</a>	8C, 1.5M, 3M & 7M HP METER, VERTICAL POSITION
<a href="#">MTRS-6505-LI</a>	CONCRETE FOUNDATIONS AND/OR FOOTINGS FOR GAS ROTARY GAS METER HEADERS – OUTDOOR LOCATION
<a href="#">MTRS-6525-LI</a>	FENCING ENCLOSURES FOR METER SETS
<a href="#">MTRS-6545-LI</a>	GENERAL NOTES FOR ROTARY GAS METERS
<a href="#">MTRS-6627</a>	TYPICAL MANIFOLD WITH 250 METERS AND BYPASS REAR ENTRY METER BARS
<a href="#">MTRS-6628</a>	DRESSER 630 METER INSTALLATION
<a href="#">MTRS-6629</a>	DRESSER 1000 METER WITH BYPASS
<a href="#">MTRS-6630</a>	DRESSER 1000 METER WITH NO BYPASS
<a href="#">020010-CS</a>	8C – 3M PREFABRICATED HEADER 800 – 3,000 SCFH
<a href="#">020011-CS</a>	5M AND 7M PREFABRIATED METER HEADER UP TO 7,000 SCFH
<a href="#">020013-CS</a>	OUTDOOR LOCATION FOR RISERS AND REGULATOR VENT TERMINUS
<a href="#">CS-CNST004</a>	CONDUIT INSTALLATION GUIDELINES FOR GAS SERVICE INSERTION
<a href="#">CS-DAM01016</a>	MARKOUT OF UNDERGROUND FACILITIES
<a href="#">CNST-6015-LI</a>	CLEARANCES OF GAS AND UNDERGROUND ELECTRIC FACILITIES
<a href="#">CNST-6025-LI</a>	DEPTH OF COVER AND CLEARANCES OF GAS MAIN AND SERVICES
<a href="#">030031-CS</a>	STEEL MAIN AND SERICE COATING GUIDE
<a href="#">CSMET022</a>	8C TO 3M ROTARY METER SET - NO BYPASS FOR RESIDENTIAL L.I. SETS
000-0000	GENERATOR INSTALLATION USING 1 METER/2 REGULATORS


**DISCLAIMER:** The standards with the “-LI” suffix are for Long Island and the Rockaways only. The standards that include “NYC” in the suffix are valid in New York City as well. These standards are current as of December 2020. They may be revised at any time. It is up to the installing Contractor to verify the latest edition with National Grid’s Project Manager, Gas Customer Service or Field Operations Representative.


The internal website for the standards for National Grid are at this site:  
[nationalgrid Gas Work Methods - Home \(sharepoint.com\)](https://nationalgrid.com/work-methods)


The external website for the standards for National Grid are at this site:  
<https://www.nationalgridus.com/media/pronet/gas-blue-book.pdf>

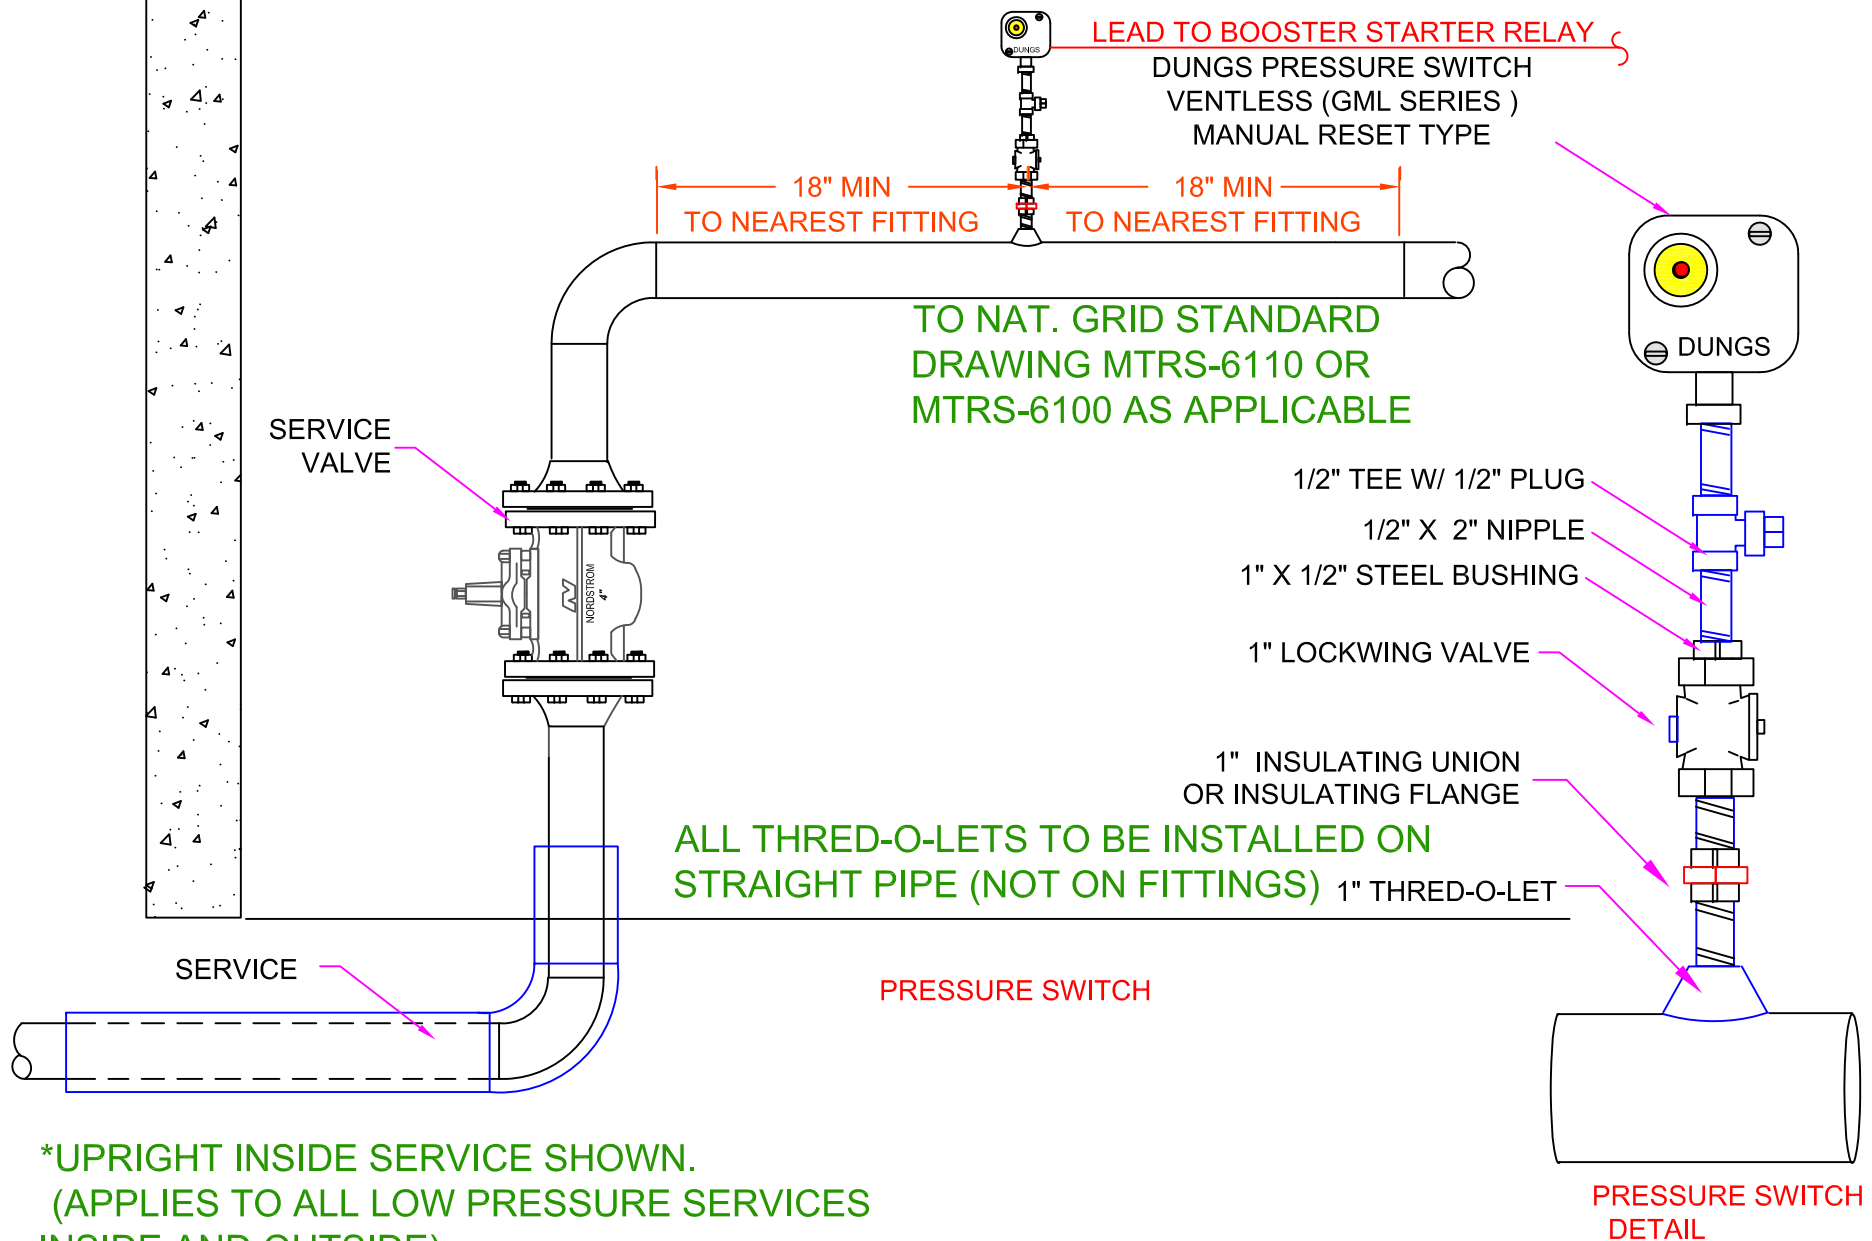

\*UPRIGHT INSIDE SERVICE SHOWN.  
(APPLIES TO ALL LOW PRESSURE SERVICES  
INSIDE AND OUTSIDE)


		<b>PRESSURE SWITCH DETAILS FOR BOOSTER INSTALLATIONS</b>	
REVISIONS: NEW DRAWING		DATE: 12/15/2014	EFFECTIVE DATE: 12/15/2014
		DESIGN: PAUL GUGLIOTTA	STD. DWG. NO.
		DRAWN: PAUL GUGLIOTTA	<b>CS-MET013</b>

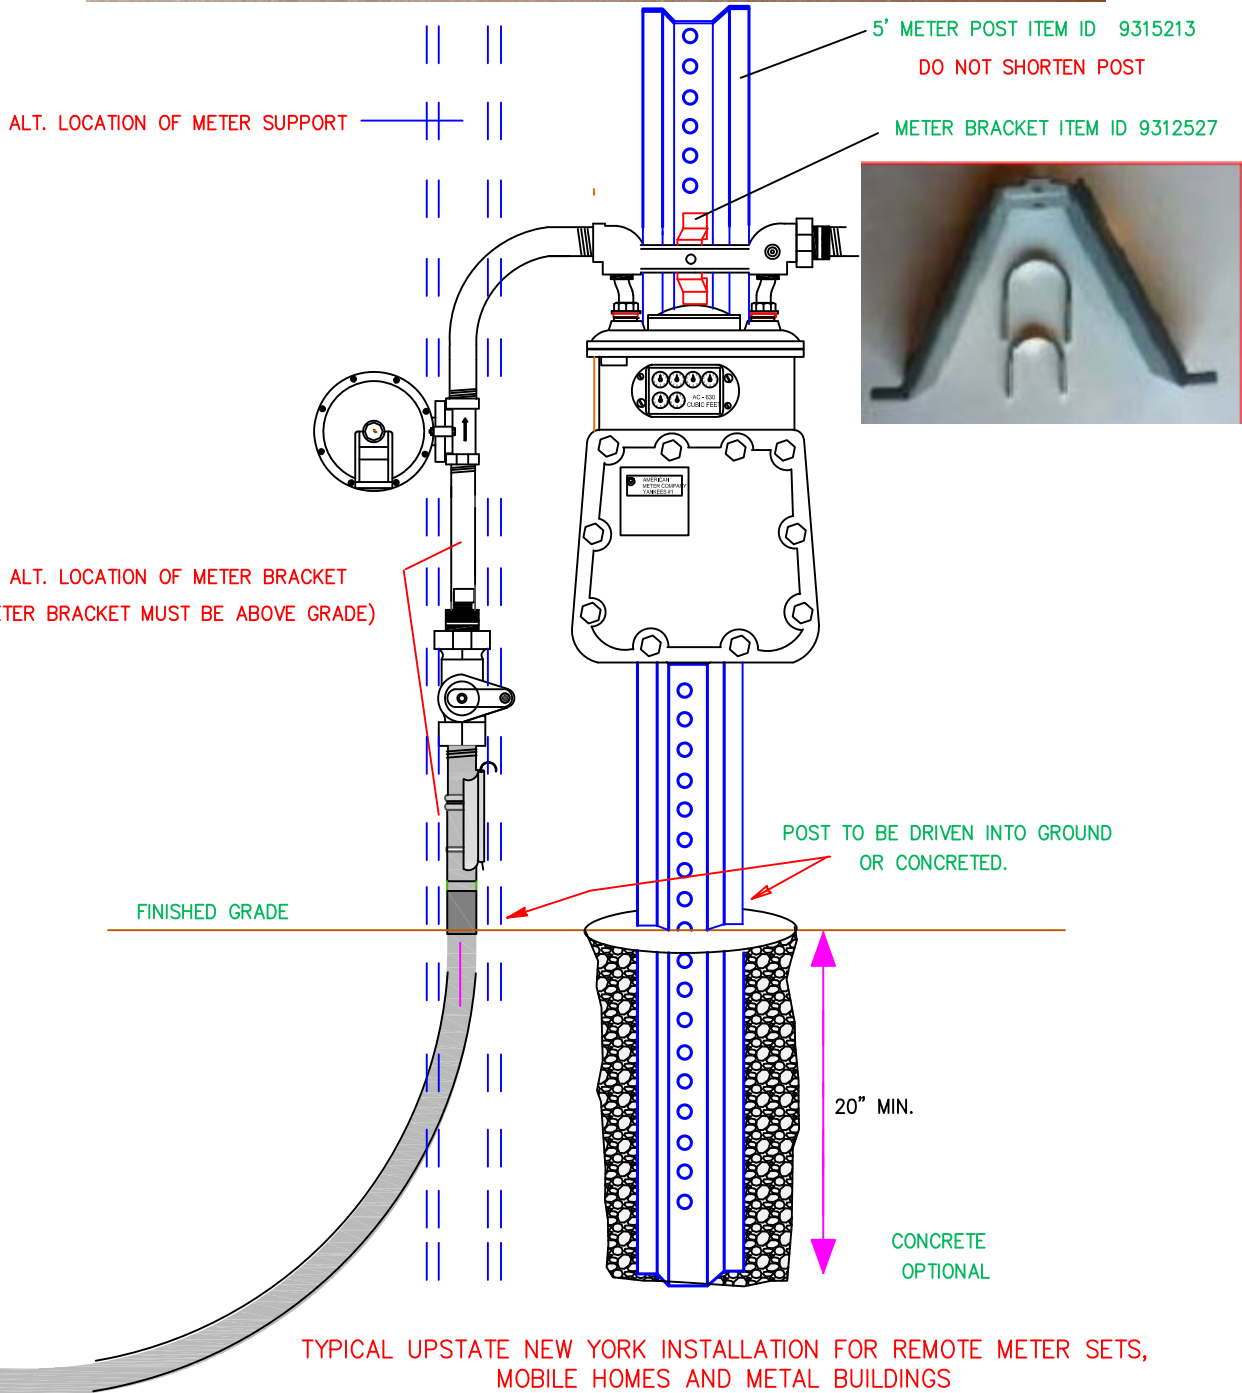

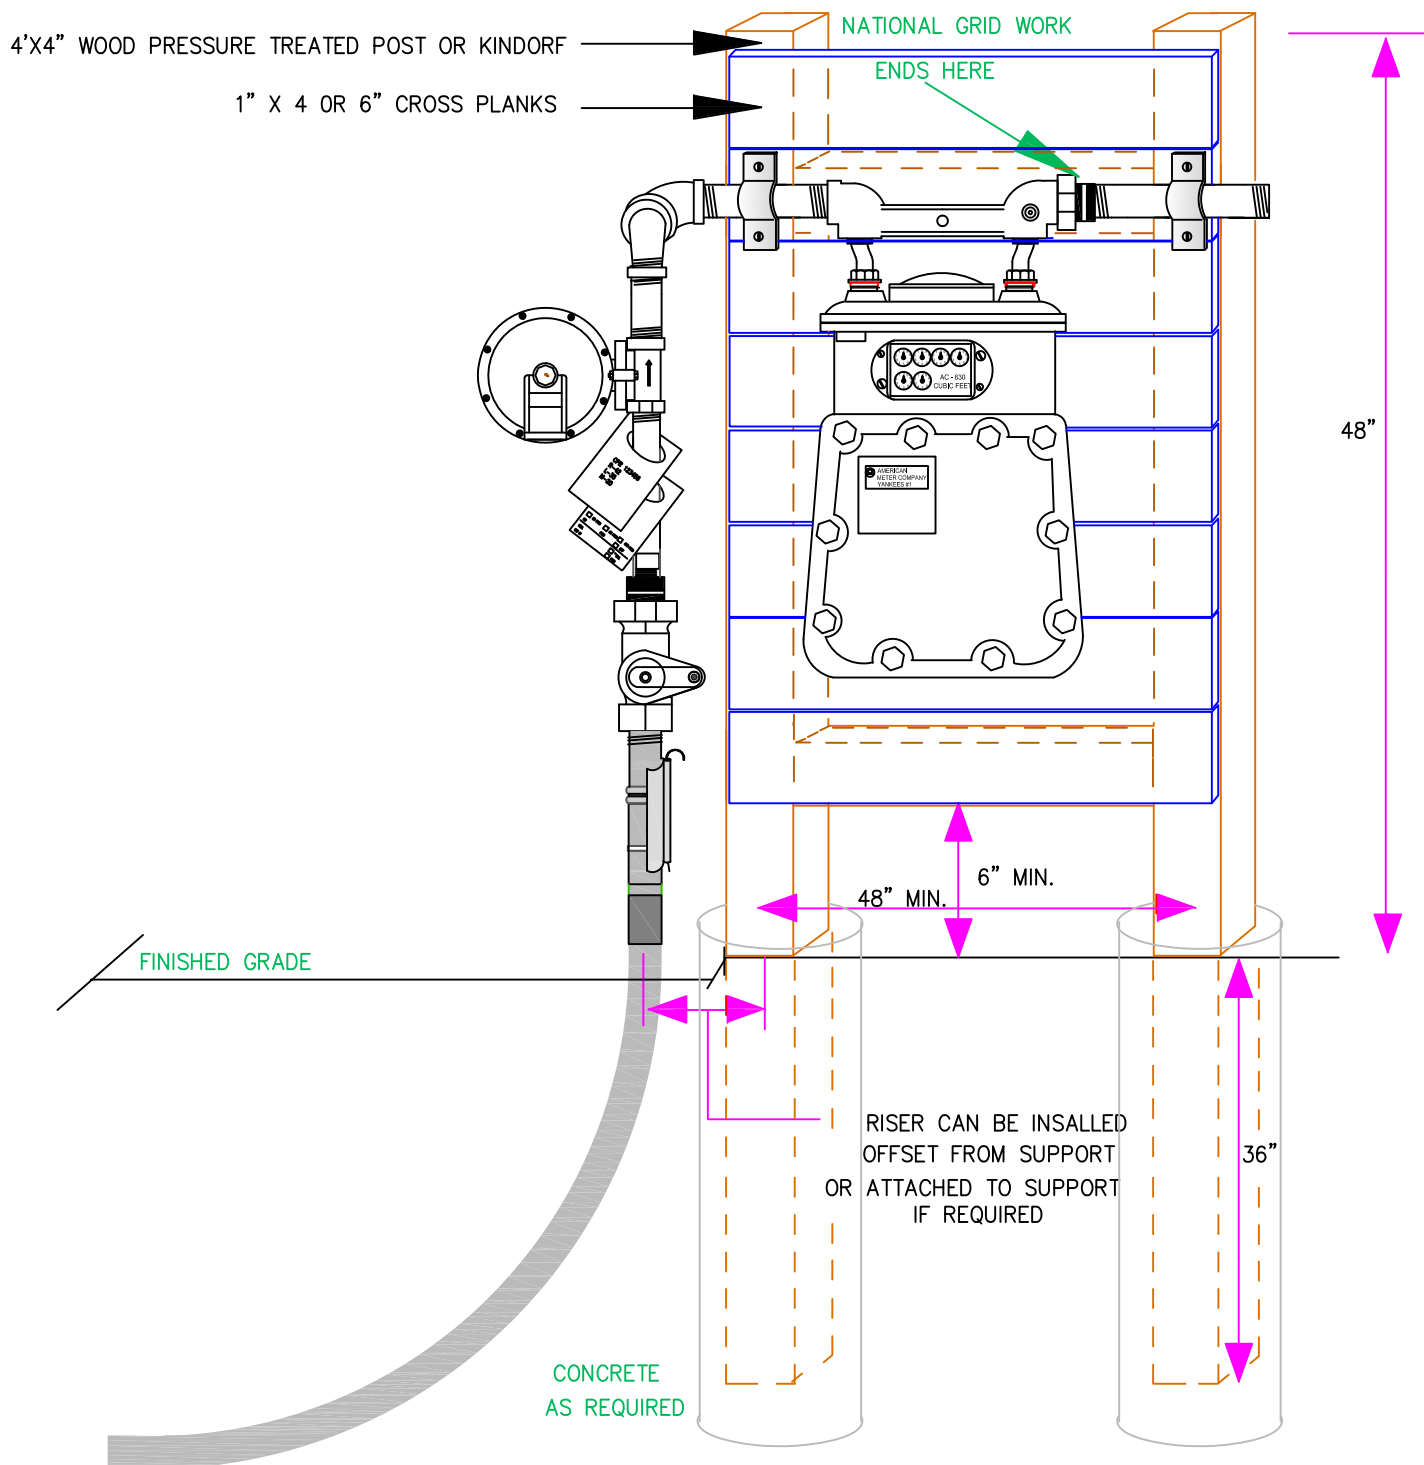


## ALTERNATE DESIGN FOR REMOTE METER SETS




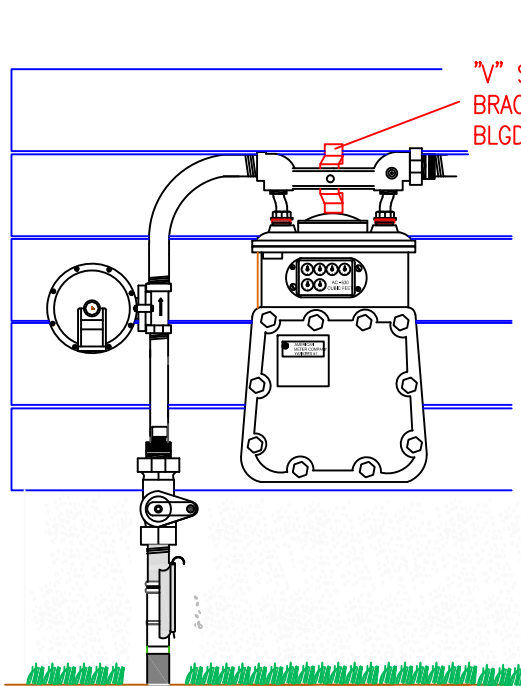

"V" SUPPORT  
BRACKET TO  
BLGD./HOUSE WALL

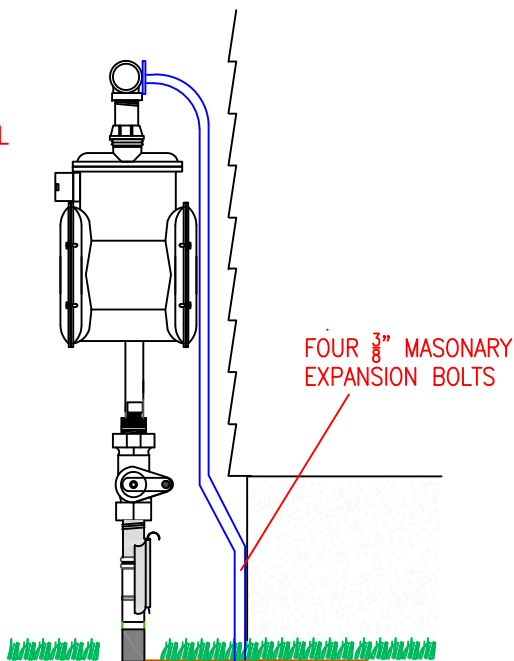

FOUR  $\frac{3}{8}$ " MASONRY  
EXPANSION BOLTS

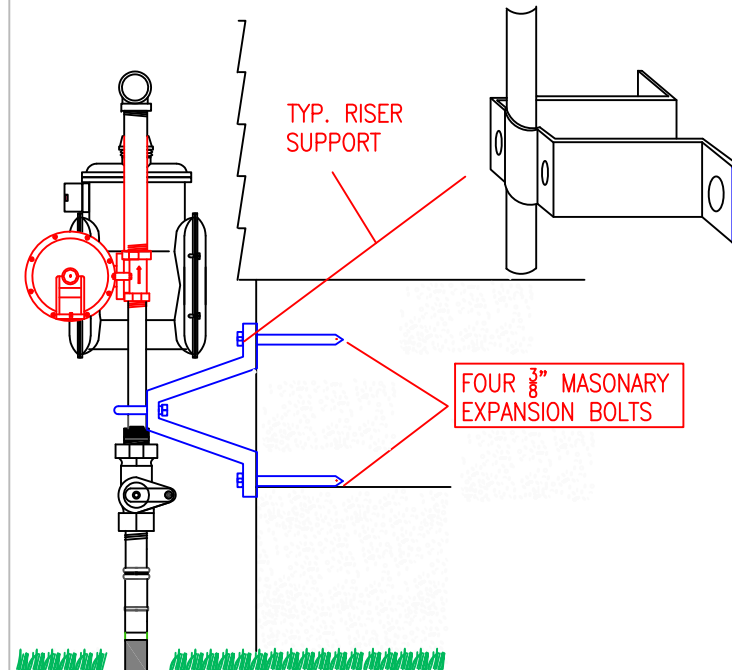

TYP. RISER  
SUPPORT


FOUR  $\frac{3}{8}$ " MASONRY  
EXPANSION BOLTS




9315271 12" ADJUSTABLE UNY



9312528 UNY

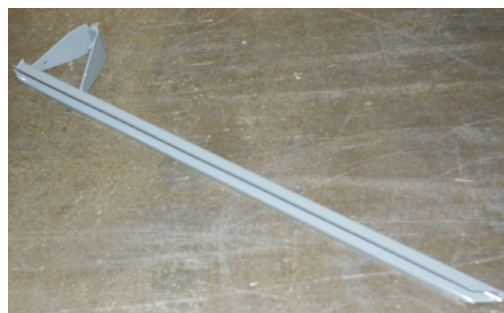


9323008 MASS ONLY

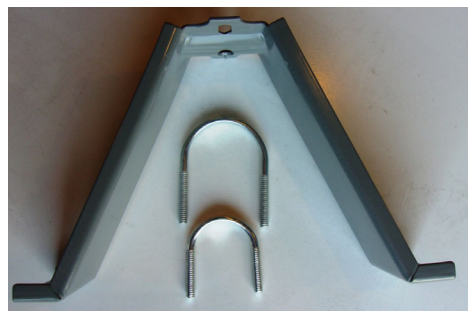

9312527 UNY


TYPICAL METER BAR SUPPORTS




9312525 2" RISER UNY  
9336833 2" & 3" RISER MASS ONLY

9340885  $\frac{3}{4}$ " & 2" RISER  
LI/MASS/NYC


9340886 2" & 3" RISER LI/NYC  
4" OFFSET



9312526 ALUM 4" WIDE UNY ONLY




9384078 MASS ONLY

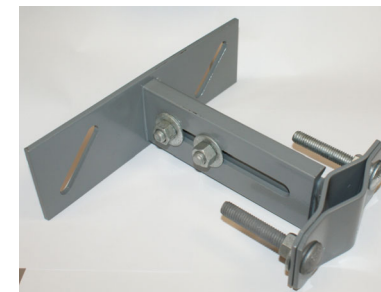

9310291 RI ONLY

TYPICAL RISER SUPPORTS



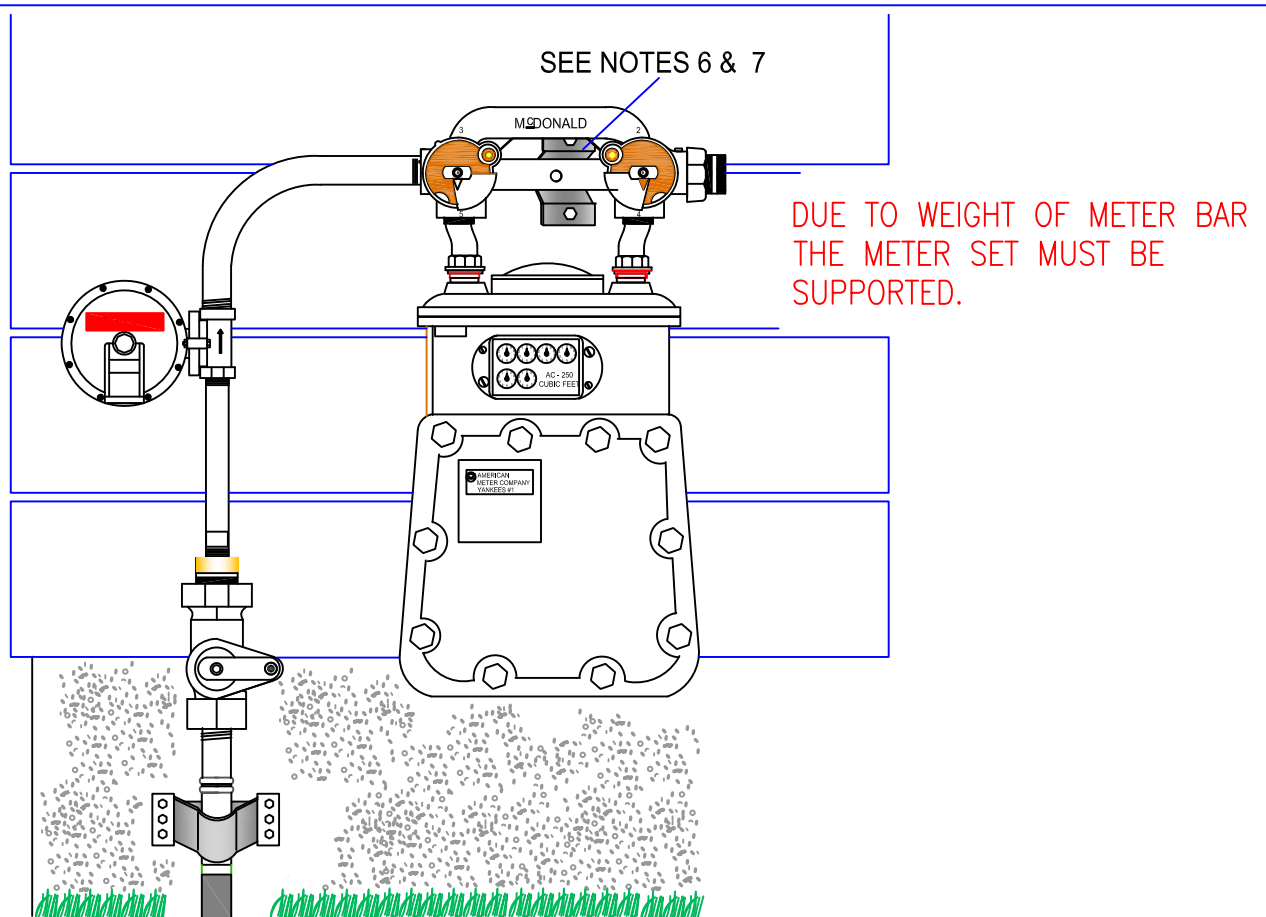

### ADDITIONAL BRACKETS AVAILABLE



9311169 24"x12"x2"x2"  
MASS/RI




9322430 MASS ONLY

9384105 10"x12"x1.5"x 1/8" MASS ONLY  
9384106 18"x18"x2"x 3/16" MASS ONLY





### NOTES:


1. THIS STANDARD SHOWS TYPICAL METER AND RISER SUPPORTS, AS WELL AS, REMOTE METER INSTALLATION. ALTERNATE METHODS CAN BE USED IF APPROVED BY ENGINEERING.
2. REMOTE METER LOCATIONS SHALL ONLY BE USED WHEN NO FEASIBLE LOCATION AT THE HOUSE IS POSSIBLE AND MUST BE APPROVED BY NATIONAL GRID.
3. PROTECTION POSTS MAY BE REQUIRED PER MTRS-6060.
4. IT IS THE CUSTOMER'S RESPONSIBILITY TO SUPPLY AND INSTALL THE H-FRAME (SHOWN ON PAGE 2) PRIOR TO THE INSTALLATION OF THE GAS SERVICE.
5. ALL FLEX RISER MUST BE SUPPORTED
6. SINGLE RESIDENTIAL BY-PASS METER BARS SHALL BE INSTALLED WITH APPROPRIATE SUPPORT BRACKET (ITEM ID 9322430)
7. WHEN ATTACHING SUPPORTS TO SIDING OR SHINGLES, PRE-DRILL THE HOLES IN THE SIDING OR SHINGLES.
8. WHEN REMOTE METER SET IS FOR A SECOND SERVICE, IT MUST BE LOCATED 25 FEET MINIMUM FROM THE PRIMARY BUILDING / RESIDENCE.
9. WHEN REMOTE METER SET IS FOR A SECOND SERVICE, THE PIPING AFTER THE METER SHALL NOT ENTER THE PRIMARY BUILDING / RESIDENCE.

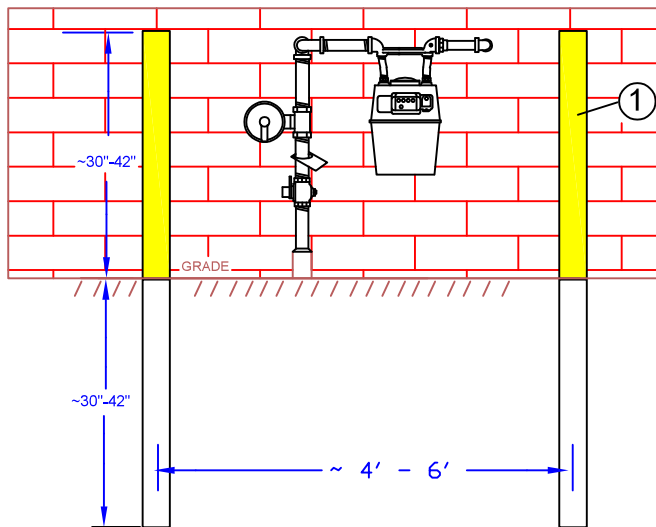

## GAS METER

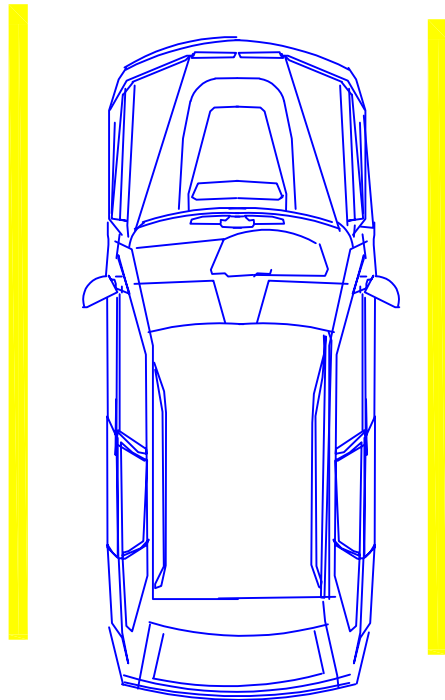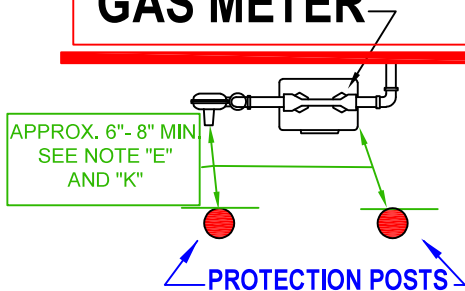

**FIGURE 1**  
HEAD ON PARKING

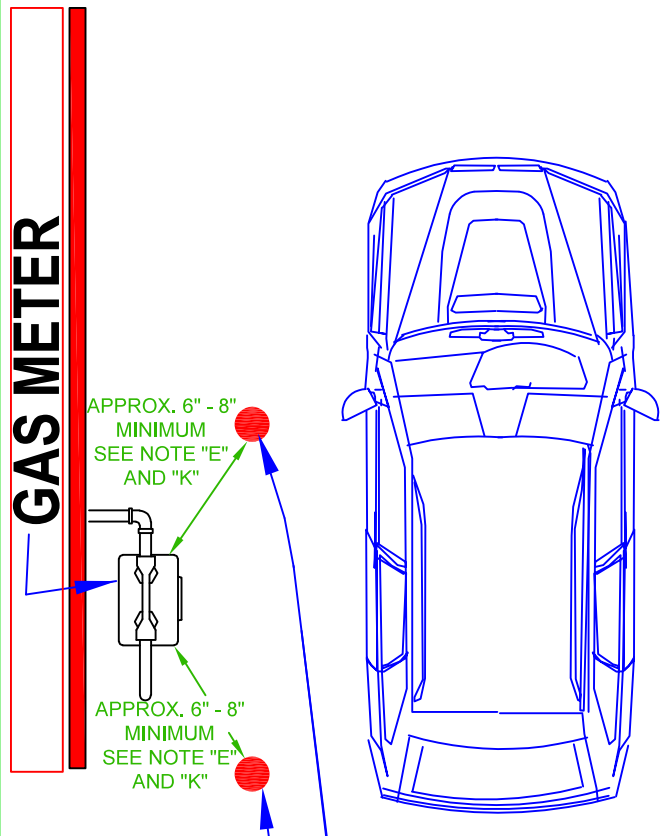

**PROTECTION POSTS**  
INSTALL PROTECTION POSTS ON  
BOTH SIDES OF METER SET. SEE  
NOTE "K".

**FIGURE 2**  
DRIVEWAY OR ADJACENT PARKING

**nationalgrid**

ALL REGIONS

## INSTALLATION OF PROTECTION POST OUTSIDE METER SETS

REVISIONS: MADE FOR ALL REGIONS

DATE: 04/10/2025

DESIGN: PG

DRAWN: PG


EFFECTIVE DATE: 04/10/2025

STD. DWG.  
NO. **MTRS-6060**


**NOTES:**

- A. WHERE PRACTICAL, CUSTOMER METERS AND SERVICE REGULATORS SHOULD BE INSTALLED IN AN AREA AWAY FROM VEHICULAR TRAFFIC AND OTHER POTENTIAL HAZARDS.
- B. WHENEVER THE METER AND/OR SERVICE REGULATOR ASSEMBLY AND GAS PIPING ARE POTENTIALLY SUBJECTED TO DAMAGE FROM VEHICULAR TRAFFIC, AND NO OTHER MEANS OF PROTECTION EXISTS (E.G., CURB STOP, RETAINING WALL, ELEVATED PLATFORM, ETC.) PROTECTION POST(S) OR OTHER SUITABLE PROTECTION SHALL BE INSTALLED. THE ENTIRE EXPOSED METER SET AND ASSOCIATED PIPING SHALL BE PROTECTED FROM TRAFFIC IN BOTH DIRECTIONS. IN SOME CASES, TWO OR MORE POSTS WILL BE REQUIRED TO ADEQUATELY PROTECT A METER SET.
- C. EXAMPLES OF METER/SERVICE RISER LOCATIONS REQUIRING PROTECTION SHALL INCLUDE BUT NOT BE LIMITED TO:
- 1) WHERE THE METER/SERVICE RISER IS LOCATED AT THE END OF A DRIVEWAY (SEE FIG. (1.))
  - 2) WHERE THE METER/SERVICE RISER IS LOCATED ADJACENT A DRIVEWAY (SEE FIG. (2.))
  - 3) WHERE THE METER/SERVICE RISER IS LOCATED IN A PARKING LOT
  - 4) WHERE THE METER/SERVICE RISER IS LOCATED IN A LOADING AREA
- D. THE RESPONSIBILITY FOR METER SET PROTECTION SHALL BE DETERMINED ON A CASE-BY-CASE BASIS.
- E. THE SPACE FROM THE PROTECTION POST TO THE METER, REGULATOR OR GAS PIPING SHOULD BE SUCH THAT CMS PERSONNEL CAN INSTALL, MAINTAIN AND REPAIR THE METER SET WITHOUT INTERFERENCE FROM THE PROTECTION POST
- F. FOR CERTAIN COMMERCIAL AND INDUSTRIAL APPLICATIONS ADDITIONAL PROTECTION MAY BE REQUIRED IN EXCESS OF THIS POLICY DOCUMENT.
- G. THE INSTALLATION OF PROTECTION POSTS SHOULD BE DOCUMENTED ON THE GAS SERVICE RECORD CARD.
- H. PROTECTION FOR RESIDENTIAL OR SMALL COMMERCIAL SETS SHOULD BE 3-1/2 OR 4 INCHES OD STEEL, PAINTED OR GALVANIZED POSTS, AND 5-7 FEET IN LENGTH. WHERE FEASIBLE, FILL POSTS WITH CONCRETE.
- NOTE: 2" GALV. STEEL IS CURRENTLY USED IN UNY AND ACCEPTABLE FOR RESIDENTIAL AND SMALL COMMERCIAL INSTALLATIONS.**
- I. THE POST SHOULD BE SET 30-42 INCHES ABOVE AND 30-42 INCHES BELOW GRADE.
- J. ALTERNATES ARE PERMISSIBLE IF THE ABOVE MATERIAL IS NOT IN STOCK. OBTAIN APPROVAL FROM YOUR SUPERVISOR OR ENGINEERING.
- K. IF TRAFFIC CAN APPROACH THE METER SET IN TWO DIRECTIONS, THEN POSTS ARE REQUIRED ON BOTH SIDES OF THE METER SET. FOR HEAD ON PARKING, ONE POST MAY BE ADEQUATE IF IT IS DETERMINED TO ADEQUATELY PROTECT THE METER SET. THE HEIGHT OF THE POST ONLY NEEDS TO ENSURE THE POST(S) ADEQUATELY PROTECTS THE TOP OF THE METER SET. THE 30" DISTANCE IS AN APPROXIMATION OF SUCH A TYPICAL INSTALLATION.


		SAP ITEM ID'S
2	CONCRETE – READY MIX 40 LB. BAG	9331384 LI, NYC
1	POST 3.5" O.D. 6' LONG – CONCRETE FILLED - PRIMED COATED OR POST 4.5" O.D. 5' LONG GALVANIZED 0.237" WALL – <b>NOT CONCRETE FILLED</b> POST 2" GALVANIZED 154" WALL + CAP FOR 2" POST PIPE 6" STEEL .280" WALL (FOR LARGE COMMERCIAL SETS IN UNY) + OUTER YELLOW PLASTIC SLEEVE	<a href="#">9393855 LI, NYC, MASS</a> 9340113 LI, NYC, MASS 9312317 UNY 9312317 UNY 9312325 UNY 9308350 UNY
NO.	ITEM	CODE No.
<b>BILL OF MATERIAL</b>		

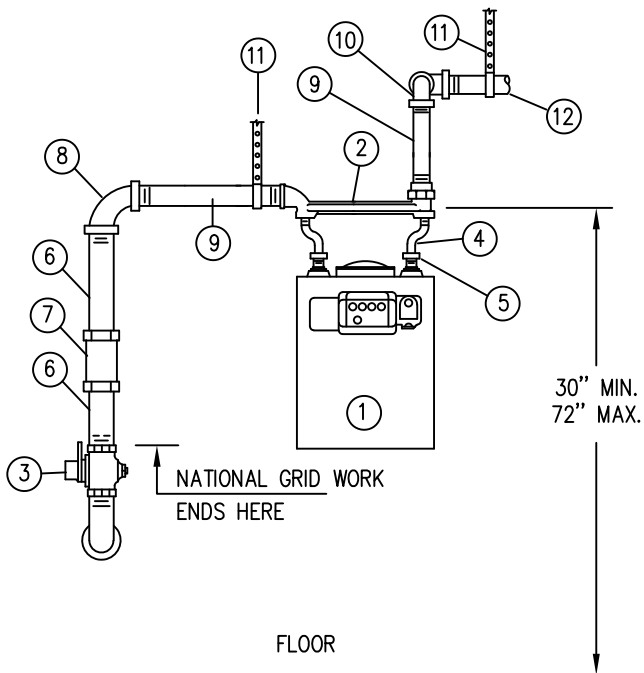


ELEVATION  
250 CFH TYPE

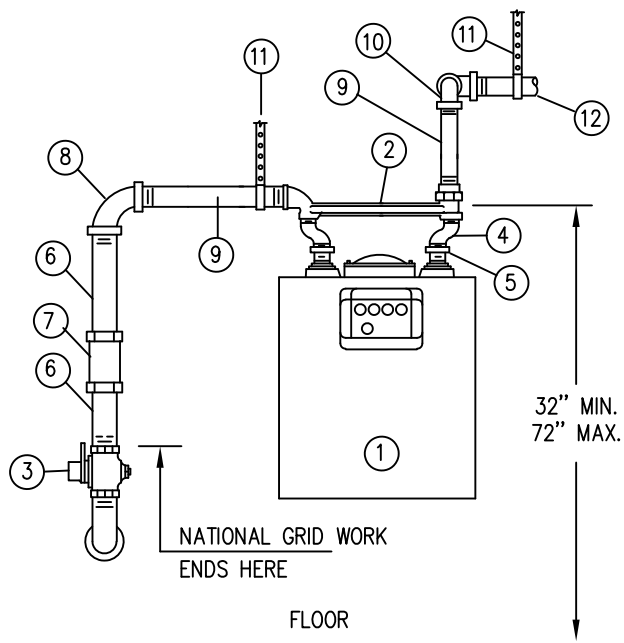

ELEVATION  
425 CFH TYPE

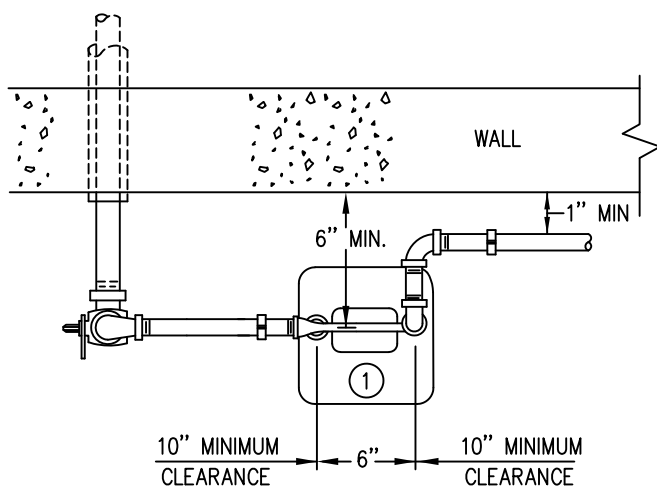

PLAN  
250 CFH TYPE

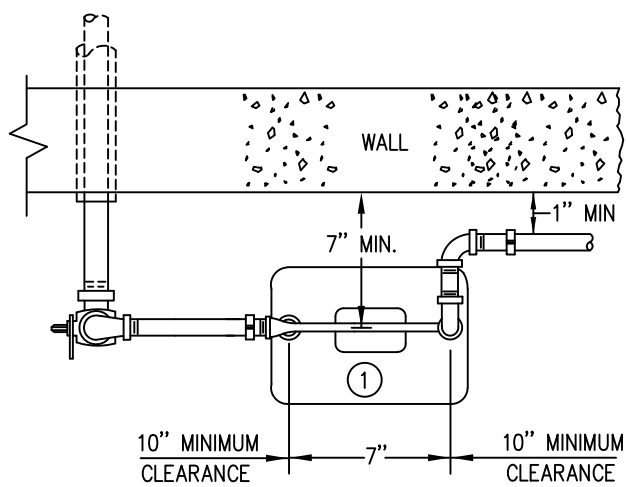

PLAN  
425 CFH TYPE

**nationalgrid**

NEW YORK CITY

**SINGLE INSIDE METER INSTALLATION  
0 - 250 CFH AND 0 - 425 CFH RANGE  
LOW PRESSURE**

**REVISIONS:** UPDATED SAP ITEM ID #'S

DATE: 07/01/2003

DESIGN: F. TAYLOR

DRAWN: J. CASTALUCCI

EFFECTIVE DATE: 06/10/2020

STD. DWG.

NO. **MTRS-6070**

**NOTES**

- A. KEY REQUIREMENTS FOR THE CONSTRUCTION OF METER HEADERS AND METER INSTALLATIONS ARE CONTAINED IN SPECIFICATIONS [CMS03002](#).
- B. IN PRIVATE HOUSE WITH SINGLE METER ONLY, METER VALVE IS PREFERRED, BUT NOT REQUIRED, PROVIDED METER IS 6' OR LESS FROM SERVICE VALVE AND ALL PIPING EXPOSED. THE SERVICE VALVE SHALL BE LOCK TYPE AND ALWAYS ACCESSIBLE.
- C. ADDITIONAL FITTINGS MAY BE REQUIRED TO MAKE THE METER INSTALLATION.


**NOTE: ALL MATERIALS AFTER THE SERVICE VALVE WILL BE FURNISHED AND INSTALLED BY THE CUSTOMER EXCEPT FOR THE REGULATOR WHICH IS FURNISHED BY THE COMPANY AND INSTALLED BY THE CUSTOMER. THE METER, SWIVEL AND CAPS (METER NUTS) WILL BE FURNISHED AND INSTALLED BY THE COMPANY.**

METER CHART		
METER CAPACITIES	0-250 CFH RANGE	0-425 CFH RANGE
AMERICAN	AL-250	AL-425
ROCKWELL EQUIMETER SENSUS	275	415
SPRAGUE SCHLUMBERGER ACTARIS ITRON	250	400


12	HOUSE PIPING TO LOAD	----	----
11	PIPING SUPPORT / STRAPPING	----	----
10	ELBOW, 90 M.I. SIZE OF HOUSE PIPE RISER X	1"	1-1/4"
9	NIPPLE (LENGTH AS REQUIRED)	1"	1-1/4"
8	ELBOW, REDUCING, 90 M.I. SERVICE COCK SIZE X	1"	1-1/4"
7	COMPRESSION COUPLING, INSULATING, DRESSER STYLE 90	SERVICE COCK SIZE	SERVICE COCK SIZE
6	NIPPLE 4" MINIMUM (LENGTH AS REQUIRED)	SERVICE COCK SIZE	SERVICE COCK
5	METER NUT 20 LT FOR 250 METER METER NUT 30 LT FOR 400/450 METER	9312379 -	- 9312381
4	METER, OFFSET SWIVEL	9312385 1" X 20 LT	9342456 1-1/4" X 30 LT
3	COCK, MUELLER LOCK WING, TAMPER PROOF H- 1111 OR APPROVED EQUAL	9312256 1"	9308487 1-1/4"
2	METER BAR SIDE INLET – TOP OUTLET ALTERNATE: METER BAR SIDE INLET – SIDE OUTLET (GALVANIZED)	1" 9339755 1" 9383181	1-1/4" 9339756 1-1/4" 9383209
1	METER	250	425

No.	ITEM	NGG CODE No.
-----	------	--------------

**BILL OF MATERIAL**

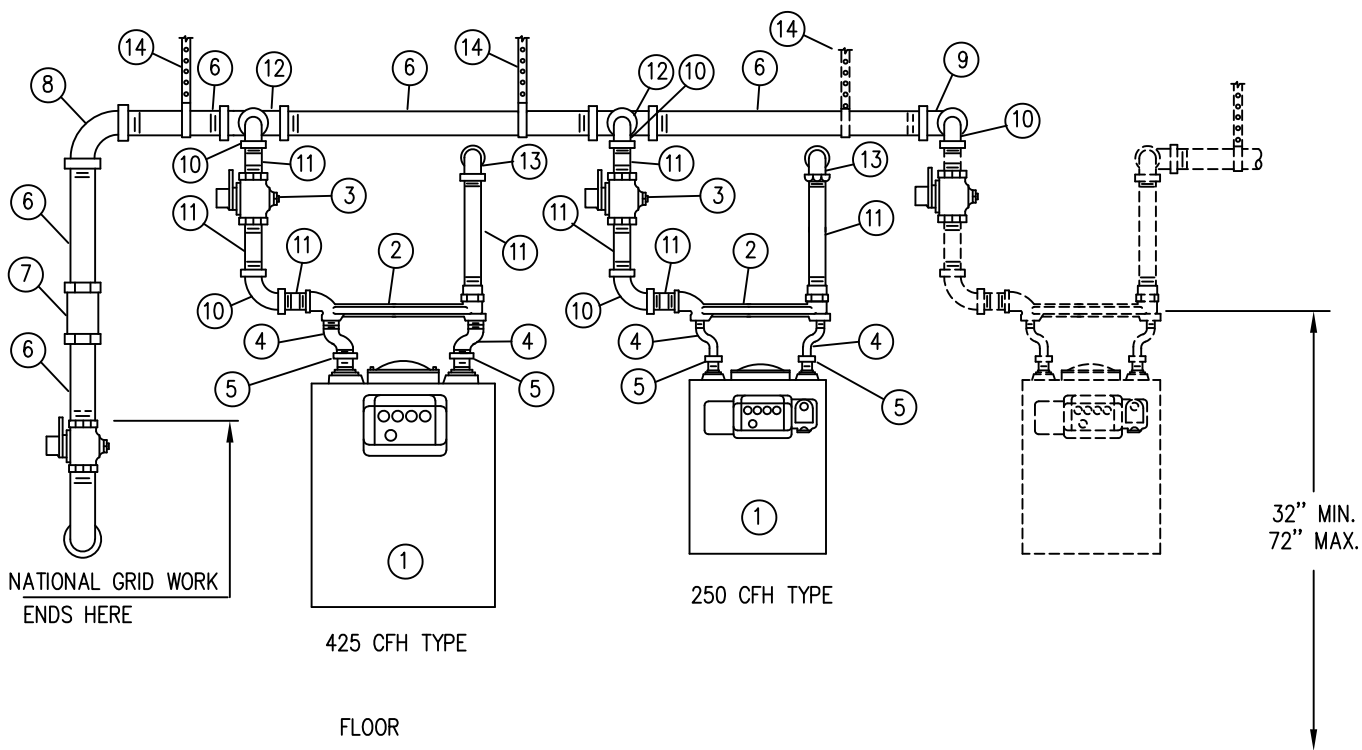

ELEVATION  
250 CFH AND 425 CFH TYPE

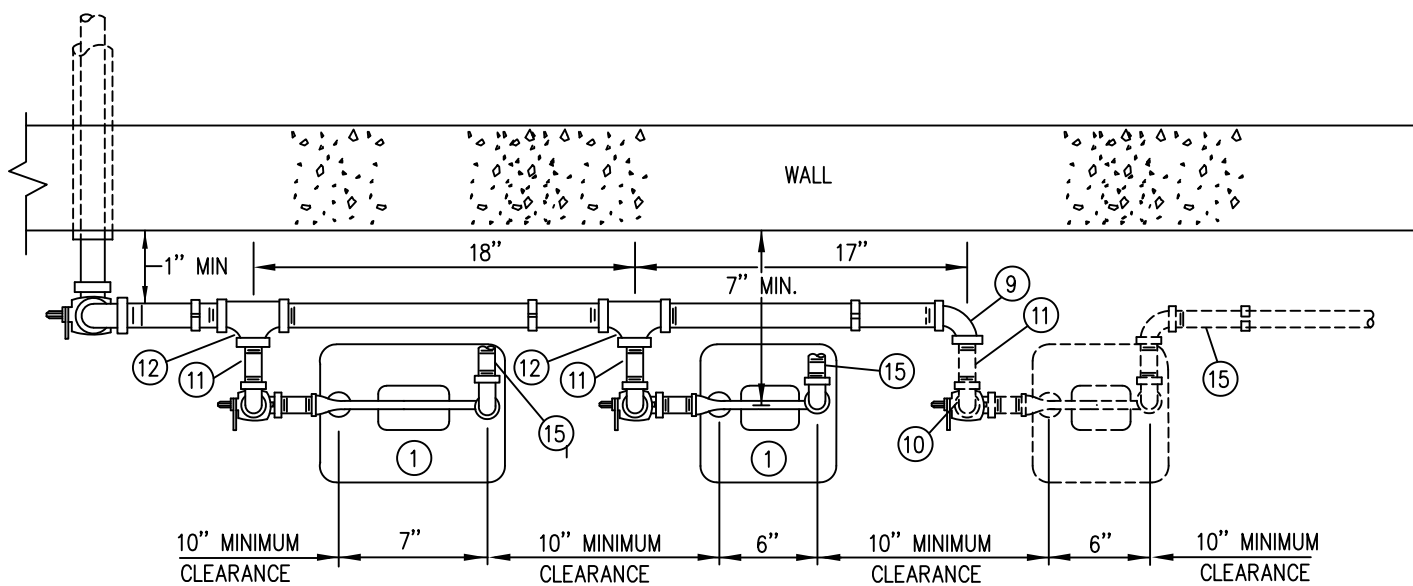

PLAN  
250 CFH AND 425 CFH TYPE

**nationalgrid**

NEW YORK CITY

**MULTI INSIDE METER INSTALLATION  
0 - 250 CFH AND 0 - 425 CFH RANGE  
LOW PRESSURE**

**REVISIONS:** UPDATED PAGE 2 SAP ITEM ID'S

DATE: 07/01/2003

DESIGN: F. TAYLOR /PG

DRAWN: J. CASTALUCCI

EFFECTIVE DATE: 06/10/2020

STD. DWG.

NO. **MTRS-6071**

**NOTES**


- A. KEY REQUIREMENTS FOR THE CONSTRUCTION OF METER HEADERS AND METER INSTALLATIONS ARE CONTAINED IN SPECIFICATIONS [CMS03002](#).
- B. THE METER PIPING LAYOUT MAY VARY SOMEWHAT FROM THIS DRAWING ACCORDING TO FIELD CONDITIONS. INSTALLATION MAY REQUIRE TWO 425 CFH TYPE AND ONE 250 CFH TYPE OR ALL OF 425 CFH RANGE METERS OR ALL 250 CFH RANGE METERS. PIPING TO MATCH REQUIRED INLET/OUTLET SPACING. LAST METER TAKEOFF FROM HEADER MANIFOLD SHALL BE FROM A REDUCING ELBOW, (ITEM 9), NOT A TEE.
- C. ADDITIONAL FITTINGS MAY BE REQUIRED TO MAKE THE METER INSTALLATION.

**NOTE: ALL MATERIALS AFTER THE SERVICE VALVE WILL BE FURNISHED AND INSTALLED BY THE CUSTOMER EXCEPT FOR THE REGULATOR WHICH IS FURNISHED BY THE COMPANY AND INSTALLED BY THE CUSTOMER. THE METER WILL BE FURNISHED AND INSTALLED BY THE COMPANY.**

METER CHART


METER CAPACITIES		0-250 CFH RANGE	0-425 CFH RANGE
AMERICAN HONEYWELL		AL-250	AL-425
ROCKWELL EQUIMETER SENSUS		275	415
SPRAGUE SCHLUMBERGER ACTARIS ITRON		250	400
15	HOUSE PIPING TO LOAD	-----	-----
14	PIPING SUPPORT / STRAPPING	-----	-----
13	ELBOW, 90 M.I. SIZE OF HOUSE PIPE RISER X	1"	1- 1/4"
12	TEE, M.I. SERVICE COCK SIZE X	1"	1-1/4"
11	NIPPLE (LENGTH AS REQUIRED)	1"	1-1/4"
10	ELBOW, 90 M.I.	1"	1- 1/4"
9	ELBOW, REDUCING, 90 M.I. SERVICE COCK SIZE X	1"	1-1/4"
8	ELBOW, 90 M.I.	SERVICE VALVE SIZE	SERVICE VALVE SIZE
7	COMPRESSION COUPLING, LOCK TYPE INSTALLATION, DRESSER STYLE 90	SERVICE VALVE SIZE	SERVICE VALVE SIZE
6	NIPPLE 4" MINIMUM (LENGTH AS REQUIRED)	SERVICE VALVE SIZE	SERVICE VALVE SIZE
5	METER NUT 20 LT FOR 250 METER METER NUT 30 LT FOR 400/450 METER	9312379 -	- 9312381
4	METER, OFFSET SWIVEL	9312385 1" X 20 LT	9342456 1-1/4" X 30 LT
3	VALVE, LOCK WING TAMPER PROOF, MUELLER H-11175 OR AYMCDONALD 560B OR APPROVED EQUAL	9312256 1"	9308487 1-1/4"
2	METER BAR SIDE INLET – TOP OUTLET ALTERNATE – METER BAR SIDE INLET – SIDE OUTLET - GLAVANIZED	1" 9339755 1" 9383181	1-1/4" 9339756 1-1/4" 9383209
1	METER	250 TYPE	425 TYPE
<b>No.</b>	<b>ITEM</b>	<b>NATIONAL GRID ITEM ID</b>	

**BILL OF MATERIAL**

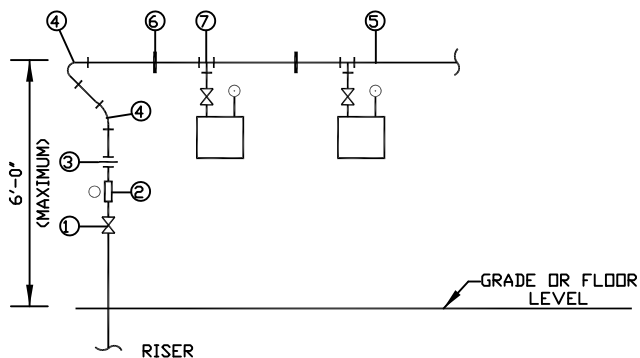

- (A) TWO OR THREE METERS MAXIMUM MOUNTED IN A SINGLE TIER AND SUPPLIED BY A SINGLE REGULATOR  
(CLASS 175 AND 250)


REFERENCE DRAWINGS:  
MTRS-6095  
MTRS-6105

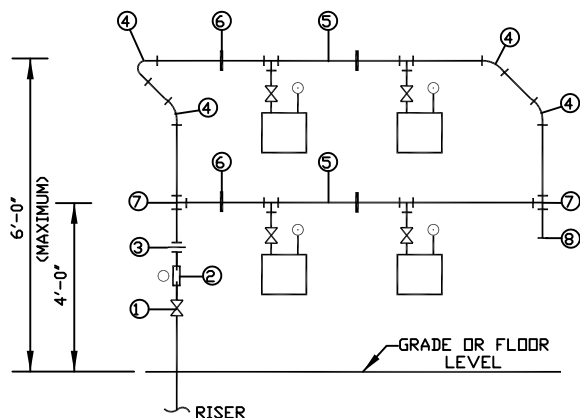

### PREFERRED METHOD

- (B) MULTIMETER "STACKED"  
FOR TWO OR MORE METERS  
(CLASS 250, 400, 800 AND 1000)

REFERENCE DRAWINGS:  
MTRS-6215 (SINGLE REGULATOR)  
MTRS-6225 (DUAL REGULATOR)  
(FOR INSIDE SETS, CLASS 175 AND 250)

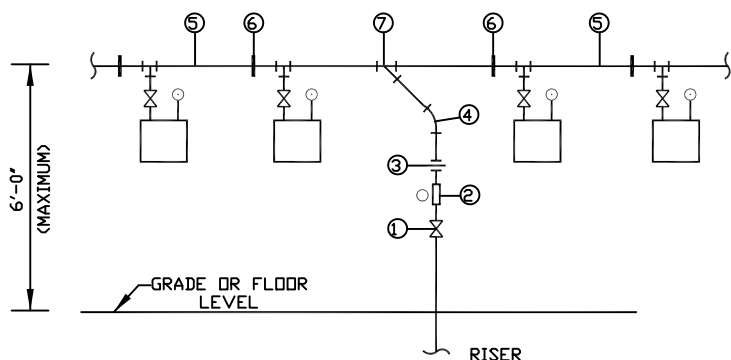

### ALTERNATE METHOD

- (C) ALTERNATE INSTALLATION  
FOR TWO TO FOUR METERS MAXIMUM  
T-CONFIGURATION  
(CLASS 250, 400, 800 AND 1000)

REFERENCE DRAWINGS:  
MTRS-6085 (SINGLE REGULATOR)

**nationalgrid**

LI

## MULTIMETER INSTALLATION HARD CASE METERS

REVISIONS: UPDATED NOTES

DATE: 7/1/2003

DESIGN: MLoP

DRAWN: MLoP

EFFECTIVE DATE: 06/18/2020

STD. DWG.  
NO.


**MTRS-6075**




ITEM	DESCRIPTION
1	VALVE (SCREW TYPE OR FLANGE)
2	SERVICE REGULATOR
3	UNION
4	90° BEND ELBOW
5	PIPE
6	SUPPORTS-PIPE, ROD OR HANGERS
7	TEE
8	DRIP LEG WITH CAP

### NOTES:

1. THIS STANDARD IS PROVIDED TO INDICATE THE AVAILABLE METERING STANDARDS FOR HANDLING COMMERCIAL CUSTOMERS HAVING MULTIPLE HARD CASE METERS.
2. INSIDE METER SETS SHALL ONLY BE INSTALLED WHEN, IN THE COMPANIES OPINION, AN OUTSIDE SET IS NOT PRACTICAL. INSIDE METER SETS SHALL NOT BE INSTALLED ON 99 AND 124 P.S.I. GAS SERVICE.
3. REFER TO CONSTRUCTION STANDARD MTRS-6215 FOR ADDITIONAL REQUIREMENTS AND NOTES ON TYPICAL MULTIMETER SET INSTALLATIONS. **THE PROPER MANIFOLD PIPING SIZES ARE ALSO PROVIDED ON A TABLE IN MTRS-6215.**
4. VENT PIPING SHALL BE INSTALLED PER 020013-CS
5. THE EXACT LAYOUT, BILL OF MATERIAL AND ADDITIONAL NOTES CAN BE FOUND ON THE APPROPRIATE REFERENCED CONSTRUCTION STANDARD.
6. DUAL REGULATORS CAN BE INSTALLED TO OBTAIN THE REQUIRED CAPACITY (WITH GAS ENGINEERING'S APPROVAL) THEY CAN ALSO BE USED WHEN CONTINUITY OF SERVICE IS A PRIORITY AS AGREED TO BY NATIONAL GRID.

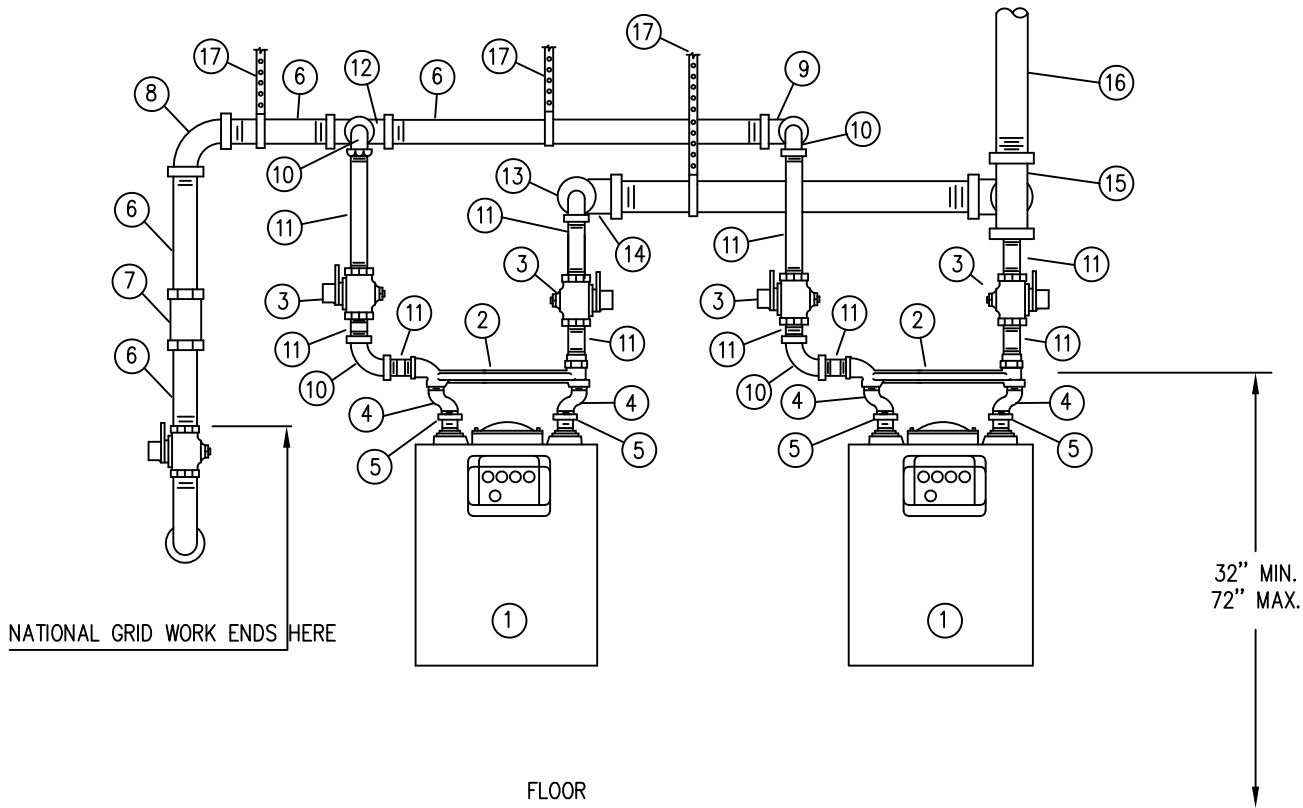

ELEVATION

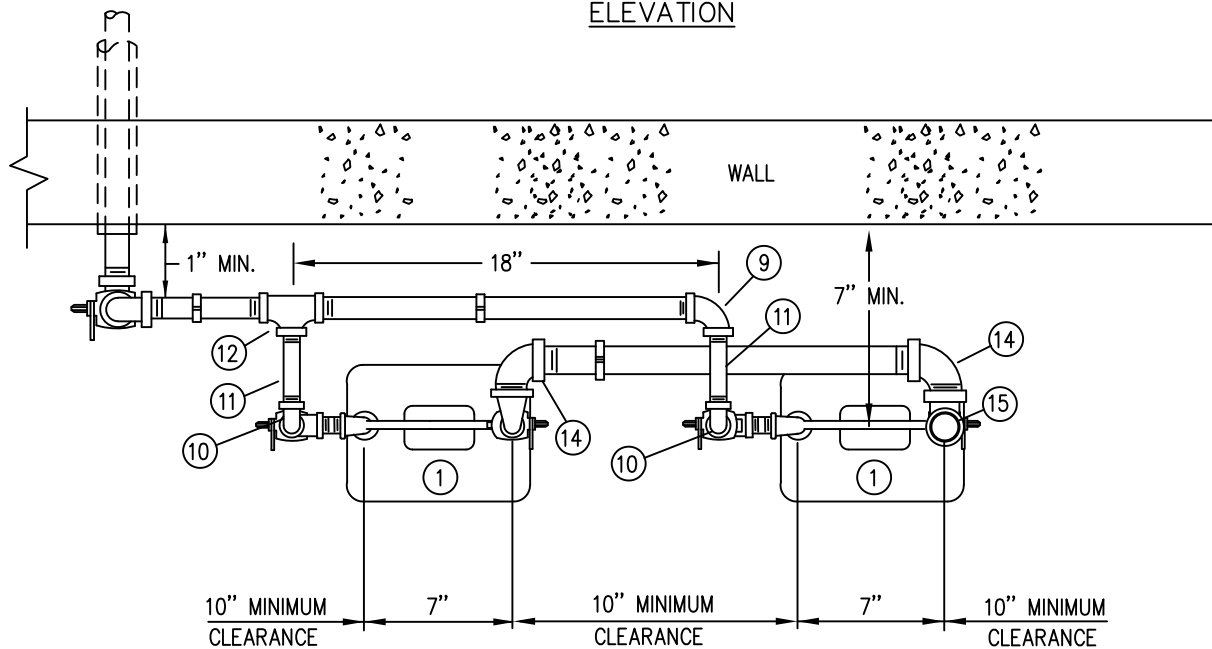

PLAN

**nationalgrid**

NEW YORK CITY

**SIAMESE INSIDE METER INSTALLATION  
0 - 425 CFH RANGE - LOW PRESSURE**

**REVISIONS:** UPDATED SAP ITEM ID #'S

DATE: 07/01/2003

DESIGN: F. TAYLOR

DRAWN: P. DIMAIO

EFFECTIVE DATE: 06/18/2020

STD. DWG.

NO.

**MTRS-6080**

**NOTES**

- A. KEY REQUIREMENTS FOR THE CONSTRUCTION OF METER HEADERS AND METER INSTALLATIONS ARE CONTAINED IN [CMS03002](#)
- B. ADDITIONAL FITTINGS MAY BE REQUIRED TO MAKE THE METER INSTALLATION.

**NOTE: ALL MATERIALS AFTER THE SERVICE VALVE WILL BE FURNISHED AND INSTALLED BY THE CUSTOMER EXCEPT FOR THE REGULATOR (FOR HIGH PRESSURE INSTALLATIONS) WHICH IS FURNISHED BY THE COMPANY AND INSTALLED BY THE CUSTOMER. THE METER, SWIVEL AND CAPS (METER NUTS) WILL BE FURNISHED AND INSTALLED BY THE COMPANY.**


**METER CHART**

METER CAPACITIES	0-425 CFH RANGE
AMERICAN	AL-425
ROCKWELL EQUIMETER SENSUS	415
SPRAGUE SCHLUMBERGER ACTARIS ITRON	400

17	PIPING SUPPORT/STRAPPING	-----	CONTRACTOR
16	HOUSE PIPING TO LOAD	HOUSE PIPE SIZE	CONTRACTOR
15	REDUCING TEE, M.I. 1-1/4" X HOUSE PIPE SIZE X	HOUSE PIPE SIZE	CONTRACTOR
14	STREET ELBOW , 90	HOUSE PIPE SIZE	CONTRACTOR
13	ELBOW , 90 M.I., SIZE OF HOUSE PIPE RISER X	1-1/4"	CONTRACTOR
12	TEE, M.I. SERVICE VALVE SIZE X	1-1/4"	CONTRACTOR
11	NIPPLE (LENGTH AS REQUIRED)	1-1/4"	CONTRACTOR
10	ELBOW, 90 M.I.	1-1/4"	CONTRACTOR
9	ELBOW, REDUCING, 90 M.I. SERVICE VALVE SIZE X	1-1/4"	CONTRACTOR
8	ELBOW, 90 M.I.	SERVICE VALVE SIZE	CONTRACTOR
7	COMPRESSION COUPLING, INSULATING, DRESSER STYLE 90	SERVICE VALVE SIZE	CONTRACTOR
6	NIPPLE 4" MINIMUM (LENGTH AS REQUIRED )	SERVICE VALVE SIZE	CONTRACTOR
5	NUT FOR 30 LT METER,/ CAP CONNECTION	9312381	NAT. GRID
4	SWIVEL METER, OFFSET, 1" X 30 LT	9342450	NAT. GRID
3	VALVE, LOCK WING TAMPER PROOF, MUELLER H-11175 OR AYMCDONALD 560B OR APPROVED EQUAL	9308487	CONTRACTOR
2	METER BAR 1-1/4" SIDE INLET – TOP OUTLET METER BAR 1-1/4" SIDE INLET – SIDE OUTLET – GALVANIZED METER BAR 1" SIDE INLET – TOP OUTLET	9339756 9383209 9339755	CONTRACTOR
1	METER	425 TYPE	NAT. GRID
No.	ITEM	NAT. GRID CODE NO.	SUPPLIED BY

**BILL OF MATERIAL**

# "T" CONFIGURATION

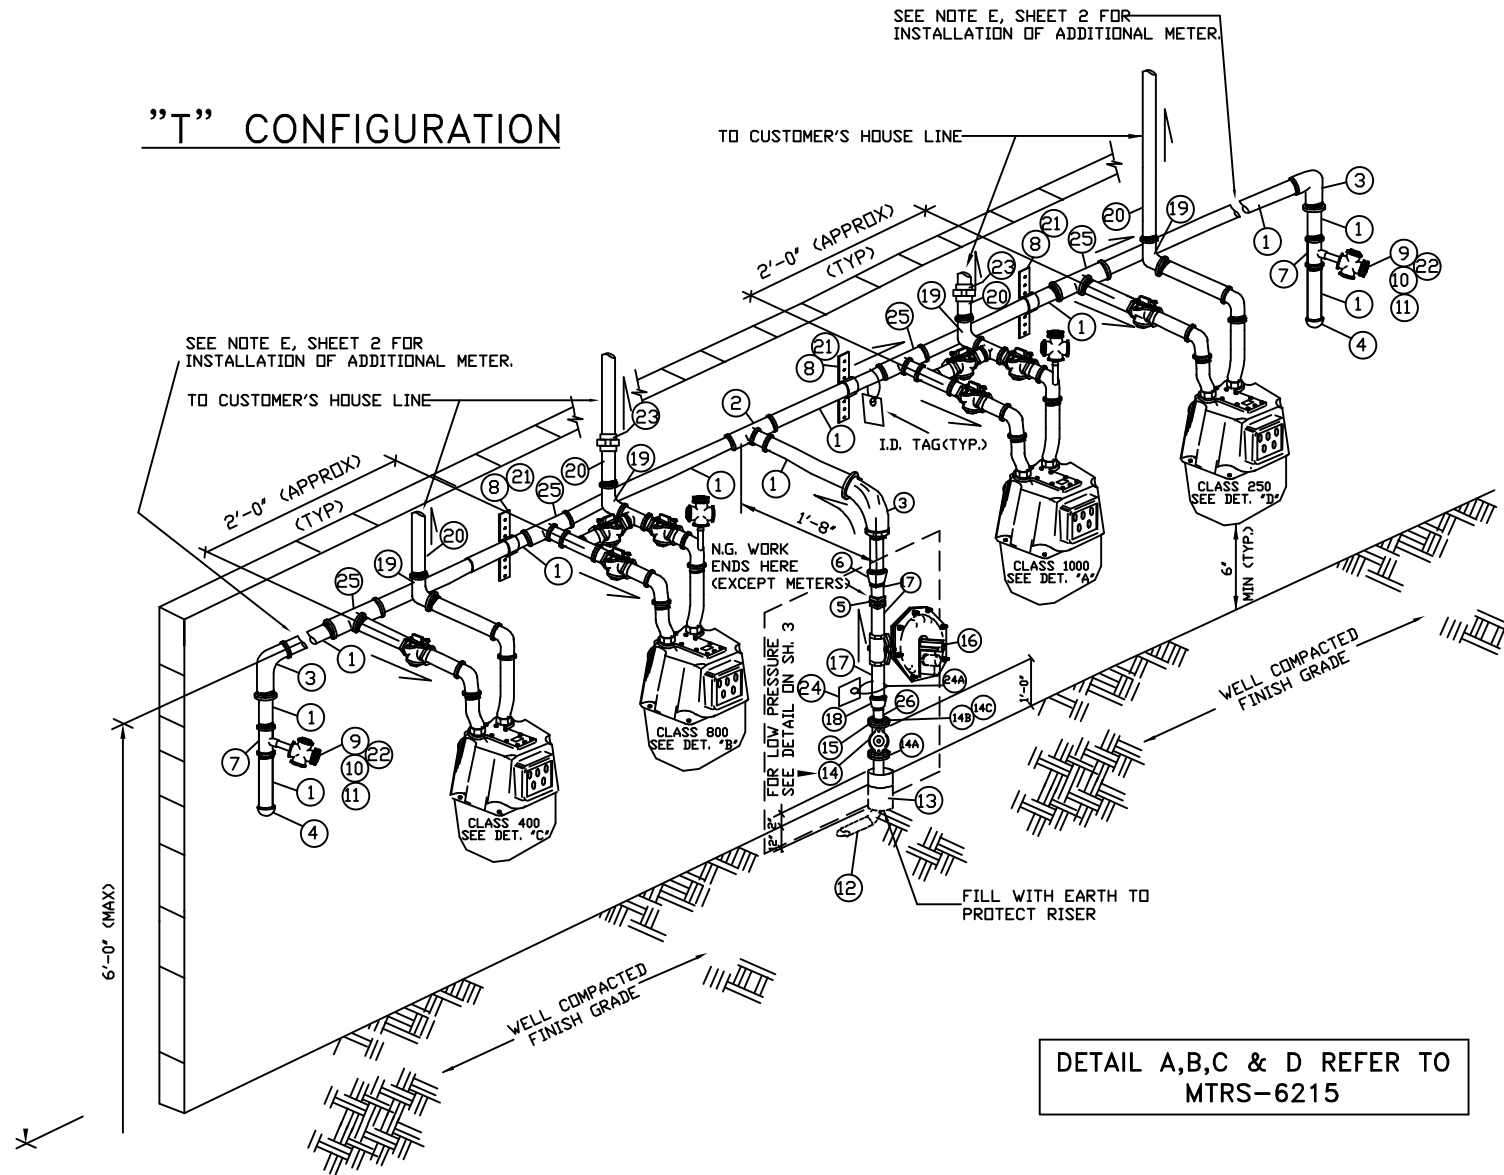

**nationalgrid**

LONG ISLAND

## TYPICAL MULTIMETER CONFIGURATION FOR CLASS 250, 400, 800 AND 1000 WITH SINGLE AND DUAL REGULATORS

REVISIONS: UPDATED PAGE 1 AND LINKS

DATE: 07/01/2003

DESIGN: GJK

DRAWN: MLoP

EFFECTIVE DATE: 03/27/2025

STD. DWG.

NO. **MTRS-6085**

**NOTES**


- A. NAT. GRID WILL SUPPLY AND INSTALL ITEMS 12 THRU 18 AND ITEMS 22 THRU 24A.  
 B. SEE MTRS – 6215 FOR DIFFERENT METER HEADER PIPE SIZES.  
 C. FOR ITEM ID'S FOR ITEMS 27 THRU 43 ON SEE SHEETS 4 THRU 7 FOR APPROPRIATE METER CLASS.  
 D. FOR HIGH AND LOW PRESSURE INSTALLATIONS; USE A THREADED TYPE VALVE WHEN THE OUTLET OF RISER IS 1 ¼" AND A FLANGE VALVE WITH GASKETS AND ETC. WHEN THE RISER OUTLET IS 2" OR LARGER.  
 E. ADDITIONAL METER SETS CAN BE ADDED BY THE USE OF A FULL TEE (ITEM 25). SEE SHEET 1.  
 F. FOR ADDITIONAL NOTES SEE [MTRS-6215](#).  
 G. **CUSTOMER TO INSTALL BRASS OR ALUMINUM PERMANENT ID TAG ON EACH METER STAMPED OR ENGRAVED WITH STORE # / APARTMENT NUMBER/ UNIT # OR ADDRESS.**  
 H. DO NOT EXCEED 3 METERS IN ONE BRANCH. AFTER 3 METERS, INSTALL A LOOPED PIPING HEADER AS SHOWN IN [MTRS-6215](#).

**LEGEND:**

- + - AS REQUIRED  
 ++ - TO BE SUPPLIED BY FIELD OPERATIONS  
 \*\* - SUPPLIED BY CUSTOMER

26	NIPPLE – AS REQUIRED	+	NAT. GRID
25	TEE: 1 PER METER – SIZE AS REQUIRED (SEE DET. A,B,C,D, <a href="#">MTRS-6215</a> )	+	**
24A	STRIP – 14” – SELF LOCKING - NYLON	1	9325971
24	TAG – GAS SERVICE LOCATION (CPR TAG)	1	9340255
23	UNION – GALVANIZED, HOUSE LINE SIZE	+	**
22	GAS SNAPLOCK	2	9330915
21	SUPPORT PIPE OR ROD – 1” (OPTION)	+	**
20	HOUSE LINE – SIZE AND QUANTITY AS REQ'D	+	**
19	ELBOW – SIZE AND QUANTITY AS REQ'D	+	**
18	REDUCER (IF REQUIRED)	1	NAT. GRID
17	NIPPLE	+	NAT. GRID
16	REGULATOR – 1 ¼” OR 2” – RELIEF / MONITOR	1	*
15	GASKET RING	1	NAT. GRID
14C	FLANGE – WELD NECK (FOR FLANGED TYPE VALVE ONLY)	2	NAT. GRID
14B	BOLT – 5/8” X 2 ¾” A3 07– MACHINE	8	9339766
14A	GASKET – INSULATED FLANGE KIT	1	NAT. GRID
14	VALVE (SEE #4 BELOW)	1	NAT. GRID
13	SLEEVE – PIPE – PLASTIC OR EQUIVALENT	1	NAT. GRID
12	RISER – SERVICE (PRIMED & PAINTED) – SIZE AS REQUIRED	1	NAT. GRID
11	PLUG- 3 / 4” – THREADED	2	**
10	METER COCK – 3 / 4” – LOCKWING	2	**
9	NIPPLE – ¾” X 3”	2	**
8	CHANNEL – 1 5 / 8”UNISTRUT W/CLAMP (SEE ITEM 21)	+	**
7	TEE – BULL – SIZE AS REQUIRED	2	**
6	REDUCER (IF REQUIRED)	1	**
5	UNION – INSULATED (ONLY IF SCREWED VALVE IS USED AND SERVICE IS STEEL)	1	**
4	CAP	2	**
3	ELBOW – 90 DEGREE	3	**
2	TEE – (EQUAL TO SIZE OF HEADER)	1	**
1	PIPE – AND LENGTH AS REQ'D (REFER TO NOTE C)	+	**
			4 METER SETS
No.	ITEM	NAT. GRID	
BILL OF MATERIAL			

↑ FOR CONTINUATION  
SEE SH. 1

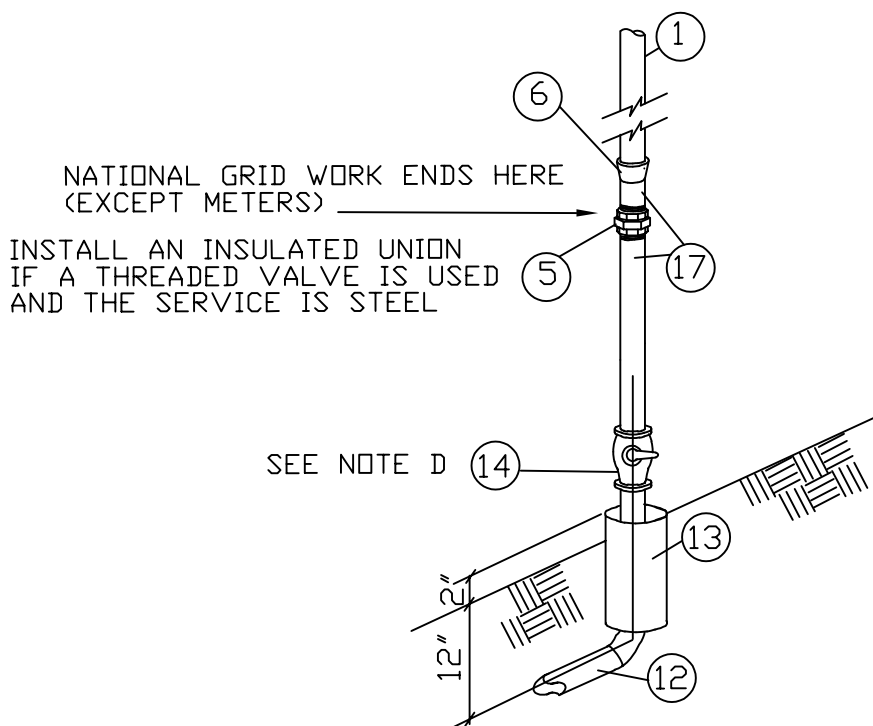


RISER CONFIGURATION  
FOR LOW PRESSURE SERVICE

SEE SHEET 2 OF 5 FOR BILL OF MATERIAL

"T" CONFIGURATION  
DUAL REGULATORS

SEE SHEET 1 FOR  
ADDITIONAL METER  
INSTALLATIONS

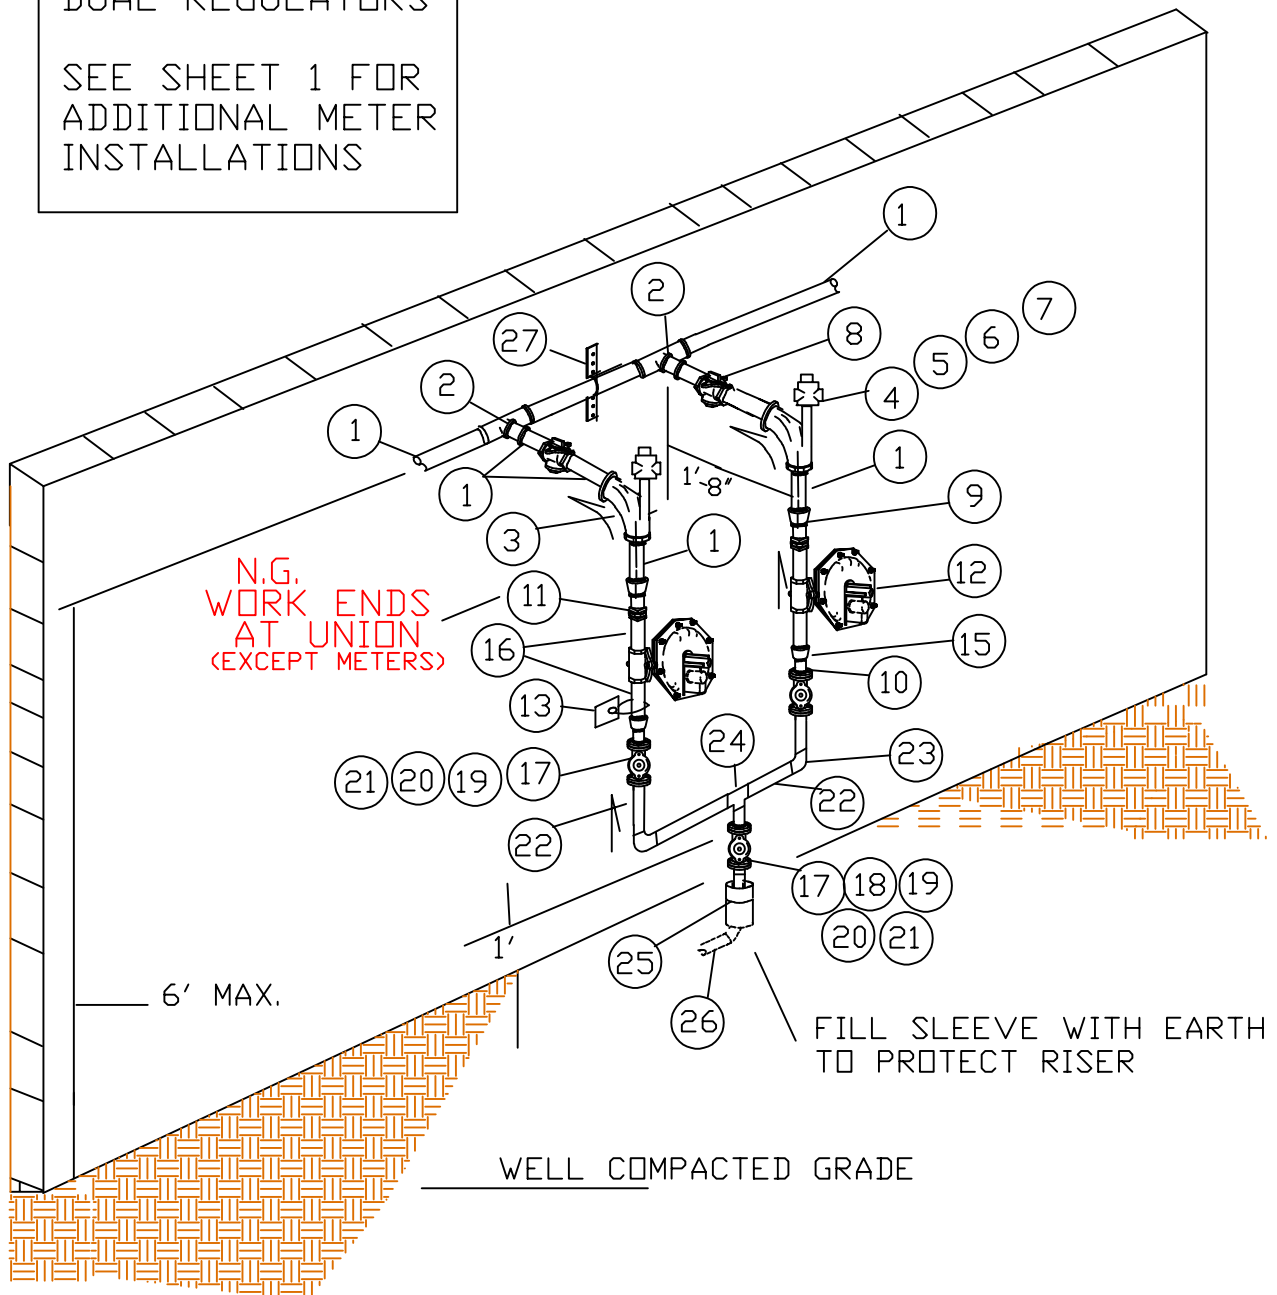

**NOTES**

1. SEE SHEET 3 OF [MTRS-6215](#) FOR DIFFERENT METER HEADER PIPE SIZES.
2. FOR ADDITIONAL NOTES REGARDING METER HEADER CONFIGURATIONS SEE [MTRS-6215](#).
3. PARALLEL REGULATORS ARE TO BE INSTALLED ONLY WHEN CONTINUITY OF SUPPLY IS A PRIORITY FACTOR. BOTH FIELD OPERATIONS AND GAS CONSTRUCTION MUST AGREE ON FINAL DESIGN PRIOR TO GIVING CUSTOMER APPROVAL. ALSO SEE NOTE I ON [MTRS-6545](#).
4. USE A SCREW TYPE VALVE FOR 1 ¼" RISER AND A FLANGE TYPE VALVE FOR 2" RISERS. (ITEM 17). IF ITEM 17 IS A SCREW VALVE ITEMS 18, 19, 20 AND 21 IS NOT REQUIRED.

\* SEE [CMS-03002](#) FOR PROPER REGULATOR , SELECTION AND SIZING

+ AS REQUIRED

\*\* TO BE SUPPLIED BY CUSTOMER

27	1 5/8" STRUT CHANNEL WITH CLAMP	+	**
26	RISER – SERVICE – SIZE AS REQUIRED	1	NAT. GRID
25	SLEEVE – PIPE PLASTIC OR EQUIVALENT	1	NAT. GRID
24	TEE 3WAY – SIZE AS REQUIRED	1	
23	ELBOW 90 DEG. – SIZE AS REQUIRED	2	NAT. GRID
22	NIPPLE – SIZE AS REQUIRED	+	
21	FLANGE – SIZE AS REQUIRED	6	
20	GASKET – SIZE AS REQUIRED	5	
19	BOLTS – 5/8" X 2 ¾"	24	NAT. GRID
18	GASKET – INSULATED – SIZE AS REQUIRED	1	
17	VALVE – SIZE AS REQUIRED (SEE NOTE 4)	3	
16	NIPPLE – SIZE AS REQUIRED	+	NAT. GRID
15	REDUCER – SIZE AS REQUIRED	2	NAT. GRID
14	STRAP – SELF LOCKING	2	9325971
13	TAG – GAS SERVICE LOCATION	1	9340255
12	REGULATOR – 1-1/4" OR 2" RELIEF / MONITOR	2	*
11	UNION – IF REQUIRED	2	NAT. GRID
10	NIPPLE – SIZE AND LENGTH AS REQUIRED	2	NAT. GRID
9	REDUCER – IF REQUIRED	2	**
8	VALVE – SCREW – SIZE EQUAL TO HEADER DIAMETER	2	**
7	GAS SNAP LOCK	2	9330915
6	PLUG – ¾" SCREW	2	**
5	NIPPLE ¾" X 3"	2	**
4	VALVE – LOCKWING ¾"	2	**
3	TEE – HEEL SIZE X ¾"	2	**
2	TEE – 3 - WAY – SIZE AS REQUIRED	2	**
1	PIPE – SIZE AND LENGTH AS REQUIRED	+	**
No.	ITEM	NAT. GRID CODE No.	
BILL OF MATERIAL			



**NOTE:** FOR HIGH PRESSURE SERVICES:  
When 2 meters manifold piping can be 1".  
When 3 meters are to be installed  
which has a maximum load of  
750 Cubic Feet per Hour,  
the manifolds shall be a minimum  
of 1 1/4" in diameter.  
See note I

## HIGH PRESSURE

See Detail A for  
Low Pressure  
installation.

See Note C

Service  
Termination

See Note K

See Note B  
**MINIMUM 12"  
PREFERRED 18"**

See Note D



**FOR LOW PRESSURE SERVICES  
PIPING SHALL BE 1-1/4" MIN.**

See Detail B for  
3 meter installation.  
See Note F

## LOW PRESSURE INSTALLATION


### DETAIL A

See Notes A and C

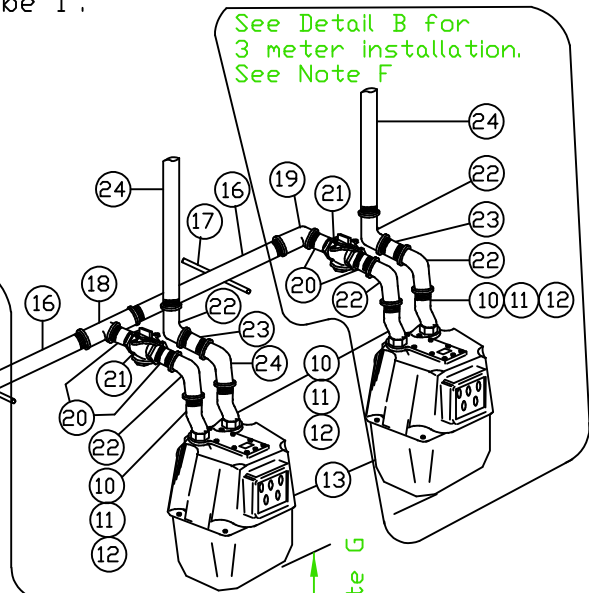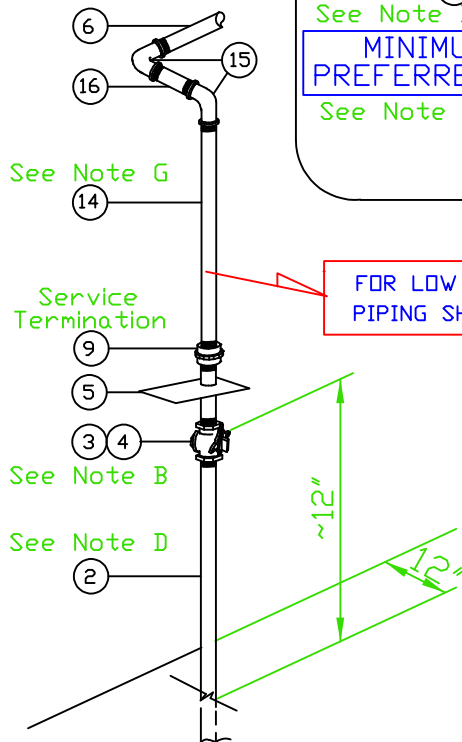

## 3 METER INSTALLATION DETAIL B

See Note F

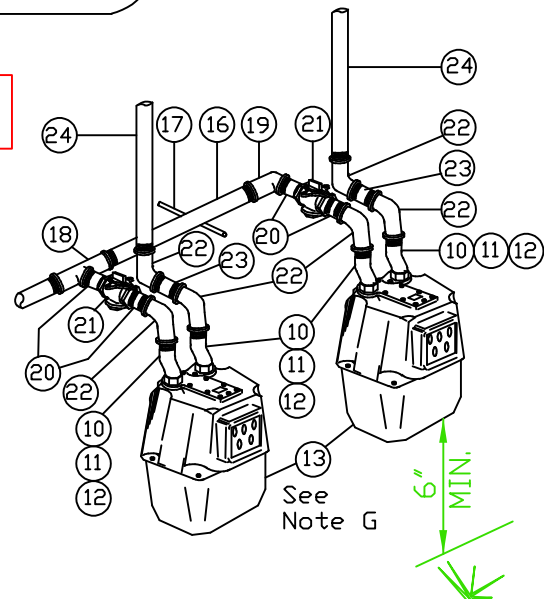

**nationalgrid**

LONG ISLAND

## OUTDOOR MULTIPLE METER HEADERS FOR CLASS 175 OR 250 C.F.H. METERS

**REVISIONS:** [UPDATED LINKS](#)

DATE: 07/01/2003

EFFECTIVE DATE: 04/22/2025

DESIGN: MLoP/PAUL GUGLIOTTA

STD. DWG.

DRAWN: MLoP

NO. **MTRS-6095**

# NOTES


- A. NATIONAL GRID SHALL SUPPLY AND INSTALL ITEMS 1 THROUGH 13 INCLUSIVE.
  - B. AFTER PURGING A NEW SERVICE AND BEFORE INSTALLING ANY METER, THE LOCKWING METER VALVE (ITEM NO. 3) SHALL BE LOCKED BY NATIONAL GRID WITH A GAS SNAP LOCK. SHOULD ONE OF THE METERS REQUIRE SERVICE BEFORE THE OTHERS, THE LOCKWING METER VALVES (ITEM NO. 21) TO THE METERS NOT YET READY FOR SERVICE SHALL BE LOCKED BY NATIONAL GRID.
  - C. ALL PIPE AND FITTINGS SHALL BE GALVANIZED.
  - D. RISER PIPE AND METER SET SHALL BE LOCATED TO PREVENT PHYSICAL DAMAGE TO THE INSTALLATION BY VEHICLES OR OTHER MECHANICAL DEVICES. REFER TO [CMS03002](#) AND [MTRS6060](#).
  - E. MAINTAIN 1/2" MINIMUM CLEARANCE BETWEEN REGULATOR AND METER CASE OR ANY OTHER FOREIGN STRUCTURE. SWING REGULATOR IF NECESSARY TO OBTAIN CLEARANCE.
  - F. **CUSTOMER TO INSTALL BRASS OR ALUMINUM PERMANENT ID TAG ON EACH METER OUTLET PIPING (ITEM NO. 23 OR 24) STAMPED OR ENGRAVED WITH STORE # / APARTMENT # / UNIT OR ADDRESS**
  - G. PROPER LENGTH OF NIPPLE (ITEM NO. 8 OR 14) ABOVE UNION (ITEM NO. 9) SHALL BE SELECTED SO THAT THE TOP OF THE METER SHALL NOT EXCEED 6 FEET ABOVE GROUND LEVEL. BOTTOM OF THE METER SHALL NEVER BE LESS THAN 4 INCHES ABOVE GROUND LEVEL.
  - H. VENT PIPING SIZE, LENGTH AND NUMBER OF ELBOWS SHALL MEET THE REQUIREMENTS OF [CMS-03002](#), AND [020013-CS](#).
  - I. **1-1/4" PIPING IS PREFERRED; HOWEVER, TWO 250 METERS OFF A HIGH PRESSURE SERVICE MAY USE 1" PIPING FOR THE MANIFOLD. FOR THREE 250 METERS OFF AN HIGH PRESSURE SERVICE OR TWO OR THREE METERS OFF A LOW PRESSURE SERVICE, THE MANIFOLD PIPING SHALL BE 1-1/4" DIAMETER MINIMM. FOR MORE THAN THREE METERS AND HIGHER LOADS, REFER TO MTRS-6215**
  - J. THE GAS SERVICE LOCATION TAG SHALL BE INSTALLED PER [SERV-6305](#)
  - K. SEE [020013-CS](#) FOR VENT PIPING LOCATION. IT IS PREFERRED THAT REGULATOR VENTS BE INSTALLED AT A HEIGHT 18 INCHES ABOVE GRADE, HOWEVER, THE MINIMUM ALLOWABLE VENT HEIGHT SHALL BE 12 INCHES ABOVE FINAL GRADE. IN CASES OF KNOWN FLOOD LOCATIONS, THE PREFERRED REGULATOR VENT HEIGHT ABOVE THE FLOOD HEIGHT IS 18" (12" MINIMUM). THE REGULATOR VENT SHALL BE 18" (WHERE PRACTICAL) FROM ANY OPENING WHICH COULD ALLOW VENTED GAS TO ENTER.
- \* \* SUPPLIED AND INSTALLED BY THE CUSTOMER X X TO BE SUPPLIED BY FIELD OPERATIONS + AS REQUIRED**

24	CUSTOMER HOUSE LINE	+	**	+	**	+	**	+	**
23	NIPPLE – 1" X AS REQUIRED	2	**	3	**	2	**	3	**
22	ELBOW - 1" 90 DEGREE	6	**	9	**	6	**	9	**
21	METERCOCK – LOCKWING – 1"	2	**	3	**	2	**	3	**
20	NIPPLE – 1" X 3"	4	**	6	**	4	**	6	**
19	ELBOW – 1" OR 1 ¼" X 1" – 90 DGREE - REDUCING	1	1"	1	1"	1	1-1/4"	1	1-1/4"
18	TEE – 1"X1"X1" OR 1 ¼" X 1 ¼"X 1" - REDUCING	1	1"	2	1"	1	1-1/4"X1"	2	1-1/4"X1"
17	ROD OR PIPE – ½" OR GAL. PIPE STRAPS	+	**	+	**	+	**	+	**
16	NIPPLE – 1" OR 1 ¼" X LENGTH AS REQUIRED	1	1"	2	1"	1	1-1/4"	2	1-1/4"
15	ELBOW – 1 ¼" – 90 DEGREE – GALV . OR 1-1'4" X 1" REDUCING FOR 1" HEADERS	2	**	2	**	2	**	2	**
14	NIPPLE – 1 ¼" X 12"	2	**	3	**	2	**	3	**
13	GAS METER – TEMP . COMPENSATED GAS – 175 OR 250 CLASS	2	X X	3	X X	2	X X	3	X X
12	METER NUT GASKET – 20 LIGHT	4	9312524	6	9312524	4	9312524	6	9312524
11	METER NUT – 20 LIGHT	4	9340787	6	9340787	4	9340787	6	9340787
10	METER SWIVEL – 1" X 20 LIGHT	4	9383109	6	9383109	4	9383109	6	9383109
9	INSULATED UNION – 1" OR 1 ¼" – GALV.	1	9341691	1	9341691	1	9341691	1	9341691
8	NIPPLE – 1" OR 1 ¼" X 3" – GALV. – THREADED END	1	**	1	**	-	-	-	-
7	REGULATOR – 1 ¼" –15# MAX INLET – ¼" ORIFICE REGULATOR – 1 ¼" –60# MAX INLET – 3/16" ORIFICE REGULATOR – 1 ¼" –124# MAX INLET – 1/8" ORIFICE	1	9342623 9342206 9383127	1	9342623 9342206 9383127	-	-	-	-
6	NIPPLE – 1 ¼" X 4" – GALV. – THREADED END	2	9340652	2	9340652	1	**	1	**
5	GAS SERVICE LOCATION TAG TAG – SYSTEM PRESSURE - ALUMINUM	1 1	9340255 9346233	1 1	9340255 9346233	1 1	9340255 9346233	1 1	9340255 9346233
4	GAS SNAP LOCK	1	9330915	1	9330915	1	9330915	1	9330915
3	LOCKWING METER VALVE – 1 ¼" – THREADED END	1	9339609	1	9339609	1	9339609	1	9339609
2	RISER – 1 ¼" C.T.S. PLASTIC X 1 ¼" I.P.S. STEEL - PREBENT	-	-	1	-	1	9340941	1	9340941
1	RISER – 1" C.T.S. PLASTIC X 1 ¼" I.P.S. STEEL - PREBENT	1	9340874	1	9340874	1	-	-	-
		2 METER	3 METER			2 METER		3 METER	
		HIGH PRESSURE (60 PSIG)				LOW PRESSURE (6" W.C.)			
No.	ITEM						NG ITEM ID		

## BILL OF MATERIAL

# HORIZONTAL CONFIGURATION

SEE NOTE E, SHEET 2 FOR  
INSTALLATION OF ADDITIONAL METER.

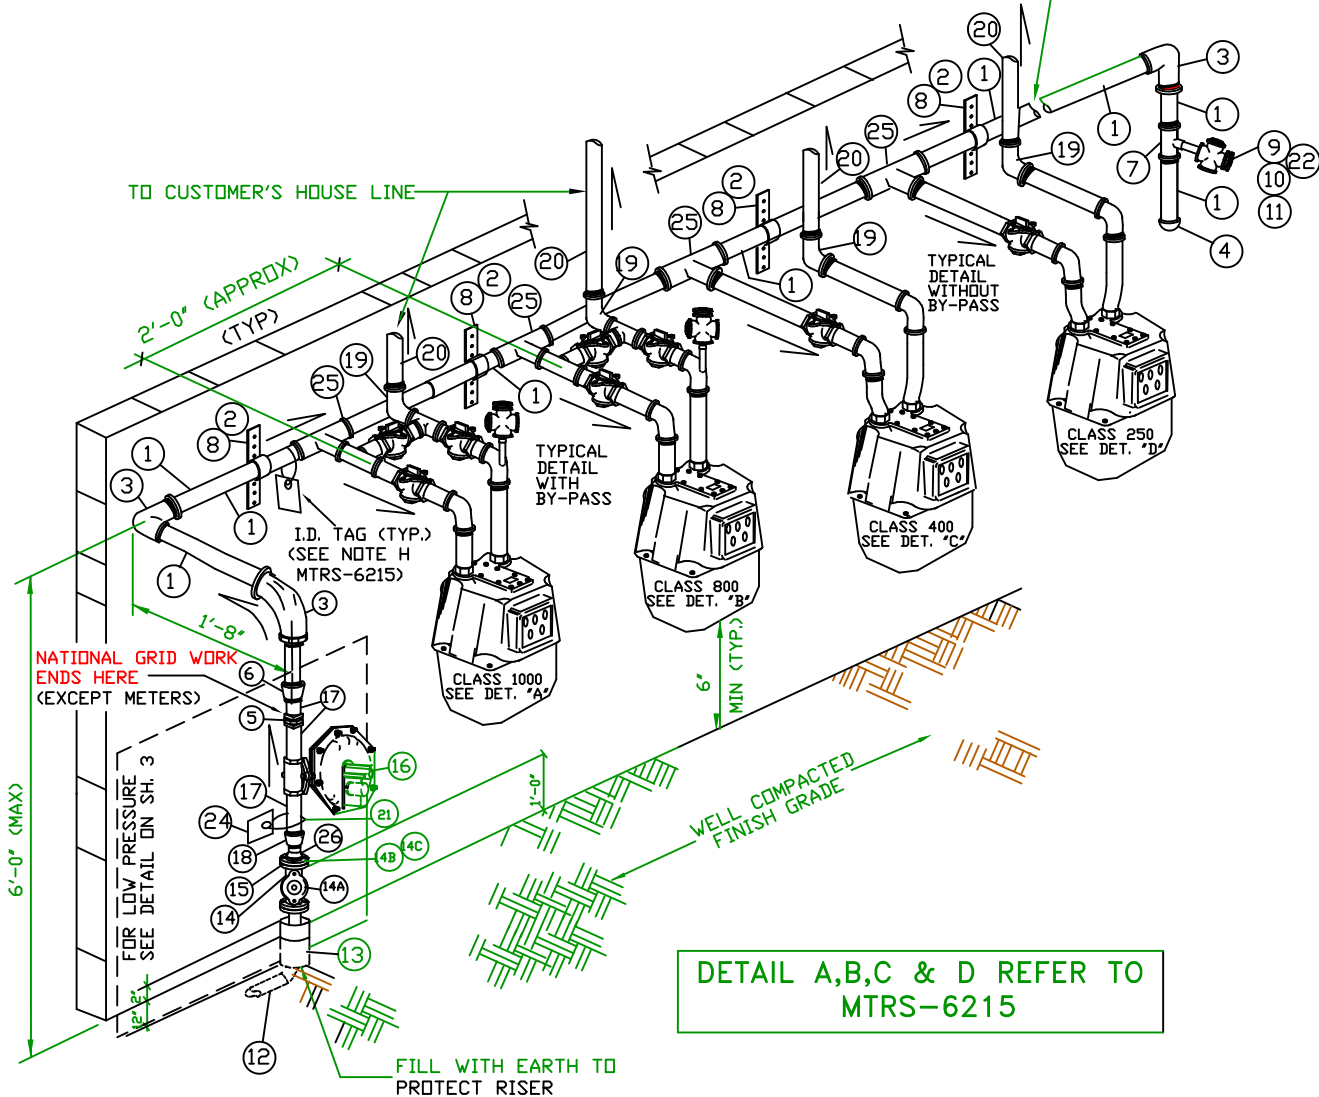

**FOR REFERENCE ONLY  
SEE MTRS-6215 FOR  
NEW CONSTRUCTION**

**nationalgrid**

LONG ISLAND

**TYPICAL MULTIMETER CONFIGURATION  
FOR CLASS 250, 400, 800 AND 1000  
WITH SINGLE REGULATOR**

**REVISIONS:** MADE FOR REFERENCE ONLY

DATE: 07/01/2003

DESIGN: MLoP

DRAWN: JAL

EFFECTIVE DATE: 11/25/2004

STD. DWG.

NO. **MTRS-6115**

**NOTES**


- A. NATIONAL GRID WILL SUPPLY AND INSTALL ITEMS 12 THRU 18 AND ITEMS 22 THRU 24.  
 B. FOR HIGH AND LOW PRESSURE INSTALLATIONS: USE A SCREW TYPE VALVE FOR 1 1/4" RISER. FOR 2" RISER USE FLANGE TYPE PLUG VALVE.  
 C. ADDITIONAL METER SETS CAN BE INSTALLED BY THE USE OF A FULL TEE (ITEM 25). SEE SHEET1.  
 D. SEE SHEET 3 OF MTRS -6215 FOR DIFFERENT METER HEADER PIPE SIZES.  
 E. FOR ADDITIONAL NOTES SEE MTRS 6215  
 F. FOR ITEM ID'S ON ITEMS 27 THRU 43, SEE SHEETS 4 THRU 7 OF MTRS - 6215 WHICHEVER APPROPRIATE CLASS OF METER APPLIES.

**LEGEND:**

- + - AS REQUIRED  
 ++ - TO BE SUPPLIED BY KED  
 \*\* - SUPPLIED BY CUSTOMER  
 \* - SEE DESIGN SECTION FOR PROPER REGULATOR SELECTION AND SIZING

26	NIPPLE (AS REQUIRED)	+	**
25	TEE: 1 PER METER, SIZE AS REQUIRED (SEE DET. A,B,C,D, MTRS 6215)	+	**
24	TAG – GAS SERVICE LOCATION (CPR TAG)	1	9340255
23	NOT USED		
22	GAS SNAP LOCK	1	9330915
21	STAINLESS STEEL CLAMP	1	9307872
20	HOUSE LINE – SIZE AND QUANTITY AS REQ'D	+	**
19	ELBOW – SIZE AND QUANTITY AS REQ'D	+	**
18	REDUCER (IF REQUIRED)	1	NAT. GRID
17	NIPPLE	+	NAT. GRID
16	REGULATOR – 1 1/4" OR 2" – RELIEF / MONITOR	1	*
15	GASKET RING	1	NAT. GRID
14 C	FFLANGE - WELDED NECK (FOR FLANGED TYPE VALVE ONLY)	2	NATGRID
14 B	BOLT – 5 /8" X 2 3 /4" B7 - MACHINE OR BOLT - STUD 5/8" X 4" WITH 2 NUTS ANTI CORROSION	8	9339766 9392186
14 A	GASKET – INSULATED – FLANGE KIT	1	NAT. GRID
14	VALVE (SEE NOTE # B)	1	NAT. GRID
13	PIPE SLEEVE – PLASTIC OR EQUIVALENT	1	NAT. GRID
12	RISER – SERVICE (PRIMED & PAINTED) – SIZE AS REQUIRED	1	NAT. GRID
11	PLUG – 3 /4" - THREADED	1	**
10	METER COCK – 3 /4" - LOCKWING	1	**
9	NIPPLE – 3 /4" X 3"	1	**
8	CHANNEL – 1 5/8" – UNISTRUT W/ CLAMP (SEE ITEM 21)	+	**
7	TEE – BULL – SIZE AS REQUIRED	1	**
6	REDUCER (IF REQUIRED)	1	**
5	UNION – INSULATED (ONLY IF THREADED VALVE IS USED)	1	**
4	CAP	1	**
3	ELBOW – 90 DEGREE (EQUAL TO SIZE OF HEADER)	3	**
2	SUPPORT PIPE OR ROD – 1" (OPTION)	+	**
1	PIPE – SIZE AND LENGTH AS REQ'D (REFER TO NOTE C)	+	**
N o.	ITEM	ITEM ID	
BILL OF MATERIAL			

↑ FOR CONTINUATION  
SEE SHEET 1

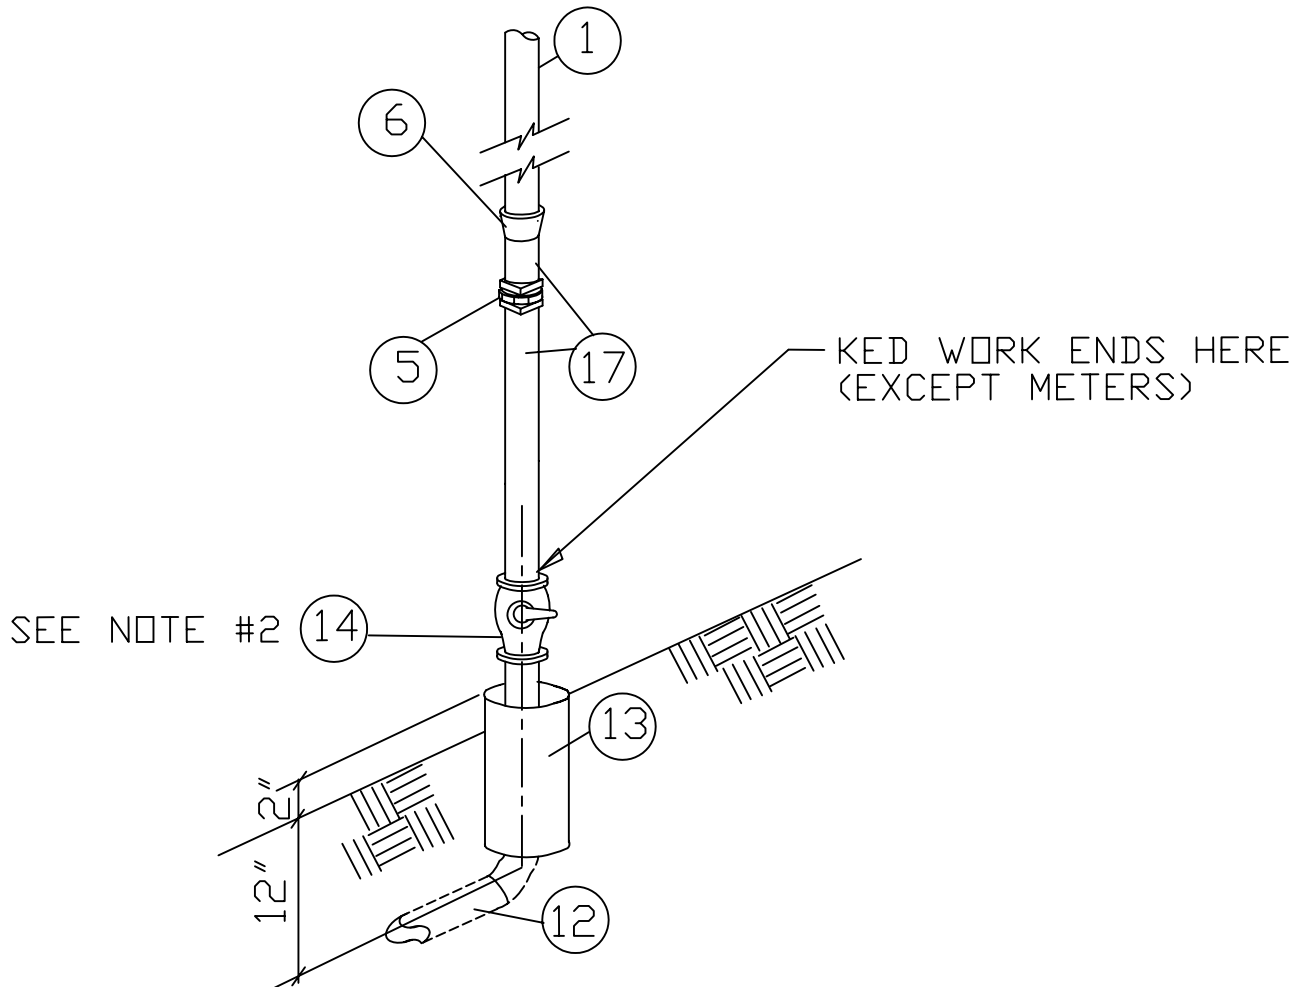

FOR 1 1/4" LOW PRESSURE SERVICE

**FOR REFERENCE ONLY  
SEE MTRS-6215 FOR NEW  
CONSTRUCTION**



**NOTES**

- A. NOTE KEY REQUIREMENTS FOR THE CONSTRUCTION OF METER HEADERS AND METER INSTALLATION ARE CONTAINED IN NAT. GRID SPECIFICATIONS CMS03002.
- B. ADDITIONAL FITTINGS MAY BE NEEDED TO MAKE THE METER INSTALLATION.
- C. NAT. GRID SHALL NOT BE RESPONSIBLE FOR FITTING DIMENSIONS OR FOR SCALED DIMENSIONS.
- D. RECOMMENDED SETTINGS FOR REGULATORS AS FOLLOWS.  
 (A) ONE SET AT 6" W.C. AND THE SECOND SET AT 5.5" W.C. FOR NEW INSTALLATIONS.  
 (B) ONE SET AT 6.5" W.C. AND THE SECOND SET AT 6" W.C. FOR EXISTING INSTALLATIONS.
- E. A MAXIMUM SETTING OF 8" W.C. IS TO BE USED ONLY WHEN THERE IS A PROBLEM OF UNDER FIRE EQUIPMENT (FOR EXISTING INST. ONLY).
- F. ALWAYS SET THE OUTLET OF THE REGULATOR SO THERE IS 0.5" W.C. DIFFERENTIAL IN STATIC PRESSURE POINTS.
- G. IF LENGTHS "X" OR "Y" ARE GREATER THAN 4'-0" AND DO NOT EXCEED 9'-0", A METER ROOM WITH THREE (3) HOUR FIRE RATING CONSTRUCTION AND ADEQUATE VENTILATION IS REQUIRED. FOR INSTALLATION GREATER THAN 9'-0", CONTACT SYSTEM DESIGN SECTION, DFS.
- H. A MINIMUM OF 5'-0" OF CLEAR SPACE AROUND THE METER AND REGULATOR INSTALLATION MUST BE MAINTAINED.
- I. FOR FLOW RATES BELOW 470 CFH (60 PSIG SYSTEM) SEE STANDARD DRAWING MTRS – 6140
- J. FOR FLOW RATES BELOW 775 CFH (15 PSIG SYSTEM) SEE STANDARD DRAWING MTRS – 6050
- K. FOR FLOW RATES THAN 940 CFH (60 PSIG SYSTEM) OR 1550 CFH (15 PSIG SYSTEM) SEE SPECIAL ENGINEERING METER AND REGULATOR LAYOUT.
- L. PURGE POINTS SHALL BE 1/2" THREDOLET, OR A SCREW REDUCING TEE MAY BE USED AS AN ALTERNATE. SAM LOCK PLUGS TO BE INSTALLED BY FIELD SERVICE IF REQUIRED.
- M. VERTICAL PIPE SUPPORTS SHALL BE ADEQUATELY SEALED FROM WATER INFILTRATION AND PROPERLY COATED TO RESIST CORROSION.
- N. FOR OUTSIDE SETS, A FULLY ENCLOSED (INCLUDING TOP) CHAIN LINK FENCE MAY BE REQUIRED, DEPENDING ON AREA OR METER LOCATION. FENCE GATE SHALL HAVE CHAIN WITH DOUBLE LOCK, ONE PADLOCK AND ONE BULLET LOCK.
- O. COAT ALL PIPE AND FITTINGS WITH RUSTOLEUM #7715 OR EQUAL. TWO COATS REQUIRED, BRUSH APPLIED. ALSO SERVICE VALVE MUST BE PAINTED RED.
- P. REGULATOR VENT HEAD ASSEMBLY MUST FACE DOWN. VENT TERMINUS MUST BE A MINIMUM OF 6 FT. ABOVE OUTSIDE GRADE FOR NON-DOMESTIC AND 18" FOR DOMESTIC INSTALLATIONS. A MINIMUM OF 18" MUST BE MAINTAINED FROM ANY OPENINGS.
- Q. DO NOT WELD WITH METER IN LINE-USE SPOOL PIECE.
- R. THE METER IS DESIGNED FOR DIRECT IN –THE-LINE MOUNTING AND LEVEL POSITION. THE ALTERNATE INSTALLATION IS TOP INLET IN A VERTICAL LINE, GAS FLOW BEING DOWNWARD.
- S. CONCRETE PAD FOR METER TO BE 4" THICK, 5' WIDE, LENGTH TO BE DETERMINED BY LENGTH OF METER RUN.  
 INSIDE INSTALLATION OF STRAINERS PERMITTED WHEN OUTSIDE INSTALLATION IS IMPRACTICABLE. FOR FURTHER CLARIFICATION CONTACT STANDARDS AND PRACTICES SECTION NAT. GRID.

22	PLUG 1/2" M.I. SOLID		1/2"	1/2"	customer
21	VALVE 1/2" LOCK WING AY MCDONALD 560B OR MUELLER H-11175		1/2"	1/2"	customer
20	NIPPLE 1/2" X 3" LONG SCH. 40 - THREADED		1/2" X 3"	1/2" X 3"	customer
19	TEE M.I. 1-1/2" X 1/2" THREADED		1-1/2" X 1/2"	1-1/2" X 1/2"	customer
18	COCK, LOCK WING, LUB-O-SEAL, MUELLER H11175, LOCK CLOSED OR APPROVED EQUAL		3/4"	3/4"	NAT. GRID
17	REDUCER	15 PSIG SERVICE 60 PSIG SERVICE	1-1/2"X1-1/4" 1-1/2"X1"	1-1/2"X1-1/4" 1-1/2"X1"	customer
16	PIPE STRAPS/SUPPORT (NEOPRENE OR EQUAL BETWEEN THE SUPPORT AND THE PIPE) SEE NOTE M		LENGTH AS REQ'D	LENGTH AS REQ'D	customer
15	TEE, M.I.		1-1/2"	1-1/2"	customer
14	FLANGE, 150# ANSI F-F STEEL, WELD NECK OR SCREWED		-----	2"	customer
13	REDUCING ELBOW, M.I.		-----	2"x1-1/2"	customer
12	ELBOW, M.I.		1-1/2"	1-1/2"	customer
11	STRAINER, 260C, SCREWED (SEE NOTE T)	(15 PSIG) 1- 1/4" (60 PSIG) 3/4"	9340160 9340181	9340160 9340181	customer
10	COCK, LOCK WING, LUB-O-SEAL, MUELLER H-11175 OR APPROVED EQUAL		1-1/2" 9339661	1 - 1/2" 9339661	customer
9	VENT ASSEMBLY WITH RAIN AND INSECT RESISTANT SCREEN (SEE VENT TABLE FOR SIZE)	1" 1- 1/2"	9315859 9358641	9315859 9358641	customer
8	COMPRESSION COUPLING, DRESSER STYLE 90, INSULATED		1 - 1/2" 9341465	2" 9341468	customer
7	COCK, LOCK WING, LUB-O-SEAL, MUELLER H-11175 OR APPROVED EQUAL		1-1/2" 9341980	-----	customer
6	PLUG VALVE, NORDSTROM FIG. 114 OR APPROVED EQUAL 2"		-----	9341953	customer
5	COMPRESSION COUPLING, DRESSER STYLE 90, INSULATED (SEE VENT TABLE FOR SIZE)	1" 1-1/2"	9341467 9341465	9341467 9341465	customer
4	COMPRESSION COUPLING, DRESSER STYLE 90, INSULATED	(15 PSIG) 1-1/4" (60 PSIG) 1"	9341466 9341467	9341466 9341467	customer
3	COCK, LOCK WING, LUB-O-SEAL, MUELLER H11175 OR APPROVED EQUAL	(15 PSIG) 1-1/4" (60 PSIG) 3/4"	9339699 9339701	9339699 9339701	customer
2	REGUALTOR, WITH 1/4" ORIFICE (15# MAX INLET) OR EQ. 1-1/4"X1-1/4" REGULATOR, WITH 3/16" ORIFICE (60# MAX INLET) OR EQ. 1-1/4"X1-1/4" REGULATOR, WITH 1/8" ORIFICE (60# MAX INLET) OR APPROVED EQ 3/4"X 1"		9342623 9342206 9383047	9342623 9342206 9383047	NAT. GRID
1	METER, (DRESSER) ROOTS ROTARY, TEMPERATURE COMPENSATED (SEE TABLE ABOVE) 1-1/4" SERVICE (15 PSIG) AND 3/4" SERVICE (60 PSIG)		1.5M175	15C175 11C175 8C175	NAT. GRID

#	ITEM	NAT. GRID CODE No.
---	------	--------------------

NOTE: ALL MATERIALS AFTER THE SERVICE VALVE WILL BE FURNISHED AND INSTALLED BY THE CUSTOMER EXCEPT FOR THE REGULATOR, SECURITY VALVE AND EXTERNAL RELIEFS - IF APPLICABLE (FOR HIGH PRESSURE INSTALLATIONS) WHICH IS FURNISHED BY THE COMPANY AND INSTALLED BY THE CUSTOMER. THE METER, METER GASKETS, NUTS AND BOLTS WILL BE FURNISHED BY THE COMPANY.







**NOTES**

- A. RISER AND VALVE SHALL BE OF THE SAME SIZE AS THE SERVICE SIZE I.E. FOR A 4" SERVICE USE A 4" RISER AND A 4" VALVE WITH THE APPROPRIATE ITEM SIZES REQUIRED.

DESCRIPTION 3 M		SAP ITEM ID	QUANTITY	
			NG	BY CUSTOMER
27	TEE – 3" X 3" X 3/4" - THREADED	X X		3
26	PIPE SLEEVE – 4" – PLASTIC OR EQUIVALENT	NG	1	
25	GASKET RING –	X X		1
24	SLAB REINF. – 4X4 – 4/4 WIRE WELDED FABRIC	X X		1
23	GASKET RING - METER 2" FLEXITALLIC SIGMA 588	9341161	2	
22	PIPE – HOUSE LINE	X X		1
21,21A	REDUCER – 3" X 2" - THREADED	X X		3
20	NOT USED			
19	GAS SNAP LOCK	9330915	3	
18	SUPPORT - 12-24" HEIGHT SUPPORT – 23-35" HEIGHT	<a href="#">9391870</a> <a href="#">9391559</a>		1
17	METER – LINE MOUNTED ROTARY – 3M125	X X	1	
16	TAG – SERVICE LOCATION	9340255	1	
15	COUPLING – 3" – COMPANION – DRESSER STYLE 38	XX		1
14	TEE – 3" - THREADED	X X		3
13	CAP – 3" - THREADED	X X		1
12	PIPE – 3" X LENGTH AS REQUIRED - THREADED	X X		=
11	ELBOW – 3" - THREADED	X X		3
10A	BOLT – 5/8" X 2" ASTM B7 GR. B (CAP SCREWS) FOR METER	9342411	8	
10	BOLT STUD 5/8" X 4" WITH 3 NUTS – ANTI-CORROSION OR BOLT – 5/8" X 2 3/4" B7 – MACHINE	9392186 9339766	8	
9	KIT – 2" – FLANGED - INSULATED	9340992	1	
8A	VALVE – 3" - THREADED	X X		3
8	VALVE – 2" – FLANGED – SEE NOTE A BELOW	9341980	1	
7	LOCKING DEVICE	NG	1	
6,6A	FLANGE – 2" FF. – COMPANION – ANSI CLASS 125	X X		3
5	PLUG – 3/4" - THREADED	X X		3
4	GAS LOCK COCK – 3/4"	X X		3
3	NIPPLE – 3/4" X 3" - THREADED	X X		3
2	FLANGE – 2" – WELD NECK	<a href="#">9314322</a>	1	
1	RISER – 2" – PIPE- -SEE NOTE A ABOVE	* 350+/-		
No.	ITEM	NAT. GRID CODE No.		

**BILL OF MATERIAL FOR 3M METER**

**NOTES**

	ITEM	ITEM ID	QTY BY NG	QTY BY CUSTOMER
27	TEE – 4" X 4" X 3/4" - THREADED	X X		3
26	SLEEVE – 6" – PIPE – PLASTIC OR EQUIVALENT	NG	1	
25	GASKET RING – 4"	X X		1
24	SLAB REINF. – 4 X 4 – 4/4 WIRE WELDED FABRIC	X X		1
23	GASKET RING – METER FLEXITALLIC SIGMA 511	9341162	2	
22	PIPE – HOUSE LINE	X X		1
21A	NOT TO BE USED			
21	REDUCER 4" X 3"	X X		2
20	NOT USED			
19	GAS SNAP LOCK	9330915	3	
18	SUPPORT - 12-24" HEIGHT SUPPORT – 23-35" HEIGHT	9391870 9391559		1
17	METER – LINE MOUNTED ROTARY – 7M125	X X	1	
16	TAG – SERVICE LOCATION	9340255	1	
15	COUPLING – 4" – COMPANION – DRESSER STYLE 38	X X		1
14	TEE – 4" - THREADED	X X		3
13	CAP – 4" - THREADED	X X		1
12	PIPE – 4" X LENGTH AS REQUIRED – THREADED ENDS	X X		+
11	ELBOW – 4" - THREADED	X X		3
10A	BOLT – 5 / 8" X 2" ASTM B7 GR. B (CAP SCREWS) FOR METER	9342411	8	
10	BOLT STUD 5/8" X 4" WITH 3 NUTS – ANTI-CORROSION OR BOLT – 5 / 8" X 2 - 3/ 4" B7 – MACHINE	9392186 9339766	8	
9	KIT – 4" – FLANGED - INSULATED	9341024	1	
8A	VALVE - 4" - THREADED	X X		3
8	VALVE – 4" - FLANGED	9382541	1	
7	LOCKING DEVICE	NG	1	
6A	FLANGE – 3" FF – COMPANION – ANSI CLASS 125	X X		2
6	FLANGE – 4" FF – COMPANION – ANSI CLASS 125	X X		1
5	PLUG – 3 / 4" - THREADED	X X		3
4	GAS LOCK COCK – 3 / 4"	X X		3
3	NIPPLE – 3 / 4" X 3" - THREADED	X X		3
2	FLANGE – 4" – WELD NECK	9314430	1	
1	RISER – 4" - PIPE		+	
No.	ITEM		NAT. GRID'S CODE No.	
BILL OF MATERIAL FOR 7M METER				

## **NOTES**





- A. FOR GENERAL NOTES SEE MTRS-6545.
- B. THIS CONSTRUCTION STANDARD SHALL BE USED WHEN AN OUTDOORS 3M OR 7M LOW PRESSURE MAIN & LOW PRESSURE METER SET IS SPECIFIED ON A WORK ORDER. IT SHOULD BE DESIGNED IN ACCORDANCE WITH THE CUSTOMERS TOTAL SERVICE LENGTH AND SIZE AS OUTLINED IN THE DESIGN SECTION.
- C. DISTANCE BETWEEN METER CONNECTION IS 6-3/4" (3M) & 9-1/2" (7M).
- D. CENTERLINE OF PIPING SHALL BE APPROX. 1'-8" FROM WALL.
- E. CINCH ANCHORS OR EQUIVALENT TO BE INSTALLED IN FLOOR FLANGES (ITEMS 29) BY CUSTOMER.
- F. NATIONAL GRID WILL SUPPLY AND INSTALL ALL ITEMS AS LISTED IN M&S CODE COLUMN OF BILL OF MATERIAL.

\* MISSING DIGIT DETERMINED BY TYPE SIZE OR LENGTH OF ITEM

+ AS REQUIRED

X X TO BE SUPPLIED BY F.O.

\*\* SUPPLIED AND INSTALLED BY CUSTOMER

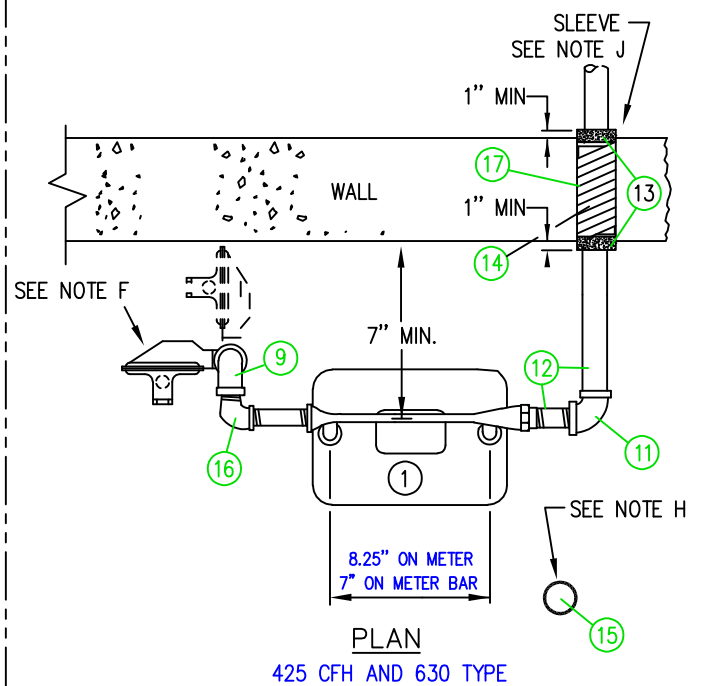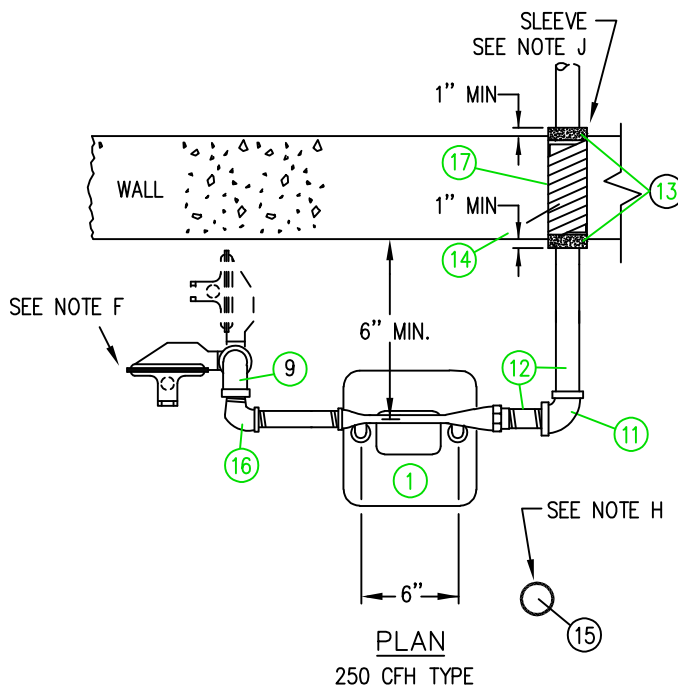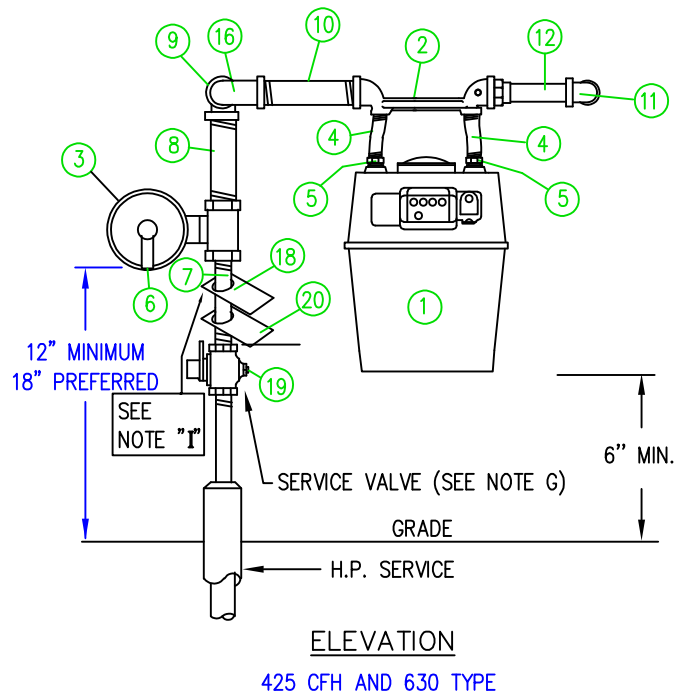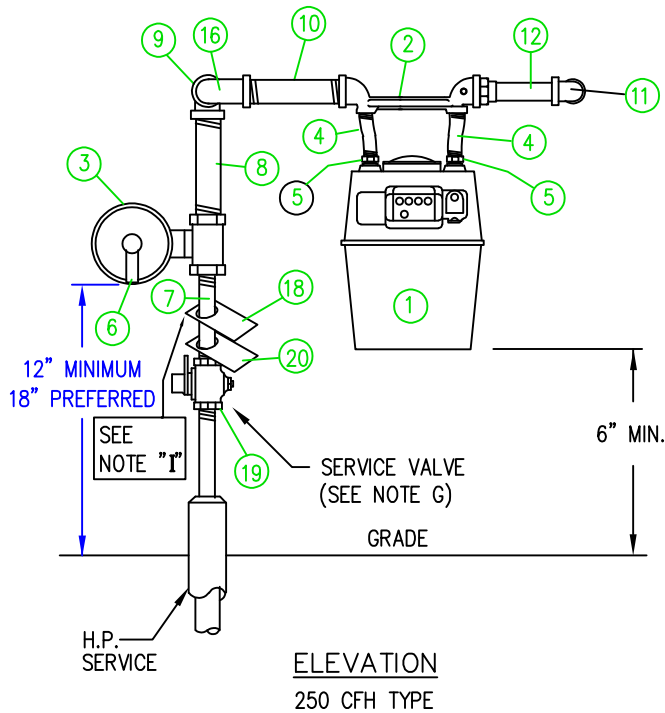

**nationalgrid**

LI-NYC

SINGLE METER AND REGULATOR INSTALLATION  
OUTSIDE SET, 1/2" AND 3/4" DIAMETER  
SERVICES OPERATING AT 15 - 124 PSIG  
250 CFH, 425 CFH AND 630 CFH RANGE

REVISIONS: UPDATED SAP ID #'S AND LINKS

DATE: 07/01/2003

EFFECTIVE DATE: 06/03/2025

DESIGN: JTK

STD. DWG.

DRAWN: GVG





NO. MTRS-6140

## NOTES

- A. KEY REQUIREMENTS FOR THE CONSTRUCTION OF METER HEADERS AND INSTALLATIONS ARE CONTAINED IN NATIONAL GRID'S SPECIFICATIONS [CMS03002](#) AND THE NATIONAL GRID BLUE BOOK
- B. ADDITIONAL FITTINGS MAY BE REQUIRED TO MAKE THE METER AND REGULATOR INSTALLATION.
- C. NATIONAL GRID SHALL NOT BE RESPONSIBLE FOR FITTING DIMENSIONS OR FOR SCALED DIMENSIONS.
- D. FOR FLOW RATES GREATER THAN 630 CFH SEE [MTRS6185-LI](#) OR [MTRS6121-NYC](#) FOR DUAL REGULATOR CONFIGURATIONS
- E. **FOR FLOW RATES GREATER THAN 940 CFH (60 PSIG SYSTEM) OR 1550 CFH (15 PSIG SYSTEM), CONTACT GAS ENGINEERING FOR SPECIAL ENGINEERING METER AND REGULATOR LAYOUT.**
- F. REGULATOR VENT MUST FACE DOWN AND BE EQUIPPED WITH A RAIN AND INSECT RESISTANT SCREEN. FOR NEW CONSTRUCTION OR ALTERATIONS SEE [020013-CS](#) VENT PIPING LOCATION. IT IS PREFERRED THAT REGULATOR VENTS BE INSTALLED AT A HEIGHT 18 INCHES ABOVE GRADE, HOWEVER, THE MINIMUM ALLOWABLE VENT HEIGHT SHALL BE 12 INCHES ABOVE FINAL GRADE. IN CASES OF KNOWN FLOOD LOCATIONS, THE PREFERRED REGULATOR VENT HEIGHT ABOVE THE FLOOD HEIGHT IS 18" (12" MINIMUM). THE REGULATOR VENT SHALL BE 18" (WHERE PRACTICAL) FROM ANY OPENING WHICH COULD ALLOW VENTED GAS TO ENTER.
- G. SERVICE VALVE MUST BE PAINTED RED (IN NEW YORK CITY ONLY).
- H. WHERE VEHICULAR TRAFFIC IS A CONCERN, INSTALL PROTECTION POST. SEE STANDARD DRAWING [MTRS-6060](#) FOR INSTALLATION REQUIREMENTS.
- I. CPR TAGS ARE REQUIRED IN LONG ISLAND INSTALLATIONS ONLY.
- J. WALL SLEEVES ARE ONLY REQUIRED WHEN SERVICE PENETRATES CONCRETE OR MASONRY WALL. WALL SLEEVES ARE RECOMMENDED, BUT NOT REQUIRED THROUGH STUCCO OR FRAME CONSTRUCTION.
- K. THE CLASS 400 METERS HAVE 30 LIGHT CONNECTIONS IN NEW YORK CITY AND 45 LIGHT CONNECTIONS IN LONG ISLAND. THE CLASS 630 METERS WILL HAVE 45 LIGHT CONNECTIONS IN NYC AND LI.
- L. THE PIPE AND FITTING LISTED BELOW ARE GALVANIZED. BLACK PIPE AND FITTINGS THAT ARE PRIMED AND PAINTED ARE ALSO ACCEPTABLE. **NOTE FOOTNOTES ON METER & SWIVELS B = BLACK, G = GALVANIZED**

METER CAPACITIES		0-250 CFH RANGE		0-425 CFH RANGE		0-630 CFH RANGE			
AMERICAN		250		425		630			
EQUIMETER/SENSUS		275		415					
ACTARIS/ITRON		250		400					
				250 METER SET		400 & 630 METER SET		SUPPLIED BY	
20	SYSTEM PRESSURE TAG			9346233		9346233		NGG	
19	METER VALVE, LOCK WING GALVANIZED			9339593		9339609		NGG	
18	CPR TAG (LONG ISLAND ONLY)			9340255		9340255		NGG	
17	WALL SLEEVE – PVC PLASTIC PIPE OR STD. WT STEEL PIPE (2” LONGER THAN WALL THICKNESS)			---		---		CUSTOMER	
16	STREET ELBOW 90 DEGREE GALVANIZED			9341192		9341193		CUSTOMER	
15	PROTECTION POST (SEE NOTE H)			---		---		CUSTOMER	
14	YARN, PACKING			---		---		CUSTOMER	
13	FLEXIBLE SEALING COUMPOUND (DUXSEAL)			---		---		CUSTOMER	
12	HOUSE PIPING TO LOAD			---		---		CUSTOMER	
11	ELBOW 90 DEGREES M.I., SIZE OF HOUSE PIPE (GALV.)			1”		1-1/4”		CUSTOMER	
10	NIPPLE, 3” MINIMUM GALVANIZED (LENGTH AS REQUIRED)			1”	9340641	1-1/4”	9340652	CUSTOMER	
9	ELBOW/REDUCING ELBOW 90 DEG M.I. GALVANIZED			1”	9341181	1”X1-1/4”	9341185	CUSTOMER	
8	NIPPLE 1” X 3” MINIMUM (LENGTH AS REQUIRED)			1”	9340641	1”	9340641	CUSTOMER	
7	NIPPLE ¾” X 4” MINIMUM (LENGTH AS REQUIRED)			¾”	9340633	¾”	9340633	CUSTOMER	
6	VENT ASSEMBLY WITH INSECT RESISTANT SCREEN IF REQ'D, 1”			9315859		9315859		NGG	
5	METER CAP/NUT CONNECTION SEE NOTE K		NEW YORK CITY 250 & 400		9340787 <sup>G</sup> 9312379 <sup>B</sup>		1-1/4” 30 LT	9383207 <sup>G</sup> 9312381 <sup>B</sup>	NGG
			NEW YORK CITY 630 CLASS		---		1-1/4” 45 LT	9339623	NGG
			LONG ISLAND 250/400/630		9340787		1-1/4” 45 LT	9340788	NGG
4	METER SWIVEL OFFSET GALV. SEE NOTE K		NEW YORK CITY 250 & 400		1”	9383109 <sup>G</sup> 9312385 <sup>B</sup>	1-1/4” 30 LT	9383108 <sup>G</sup> 9342456 <sup>B</sup>	NGG
			NEW YORK CITY 630 CLASS		-	-	1-1/4” 45 LT	9386167	
			LONG ISLAND 250/400/630		1”	9383109	1-1/4” 45 LT	9342425	
3	REGULATOR, ¾” X 1” WITH 1/8” ORIFICE: FISHER HSR , ITRON B-42R OR B-31R, SENSUS 143-80-2, AMERICAN 1813B2 OR SR100			9383047		9383047		NGG	
2	METER BAR, W/INSUL. OUTLET, GALV. AY MCD#6610-GCCD OR EQ METER BAR, W/INSUL. OUTLET, GALV. AY MCD#6640-GCCD OR EQ METER BAR, W/INSUL. OUTLET, BLACK WITH TOP OUTLET			1” X 1” X 1” 9383181		---		NGG	
				9339755		1-1/4” X 1-1/4” 9383209 1-1/4” X 1-1/4” 9339756			
1	METER (TEMPERATURE COMPENSATED)			250 CLASS		400 & 630 CLASS			
No.	ITEM							ITEM ID	

**NOTE: IN NYC, ALL MATERIALS AFTER THE SERVICE VALVE WILL BE FURNISHED AND INSTALLED BY THE CUSTOMER EXCEPT FOR THE REGULATOR WHICH IS FURNISHED BY THE COMPANY AND INSTALLED BY THE CUSTOMER. THE METER, SWIVEL AND CAPS (METER NUTS) WILL BE FURNISHED AND INSTALLED BY THE COMPANY. IN LONG ISLAND, NATIONAL GRID WILL INSTALL TO THE METER BAR.**

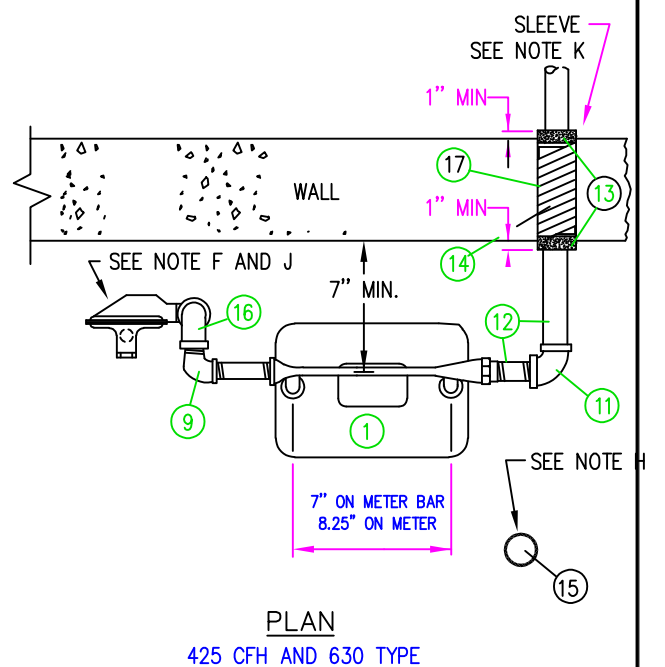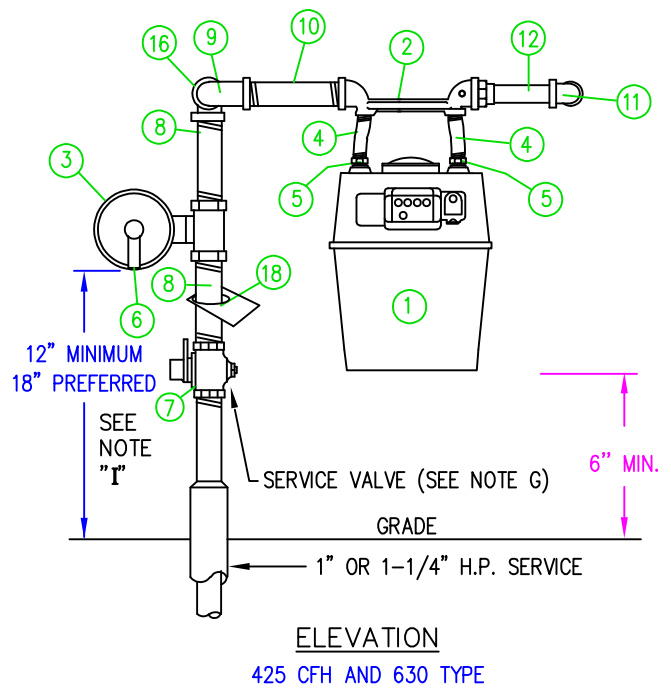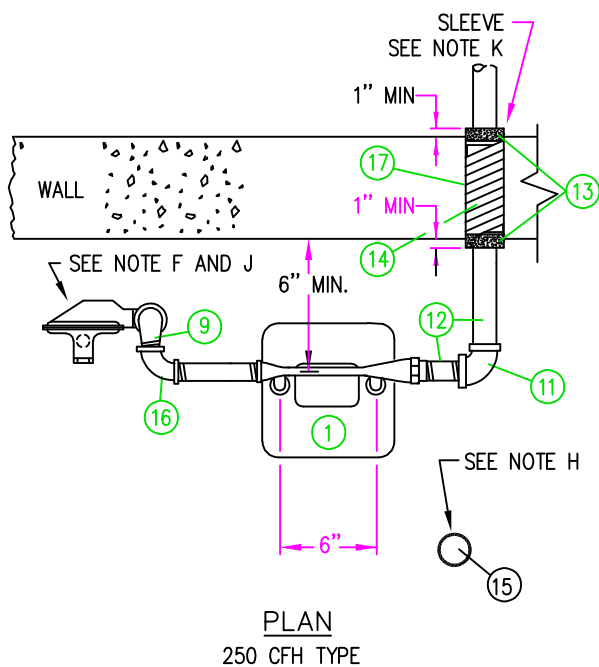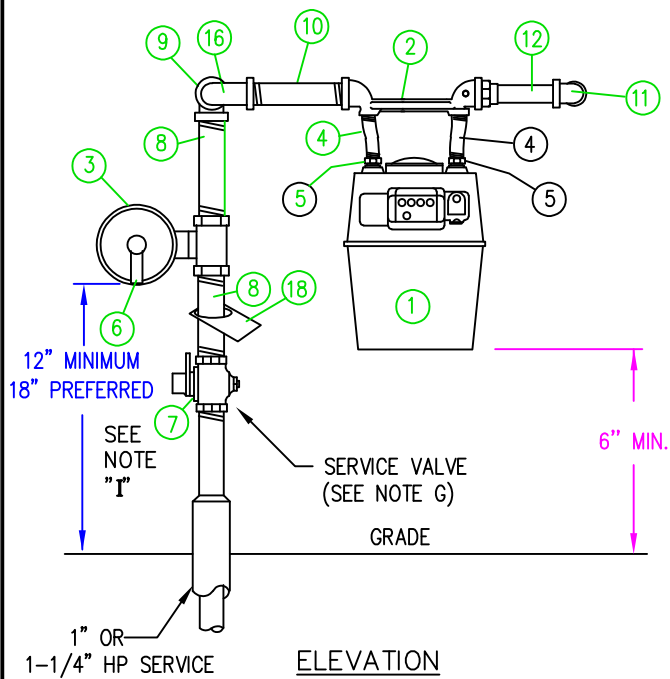

**nationalgrid**

LI-NYC

**SINGLE METER AND REGULATOR INSTALLATION  
OUTSIDE SET, 1" AND 1-1/4" DIAMETER SERVICES  
OPERATING AT 15 - 124 PSIG  
0 - 250 CFH, 0 - 425 CFH AND 0 - 630 CFH RANGE**

REVISIONS: **UPDATED NOTES AND LINKS**

DATE: 07/01/2003

EFFECTIVE DATE: 04/23/2025

DESIGN: MJM / PAUL GUGLIOTTA

STD. DWG.

DRAWN: DiMaio

NO.

**MTRS-6142**

UNCONTROLLED WHEN PRINTED

© NationalGrid Gas plc 2025- All Rights Reserved


**NOTES:**

- A. KEY REQUIREMENTS FOR THE CONSTRUCTION OF METER HEADERS AND INSTALLATIONS ARE CONTAINED IN NATIONAL GRID'S SPECIFICATIONS **CMS03002**
- B. ADDITIONAL FITTINGS MAY BE REQUIRED TO MAKE THE METER AND REGULATOR INSTALLATION.
- C. NATIONAL GRID SHALL NOT BE RESPONSIBLE FOR FITTING DIMENSIONS OR FOR SCALED DIMENSIONS.
- D. IN NYC, FOR FLOW RATES BETWEEN 470 CFH AND 940 CFH (60# SYSTEM) AND 775 CFH AND 1550 CFH (15# SYSTEM) SEE STANDARD DRAWING **MTRS-6121**.
- E. IN NYC, FOR FLOW RATES GREATER THAN 940 CFH (60 PSIG SYSTEM) OR 1550 CFH (15 PSIG SYSTEM) SEE SPECIAL ENGINEERING METER AND REGULATOR LAYOUT.
- F. REGULATOR VENT MUST FACE DOWN AND BE EQUIPPED WITH A RAIN AND INSECT RESISTANT SCREEN. FOR NEW CONSTRUCTION OR ALTERATIONS SEE **020013-CS** VENT PIPING LOCATION. IT IS PREFERRED THAT REGULATOR VENTS BE INSTALLED AT A HEIGHT 18 INCHES ABOVE GRADE, HOWEVER, THE MINIMUM ALLOWABLE VENT HEIGHT SHALL BE 12 INCHES ABOVE FINAL GRADE. IN CASES OF KNOWN FLOOD LOCATIONS, THE PREFERRED REGULATOR VENT HEIGHT ABOVE THE FLOOD HEIGHT IS 18" (12" MINIMUM). THE REGULATOR VENT SHALL BE 18" (WHERE PRACTICAL) FROM ANY OPENING WHICH COULD ALLOW VENTED GAS TO ENTER.
- G. SERVICE VALVE MUST BE PAINTED RED (IN NEW YORK CITY ONLY).
- H. WHERE VEHICULAR TRAFFIC IS A CONCERN, INSTALL PROTECTION POST. SEE STANDARD DRAWING **MTRS-6060** FOR INSTALLATION REQUIREMENTS.
- I. CPR TAGS ARE REQUIRED IN LONG ISLAND INSTALLATIONS ONLY.
- J. WARNING ON 99 PSIG AND 124 PSIG SERVICES, THE ORIFICE MUST 1/8".
- K. WALL SLEEVES ARE ONLY REQUIRED WHEN SERVICE PENETRATES CONCRETE OR MASONRY WALL. WALL SLEEVES ARE RECOMMENDED. BUT NOT REQUIRED THROUGH STUCCO OR FRAME CONSTRUCTION.
- L. THE CLASS 400 METERS HAVE 30 LIGHT CONNECTIONS IN NEW YORK CITY AND 45 LIGHT CONNECTIONS IN LONG ISLAND. THE CLASS 630 METER WILL HAVE 45 LIGHT CONNECTIONS IN LI AND NYC. **FOOTNOTE B = BLACK AND G = GALVANIZED**

METER CAPACITIES	0 - 250 CFH RANGE	0 - 425 CFH RANGE	0 - 630 CFH RANGE
HONEYWELL / AMERICAN / ELSTER	AL -250	AL-425	AC-630
ROCKWELL / EQUIMETER/SENSUS	275	415	
ITRON / SPRAGUE / SCHLUMBERGER	250	400	

		250 METER SET		400 & 630 METER SET			
18	CPR TAG (LONG ISLAND ONLY)	9340255		9340255		NGG	
17	WALL SLEEVE – PVC PLASTIC PIPE OR STD. WT STEEL PIPE (2" LONGER THAN WALL THICKNESS)	-----		-----		CONTRACTOR	
16	ELBOW 90 DEGREE GALVANIZED	1"	9341181	1-1/4"	9341182	CONTRACTOR	
15	PROTECTION POST (SEE NOTE H)	-----		-----		CONTRACTOR	
14	YARN, PACKING	-----		-----		CONTRACTOR	
13	FLEXIBLE SEALING COMPOUND (DUXSEAL)	-----		-----		CONTRACTOR	
12	HOUSE PIPING TO LOAD	-----		-----		CONTRACTOR	
11	ELBOW ,90 M.I. SIZE OF HOUSE PIPE (GALV.)	1"		1 - 1/4"		CONTRACTOR	
10	NIPPLE 3" MINIMUM GALVANIZED (LENGTH AS REQUIRED)	1"	9340641	1 - 1/4"	9340652	CONTRACTOR	
9	STREET ELBOW, / REDUCING STREET ELBOW 90 M.I. GALVANIZED	1" X 1 - 1/4"	9341199	1 - 1/4"	9341193	CONTRACTOR	
8	NIPPLE 4" MINIMUM GALVANIZED (LENGTH AS REQUIRED)	1 - 1/4"	9340652	1 -1/4"	9340652	CONTRACTOR	
7	METER VALVE, LOCK WING GALVANIZED	1 - 1/4"	9339609	1 -1/4"	9339609	CONTRACTOR	
6	VENT ASSEMBLY WITH INSECT RESISTANT SCREEN, IF REQUIRED, 1"	9315859		9315859		NGG	
5	METER CAP / NUT CONNECTION SEE NOTE L	NEW YORK CITY 250 & 400	9340787 <sup>G</sup> 9312379 <sup>B</sup>	1 – 1 / 4" 20LT	9383207 <sup>G</sup> 1-1/4" 30 LT 9312381 <sup>B</sup> 1-1/4" 30 LT	NGG	
		NEW YORK CITY 630 CLASS	-	-	9339623 1-1/4" 45 LT <sup>B</sup> 9340788 1-1/4" 45 LT <sup>G</sup>		
		LONG ISLAND (GALV.)	9340787		1 – 1 / 4" 45 LT		9340788
4	METER, OFFSET SWIVEL SEE NOTE L	NEW YORK CITY 250 & 400	1" 20 LT	9383109 <sup>B</sup> 9312385 <sup>G</sup>	1-1/4" 30 LT.	9342456 <sup>B</sup> 9383108 <sup>G</sup>	NGG
		NEW YORK 630 CLASS	-	-	1-1/4" 45 LT.	9386167 <sup>B</sup> 9342425 <sup>G</sup>	
		LONG ISLAND (GALV.)	1" 20 LT.	9383109	1-1/4" 45 LT.	9342425	
3	REGULATOR, 1 –1/4" DRESSER – 42R / B 31 R, USG 143 – 80 –2, HONEYWELL 1813 OR SR-100 FOR 15 PSIG SERVICE – REGULATOR, 1 – 1/4" WITH 1/4" ORIFICE FOR 60 PSIG SERVICE- REGULATOR, 1 – 1/4" WITH 3 /16" ORIFICE FOR 99 / 124 PSIG SERVICE – REGULATOR, 1 – 1/4" WITH 1/8" ORIFICE	9342623 9342206 9383127		9342623 9342206 9383127		NGG NGG NGG	
2	METER BAR, W / INSUL. OUTLET, GALV. AY MCD#6610-GCCD OR EQ. METER BAR, W / INSUL. OUTLET, GALV. AY MCD#6640-GCCD OR EQ. METER BAR, W/INSULATED OUTLET, BLACK WITH TOP OUTLET	1" X 1" X1" 9383181 ----- -----		----- 1-1/4" X 1-1/4" 9383209 1-1/4" X 1-1/4" 9339756		NGG	
1	METER (TEMPERATURE COMPENSATED)	0-250		0-425 & 0-630		NGG	
No.	ITEM	250 METER SET NGG CODE NO.		400 & 630 METER SET NGG CODE NO.		NGG CODE No.	

**NOTE: IN NYC, ALL MATERIALS AFTER THE SERVICE VALVE WILL BE FURNISHED AND INSTALLED BY THE CUSTOMER EXCEPT FOR THE REGULATOR WHICH IS FURNISHED BY THE COMPANY AND INSTALLED BY THE CUSTOMER. THE METER, SWIVEL AND CAPS (METER NUTS) WILL BE FURNISHED AND INSTALLED BY THE COMPANY. IN LONG ISLAND,NATIONAL GRID WILL INSTALL UP TO THE METER BAR.**

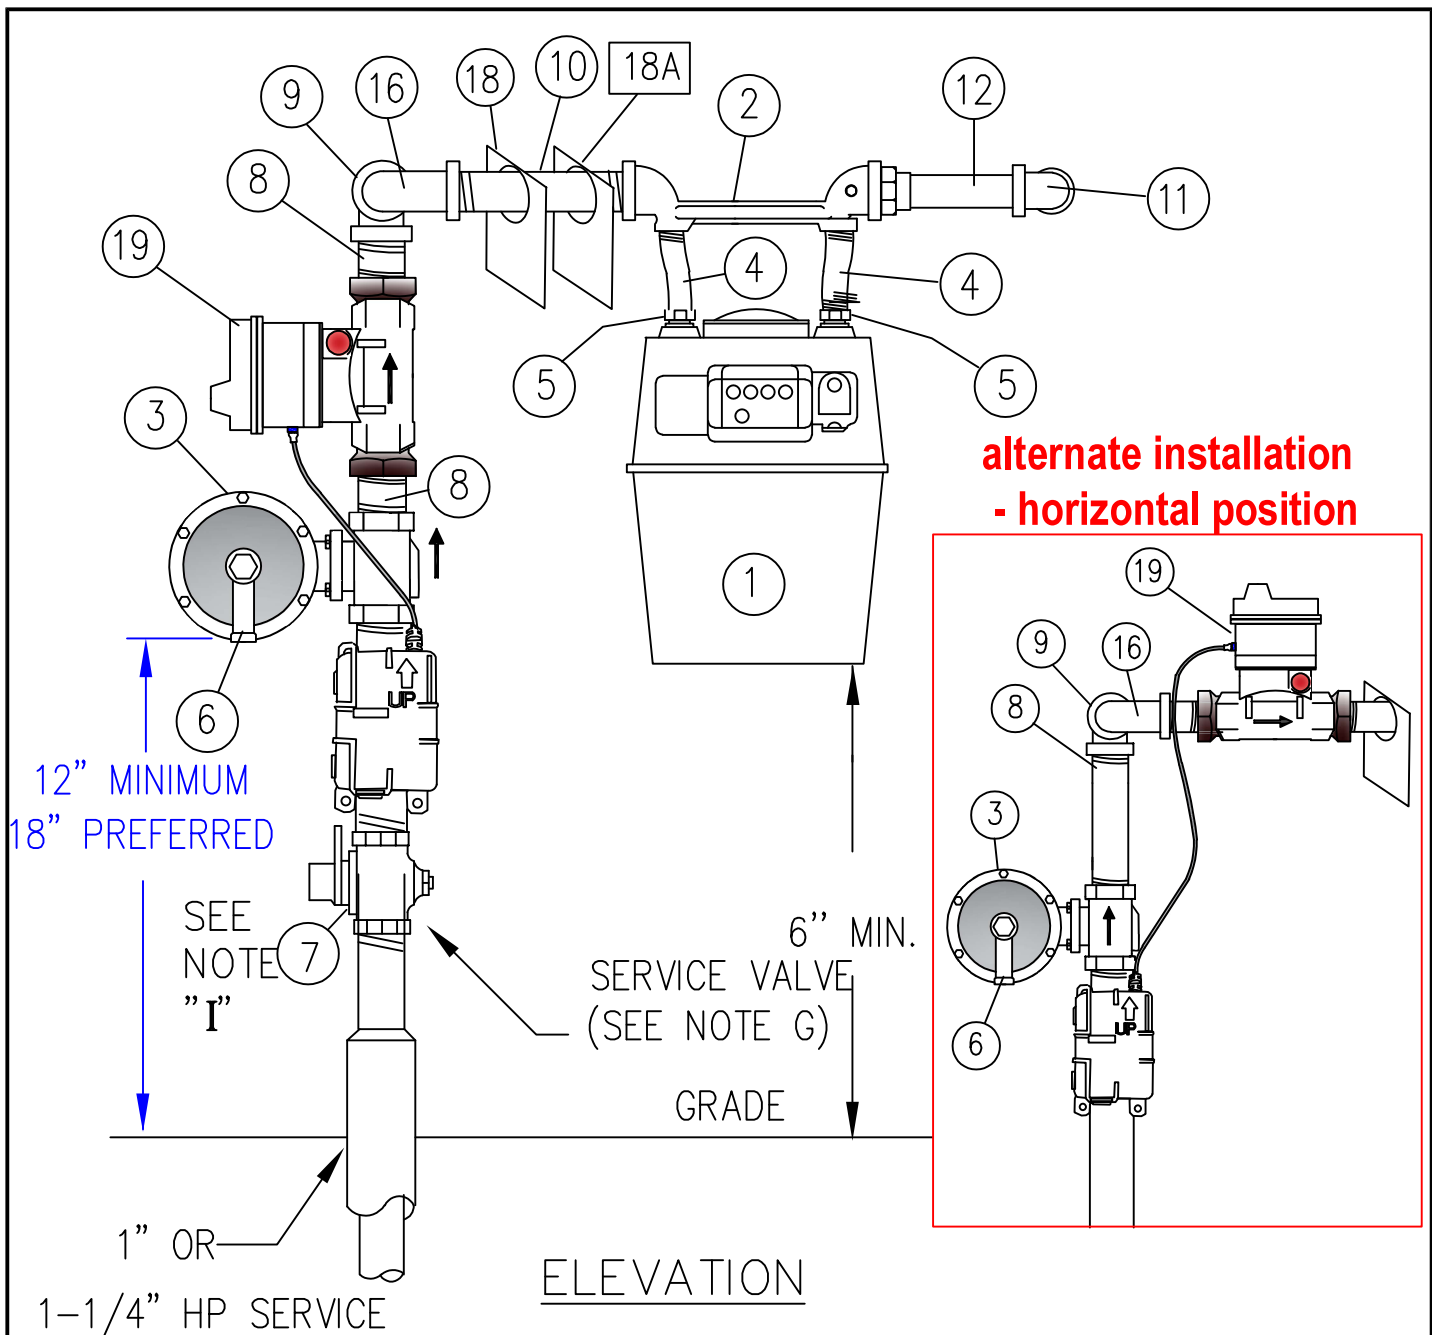

#### Notes

- The OWR-GRD can be installed in both horizontal and vertical piping with the flow arrow on the valve body pointing in the direction of the gas flow.
- Do not install the OWR-GRD with the gas out flow in a down position or in such a way that the antenna is against a wall or other structure.
- Mount the sensor using open band clamp around the pipe and the flood sensor. The arrow on the flood sensor housing must point up after installation.
- if no meter bar is installed, install insulating union after ITRON shut off valve

**nationalgrid**

LI-NYC

**SINGLE METER AND REGULATOR INSTALLATION  
OUTSIDE SET, 1" AND 1-1/4" DIAMETER SERVICES  
WITH ITRON OWR-GRD SHUTOFF VALVE  
0 - 250 CFH, 0 - 425 CFH AND 0 - 630 CFH RANGE**

**REVISIONS: UPDATED SAP IDS AND NOTES**

DATE: 10/31/2020

EFFECTIVE DATE: 04/23/2025

DESIGN: PAUL GUGLIOTTA

STD. DWG.

DRAWN: PAUL GUGLIOTTA

NO.

**MTRS-6144**

UNCONTROLLED WHEN PRINTED

© NationalGrid Gas plc 2025 - All Rights Reserved




**NOTES:**

- A. KEY REQUIREMENTS FOR THE CONSTRUCTION OF METER HEADERS AND INSTALLATIONS ARE CONTAINED IN NATIONAL GRID'S SPECIFICATIONS [CMS03002](#)
- B. ADDITIONAL FITTINGS MAY BE REQUIRED TO MAKE THE METER AND REGULATOR INSTALLATION.
- C. NATIONAL GRID SHALL NOT BE RESPONSIBLE FOR FITTING DIMENSIONS OR FOR SCALED DIMENSIONS.
- D. IN NYC, FOR FLOW RATES BETWEEN 470 CFH AND 940 CFH (60# SYSTEM) AND 775 CFH AND 1550 CFH (15# SYSTEM) SEE STANDARD DRAWING [MTRS-6121](#).
- E. IN NYC, FOR FLOW RATES GREATER THAN 940 CFH (60 PSIG SYSTEM) OR 1550 CFH (15 PSIG SYSTEM) SEE SPECIAL ENGINEERING METER AND REGULATOR LAYOUT.
- F. REGULATOR VENT MUST FACE DOWN AND BE EQUIPPED WITH A RAIN AND INSECT RESISTANT SCREEN. FOR NEW CONSTRUCTION OR ALTERATIONS SEE 020013-CS VENT PIPING LOCATION. IT IS PREFERRED THAT REGULATOR VENTS BE INSTALLED AT A HEIGHT 18 INCHES ABOVE GRADE, HOWEVER, THE MINIMUM ALLOWABLE VENT HEIGHT SHALL BE 12 INCHES ABOVE FINAL GRADE. IN CASES OF KNOWN FLOOD LOCATIONS, THE PREFERRED REGULATOR VENT HEIGHT ABOVE THE FLOOD HEIGHT IS 18" (12" MINIMUM). THE REGULATOR VENT SHALL BE 18" (WHERE PRACTICAL) FROM ANY OPENING WHICH COULD ALLOW VENTED GAS TO ENTER.
- G. SERVICE VALVE MUST BE **PAINTED RED** (IN NEW YORK CITY ONLY).
- H. WHERE VEHICULAR TRAFFIC IS A CONCERN, INSTALL PROTECTION POST. SEE STANDARD DRAWING [MTRS-6060](#) FOR INSTALLATION REQUIREMENTS.
- I. CPR TAGS ARE REQUIRED IN LONG ISLAND INSTALLATIONS ONLY.
- J. WARNING ON 99 PSIG AND 124 PSIG SERVICES, THE ORIFICE MUST 1/8".
- K. WALL SLEEVES ARE ONLY REQUIRED WHEN SERVICE PENETRATES CONCRETE OR MASONRY WALL. WALL SLEEVES ARE RECOMMENDED. BUT NOT REQUIRED THROUGH STUCCO OR FRAME CONSTRUCTION.
- L. THE CLASS 400 METERS HAVE 30 LIGHT CONNECTIONS IN NEW YORK CITY AND 45 LIGHT CONNECTIONS IN LONG ISLAND. THE CLASS 630 METER WILL HAVE 45 LIGHT CONNECTIONS IN LI AND NYC. **FOOTNOTE B = BLACK AND G = GALVANIZED**

METER CAPACITIES	0 - 250 CFH RANGE	0 - 425 CFH RANGE	0 - 630 CFH RANGE
HONEYWELL/AMERICAN / ELSTER	AL -250	AL-425	AC-630
ROCKWELL / EQUIMETER/SENSUS	275	415	
ITRON/SPRAGUE / SCHLUMBERGER	250	400	

		250 METER METER SET		400 & 630 METER SET	
19	ITRON OWR-GRD VALVE	-		-	
18	CPR TAG (LONG ISLAND ONLY) SYSTEM PRESSURE TAG	9340255 9346233		9340255 9346233	
17	WALL SLEEVE – PVC PLASTIC PIPE OR STD. WT STEEL PIPE (2" LONGER THAN WALL THICKNESS)	-----		-----	
16	ELBOW 90 DEGREE GALVANIZED	1"	9341181	1-1/4"	9341182
15	PROTECTION POST (SEE NOTE H)	-----		-----	
14	YARN, PACKING	-----		-----	
13	FLEXIBLE SEALING COMPOUND (DUXSEAL)	-----		-----	
12	HOUSE PIPING TO LOAD	-----		-----	
11	ELBOW ,90 M.I. SIZE OF HOUSE PIPE (GALV.)	1"		1 - 1/4"	
10	NIPPLE 3" MINIMUM GALVANIZED (LENGTH AS REQUIRED)	1"	9340641	1 - 1/4"	9340652
9	STREET ELBOW, / REDUCING STREET ELBOW 90 M.I. GALVANIZED	1" X 1 - 1/4"	9341199	1 - 1/4"	9341193
8	NIPPLE 4" MINIMUM GALVANIZED (LENGTH AS REQUIRED)	1 - 1/4"	9340652	1 - 1/4"	9340652
7	METER VALVE, LOCK WING GALVANIZED	1 - 1/4"	9339609	1 - 1/4"	9339609
6	VENT ASSEMBLY WITH INSECT RESISTANT SCREEN, IF REQUIRED, 1"	9358640		9315859	
5	METER CAP / NUT CONNECTION SEE NOTE L	NEW YORK CITY 250 & 400		9340787 <sup>G</sup> 9312379 <sup>B</sup>	
		NEW YORK CITY 630 CLASS		1 - 1 / 4" 20LT	
		LONG ISLAND (GALV.)		9383207 <sup>G</sup> 9312381 <sup>B</sup>	
4	METER, OFFSET SWIVEL SEE NOTE L	NEW YORK CITY 250 & 400		9339623 1-1/4" 45 LT <sup>B</sup> 9340788 1-1/4" 45 LT <sup>G</sup>	
		NEW YORK 630 CLASS		1 - 1 / 4" 45 LT	
		LONG ISLAND (GALV.)		9340788	
3	REGULATOR, 1 –1/4" ITRON – 42R / B 31 R, SENSUS 143 – 80 –2, AMERICAN 1813 OR SR-100 FOR 15 PSIG SERVICE – REGULATOR, 1–1/4" WITH 1/4" ORIFICE FOR 60 PSIG SERVICE- REGULATOR, 1–1/4" WITH 3 /16" ORIFICE FOR 99 / 124 PSIG SERVICE – REGULATOR, 1–1/4" WITH 1/8" ORIFICE	NEW YORK CITY 250 & 400		9342623 9342206 9383127	
		NEW YORK CITY 630 CLASS		9342623 9342206 9383127	
		LONG ISLAND (GALV.)		9342623 9342206 9383127	
2	METER BAR, W / INSUL. OUTLET, GALV. AY MCD#6610-GCCD OR EQ. METER BAR, W / INSUL. OUTLET, GALV. AY MCD#6640-GCCD OR EQ. METER BAR, W/INSULATED OUTLET, BLACK WITH TOP OUTLET	1" X 1" X1" 9383181 ----- -----		1-1/4" X 1-1/4" 9383209 1-1/4" X 1-1/4" 9339756	
1	METER (TEMPERATURE COMPENSATED)	0-250		0-425 & 0-630	
No.	ITEM	250 METER SET NGG CODE NO.		400 & 630 METER SET NGG CODE NO.	

**NOTE: IN NYC, ALL MATERIALS AFTER THE SERVICE VALVE WILL BE FURNISHED AND INSTALLED BY THE CUSTOMER EXCEPT FOR THE REGULATOR WHICH IS FURNISHED BY THE COMPANY AND INSTALLED BY THE CUSTOMER. THE METER, SWIVEL AND CAPS (METER NUTS) WILL BE FURNISHED AND INSTALLED BY THE COMPANY. IN LONG ISLAND, NATIONAL GRID WILL INSTALL UP TO THE METER BAR.**

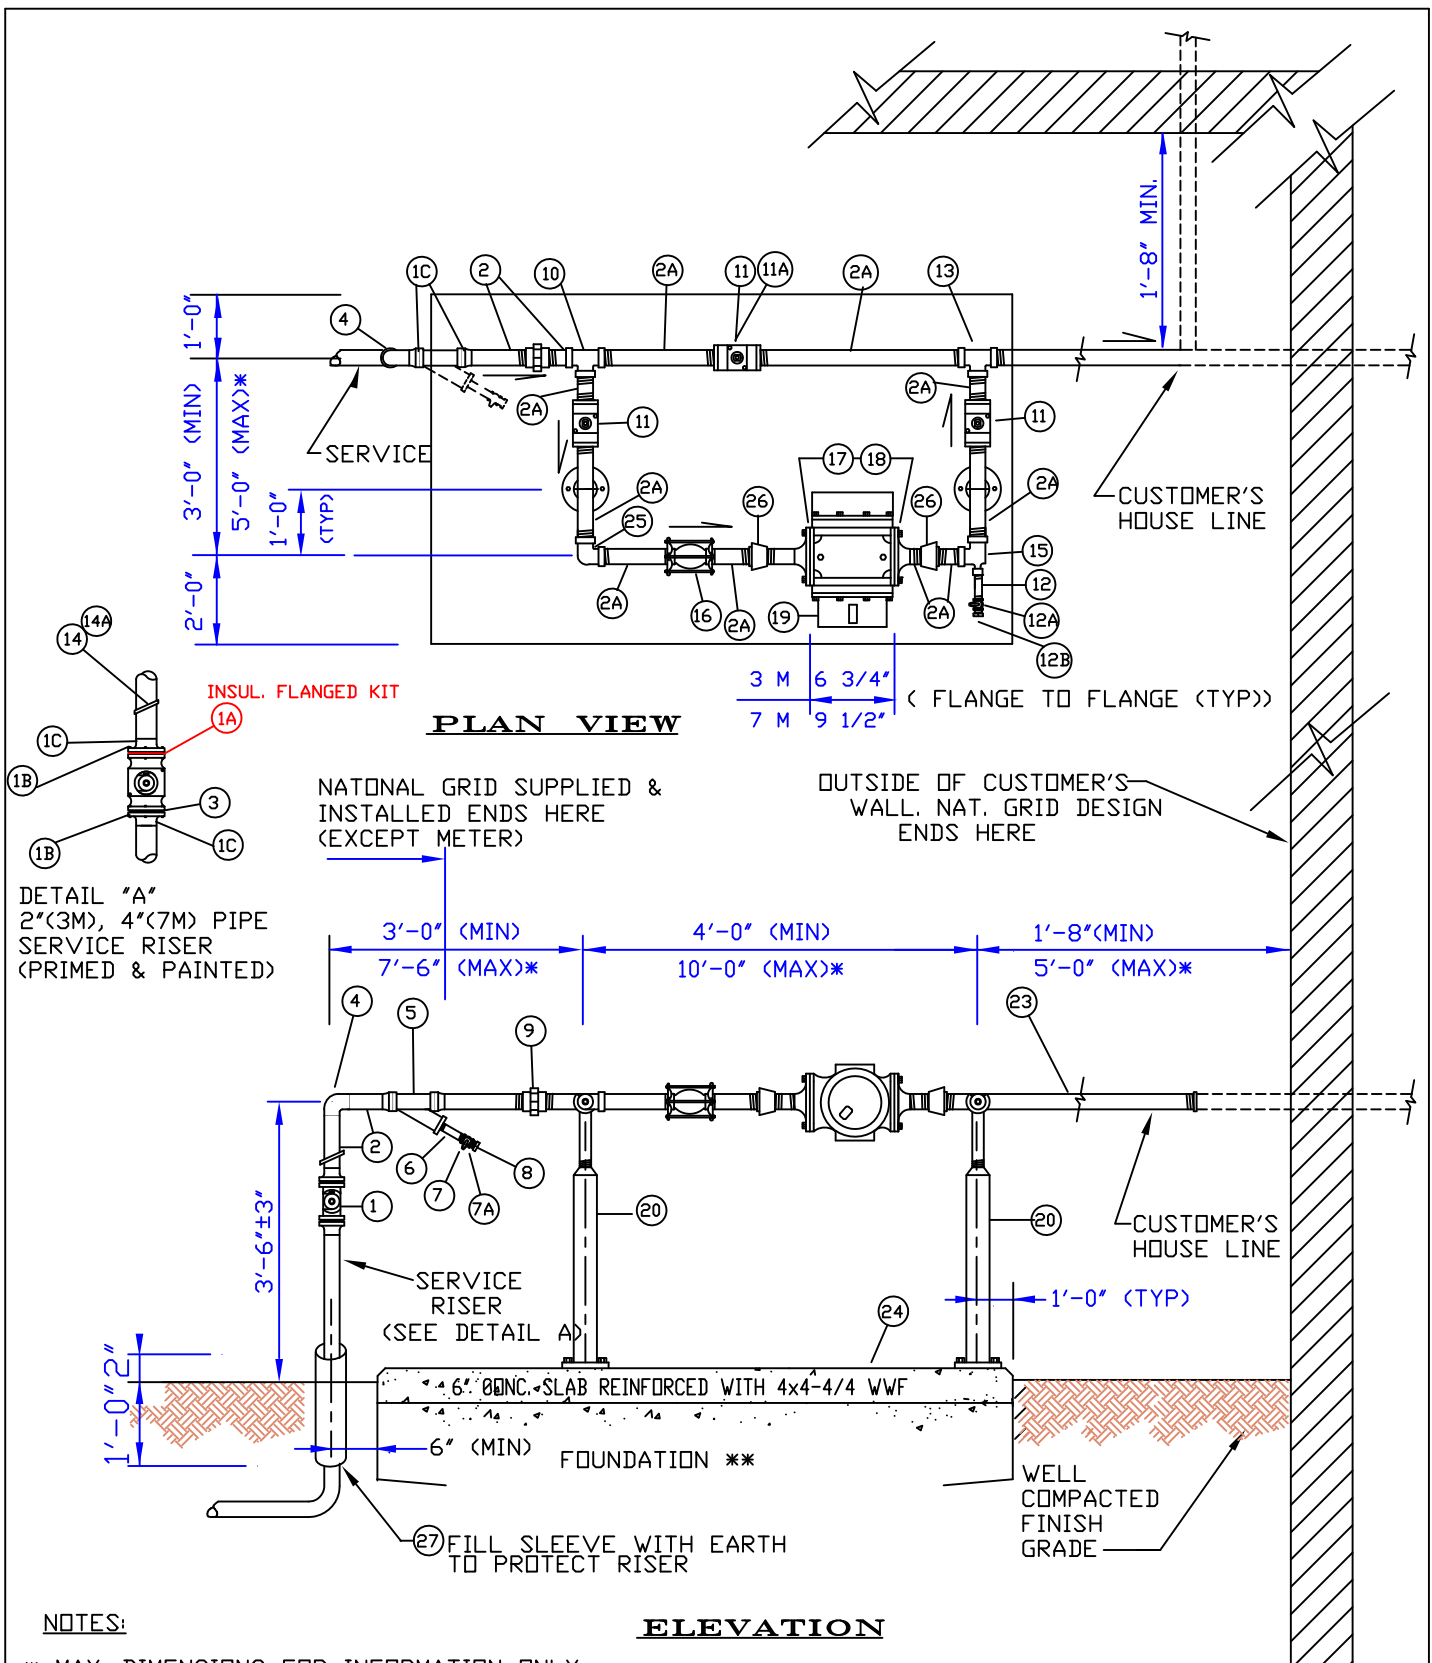

<p><b>nationalgrid</b></p> <p>LONG ISLAND</p>	<p><b>LP MAIN / LP METERING FOR 3M125, OR 7M125 HORIZONTAL - ROTARY GAS METER OUTSIDE LOCATIONS</b></p>	
<p><b>KEY CHANGES:</b> UPDATED ITEM ID'S</p>	<p>DATE: 7/1/2003</p> <p>DESIGN: GJK</p> <p>DRAWN: HF</p>	<p>EFFECTIVE DATE: 07/08/2024</p> <p>STD. DWG. NO. <b>MTRS-6145</b></p>

**NOTES**

- A. SEE GENERAL NOTES MTRS- 6545  
 B. ALL SCREW TYPE PIPE FITTINGS TO BE HOT DIPPED GALVANIZED  
 C. ALL FITTINGS SHALL BE MALLEABLE IRON CLASS 150, ANSI B 16.3  
 D. CINCH ANCHORS TO BE INSTALLED IN FLOOR FLANGES (ITEM 20) BY CUSTOMER  
 E. FOR UNDERGROUND CUSTOMER'S HOUSE PIPING REFER TO DESIGN SECTION  
 F. FOR VEHICULAR DAMAGE PROTECTION SEE MTRS – 6060  
 G. A METER SHALL NEVER BE INSTALLED LOWER THAN EITHER SIDE OF PIPE RUNS  
 H. NATIONAL GRID WILL SUPPLY AND INSTALL ITEMS 1 THRU 8 (EXCEPT 2A). 11A,14, 17A THRU 19 AND 27

**LEGEND**

X X – SUPPLIED BY CUSTOMER

\*\* – TO BE SUPPLIED BY F.O.

+ AS REQUIRED



27	SLEEVE – 4" PIPE (PLASTIC OR EQUIVALENT)	1	NATIONAL GRID
26	REDUCER 3" X 2"	2	X X
25	ELBOW – 90 3"	1	X X
24	SLAB REINF 4X 4 – 4/4 WWF	1	X X
23	PIPE HOUSE LINE	+	X X
22	NOT USED		
21	NOT USED		
20	SADDLE – PIPE STANCHION – ADJUSTABLE SEE MTRS 6475	2	NATIONAL GRID
19	METER LINE MOUNTED ROTARY 3M 125	1	**
18	GASKET RING- METER	2	9341161
17A	BOLT, 5/8 – 11 X 2 ASTM A 307 GR. B	8	9342411
17	FLANGE – COMPANION 2"FF, ANSI CLASS 125	2	X X
16	COUPLING – COMPRESSION 3" DRESSER STYLE 38	1	X X
15	TEE 3 X 3 /4 X 3	1	X X
14A	SELF LOCKING NYLON STRAP 14"	1	9325971
14	TAG – GAS SERVICE LOCATION	1	9340255
13	TEE 3" X 3" X 3"	1	X X
12B	PLUG, SOLID 3 /4" NPT	1	X X
12A	COCK, LOCKWING ¾"	1	X X
12	NIPPLE, 3 /4" X 3" LONG	1	X X
11A	LOCKING DEVICE	1	NATIONAL GRID
11	VALVE 3"	3	X X
10	TEE 2" X 3" X 3"	1	X X
9	UNION 2"	1	X X
8	PLUG, SOLID 1/2" NPT	1	9342549
7A	GAS SNAP LOCK	1	9330915
7	COCK, LOCKWING 1/2"	1	NON STOCK
6	NIPPLE, 1/2" X 3" LONG	1	9340621
5	STRAINER – CAST IRON, FLANGED END "Y" 100 MESH SCREEN W/BOLTS	1 1	9340158 9340158
4	ELBOW 2" 90	1	9315522
3	GASKET RING 2"	3	9341161
2A	PIPE- 3"	+	X X
2	PIPE – 2"	+	9340729
1C	FLANGE 2" WELDED NECK	4	9341058
1B	BOLTS MACHINE 5/8" X 2 3 /4" A 307	8	9339766
1A	GASKET – FLANGED INSULATED INSULATED , 2"	1	9340992
1	VALVE – FLANGE 2"	1	9341980
<b>No.</b>	<b>ITEM</b>	<b>NG CODE No.</b>	

**BILL OF MATERIAL**

**NOTES**

- A. SEE GENERAL NOTES MTRS-6545  
 B. ALL SCREW TYPE PIPE FITTINGS TO BE HOT DIPPED GALVANIZED  
 C. ALL FITTINGS SHALL BE MALLEABLE IRON CLASS 150, ANSI B 16.3  
 D. CINCH ANCHORS TO BE INSTALLED IN FLOOR FLANGES (ITEM 20) BY CUSTOMER  
 E. FOR UNDERGROUND CUSTOMER'S HOUSE PIPING REFER TO DESIGN SECTION  
 F. FOR VEHICULAR DAMAGE PROTECTION SEE APPROVED KEYSpan VEHICLE PROTECTOPN POST DRAWING.  
 G. A METER SHALL NEVER BE INSTALLED LOWER THAN EITHER SIDE OF PIPE RUNS  
 H. NATIONAL GRID WILL SUPPLY AND INSTALL ITEMS 1 THRU 8 (EXCEPT 2A). 11A ,14, 14A, 17A THRU 19 AND 27

27	SLEEVE – 6" PIPE (PLASTIC OR EQUIVALENT)	1	NATIONAL GRID
26	REDUCER 4" X 3"	2	X X
25	ELBOW – 90' 4"	1	X X
24	SLAB REINF 4X4 – 4/4 WWF	1	X X
23	PIPE – HOUSE LINE	+	X X
22	NOT USED		
21	NOT USED		
20	SADDLE – PIPE STANCHION - ADJUSTABLE	2	NG
19	METER LINE MOUNTED ROTARY 7M 125	1	**
18	GASKET RING - METER	2	9341162
17A	BOLTS, 5 /8 – 11X2 ASTM A 307 GR B	8	9342411
17	FLANGE – COMPANION 3"FF. ANSI CLASS 125	2	X X
16	COUPLING- COMPRESSION – 4" DRESSER STYLE 38	1	X X
15	TEE 4" X 3 /4" X 4"	1	X X
14A	SELF LOCKING NYLON STRIP 14"	1	9325971
14	TAG – GAS SERVICE LOCATION	1	9340255
13	TEE 4"	1	X X
12B	PLUG, SOLID 3/ 4" NPT	1	X X
12A	COCK, LOCKWING 3 /4"	1	X X
12	NIPPLE, 3/ 4" X 3" LONG	1	X X
11A	LOCKING DEVICE	1	NG
11	VALVE – 4"	3	X X
10	TEE 4"	1	X X
9	UNION 4"	1	X X
8	PLUG, SOLID 1 1/4" NPT	1	9340914
7A	GAS SNAP LOCK	1	9330915
7	COCK, LOCKWING 1 1/4"	1	9339609
6	NIPPLE, 1 1 /4" X 3" LONG	1	9340650
5	STRAINER – CAST IRON, FLANGED END "Y" 100 MESH SCREEN W/BOLTS	1	9340157
4	ELBOW – 90 – WELD 4"	1	9341207
3	GASKET RING 4"	3	9341160
2, 2A	PIPE – 4"	+	9340906
1C	FLANGE 4"	4	9314430
1B	BOLTS MACHINE 5 /8" X 3" A 307	16	9339769
1A	FLANGE – INSULATED 4"	1	9341024
1	VALVE – 4"	1	9341783
No.	ITEM		NG CODE No.
BILL OF MATERIAL			

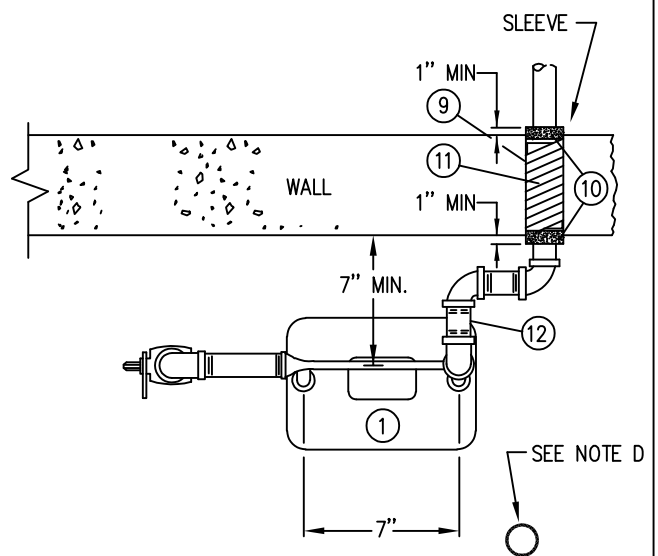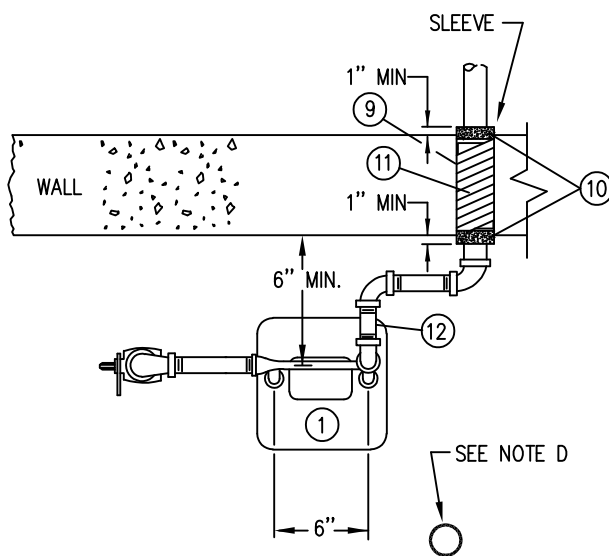

**nationalgrid**

NEW YORK CITY

**Key Changes:**      UPDATED LINKS AND SAP ITEM ID #'S

**LOW PRESSURE SINGLE METER  
OUTSIDE INSTALLATION  
0 - 250 CFH AND 0 - 425 CFH RANGE**

DATE: 7/1/2003

EFFECTIVE DATE:	04/23/2025
-----------------	------------

DESIGN: F. TAYLOR/ R. BLOISE

STD. DWG.
-----------

DRAWN: J. CASTALUCCI

NO.

**MTRS-6150**

**NOTES**


- A. KEY REQUIREMENTS FOR THE CONSTRUCTION OF METER HEADERS AND METER INSTALLATIONS ARE CONTAINED IN SPECIFICATIONS [CMS-03002](#)
- B. ADDITIONAL FITTINGS MAY BE REQUIRED TO MAKE THE METER INSTALLATION.
- C. NATIONAL GRID SHALL NOT BE RESPONSIBLE FOR DIMENSIONS OR FOR SCALED DIMENSIONS.
- D. WHERE VEHICULAR TRAFFIC IS A CONCERN, INSTALL PROTECTION POST SEE [MTRS-6060](#) FOR INSTALLATION REQUIREMENTS.
- E. COAT ALL PIPE AND FITTINGS WITH RUSTOLEUM #7715 OR EQUAL TWO COATS REQUIRED, BRUSH APPLIED.
- F. FOR UNDERGROUND PIPING AFTER METER, CONTACT GAS ENGINEERING FOR NATIONAL GRID REQUIREMENTS.

**NOTE: ALL MATERIALS AFTER THE SERVICE VALVE WILL BE FURNISHED AND INSTALLED BY THE CUSTOMER EXCEPT FOR THE REGULATOR WHICH IS FURNISHED BY THE COMPANY AND INSTALLED BY THE CUSTOMER. THE METER, SWIVEL AND CAPS (METER NUTS) WILL BE FURNISHED AND INSTALLED BY THE COMPANY.**

METER CHART		
METER CAPACITIES	0 – 250 CFH RANGE	0 – 425 CFH RANGE
AMERICAN / ELSTER	AL - 250	AL - 425
ROCKWELL EQUIMETER SENSUS	275	415
SPRAGUE /ACTARIS SCHLUMBERGER ITRON	250	400

12	HOUSE PIPING TO LOAD	----	----	CONTRACTOR
11	WALL SLEEVES SHALL BE PVC PLASTIC PIPE, OR STANDARD WEIGHT STEEL PIPE (2" LONGER THAN WALL THICKNESS)	----	----	CONTRACTOR
10	FLEXIBLE SEALING COMPOUND (DUXSEAL)	----	----	CONTRACTOR
9	YARN, PACKING	----	----	CONTRACTOR
8	ELBOW, 90 DEGREE M.I. SIZE OF HOUSE PIPE RISER x	1"	1-1/4"	CONTRACTOR
7	NIPPLE 4" MINIMUM (LENGTH AS REQUIRED)	1"	1-1/4"	CONTRACTOR
6	ELBOW, / REDUCING ELBOW 90 M.I.	1"X1-1/4"	1-1/4"	CONTRACTOR
5	NIPPLE 1 1/4" GALVANIZED OR EQUAL (LENGTH AS REQUIRED)	1-1/4"	1-1/4"	CONTRACTOR
4	METER, NUT/CAP CONNECTION OR METER, NUT/CAP CONNECTION GALVANIZED	9339504 20 LT 9340787 20 LT	9312381 30 LT 9383207 30 LT	NG
3	METER, OFFSET SWIVEL OR METER, OFFSET SWIVEL GALVANIZED	9312385 20LT 9383109 20LT	9342450 30 LT 9383108 30 LT	NG
2	METER BAR, WITH INSULATED OUTLET TOP OUT OR METER BAR, WITH INSULATED OUTLET SIDE OUT - GALVANIZED	9339755 9383181	9339756 9383209	NG
1	METER (TEMPERATURE COMPENSATED)	0 - 250	0 - 425	NG
No.	ITEM			NATL GRID CODE No.

## BILL OF MATERIAL

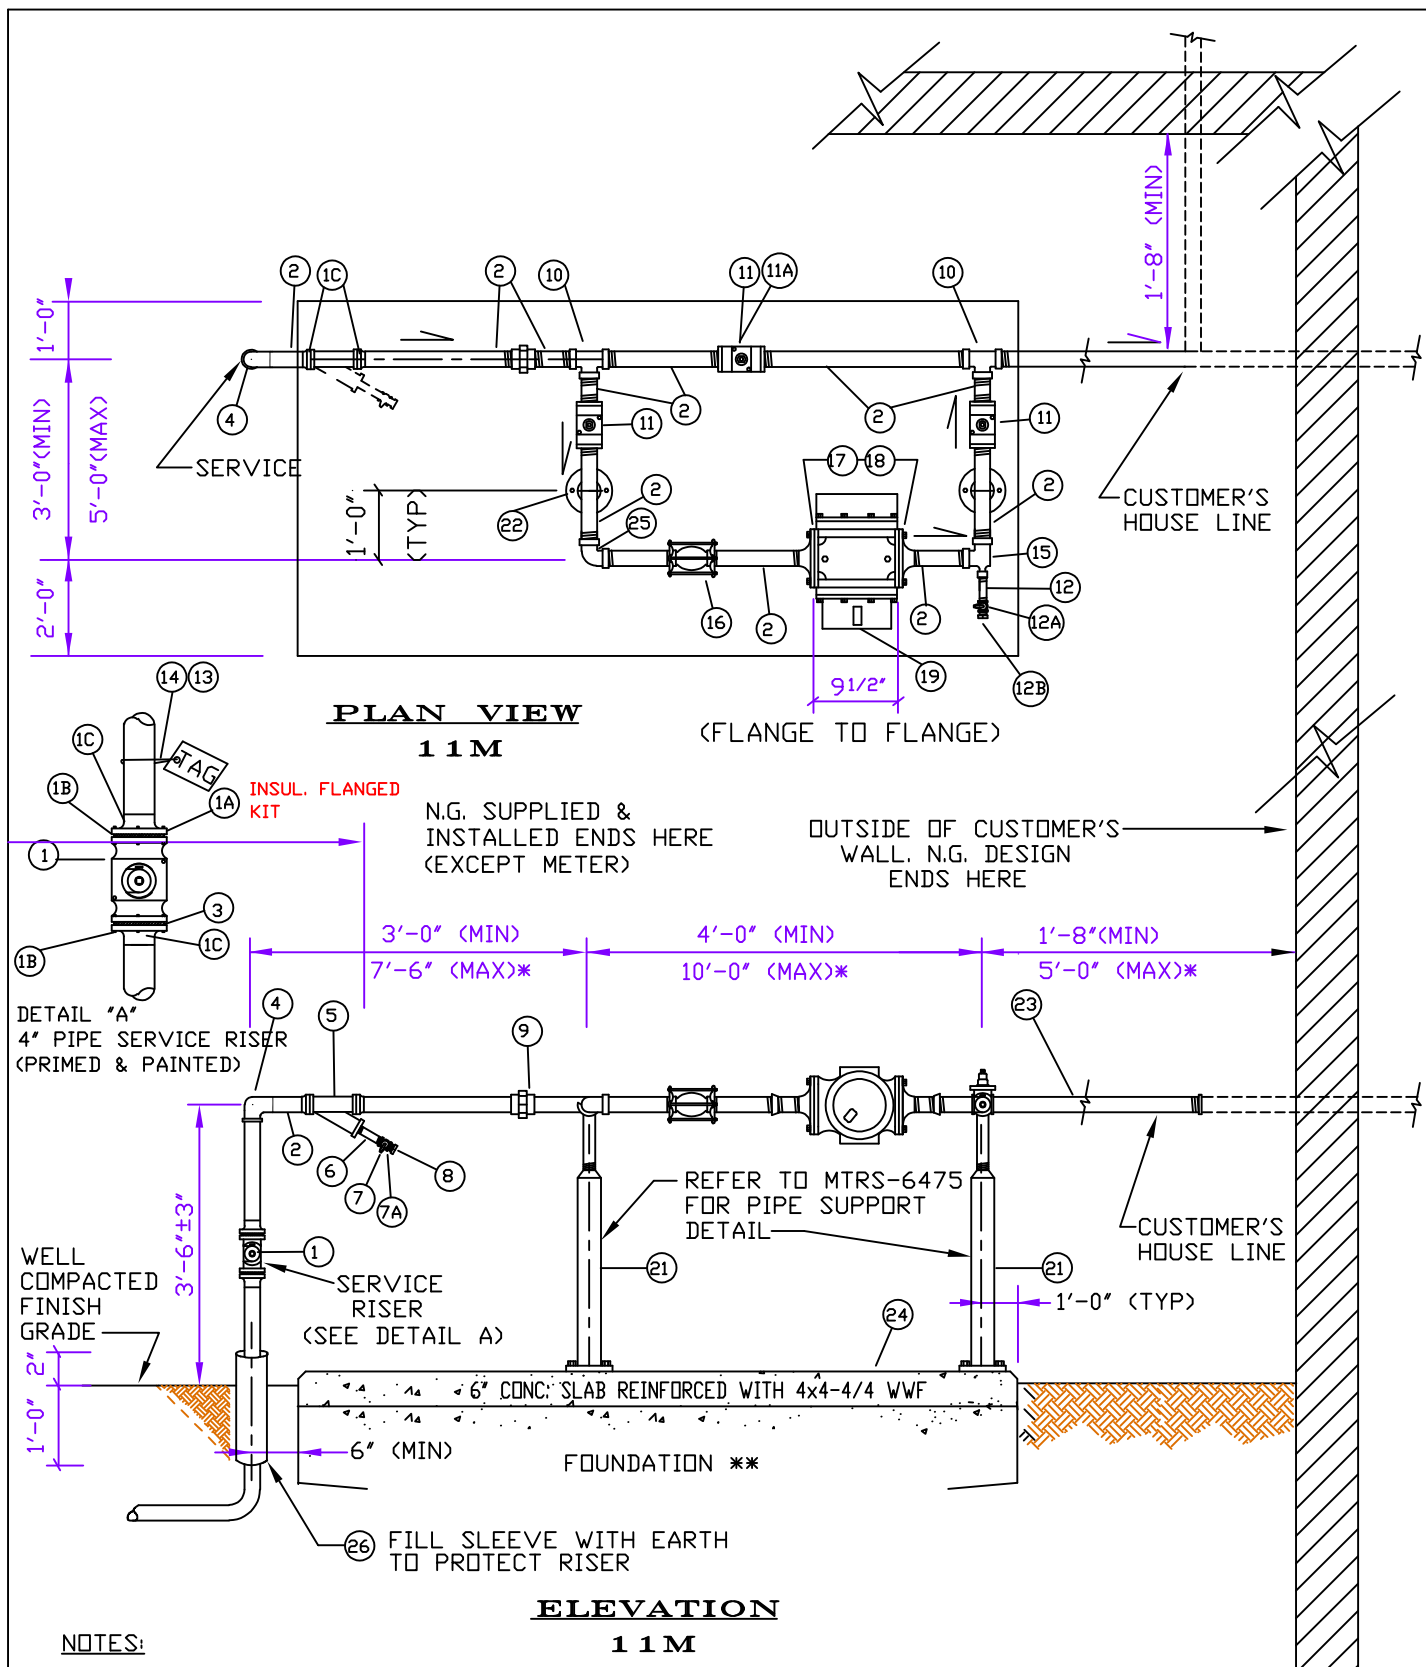

**nationalgrid**

LONG ISLAND

**LP MAIN / LP METERING  
FOR 11M125 OR 16M125  
HORIZONTAL - ROTARY GAS METER  
OUTSIDE LOCATIONS**

**REVISIONS:** UPDATED ITEM ID'S AND LINKS

DATE: 07/01/2003

DESIGN: JAL


DRAWN: MJC

EFFECTIVE DATE: 04/29/2025

STD. DWG.

NO.

**MTRS-6165**

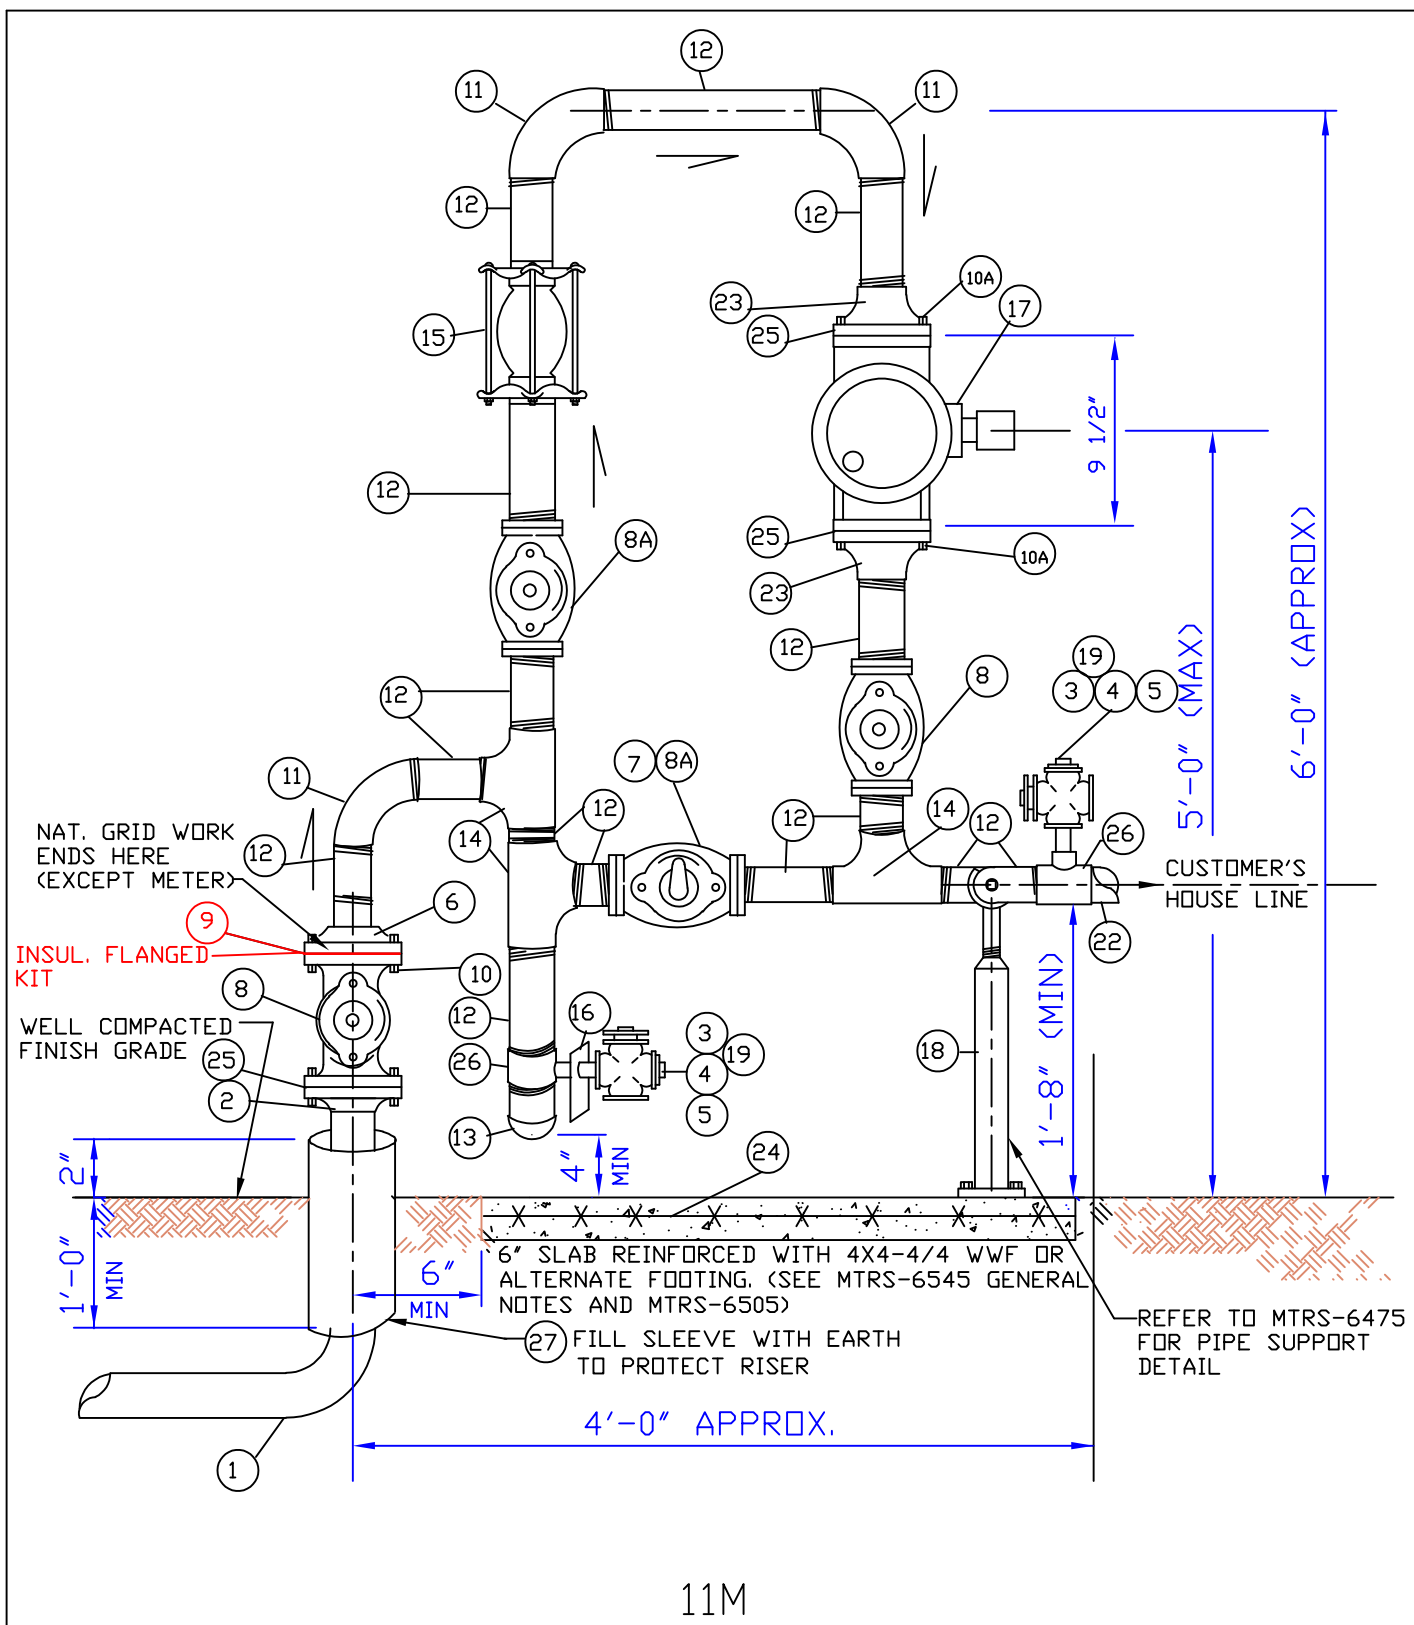

11M

<p><b>nationalgrid</b></p> <p>LONG ISLAND</p>	<p><b>LP MAIN / LP METERING</b></p> <p><b>11M125 OR 16M125</b></p> <p><b>VERTICAL - ROTARY GAS METER</b></p>	
<p><b>KEY CHANGES:</b> UPDATED ITEM ID'S</p>	<p>DATE: 07/01/2003</p> <p>DESIGN: JAL</p> <p>DRAWN: HF</p>	<p>EFFECTIVE DATE: 03/27/2025</p> <p>STD. DWG. NO. <b>MTRS-6155</b></p>



**NOTES**

- A. FOR GENERAL NOTES SEE [MTRS-6545](#)
- B. THIS CONSTRUCTION STANDARD SHALL BE USED WHEN AN OUTDOORS 11M OR 16M LOW PRESSURE MAIN & LOW PRESSURE METER SET IS SPECIFIED ON A WORK ORDER. IT SHOULD BE DESIGNED IN ACCORDANCE WITH THE CUSTOMERS TOTAL LOAD, SERVICE LENGTH AND SIZE AS OUTLINED IN THE DESIGN SECTION
- C. CENTERLINE OF PIPING SHALL BE APPROX. 1'- 8" FROM WALL.
- D. CINCH ANCHORS OR EQUIVALENT TO BE INSTALLED IN FLOOR FLANGES (ITEMS 21) BY CUSTOMER.
- E. NATIONAL GRID WILL SUPPLY AND INSTALL ITEMS AS LISTED IN BILLS OF MATERIAL
- F. AS PER NFPA-94, SECTION A268 (a) 1, ALL PIPING OVER 4" IN DIAMETER SHALL BE WELDED.
- G. THE 11M METER HAS AN INLET/OUTLET OF 4"


**LEGEND**

- + AS REQUIRED
- \*\* TO BE SUPPLIED BY F.O.
- X X SUPPLIED AND INSTALLED BY CUSTOMER

		ITEM ID	QUANTITY & SUPPLIED BY NG	QUANTITY & SUPPLIED BY CUSTOMER
27	PIPE SLEEVE – 6" – PLASTIC OR EQUIVALENT	NG	1	
26	TEE-4"X 4"X ¾" - THREADED	X X		2
25	GASKET RING – 4"	9341160	1	2
24	SLAB REINF. – 4X4 – 4/4 WIRE WELDED FABRIC	X X		1
23	FLANGE – 4" FF –COMPANION – ANSI CLASS 125	X X		2
22	PIPE – HOUSE LINE	X X		
21	NOT USED			
20	NOT USED			
19	GAS SNAP LOCK	9330915	2	
18	SUPPORT - PIPE – ADJUSTABLE – SEE <a href="#">MTRS-6475</a>	X X		1
17	METER- LINE MOUNTED ROTARY – 11M125	X X		
16	TAG – SERVICE LOCATION	9340255	1	
15	COUPLING – 4" –COMPRESSION- DRESSER STYLE 38	X X		1
14	TEE – 4" - THREADED	X X		3
13	CAP – 4" - THREADED	X X		1
12	PIPE – 4" – THREADED ENDS	X X		+
11	ELBOW – 4" - THREADED	X X		
10A	BOLT – 5/8" X 2" ASTM B7 GR. B (CAP SCREWS)	9342411	16	
10	BOLT- 5/8" X 2 3/4" BY – MACHINE OR BOLTS STUD 5/8" X 4 WITH 2 NUTS ANTI CORROSION	9339766 <a href="#">9392186</a>	16	
9	FLANGED KIT – 4" - INSULATED	9341024	1	
8A	VALVE- 4" - THREADED	X X		3
8	VALVE –4"	9382541	1	
7	LOCKING DEVICE	NG	1	
6	FLANGE – 4" FF – COMPANION – ANSI CLASS 125	X X		1
5	PLUG – 3/4" - THREADED	X X		2
4	GAS LOCK COCK – 3/4"	X X		2
3	NIPPLE – 3/4" X 3" - THREADED	XX		2
2	FLANGE –4" – WELD NECK	<a href="#">9314430</a>	1	
1	RISER 4" - STEEL		+	

No.	ITEM	
-----	------	--

**BILL OF MATERIAL FOR 11M METER**

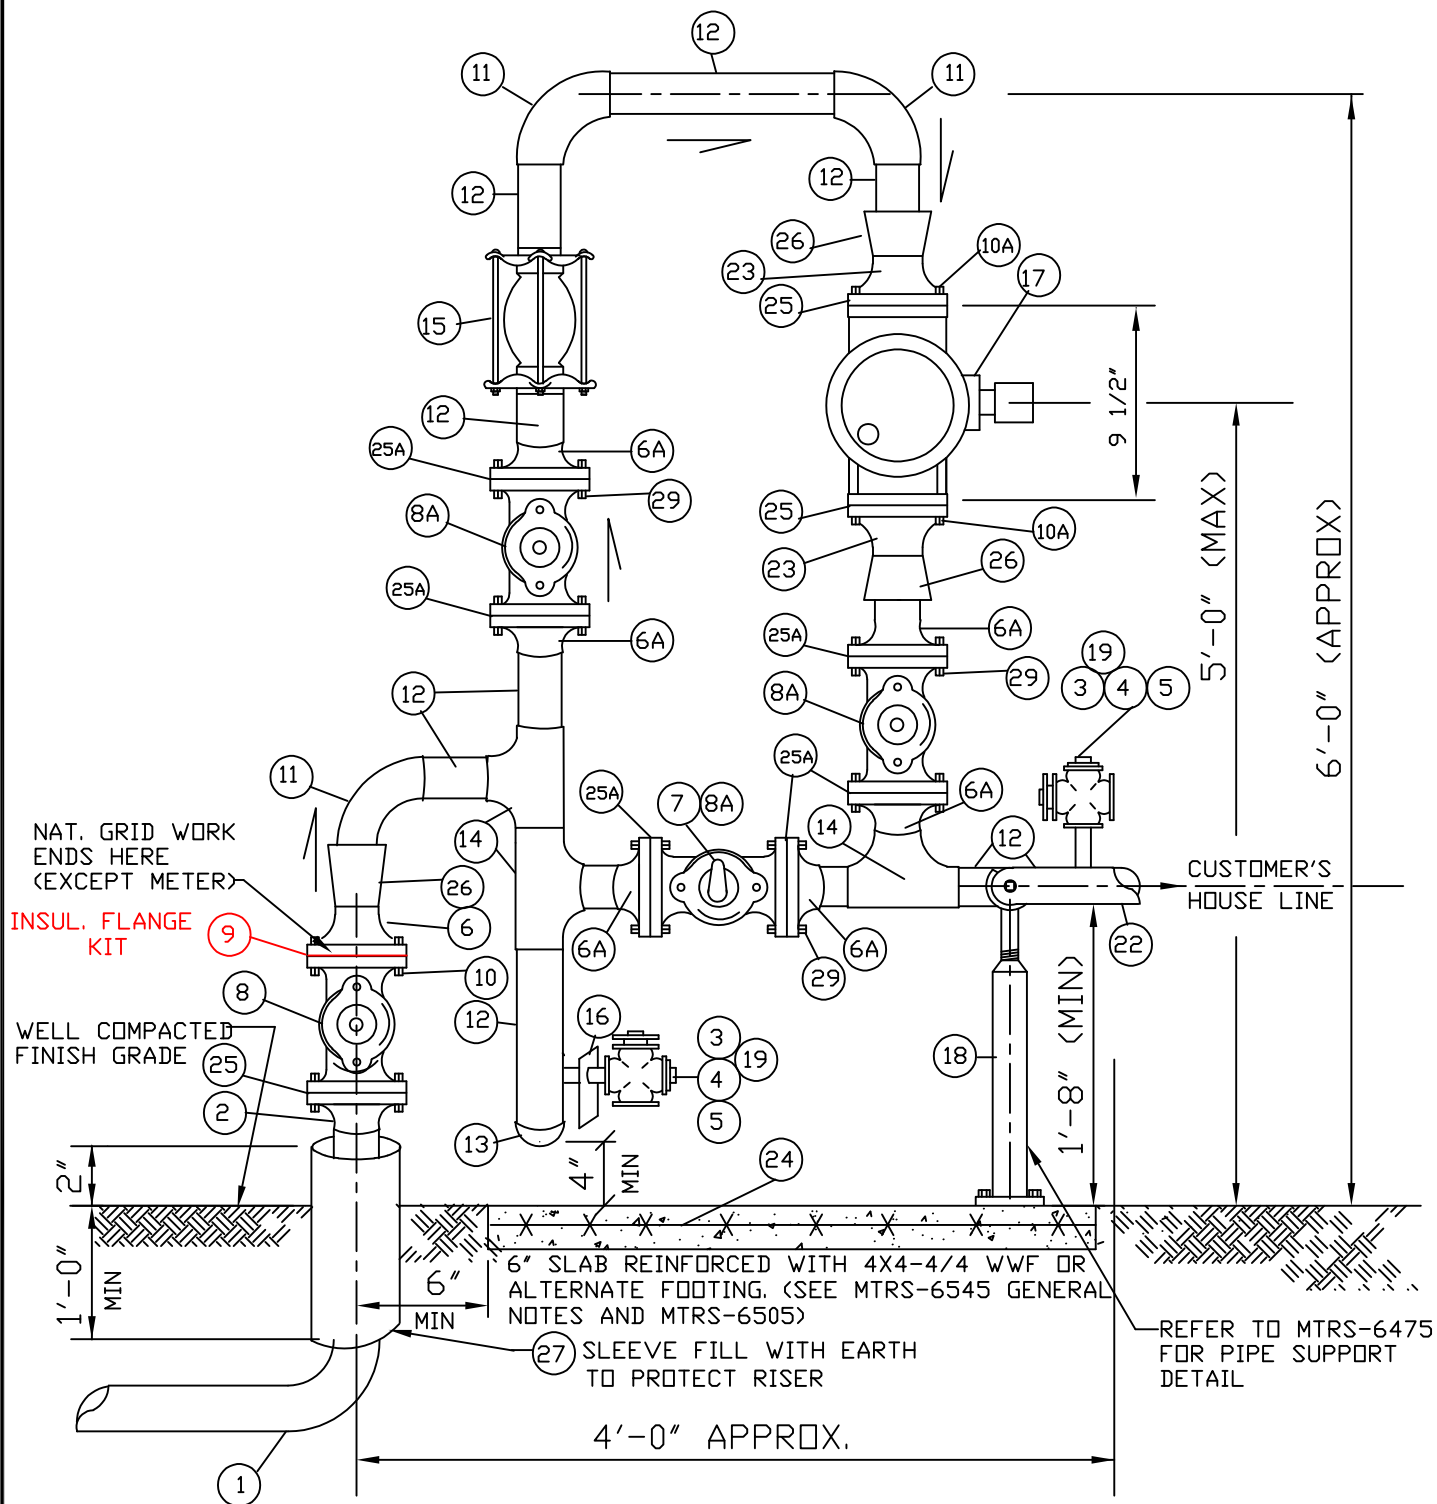

16M

**NOTES**

- A. FOR GENERAL NOTES SEE [MTRS-6545](#)
- B. THIS CONSTRUCTION STANDARD SHALL BE USED WHEN AN OUTDOORS 11M OR 16M LOW PRESSURE MAIN & LOW PRESSURE METER SET IS SPECIFIED ON A WORK ORDER. IT SHOULD BE DESIGNED IN ACCORDANCE WITH THE CUSTOMERS TOTAL LOAD, SERVICE LENGTH AND SIZE AS OUTLINED IN THE DESIGN SECTION
- C. CENTERLINE OF PIPING SHALL BE APPROX. 1'- 8" FROM WALL.
- D. CINCH ANCHORS OR EQUIVALENT TO BE INSTALLED IN FLOOR FLANGES (ITEMS 21) BY CUSTOMER.
- E. NATIONAL GRID WILL SUPPLY AND INSTALL ITEMS AS LISTED IN BILLS OF MATERIAL
- F. AS PER NFPA-94, SECTION A268 (a) 1, ALL PIPING OVER 4" IN DIAMETER SHALL BE WELDED.
- G. DRILL A 1 1/2" DIAMETER HOLE IN ITEM 12 BEFORE WELDING ON ITEM 3 FOR TAP CONNECTIONS ATTACHMENTS.
- H. THE 16M METER AN INLET/ OUTLET OF 4"

**LEGEND**

- + AS REQUIRED
- \*\* TO BE SUPPLIED BY F.O.
- X X SUPPLIED AND INSTALLED BY CUSTOMER

SEE GENERAL NOTE Z OF [MTRS-6545](#) FOR PIPE SUPPORT

		ITEM ID	QUANTITY & SUPPLIED BY NG	QUANTITY & SUPPLIED BY CUSTOMER
29	BOLT – 3 /4" X 3 – 1 /2" A 307	X X		36
28	NOT USED			
27	PIPE SLEEVE – 6" – PLASTIC OR EQUIVALENT	NG	1	
26	REDUCER – 6"X 4" - WELDED	X X		3
25A	GASKET RING – 6"	X X		6
25	GASKET RING – 4"	9341160	1	2
24	SLAB REINF. – 4X4-4/4 WIRE WELDED FABRIC	X X		1
23	FLANGE – 4" - WELDED	X X		2
22	PIPE – HOUSE LINE	X X		1
21	NOT USED			
20	NOT USED			
19	GAS SNAP LOCK	9330915	2	
18	SUPPORT – 3" – PIPE - ADJUSTABLE	NG		
17	METER – LINE MOUNTED ROTARY – 16M125	X X	1	
16	TAG – SERVICE LOCATION	9340255	1	
15	COUPLING – 6" – COMPRESSION – DRESSER STYLE 38	X X		1
14	TEE – 6" - WELDED	X X		3
13	CAP – 6" - WELDED	X X		1
12	PIPE – 6" WELDED	X X		+
11	ELBOW – 6" - WELDED	X X		3
10A	BOLT = 5 /8" X 2" ASTM B7 GR B – CAP SCREWS	9342411	16	
10	BOLT – 5/ 8" X 2 3 /4" B7- MACHINE OR BOLTS STUD 5/8" X 4" WITH 2 HEX NUTS CORROSION RESISTANT	9339766 9392186	16	
9	FLANGED KIT – 4" - INSULATED	9341024	1	
8A	VALVE – 6"	X X		3
8	VALVE - 4"	9382541	1	
7	LOCKING DEVICE	NG	1	
6A	FLANGE – 6" – WELD NECK	X X		6
6	FLANGE – 4" – WELD NECK	X X		1
5	PLUG – 3 /4" - THREADED	X X		2
4	GAS LOCK COCK – 3 /4"	X X		2
3	NIPPLE – 3 /4" X 3"- THREADED	X X		2
2	FLANGE- 4" – WELD NECK	9314430	1	
1	RISER – 4" - STEEL		+	

No.	ITEM	NATIONAL GRIDCODE No.
BILL OF MATERIAL FOR 16M METER		

**NOTES**

- A. SEE GENERAL NOTES [MTRS-6545](#)  
 B. ALL SCREW TYPE PIPE FITTINGS TO BE HOT DIPPED GALVANIZED  
 C. ALL FITTINGS SHALL BE MALLEABLE IRON CLASS 150, ANSI B 16.3  
 D. CINCH ANCHORS TO BE INSTALLED IN PIPE SUPPORT (ITEM 22) BY CUSTOMER  
 E. FOR UNDERGROUND CUSTOMER'S HOUSE PIPING REFER TO DESIGN SECTION  
 F. FOR VEHICULAR DAMAGE PROTECTION SEE [MTRS-6060](#)  
 G. A METER SHALL NEVER BE INSTALLED LOWER THAN EITHER SIDE OF PIPE RUNS  
 H. NATIONAL GRID WILL SUPPLY AND INSTALL ITEMS 1 THRU 8, 11A, 14, 14A, 17A THRU 19 AND 26.

**LEGEND:**

X X – SUPPLIED BY CUSTOMER

\*\* – TO BE SUPPLIED BY NATIONAL GRID.

+ AS REQUIRED

SEE GENERAL NOTE 26 OF [MTRS – 6545](#) FOR PIPE SUPPORT

26	PIPE SLEEVE – 6” – PLASTIC OR EQUIVALENT	1	NAT. GRID
25	ELBOW – 4” – 90 DEGREE - THREADED	1	X X
24	SLAB REINF – 4X4 – 4/4 WIRE WELDED FABRIC	1	X X
23	PIPE – HOUSE LINE	+	X X
22	NOT USED		
21	SUPPORT – 3"- PIPE - ADJUSTABLE	2	NAT. GRID
20	NOT USED		
19	METER – LINE MOUNTED ROTARY –11M 125	1	**
18	GASKET RING - METER	2	9341160
17A	BOLT – 5 /8” X 2 ASTM B7 GR. B	16	9342411
17	FLANGE – 4” FF – COMPANION – ANSI CLASS 125	2	X X
16	COUPLING – 4"- COMPRESSION (DRESSER STYLE 90 LOCK TYPE)	1	X X
15	TEE – 4” X 3 /4” X 4” - THREADED	1	X X
14	NYLON STRIP – 14” – SELF LOCKING	1	9325971
13	TAG – GAS SERVICE LOCATION	1	9340255
12B	PLUG – 3 /4” NPT - SOLID	1	X X
12A	COCK – 3 /4” - LOCKWING	1	X X
12	NIPPLE – 3/ 4” X 3” LONG	1	X X
11A	LOCKING DEVICE	1	NAT. GRID
11	VALVE – 4” - PLUG	3	X X
10	TEE – 4” - THREADED	2	X X
9	UNION – 4” - THREADED	1	X X
8	PLUG – 1-1/4” NPT - SOLID	1	9312286
7A	GAS SNAPLOCK	1	9330915
7	VALVE – 1-1/4” LOCKWING GALVANIZED	1	9339609
6	NIPPLE – 1-1/4” X 3” LONG - GALVANIZED	1	9340650
5	STRAINER – CAST IRON – FLANGED END “Y” SCREEN – 100 MESH – WITH BOLTS	1	9340157
4	ELBOW – 4” – STEEL, 90 DEGREE LONG RADIUS– WELD ASTM A234 WPB	1	9315385
3	GASKET RING – 4”	3	9341160
2	PIPE – 4”	+	<a href="#">9312326</a>
1C	FLANGE – 4” –WELD NECK	4	9314430
1B	BOLT – 5 /8” X 3” B7 – MACHINE OR STUD BOLTS 5/8” X 4” WITH 2 HEX NUTS – CORROSION RESISTANT	16	9339769 9392186
1A	GASKET – 4” – FLANGE - INSULATED	1	9341024
1	VALVE – 4”	1	9382541
No.	ITEM	ITEM ID	
BILL OF MATERIAL			

\* MAX. DIMENSIONS FOR INFORMATION ONLY  
 \*\* SEE GENERAL NOTES  
 - ALL PIPING GREATER THAN 4" SHALL BE WELDED

**NOTES**

- A. SEE GENERAL NOTES [MTRS-6545](#)  
 B. ALL SCREW TYPE PIPE FITTINGS TO BE HOT DIPPED GALVANIZED  
 C. ALL FITTINGS SHALL BE MALLEABLE IRON CLASS 150, ANSI B 16.3  
 D. CINCH ANCHORS TO BE INSTALLED IN FLOOR FLANGES (ITEMS 22) BY CUSTOMER  
 E. FOR UNDERGROUND CUSTOMER'S HOUSE PIPING REFER TO DESIGN SECTION  
 F. FOR VEHICULAR DAMAGE PROTECTION SEE [MTRS-6060](#)  
 G. A METER SHALL NEVER BE INSTALLED LOWER THAN EITHER SIDE OF PIPE RUNS  
 H. NATIONAL GRID WILL SUPPLY AND INSTALL ITEMS 1 THRU 8 (EXCEPT 2A). 11A, 14, 14A 17A THRU 19 AND 26.  
 I. SEE GENERAL NOTE 26 OF [MTRS – 6545](#) FOR PIPE SUPPORT


**LEGEND:**

X X –SUPPLIED BY CUSTOMER


\*\*- TO BE SUPPLIED BY NATIONAL GRID.

+ AS REQUIRED


26	PIPE SLEEVE – 6" – PLASTIC OR EQUIVALENT	1	NATIONAL GRID
25	ELBOW – 6" – 90 DEGREE - WELD	1	X X
24	SLAB REINF – 4X 4 - 4/4 WIRE WELDED FABRIC	1	X X
23	PIPE – HOUSE LINE	+	X X
22	NOT USED		
21	SUPPORT – 3" – PIPE - ADJUSTABLE	2	NATIONAL GRID
20	NOT USED		
19	METER – LINE MOUNTED ROTARY – 16M 125	1	**
18	GASKET RING - METER	2	9341160
17A	BOLT – 5 /8" X 2 ASTM A 307 GR B – CAP SCREW	16	9342411
17	FLANGE – 4" – WELD NECK	2	X X
16	COUPLING – 6"- COMPRESSION (DRESSER STYLE 90 LOCK YYPE)	1	X X
15A	REDUCER – 2" X 3/4"	1	X X
15	TEE – 6" X 2" X 6" -WELD	1	X X
14A	NYLON STRIP – 14" – SELF LOCKING	1	9325971
14	TAG – GAS SERVICE LOCATION	1	9340255
13B	GASKET RING – 6"	6	X X
13A	BOLT – 3 /4" X 3- 1/2"	36	X X
13	FLANGE – 6" – WELD NECK	6	X X
12B	PLUG – 3 /4" NPT - SOLID	1	X X
12A	VALVE – 3 /4" – LOCKWING GALVANIZED	1	X X
12	NIPPLE – 3 /4" X 3" LONG	1	X X
11A	LOCKING DEVICE	1	NATIONAL GRID
11	VALVE – 6" - PLUG	3	X X
10	TEE – 6" - WELDED	2	X X
9	REDUCER – 6" X 4" - SOLID	3	X X
8	PLUG – 1-1/4" NPT - SOLID	1	9312286
7A	GAS SNAPLOCK	1	9330915
7	VALVE – 1-1/4" – LOCKWING GALVANIZED	1	9339609
6	NIPPLE – 1-1/4" X 3" LONG GALVANIZED	1	9340650
5	STRAINER –CAST IRON – FLANGED END "Y" SCREEN – 100 MESH – WITH BOLTS	1	9340157
4	ELBOW – 4" – 90 DEGREE STEEL – LONG RADIUS – WELD END ASTM A234WPB	1	9315385
3	GASKET RING – 4"	3	9341160
2A	PIPE – 6"	+	X X
2	PIPE – 4"	+	9312326
1C	FLANGE – 4" – WELD NECK	4	9314430
1B	BOLT – 5 / 8" X 3" B7 – MACHINE OR STUD BOLT 5/8" X 4" WITH 2 HEX NUTS – CORROSION RESISTANT	16	9339769 9392186
1A	GASKET – 4" – FLANGE - INSULATED	1	9341024
1	VALVE – 4"	1	9382541
No.	ITEM	NATIONAL GRID ITEM ID	
BILL OF MATERIAL			

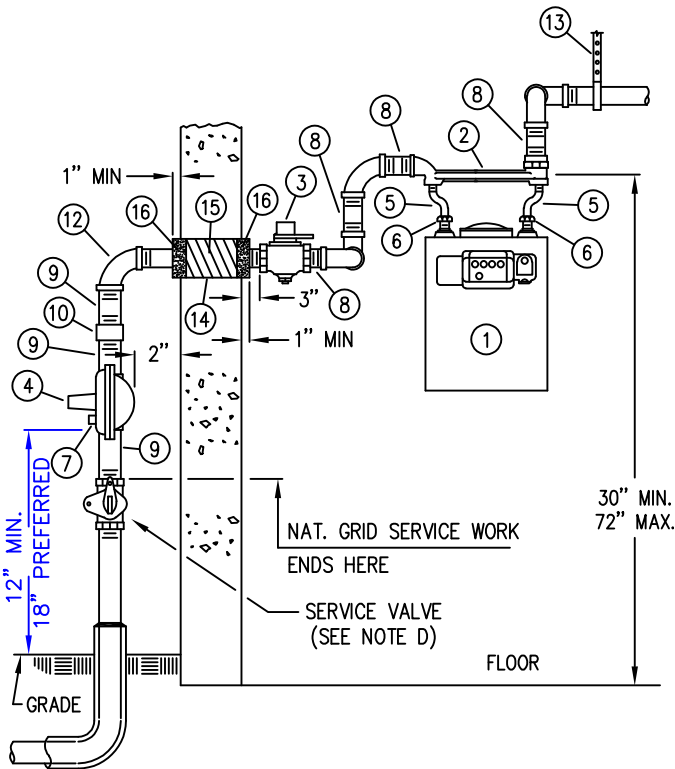


ELEVATION  
250 CFH TYPE

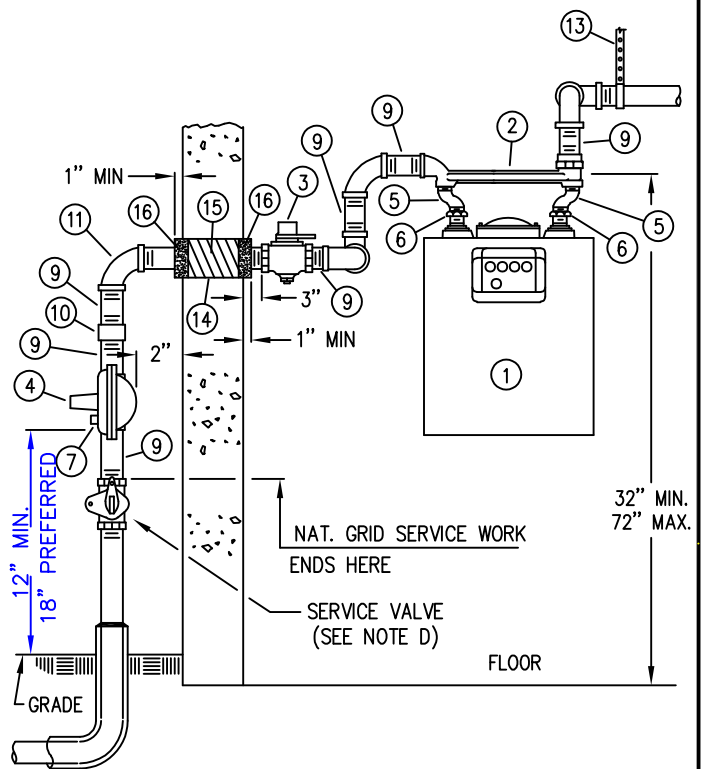

ELEVATION  
425 CFH TYPE

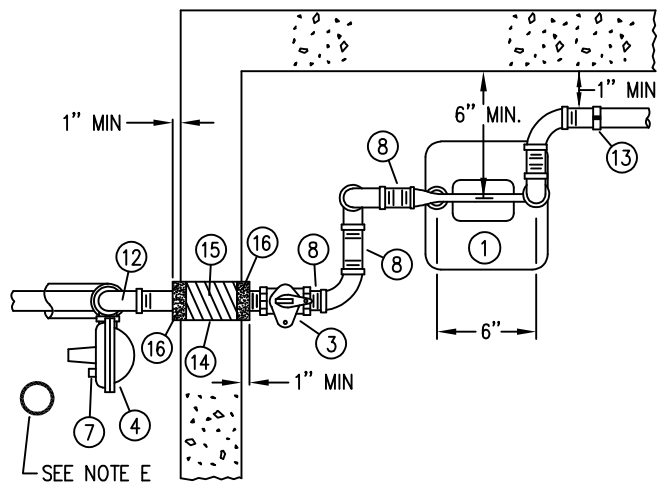

PLAN  
250 CFH TYPE

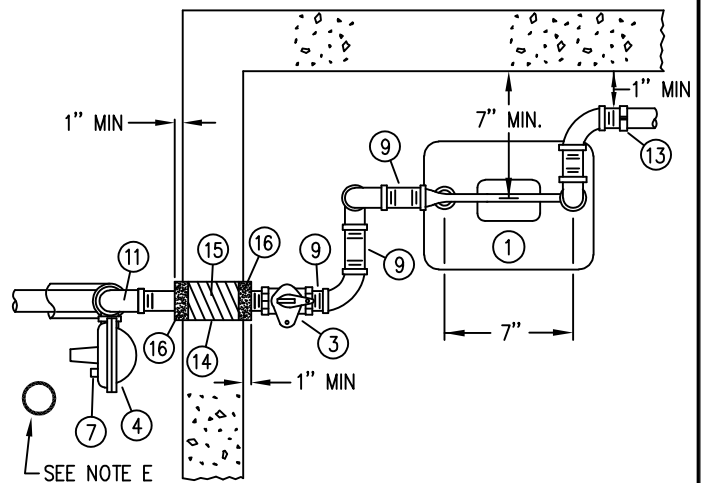

PLAN  
425 CFH TYPE

**nationalgrid**

NEW YORK CITY

# **SINGLE INSIDE METER INSTALLATION WITH OUTSIDE REGULATOR 0 - 250 CFH AND 0 - 425 CFH RANGE 15# H.P. SERVICE**

REVISIONS: [UPDATED LINKS](#)

DATE: 07/01/2003

DESIGN: R. BLOISE

DRAWN: P. O'NEIL

EFFECTIVE DATE: [04/30/2025](#)

STD. DWG.

NO. **MTRS-6180**

**NOTES**

- A. KEY REQUIREMENTS FOR THE CONSTRUCTION OF METER HEADERS AND METER INSTALLATION IN NATIONAL GRID SPECIFICATIONS [CMS03002](#).
- B. ADDITIONAL FITTINGS MAY BE REQUIRED TO MAKE THE METER AND REGULATOR INSTALLATION.
- C. CURB VALVE IS NOT REQUIRED PROVIDED THERE IS AN ACCESSIBLE OUTSIDE SHUT-OFF VALVE. [SEE CNST06004](#).
- D. COAT ALL OUTSIDE PIPE AND FITTINGS W RUSTOLEUM #7715 OR EQUAL. TWO COATS REQUIRED, BRUSH APPLIED, ALSO SERVICE VALVE MUST BE PAINTED RED.
- E. WHERE VEHICULAR TRAFFIC IS A CONCERN, INSTALL PROTECTION POSTS. SEE [MTRS-6060](#) FOR INSTALLATION REQUIREMENTS.
- F. REGULATOR VENT MUST FACE DOWN AND BE EQUIPPED WITH A RAIN AND INSECT RESISTANT SCREEN. IT IS PREFERRED THAT REGULATOR VENTS BE INSTALLED AT A HEIGHT 18 INCHES ABOVE GRADE, HOWEVER, THE MINIMUM ALLOWABLE VENT HEIGHT SHALL BE 12 INCHES ABOVE FINAL GRADE. IN CASES OF KNOWN FLOOD LOCATIONS, THE PREFERRED REGULATOR VENT HEIGHT ABOVE THE FLOOD HEIGHT IS 18" (12" MINIMUM). THE REGULATOR VENT SHALL BE 18" (WHERE PRACTICAL) FROM ANY OPENING WHICH COULD ALLOW VENTED GAS TO ENTER.
- G. FOR FLOW RATES BETWEEN 470 CFH AND 940 CFH (60PSIG SYS) AND 775 CFH AND 1,550 CFH (15 PGIG SYSTEM) SEE [MTRS-6121](#) AND [MTRS-6130](#)
- H. FOR FLOW RATES GREATER THAN 940 CFH (60 PSIG SYS) OR 1,550 CFH (15 PSIG SYS) SEE SPECIAL ENGINEERING METER AND LAYOUT.
- I. NATIONAL GRID SHALL NOT BE RESPONSIBLE FOR FITTING OR SCALED DIMENSIONS...

**METER CHART**

	METER CAPACITIES	0 -250 CFH RANGE	0 - 425 CFH RANGE		
	AMERICAN / ELSTER/HONEYWELL	AL-250	AL - 425		
	ROCKWELL / EQUIMETER / SENSUS	275	415		
	SPRAGUE / SCHLUMBERGER / ACTARIS / IRTON	250	400		
1	METER		250	425	NATIONAL GRID
2	METER BAR, WITH INSULATED OUTLET TOP OUTLET METER BAR, WITH INSULATED OUTLET SIDE OUTLET GALVANIZED		9339755 9383181	9339756 9383209	NATIONAL GRID
3	VALVE, MUELLER, LOCKWING, TAMPER PROOF, H-11118 OR APP. EQUAL 1" 1-1/4"		9312256 ---	--- 9308487	NATIONAL GRID
4	REGULATOR, FISHER HSR /ITRON B31 OR B42 / AMERICAN 1813B2 OR APP. EQUAL - 1-1/4" X 1-1/4" (1/4" ORIFICE) WITH 1" VENT (15 PSIG MAX.)		9342623	9342623	NATIONAL GRID
5	METER OFFSET SWIVEL OR METER OFFSET SWIVEL GALVANIZED		9312385 20LT 9383109 20LT	9342450 30LT 9383108 30LT	NATIONAL GRID
6	METER, CAP / NUT CONNECTION OR METER CAP / NUT COMNNECTION GALVANIZED		9312379 20LT 9340787 20 LT	9312381 30LT 9383207 30 LT	NATIONAL GRID
7	VENT ASSEMBLY W/ SCREEN 1" (SEE NOTE F)		9315859	9315859	CONTR
8	NIPPLE, 4" MINIMUM ( IF REQUIRED)		1"	1-1/4"	CONTR
9	NIPPLE 4" MINIMUM ( LENGTH AS REQUIRED)		1-1/4"	1-1/4"	CONTR
10	UNION, STEEL, SCREW, INSULATING, 150#		1-1/4"	1-1/4"	CONTR
11	ELBOW, 90 M.I.		1"	1-1/4"	CONTR
12	ELBOW, REDUCING, 90 M.I.		1-1/4" X1"	-----	CONTR
13	PIPING SUPPORT / STRAPPING (NEOPRENE OR EQUAL BETWEEN THE SUPPORT AND PIPE)		-----	-----	CONTR
14	WALL SLEEVE ( 2" LONGER THAN WALL THICKNESS)		1-1/2"	2"	CONTR
15	YARN , PACKING		----	-----	CONTR
16	FLEXIBLE SEALING COMPOUND ( DUXSEAL)		-----	-----	CONTR
17	PROTECTION POST, FOR SERVICE & REGULATOR PROTECTION (SEE NOTE E)		-----	-----	CONTR
	<b>NOTE: ALL MATERIALS AFTER THE SERVICE VALVE WILL BE FURNISHED AND INSTALLED BY THE CUSTOMER EXCEPT FOR THE REGULATOR WHICH IS FURNISHED BY THE COMPANY AND INSTALLED BY THE CUSTOMER. THE METER, SWIVEL AND CAPS (METER NUTS) WILL BE FURNISHED AND INSTALLED BY THE COMPANY.</b>				<b>NAT. GRID CODE</b>

**BILL OF MATERIAL**



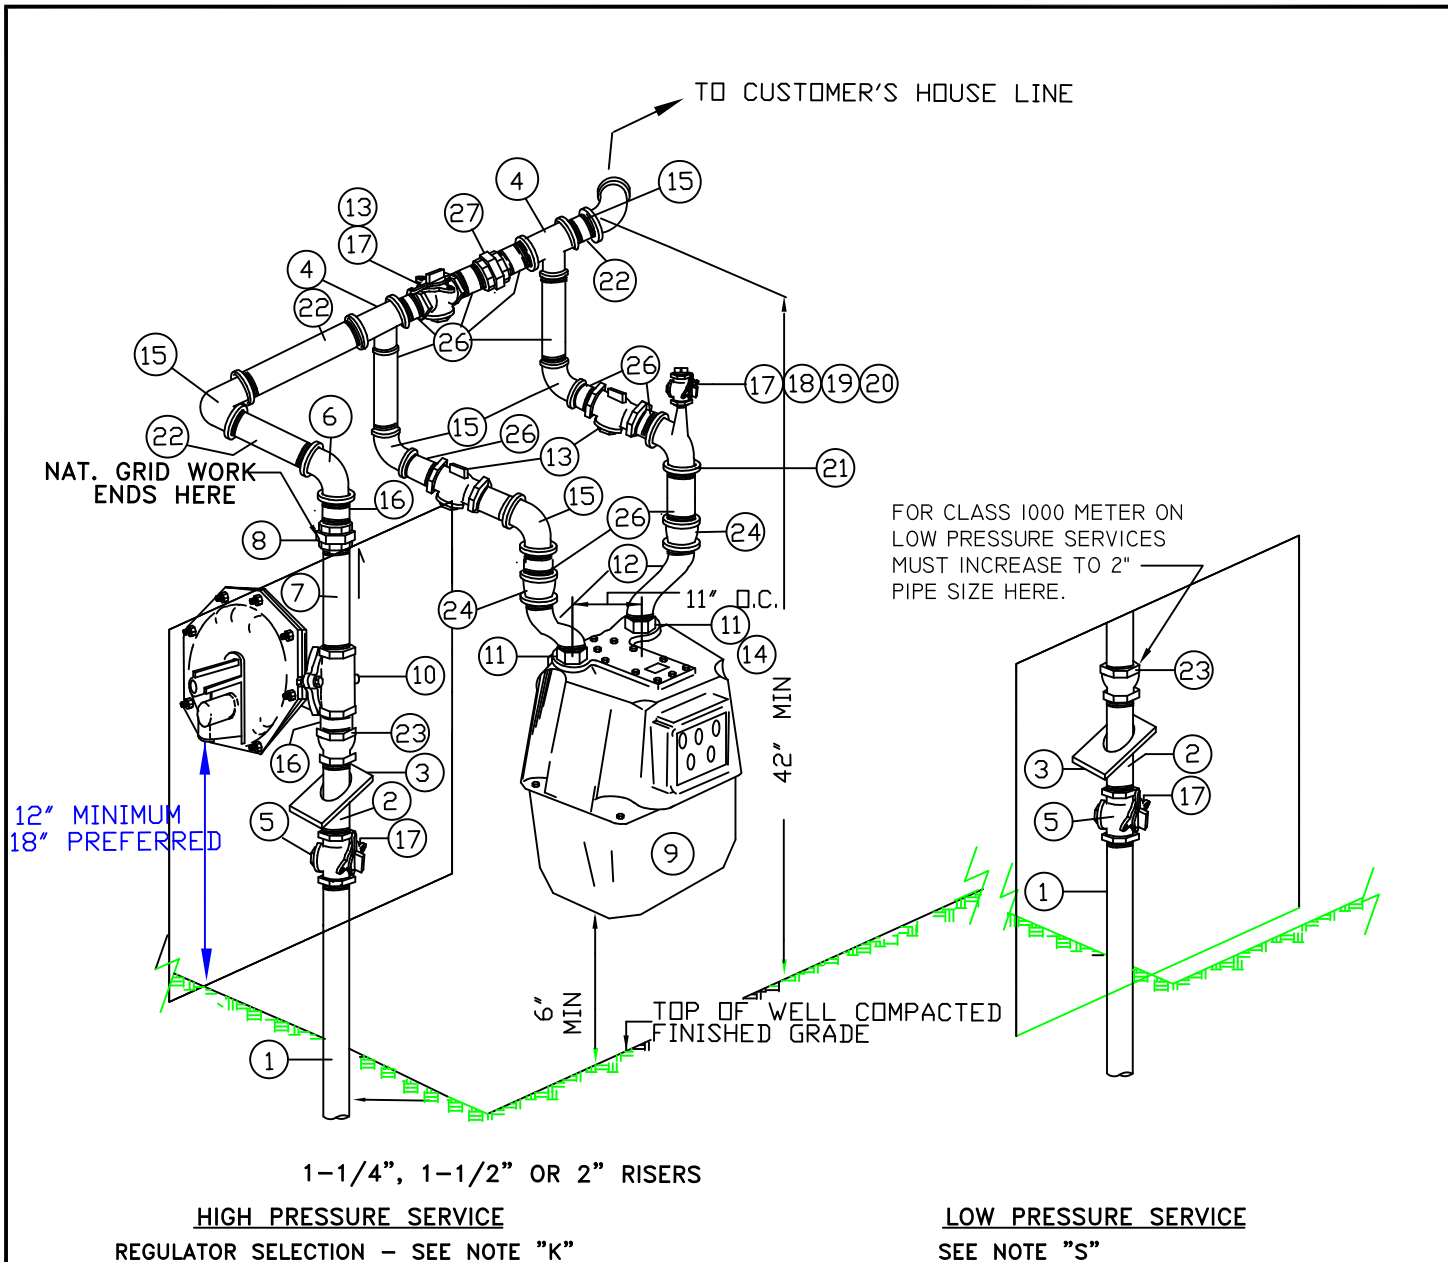


FIGURE 1 - WITH BYPASS

INLET PRESSURE	REGULATOR	ORIFICE REQUIREMENTS
30/60 PSIG INLET	2" FISHER CS-400IR ITEM ID 9388985 OR 2" FISHER CS-806IR ITEM ID 9386776 OR 1-1/4" B-31R ITEM ID 9342206 2" B34SR ITEM ID 9342660 OR 2" B34-IMRV ITEM ID 9342684 OR 1-1/2" B34SR ITEM ID 9383176	COMES WITH 7/32"x1/4" ORIFICE 60 PSIG MAX 1/2" (STANDARD ORIFICE FOR ITEM ID - 100 PSIG) 3/16" (STANDARD ORIFICE FOR ITEM ID) 7/32"x1/4" (STANDARD ORIFICE FOR ITEM ID) 1/2" (STANDARD ORIFICE FOR ITEM ID) CHANGE ORIFICE TO 7/32"x1/4" 9324363
99/124 PSIG INLET	2" FISHER CS-400IR ITEM ID 9388995 OR 2" FISHER CS-806IR ITEM ID 9386776 OR 1-1/4" B31R/B42R ITEM ID 9383127 AMER. 1813B2, SR-100 2" B34SR ITEM ID 9342660	COMES WITH 11/64" ORIFICE 124 PSIG MAX 3/8" ( ITEM ID 9386786 FOR 124 PSIG INLETS) 1/8" (STANDARD ORIFICE FOR ITEM ID) CHANGE ORIFICE TO 5/32"x3/16" 9324362

**nationalgrid**

LONG ISLAND

OUTDOOR METER SET  
CLASS 750/800/1000  
LP-124 PSIG SERVICES  
LOW PRESSURE & 1/2 PSIG OUTLETS

REVISIONS: ADDED FISHER CS400, UPDATED SAP ITEM ID #'S

DATE: 04/29/2004

EFFECTIVE DATE: 06/18/2020

DESIGN: PAUL GUGLIOTTA

STD. DWG.

DRAWN: PAUL GUGLIOTTA

NO.

**MTRS-6185**

NO.	ITEM	1 ¼" SERVICE	QTY	1 ½" SERVICE	QTY	2" SERVICE	QTY	SUPPLIED BY
27	UNION – 1-1/4" GALVANIZED NON-INSUL.		1		1		1	CUSTOMER
26	NIPPLE 1-1/4" X 2 ½" LONG LENGTH, GALV, SCH 40		9		9		9	CUSTOMER
25	ITEM DELETED		0		0		0	CUSTOMER
24	ITEM NOT NEEDED FOR CLASS 800 METER		0		0		0	CUSTOMER
23	REDUCER 1 ¼" X 2" GALV. (FOR 1 ¼" SERVICES THAT USE 2" REGULATOR)	9342614	1		0		0	NAT. GRID
22	NIPPLE – 1-1/4" X AS REQUIRED LENGTH,GALV, SCH 40		2		2		2	CUSTOMER
21	TEE – 1-1/4" X ¾" X 1-1/4" – HEEL – M.I. GALV., THREADED		1		1		1	CUSTOMER
20	VALVE LOCKWING, MUELLER TAMPER-PROOF H-11118 – LOCK CLOSED ¾"		1		1		1	CUSTOMER
19	NIPPLE ¾" X 4" GALV. SCH. 40		1		1		1	CUSTOMER
18	PLUG – ¾" GALV.		1		1		1	CUSTOMER
17	LOCK		3		3		3	NAT. GRID
16	NIPPLE 1 ¼". 1 ½" OR 2" X 3" LONG, GALV. SCH. 40		1		1		1	CUSTOMER
15	ELBOW 1-1/4" GALV. 90 DEGREE		5		5		5	CUSTOMER
14	RUBBER WASHER FOR METER SWIVEL	9310300	2	9310300	2	9310300	2	NAT. GRID
13	METER VALVE - LOCK WING – 1-1/4"	9339609	3	9339609	3	9339609	3	CUSTOMER
12	METER SWIVEL 1 ¼" X 45 LIGHT	9342425	2	9342425	2	9342425	2	NAT. GRID
11	METER NUT GALV. 45 LT	9340788	2	9340788	2	9340788	2	NAT. GRID
10	A. REGULATOR 2" SCR'D FISHER ITRON B34SR (5"-9" OUTLET SPRING RANGE) OR B. REGULATOR 1 ½" SCR'D ITRON B34SR (5"-9" OUTLET SPRING RANGE) SEE NOTE "K" C. REGULATOR 1 ¼" SCR'D FISHER HSR/ITRON B42 1/8" ORIF. OR EQ. FOR 99 AND 124 PSIG SERVICES ONLY D. REGULATOR 1 ¼" SCR'D ITRON B31R WITH 3/16" ORIFICE FOR 60 PSIG MAX E. FISHER CS-806 IR 2" THREADED F. FISHER CS-400IR 7/32X1/4" FOR 60 PSIG OR 11/64" FOR 99/124 PSIG	SEE TABLE ON PG 1	1	SEE TABLE ON PG 1	1	SEE TABLE ON PG 1	1	NAT. GRID NAT. GRID NAT. GRID
9	METER CLASS 800		1		1		1	NAT. GRID
8	UNION – INSULTAING GALV. 1-1/4", 1 ½" OR 2"	9341685	1	9341686	1	9341687	1	NAT. GRID
7	NIPPLE – LENGTH AS REQUIRED X REGULATOR SIZE OR RISER SIZE FOR LOW PRESSURE SERVICES		1		1		1	NAT. GRID
6	ELBOW 1 – ½" X 1-1/4" GALV. 90 DEGREE, THREADED FOR 1 – ½" REGULATORS ELBOW 2" X 1-1/4" GALV. 90 DEGREE, THREADED – FOR 2" REGULATORS ELBOW 1 – ¼" GALV. 90 DEGREE, THREADED FOR 1 ¼" REGULATORS		- - 1		1 - -		- 1 -	CUSTOMER
5	PLUG VALVE – SERVICE SIZE 1-¼", 1-½" OR 2" THREADED ENDS. ALTERNATE: 2" FLANGED PLUG VALVE	9339609	1	9341952	1	9341953 OR 9341980	1 1	NAT. GRID NAT. GRID
4	TEE 1-1/4" X 1-1/4" GALV. SCREWED ENDS		2		2		2	CUSTOMER
3	SERVICE LOCATION TAG – LONG ISLAND INSTALLATIONS ONLY	9340255	1	9340255	1	9340255	1	NAT. GRID
2	NIPPLE – SERVICE SIZE X LENGTH AS REQUIRED, GALV. SCH. 40		1		3		3	NAT. GRID
1	RISER	1 ¼"	1	1 ½"	1	2"	1	NAT. GRID
No.	ITEM	NAT. GRID CODE No.						
BILL OF MATERIAL FOR CLASS 800 METERS								

NO.	ITEM	1 ¼" SERVICE	QTY	1 ½" SERVICE	QTY	2" SERVICE	QTY	SUPPLIED BY
27	UNION 2" – GALVANIZED – NON-NSULATING		1		1		1	CUSTOMER
26	NIPPLE 2" X 2 ½" LONG LENGTH, GALV, SCH 40		11		11		11	CUSTOMER
25	ITEM DELETED		0		0		0	CUSTOMER
24	REDUCER 1 ¼" X 2" GALVANIZED		2		2		2	CUSTOMER
23	REDUCER 1 ¼" X 2" GALV. (FOR 1 ¼" SERVICES THAT USE 2" REGULATOR)	9342614	1		0		0	NAT. GRID
22	NIPPLE – 2" X AS REQUIRED LENGTH,GALV, SCH 40		2		2		2	CUSTOMER
21	TEE – 2" X ¾" X 2" – HEEL – M.I. GALV., THREADED		1		1		1	CUSTOMER
20	VALVE LOCKWING, MUELLER TAMPER-PROOF H-11118 – LOCK CLOSED ¾"		1		1		1	CUSTOMER
19	NIPPLE ¾" X 4" GALV. SCH. 40		1		1		1	CUSTOMER
18	PLUG – ¾" GALV.		1		1		1	CUSTOMER
17	LOCK		3		3		3	NAT. GRID
16	NIPPLE 1 ¼". 1 ½" OR 2" X 3" LONG, GALV. SCH. 40		1		1		1	CUSTOMER
15	ELBOW 2" GALV. 90 DEGREE		5		5		5	CUSTOMER
14	RUBBER WASHER FOR METER SWIVEL	9310300	2	9310300	2	9310300	2	NAT. GRID
13	METER VALVE - LOCK WING - 2"	9339610	3	9339610	3	9339610	3	CUSTOMER
12	METER SWIVEL 1 ¼" X 45 LIGHT	9342425	2	9342425	2	9342425	2	NAT. GRID
11	METER NUT GALV. 45 LT	9340788	2	9340788	2	9340788	2	NAT. GRID
10	A. REGULATOR 2" SCR'D ITRON B34SR (5"-9" OUTLET SPRING RANGE) OR CS-806IR 2" B. REGULATOR 1 ½" SCR'D FISHER S302/ITRON B34SR (5"-9" OUTLET SPRING RANGE) SEE NOTE "K" C. REGULATOR 1 ¼" SCR'D FISHER HSR/ITRON B42 1/8" ORIF. OR EQ. FOR 99 AND 124 PSIG SERVICES ONLY D. REGULATOR 1 ¼" SCR'D ITRON B31R WITH 3/16" ORIFICE FOR 60 PSIG MAX E FISHER CS400IR 7/32"X1/4" ORIF 60 PSIG F. FISHER CS400IR 11/64" ORIF 99/124 PSIG	SEE TABLE ON PG 1	1	SEE TABLE ON PG 1	1	SEE TABLE ON PG 1	1	NAT. GRID NAT. GRID NAT. GRID
9	METER CLASS 1000		1		1		1	NAT. GRID
8	UNION – INSULTAING GALV. 1-1/4" ,1 ½" OR 2"	9341685	1	9341686	1	9341687	1	NAT. GRID
7	NIPPLE – LENGTH AS REQUIRED X REGULATOR SIZE OR RISER SIZE X 2" FOR LOW PRESSURE SERVICES		1		1		1	NAT. GRID
6	ELBOW – 1 – ½" X 2" GALV. 90 DEGREE, THREADED FOR 1 – ½" REGULATORS ELBOW – 2" GALV. 90 DEGREE, THREADED – FOR 2" AND L.P. SERVICES ELBOW – 1 – ¼" X 2" GALV. 90 DEGREE, THREADED FOR 1 ¼" REGULATORS		- - 1		1 - -		- 1 -	CUSTOMER
5	PLUG VALVE – SERVICE SIZE 1-¼", 1-½" OR 2" THREADED ENDS. ALTERNATE: 2" FLANGED PLUG VALVE	9339609	1	9341952	1	9341953 OR 9341980	1 1	NAT. GRID NAT. GRID
4	TEE 2" X 2" GALV. SCREWED ENDS		2		2		2	CUSTOMER
3	SERVICE LOCATION TAG – LONG ISLAND INSTALLATIONS ONLY	9340255	1	9340255	1	9340255	1	NAT. GRID
2	NIPPLE – SERVICE SIZE X LENGTH AS REQUIRED, GALV. SCH. 40		1		3		3	NAT. GRID
1	RISER	1 ¼"	1	1 ½"	1	2"	1	NAT. GRID
No.	ITEM	NAT. GRID CODE No.						
BILL OF MATERIAL FOR CLASS 1000 METERS								

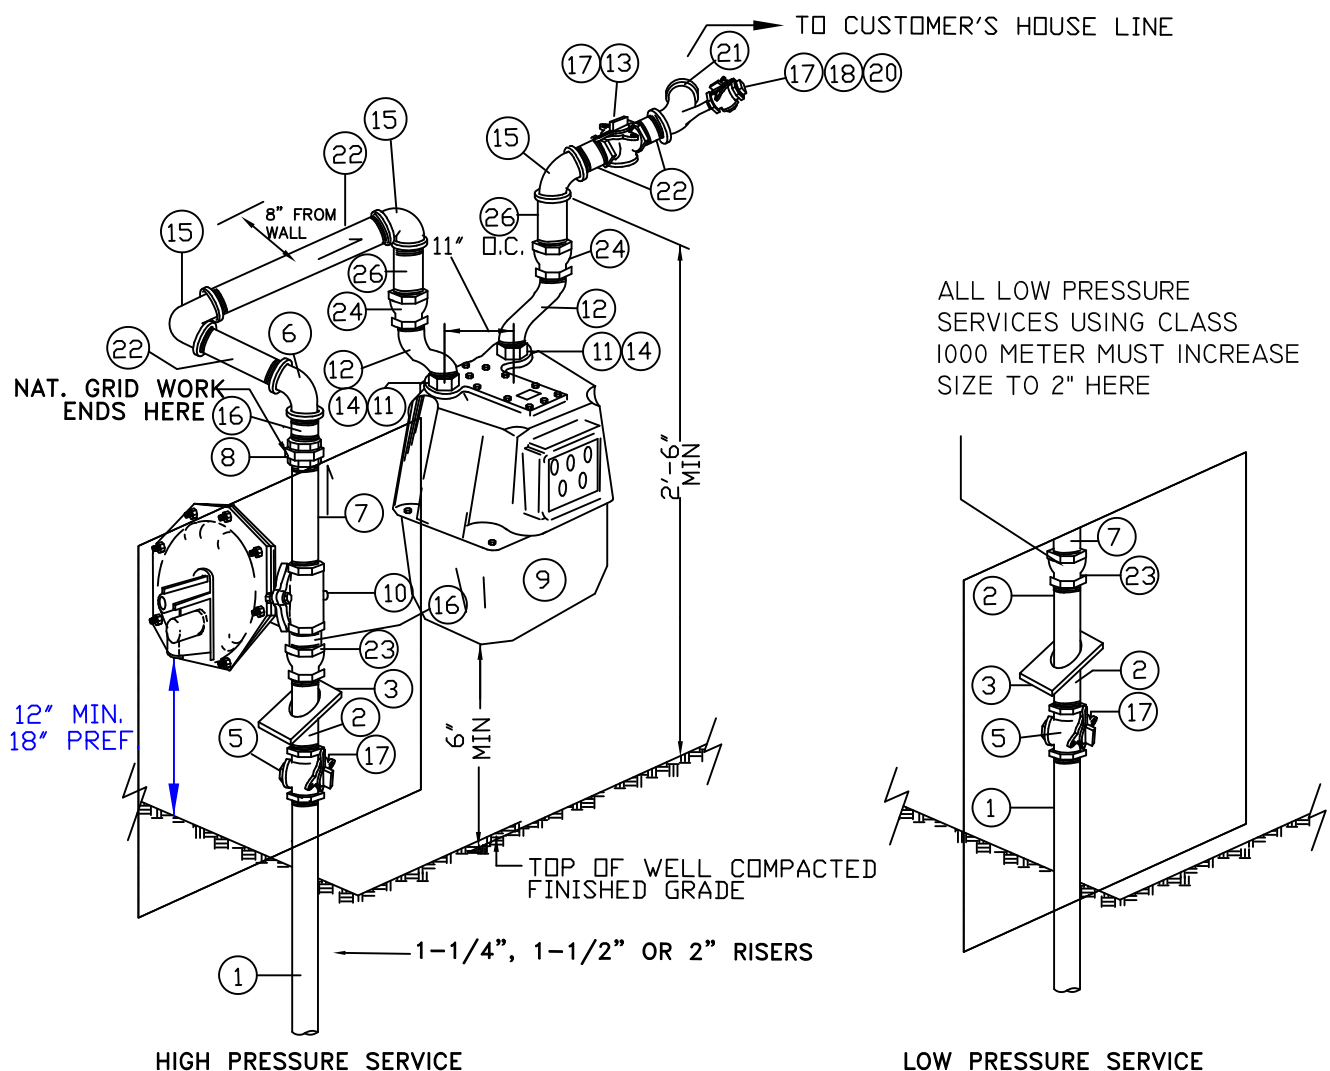


FIGURE 2 – NO BYPASS

REGULATOR SELECTION – SEE NOTE "K"

INLET PRESSURE

REGULATOR

ORIFICE REQUIREMENTS

30/60 PSIG INLET

2" FISHER CS400R ITEM ID 9388985  
1-1/4" B-31R ITEM ID 9342206  
2" B34SR ITEM ID 9342660 OR  
2" B34-IMRV ITEM ID 9342684 OR  
1-1/2" B34SR ITEM ID 9383176  
  
2" FISHER CS806IR ITEM ID 9386776

COMES WITH 7/32"x1/4" ORIFICE (60 PSIG MAX)  
3/16" (STANDARD ORIFICE FOR ITEM ID)  
7/32"x1/4" (STANDARD ORIFICE FOR ITEM ID)  
1/2" (STANDARD ORIFICE FOR ITEM ID)  
CHANGE ORIFICE TO 7/32"x1/4" ITEM ID  
9324363 FOR ITRON B34SR  
1/12" (100 PSIG MAX)

99/124 PSIG INLET

2" FISHER CS400R ITEM ID 9388995  
1-1/4" B31R/B42 ITEM ID 9383127  
2" B34SR ITEM ID 9342660  
  
2" FISHER CS806IR ITEM ID 9342206

COMES WITH 11/64" ORIFICE (124 PSIG MAX)  
1/8" (STANDARD ORIFICE FOR ITEM ID)  
CHANGE ORIFICE TO 5/32"x3/16" ITEM ID  
9324362 FOR ITRON B34SR  
FOR 124 PSIG USE 3/8" ORIF ITEM 9386786

NO.	ITEM	1 ¼" SERVICE	QTY	1 ½" SERVICE	QTY	2" SERVICE	QTY	SUPPLIED BY
26	NIPPLE 1-1/4" X 2 ½" LONG LENGTH, GALV, SCH 40		2		2		2	CUSTOMER
25	ITEM DELETED		0		0		0	CUSTOMER
24	COUPLING 1 ¼" GALVANIZED		2		2		2	CUSTOMER
23	REDUCER 1 ¼" X 2" GALV. (FOR 1 ¼" SERVICES THAT USE 2" REGULATOR)	9342614	1		0		0	NAT. GRID
22	NIPPLE – 1-1/4" X AS REQUIRED LENGTH,GALV, SCH 40		4		4		4	CUSTOMER
21	TEE – 1-1/4" X ¾" X 1-1/4" – HEEL – M.I. GALV., THREADED		1		1		1	CUSTOMER
20	VALVE LOCKWING, MUELLER TAMPER-PROOF H-11118 – LOCK CLOSED ¾"		1		1		1	CUSTOMER
19	NIPPLE ¾" X 4" GALV. SCH. 40		1		1		1	CUSTOMER
18	PLUG – ¾" GALV.		1		1		1	CUSTOMER
17	LOCK		2		2		2	NAT. GRID
16	NIPPLE 1 ¼". 1 ½" OR 2" X 3" LONG, GALV. SCH. 40		1		1		1	CUSTOMER
15	ELBOW 1-1/4" GALV. 90 DEGREE		3		3		3	CUSTOMER
14	RUBBER WASHER FOR METER SWIVEL	9310300	2	9310300	2	9310300	2	NAT. GRID
13	ITEM DELETED							
12	METER SWIVEL 1 ¼" X 45 LIGHT	9342425	2	9342425	2	9342425	2	NAT. GRID
11	METER NUT GALV. 45 LT	9340788	2	9340788	2	9340788	2	NAT. GRID
10	A. REGULATOR 2" SCR'D FISHER CS-806IR OR CS-400IR/ITRON B34SR OR B34IMRV (5"-9" OUTLET SPRING RANGE) B. REGULATOR 1 ½" SCR'D FISHER 400IR/ITRON B34SR (5"-9" OUTLET SPRING RANGE) SEE NOTE "K" C. REGULATOR 1 ¼" SCR'D AMER 1813B2 OR EQ. FOR 99 AND 124 PSIG SERVICES ONLY D. REGULATOR 1 ¼" SCR'D ITRON B31R OR AMER 1813 B2 WITH 3/16" ORIFICE FOR 60 PSIG MAX	SEE TABLE ON PG 1	1	SEE TABLE ON PG 1	1	SEE TABLE ON PG 1	1	NAT. GRID
9	METER CLASS 800		1		1		1	NAT. GRID
8	UNION – INSULTAING GALV. 1 ½" , 1 ¼" OR 2"	9341685	1	9341686	1	9341687	1	NAT. GRID
7	NIPPLE – LENGTH AS REQUIRED X REGULATOR SIZE OR RISER SIZE FOR LOW PRESSURE SERVICES		1		1		1	NAT. GRID
6	ELBOW – 1 – ½" X 1-1/4" GALV. 90 DEGREE, THREADED FOR 1 – ½" REGULATORS ELBOW – 2" X 1-1/4" GALV. 90 DEGREE, THREADED – FOR 2" REGULATORS ELBOW – 1 – ¼" GALV. 90 DEGREE, THREADED FOR 1 ¼" REGULATORS		- - 1		1 - -		- 1 -	CUSTOMER
5	PLUG VALVE – SERVICE SIZE 1 – ¼", 1 ½" OR 2" THREADED ENDS. ALTERNATE: 2" FLANGED PLUG VALVE (ITEM 382214 – SEE NOTE R)	9339609	1	9341952	1	9341953 OR 9341980	1 1	NAT. GRID NAT. GRID
4	ITEM DELETED		0		0		0	CUSTOMER
3	SERVICE LOCATION TAG – LONG ISLAND INSTALLATIONS ONLY	9340255	1	9340255	1	9340255	1	NAT. GRID
2	NIPPLE – SERVICE SIZE X LENGTH AS REQUIRED, GALV. SCH. 40		1		1		1	NAT. GRID
1	RISER	1 ¼"	1	1 ½"	1	2"	1	NAT. GRID
No.	ITEM	NAT. GRID CODE No.						
BILL OF MATERIAL FOR CLASS 800 METER FIGURE 2 (WITHOUT BYPASS)								

NO.	ITEM	1 ¼" SERVICE	QTY	1 ½" SERVICE	QTY	2" SERVICE	QTY	SUPPLIED BY
26	NIPPLE 2" X 2 ½" LONG LENGTH, GALV, SCH 40		2		2		2	CUSTOMER
25	NIPPLE 2" X 4" LONG LENGTH, GALV, SCH 40		2		2		2	CUSTOMER
24	REDUCER 1 ¼" X 2" GALVANIZED		2		2		2	CUSTOMER
23	REDUCER 1 ¼" X 2" GALV. (FOR 1 ¼" SERVICES THAT USE 2" REGULATOR)	9342614	1		0		0	NAT. GRID
22	NIPPLE – 2" X AS REQUIRED LENGTH,GALV, SCH 40		3		3		3	CUSTOMER
21	TEE – 2" X ¾" X 2" – HEEL – M.I. GALV., THREADED		1		1		1	CUSTOMER
20	VALVE LOCKWING, MUELLER TAMPER-PROOF H-11118 – LOCK CLOSED ¾"		1		1		1	CUSTOMER
19	NIPPLE ¾" X 4" GALV. SCH. 40		1		1		1	CUSTOMER
18	PLUG – ¾" GALV.		1		1		1	CUSTOMER
17	LOCK		2		2		2	NAT. GRID
16	NIPPLE 1 ¼". 1 ½" OR 2" X 3" LONG, GALV. SCH. 40		1		1		1	CUSTOMER
15	ELBOW 2" GALV. 90 DEGREE		3		3		3	CUSTOMER
14	RUBBER WASHER FOR METER SWIVEL	9342480	2	9342480	2	9342480	2	NAT. GRID
13	ITEM DELETED							
12	METER SWIVEL 1 ¼" X 45 LIGHT	9310300	2	9310300	2	9310300	2	NAT. GRID
11	METER NUT GALV. 45 LT	9340788	2	9340788	2	9340788	2	NAT. GRID
10	A. REGULATOR 2" SCR'D FISHER CS-806IR ORCS400IR/ITRON B34SR (5"-9" OUTLET SPRING RANGE) B. REGULATOR 1 ½" SCR'D FISHER SCS400IR/ITRON B34SR (5"-9" OUTLET SPRING RANGE) SEE NOTE "K" C. REGULATOR 1 ¼" SCR'D FISHER AMER. 1813B2 OR EQ. FOR 99 AND 124 PSIG SERVICES ONLY D. REGULATOR 1 ¼" SCR'D ITRON B31R WITH 3/16" ORIFICE FOR 60 PSIG MAX	SEE TABLE ON PG 1	1	SEE TABLE ON PG 1	1	SEE TABLE ON PG 1	1	NAT. GRID
9	METER CLASS 1000		1		1		1	NAT. GRID
8	UNION – INSULTAING GALV. 1 ½" , 1 ¼" OR 2"	9341685	1	9341686	1	9341687	1	NAT. GRID
7	NIPPLE – LENGTH AS REQUIRED X REGULATOR SIZE OR RISER SIZE FOR LOW PRESSURE SERVICES		1		1		1	NAT. GRID
6	ELBOW – 1 – ½" X 2" GALV. 90 DEGREE, THREADED FOR 1 – ½" AND 1 – ¼" HP SERVICES ELBOW – 2" GALV. 90 DEGREE, THREADED – FOR 2" SERVICES ELBOW – 1 – ¼" X 2" GALV. 90 DEGREE, THREADED FOR 1 ¼" REGULATORS		- - 1		1 - -		- 1 -	CUSTOMER
5	PLUG VALVE – SERVICE SIZE 1 – ¼", 1 ½" OR 2" THREADED ENDS. ALTERNATE: 2" FLANGED PLUG VALVE	9339609	1	9341952	1	9341953 OR 9341980	1 1	NAT. GRID NAT. GRID
4	TEE 2" X 2" GALV. SCREWED ENDS		0		0		0	CUSTOMER
3	SERVICE LOCATION TAG – LONG ISLAND INSTALLATIONS ONLY	9340255	1	9340255	1	9340255	1	NAT. GRID
2	NIPPLE – SERVICE SIZE X LENGTH AS REQUIRED, GALV. SCH. 40		1		1		1	NAT. GRID
1	RISER	1 ¼"	1	1 ½"	1	2"	1	NAT. GRID
No.	ITEM	NAT. GRID CODE No.						
BILL OF MATERIAL FOR CLASS 1000 METER FIGURE 2 (WITHOUT BYPASS)								

## NOTES:

- A. KEY REQUIREMENTS FOR THE CONSTRUCTION OF METER HEADERS AND METER INSTALLATION ARE CONTAINED IN NATIONAL GRID SPECIFICATIONS CMS03002 AND THE NATIONAL GRID BLUE BOOK.
- B. WHERE VEHICULAR TRAFFIC IS A CONCERN, INSTALL PROTECTION POSTS. SEE APPROVED NATIONAL GRID SPECIFICATION FOR PROTECTION POST INSTALLATION REQUIREMENTS AND SPECIFICATIONS.
- C. METERS AND SAFETY DEVICES MUST BE PROTECTED FROM DAMAGE DURING PRESSURE TEST.
- D. ADDITIONAL FITTINGS MAY BE REQUIRED TO MAKE THE METER INSTALLATION.
- E. NATIONAL GRID SHALL NOT BE RESPONSIBLE FOR FITTING DIMENSIONS OR FOR SCALED DIMENSIONS.
- F. IF BRANCH LOAD IS REQUIRED, SEE APPROPRIATE NATIONAL GRID DRAWINGS FOR METER SIZING, PIPE DESIGN AND VALVE REQUIREMENTS. BRANCH PIPING IS TO BE ELECTRICALLY INSULATED FROM DISTRIBUTION PIPING AT VALVE.
- G. COAT ALL NON-GALVANIZED PIPE AND FITTINGS WITH RUSTOLEUM #7715 OR EQUAL. TWO COATS REQUIRED, BRUSH APPLIED.
- H. FOR UNDERGROUND PIPING AFTER METER, CONTACT CORROSION CONTROL SECTION FOR NATIONAL GRID'S REQUIREMENTS.
- I. ALL MAXIMUM CFH'S ARE MEASURED AT 1.0" WATER COLUMN DROP ACROSS THE METER.
- J. A FULLY ENCLOSED (INCLUDING TOP) CHAIN LINK FENCE (CYCLONE) MINIMUM 8FT. HIGH WITH GATE AND LOCK MAY BE REQUIRED ON OUTSIDE SETS DEPENDING ON LOCATION. TO BE SUPPLIED BY CUSTOMER.
- K. THE 2" ITRON/ITRON B34 SR REGULATOR COMES STANDARD WITH A 7/32" X 1/4" ORIFICE (60# MAX.). THE 1-1/2" ITRON B34SR REGULATOR COMES STANDARD WITH A 3/8" ORIFICE (15# MAX.).
- FOR 99 AND 124 PSIG INLET PRESSURES** INSTALL 2" FISHER CS-400IR WITH 11/64" ORIFICE ITEM ID 9388995. OR INSTALL AN 1-1/2" OR A 2" B34SR REGULATOR AND CHANGE THE ORIFICE TO 5/32" X 3/16" ORIFICE ITEM ID . FAILURE TO CHANGE THE ORIFICE WILL CAUSE DAMAGE TO THE REGULATOR. AN ALTERNATE OPTION ON THE 99#/124# SYSTEM IS TO USE THE 1- 1/4" FISHER HSR OR ITRON B-42R, B31R OR AMERICAN 1813B2 OR SR-100 WITH 1/8" ORIFICE (ITEM ID 9383127).
- FOR 60 PSIG SYSTEMS** INSTALL AN 1-1/4" ITRON B-31R REGULATOR (ITEM ID 9342206) OR INSTALL A 2" B34SR WHICH HAS A 7/32" X 1/4" ORIFICE OR INSTALL A 1-1/2" ITRON B34SR AND CHANGE THE ORIFICE TO 7/32" X 1/4" (ITEM ID 9383242 FOR FISHER AND ITEM ID 9324363 FOR ITRON). A 2" B34IMRV (ITEM ID 9342684) IS ALSO ACCEPTABLE FOR 60 PSIG INLETS. A FOSHER 2" CS-400IR (7/32"X1/4") ITEMID 9388985
- FOR 15 PSIG SERVICE**, INSTALL AN 1 1/2" ITRON B34SR WHICH HAS A 3/8" DIAM. ORIFICE. OR USE A 2" ITRON B34SR AND CHANGE THE ORIFICE TO 3/8" (ITEM ID 9324359 FOR ITRON B34SR). OR USE A 1 1/2" FISHER CS400IR ITEM ID 9388986. THESE REGULATOR HAVE A MAX INLET PRESSURE OF 15 PSIG.
- THE REGULATOR VENT ASSEMBLY MUST BE FACE DOWN AND EQUIPPED WITH A RAIN AND INSECT RESISTANT SCREEN. FOR NEW CONSTRUCTION OR ALTERATIONS SEE 020013-CS FOR VENT PIPING LOCATION. IT IS PREFERRED THAT REGULATOR VENTS BE INSTALLED AT A HEIGHT 18 INCHES ABOVE GRADE, HOWEVER, THE MINIMUM ALLOWABLE VENT HEIGHT SHALL BE 12 INCHES ABOVE FINAL GRADE. IN CASES OF KNOWN FLOOD LOCATIONS, THE PREFERRED REGULATOR VENT HEIGHT ABOVE THE FLOOD HEIGHT IS 18" (12" MINIMUM). A MINIMUM OF 18 INCHES MUST BE MAINTAINED FROM ANY OPENING WHERE GAS MAY ENTER THE PREMISE.
- L. ALL PIPING SHALL BE IN COMPLIANCE WITH NFPA 54.
- M. RISER SHALL BE A MINIMUM OF 12" FROM THE OUTSIDE BUILDING FOUNDATION WALL.
- N. THE METER AND ASSOCIATED PIPING SHALL BE PLUMB AND LEVEL FROM BOTH FRONT AND SIDE.
- O. ALL FITTINGS SHALL BE GALVANIZED OR BLACK PIPE PRIMED AND PAINTED.
- P. SERVICE LOCATION TAGS ARE REQUIRED ON LONG ISLAND INSTALLATIONS ONLY.
- Q. WHEN USING A 2" FLANGED VALVE, USE THE FOLLOWING:
- 2" INSULATING FLANGED KIT QTY 1 – ITEM ID 9340992
  - 2" THREADED NIPPLE WITH FLANGE QTY 1 – ITEM ID 9383856
  - MACHINE BOLTS – 5/8" X 2 – 3/4" QTY – ITEM ID 9339766
- R. AT FLOW RATES OF 700 CFH AND 800 CFH, THE PRESSURE DROP OF THE 800 METER SET WITH THE BYPASS IS APPROXIMATELY 1.5" W.C. (INCLUDING THE METER). ON LOW PRESSURE SYSTEMS, WHERE TOTAL CONNECTED LOAD APPROACHES 800 CFH, IT IS RECOMMENDED TO USE 2" PIPING.
- S. FOR 14" W.C. – 2 PSIG METERING, USE FIXED FACTOR METERING.
- T. FOR 14"- 2 PSIG METERING, THE REGULATOR SPRING MUST BE CHANGED.

Vent Line Pipe Size	
Length	Pipe Size
0' – 50'	1 – 1/2"
50' – 100'	2"
>100'	Cont. Gas Eng.





BILL OF MATERIAL		APPLICATION FOR FOUR (4) METER SETS	
ITEM NO.	DESCRIPTION	QUANTITY	ITEM ID
1	PIPE SIZE AND LENGTH AS REQ'D (SEE SHEET 3)	+	***
2	TEE (EQUAL TO SIZE OF HEADER)	2	***
3	ELBOW - 90°	4	***
4	CAP - SIZE AS REQUIRED	1	***
5	UNION - INSULATED (ONLY IF SCREWED VALVE IS USED)	1	***
5A	UNION (PLUMBER'S OPTION)	2	***
6	REDUCER (IF REQUIRED)	1	***
7	TEE - BULL, SIZE AS REQUIRED	1	***
8	1 5/8" UNISTRUT CHANNEL W/CLAMP	+	***
9	NIPPLE 3/4" X 3"	1	***
10	VALVE - LOCKWING 3/4"	1	***
11	PLUG SCREWED 3/4"	1	***
12	RISER - SERVICE (PRIMED & PAINTED) SIZE AS REQUIRED	1	NAT. GRID
13	SLEEVE - PIPE, PLASTIC OR EQUIVALENT	1	NAT. GRID
14	VALVE (SEE NOTE BELOW)	1	NAT. GRID
14A	GASKET - SET - INSULATED FLANGE KIT (FOR FLANGE VALVE)	1	NAT. GRID
14B	BOLTS MACHINE (5/8" X 2 3/4") B7	8	9392186
14C	FLANGE - WELD NECK (FOR FLANGED TYPE VALVE ONLY)	2	NAT. GRID
15	GASKET - RING FOR FLANGE VALVES	1	NAT. GRID
16	REGULATOR - 1 1/4" OR 2" RELIEF/MONITOR	1	*
17	NIPPLE	+	NAT. GRID
18	REDUCER (IF REQUIRED)	1	NAT. GRID
19	ELBOW - SIZE AND QUANTITY AS REQ'D	+	***
20	PIPE - HOUSE LINE SIZE AND QUANTITY AS REQ'D	+	***
21	SUPPORT - PIPE OR ROD 1"	+	***
22	GAS SNAP LOCK	1	9330915
23	SYSTEM PRESSURE TAG	1	9346233
24	TAG - GAS SERVICE LOCATION (CPR TAG)	1	9340255
24A	SELF LOCKING NYLON STRIP 14"	1	NON STOCK
25	TEE - 1 PER METER, SIZE AS REQUIRED (SEE DET. A,B,C,D,E)	+	***
26	NIPPLE - AS REQUIRED	+	***
27	UNION - 2" FOR 1000 METER/ 1-1/4" FOR 630/750/800 METER - GALV.	1	***
44	REDUCER - 2" X 1-1/4"	2	***


LEGEND:

- + - AS REQUIRED
- ++ - TO BE SUPPLIED BY NATIONAL GRID.
- \*\*\* - SUPPLIED BY CUSTOMER
- \* - SEE CMS-03002 FOR PROPER REGULATOR AND SELECTION & SIZING.

NOTES (FOR SHEET 1)

- A - FOR ITEM ID'S ON ITEMS 28 THRU 43 SEE SHEETS 4 THRU 7 WHICHEVER APPROPRIATE CLASS OF METER APPLIES
- B - NATIONAL GRID WILL SUPPLY AND INSTALL ITEMS 12 THRU 18 AND ITEMS 22 THRU 24A.
- C - SEE SHEET 3 FOR DIFFERENT METER HEADER PIPE SIZES.
- D - USE SCREW TYPE VALVE FOR 1-1/4" RISER, FOR 2" RISER USE FLANGE TYPE VALVE. IF A SCREW VALVE IS USED, ITEMS 14A, 14B, 14C AND 15 IS NOT REQUIRED.
- E - IF ADDITIONAL METER SETS ARE REQUIRED THEN ADD A FULL TEE (ITEM 25) TO TOP OR LOWER MANIFOLD LEVELS SEE SH. 1.
- F - 1000 CLASS METERS MUST USE 2" PIPING AND REDUCE DOWN TO 1-1/4" FOR METER CONNECTIONS.
- G - ON THE 99 AND 124 PSIG SYSTEMS, THE 2" REGULATOR MUST HAVE THE ORIFICE CHANGED TO 3/8". ON THE 99 AND 124 PSIG SYSTEM, THE 1-1/4" REGULATOR ITEM ID IS 9383127.
- H - CUSTOMER TO INSTALL PERMANENT BRASS OR ALUMINUM TAG ON EACH METER INDICATING CUSTOMER'S ADDRESS/ STORE #/ APARTMENT #/ OR UNIT. THIS INFORMATION SHALL BE ENGRAVED OR STAMPED ON THE TAG.


FOR LOW PRESSURE SERVICE  
(SEE SH.1, FOR INFORMATION NOT SHOWN)

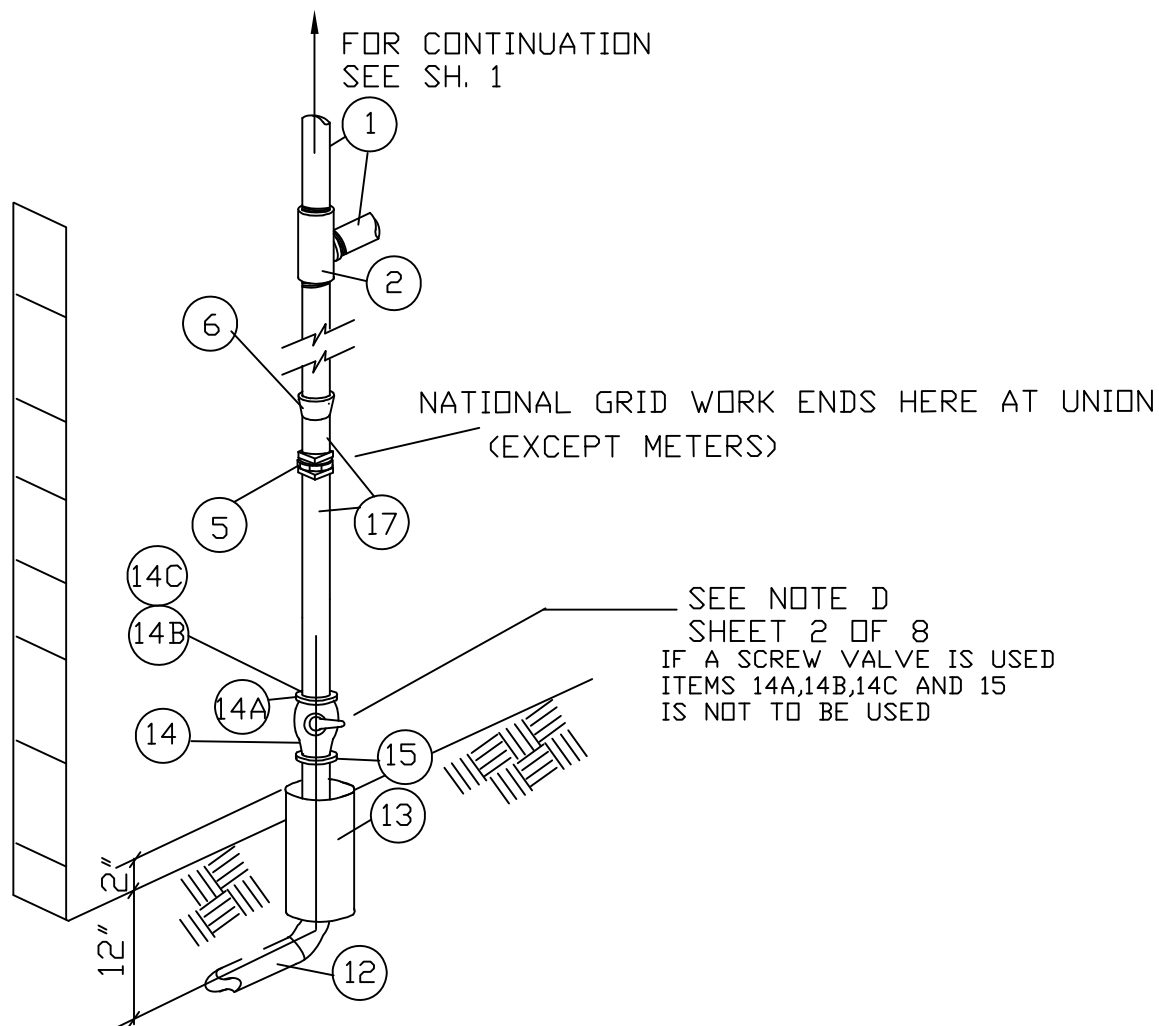

ALLOWABLE LOADS FOR DIFFERENT METER HEADER PIPE SIZES.

PIPE SIZE	1-1/4"	1-1/2"	2"	2-1/2"	3"	4"
MAX. ALLOWABLE LOAD	750 CFH	1350 CFH	2250 CFH	2750 CFH	3700 CFH	4550 CFH


- 1 -MAXIMUM CAPACITY BASED ON PREFERABLY TWO ROWS. LAYOUT AS SHOWN ON MTRS-6215 AND MTRS-6225 ONLY.
- 2 -FOR A SINGLE TIER LAYOUT, SEE MTRS-6075
- 3 -THE METER CLASS SHALL BE USED AS INDICATED IN MTRS-6075, SHEET 1 OF 2. SPECIAL ATTENTION IS REQUIRED ON NOTE A, SHEET 8 OF 8.
- 4 -THIS LOADING IS THE MAXIMUM THAT SHOULD BE PLACED ON THE SPECIFIED SIZE CUSTOMER INSTALLED PIPING. THE CUSTOMER SHOULD BE ADVISED THAT AN INCREASED SIZE COULD PROVIDE FOR UNKNOWN OR POSSIBLE INCREASED LOAD.

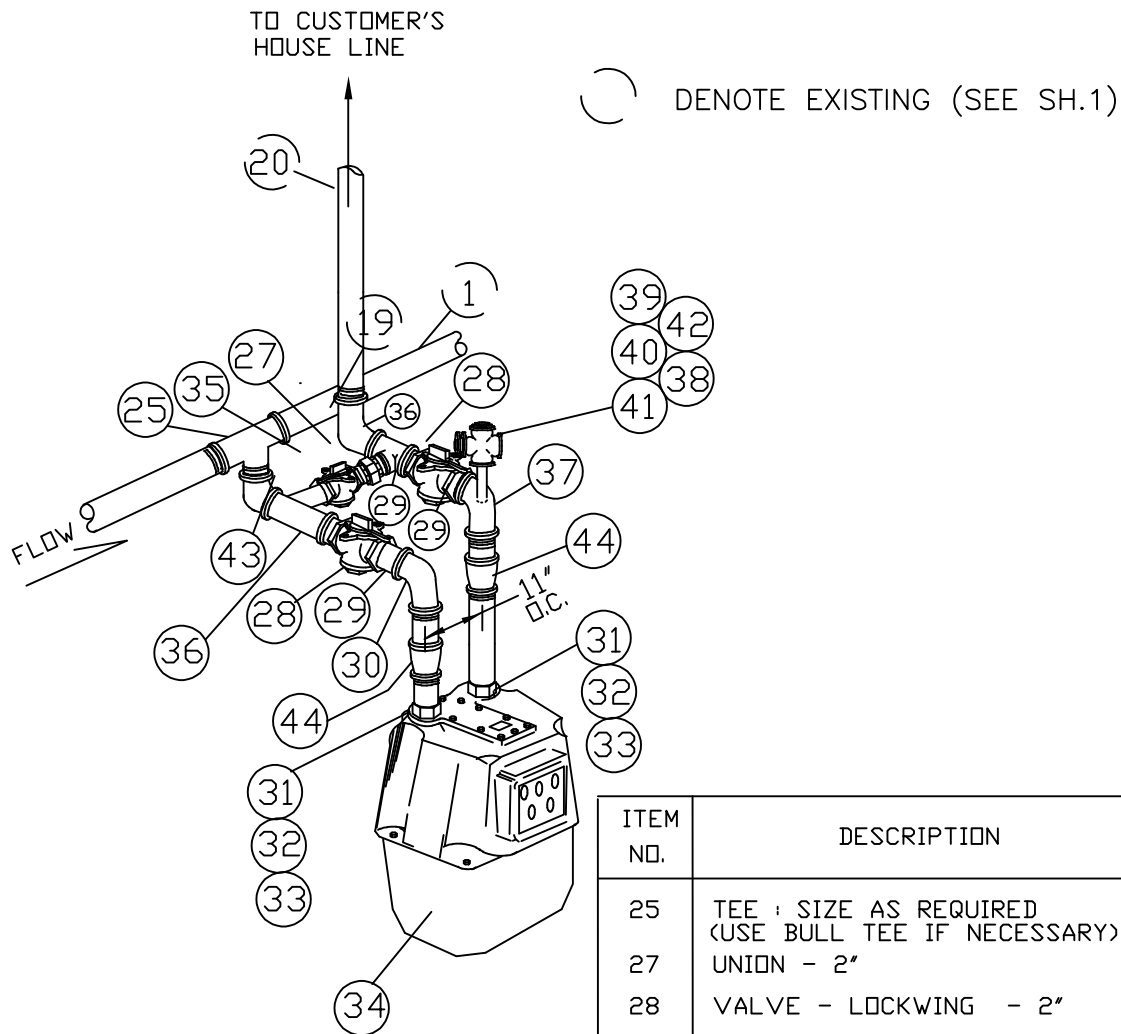

DETAIL "A"  
CLASS 1000 METER  
AND CLASS 800  
METER ON LOW  
PRESSURE SERVICES

ITEM NO.	DESCRIPTION	QUANTITY	ITEM ID
25	TEE : SIZE AS REQUIRED (USE BULL TEE IF NECESSARY)	1	**
27	UNION - 2"	1	**
28	VALVE - LOCKWING - 2"	2	**
29	NIPPLE 2"	+	**
30	ELBOW 90° - 2"	2	**
31	SWIVEL - 1-1/4" 45 LT	2	9342425
32	NUT - METER - 1000 45 LT	2	9340788
33	METER NUT GASKET - 1000	2	9310300
34	GAS METER - 1000 CFH	1	++
35	VALVE - LOCKWING 2" BY PASS	1	9339610
36	TEE - 3WAY 2"x 2"x 2"	2	**
37	TEE - HEEL 2"x 2"x 3/4"	1	**
38	PLUG SCREW 3/4"	1	**
39	GAS SNAP LOCK	1	9386820
40	NOT TO BE USED	-	-
41	NIPPLE 3/4"x 3"	1	**
42	VALVE - LOCKWING 3/4"	1	**
43	NIPPLE 2"	+	**
44	REDUCER 2" X 1-1/4"	2	**

NOTE: NAIONAL GRID WILL SUPPLY AND INSTALL ITEMS 31 THRU 35, 39 AND 40

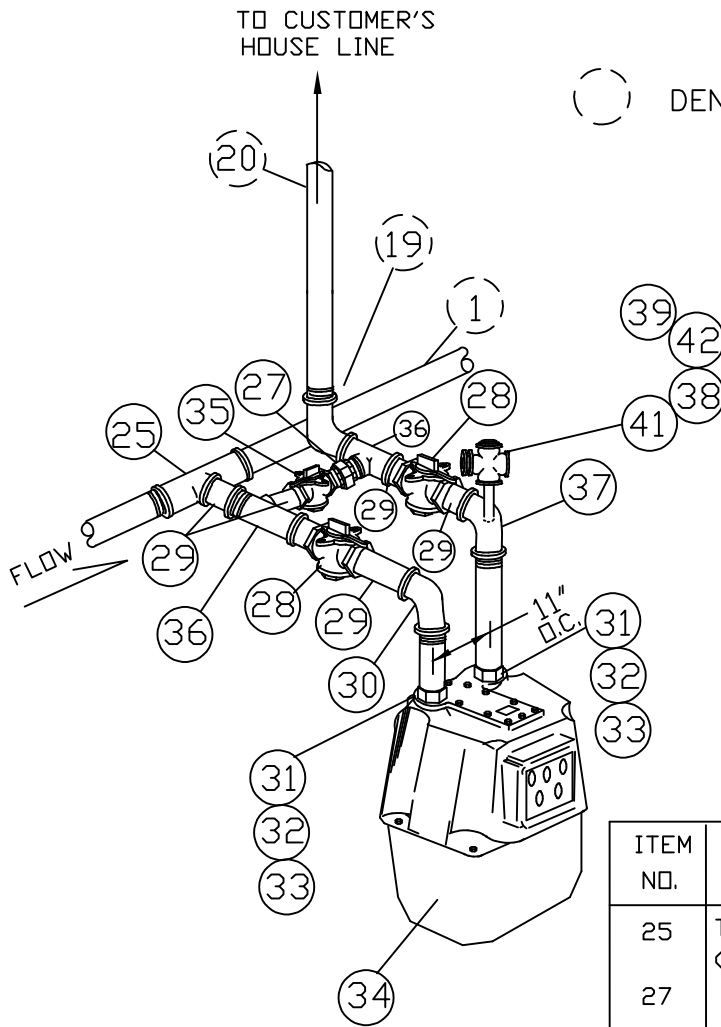


DETAIL "B"  
CLASS 630  
CLASS 800

NOTE:

FOR LOW PRESSURE SERVICES,  
2" PIPING IS RECOMMENDED TO 800  
CLASS METER. USE DESIGN FOR  
1000 METER ON PAGE 4.

ITEM NO.	DESCRIPTION	QUAN TITY	ITEM ID
25	TEE : REDUCER, SIZE AS REQUIRED (USE BULL TEE IF NECESSARY)	1	**
27	UNION - 1 1/4"	1	**
28	VALVE - LOCKWING - 1-1/4"	2	**
29	NIPPLE 1-1/4"	+	**
30	ELBOW 90° - 1-1/4"	1	**
31	SWIVEL-METER-1 1/4"x45 LIGHT	2	9342425
32	NUT - METER - 45 LIGHT	2	9340788
33	GASKET - METER NUT	2	9310300
34	GAS METER CLASS - 630 CFH OR GAS METER CLASS - 800 CFH	1	++
35	VALVE- LOCKWING - 1 1/4"	1	9339609
36	TEE 1-1/4"	2	**
37	TEE - HEEL 1-1/4"x 3/4"x 1-1/4"	1	**
38	PLUG SCREW 3/4"	1	**
39	GAS SNAP LOCK	1	9330915
40	NOT TO BE USED	-	-
41	NIPPLE 3/4"x 3"	1	**
42	VALVE - LOCKWING 3/4"	1	**

NOTE: NATIONAL GRID WILL SUPPLY AND INSTALL ITEMS 31 THRU 35, 39 AND 40

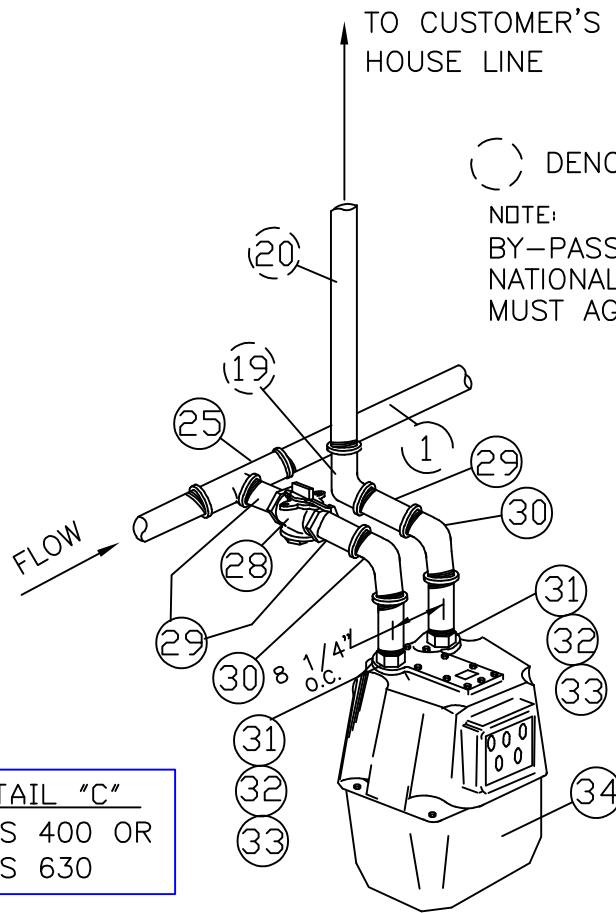


( ) DENOTE EXISTING (SEE SH.1)

NOTE:  
BY-PASS MAY BE REQUIRED.  
NATIONAL GRID – GAS ENGINEERING  
MUST AGREE ON FINAL DESIGN.

DETAIL "C"  
CLASS 400 OR  
CLASS 630

ITEM NO.	DESCRIPTION	QUANTITY	M & S CODE
25	TEE : REDUCER, SIZE AS REQUIRED (USE BULL TEE IF NECESSARY)	1	**
28	VALVE - LOCKWING - 1-1/4"	1	**
29	NIPPLE 1-1/4"	+	**
30	ELBOW 90°- 1-1/4"	2	**
31	SWIVEL METER - 1-1/4"X 45 LIGHT	2	9342425
32	METER NUT - 45 LIGHT	2	9340788
33	NUT - METER WASHER - 45 LIGHT	2	9310300
34	METER - GAS - CLASS - 400 CFH OR METER - GAS - CLASS - 630 CFH	1	++

NOTE: NATIONAL GRID WILL INSTALL AND SUPPLY ITEMS 31 THRU 34

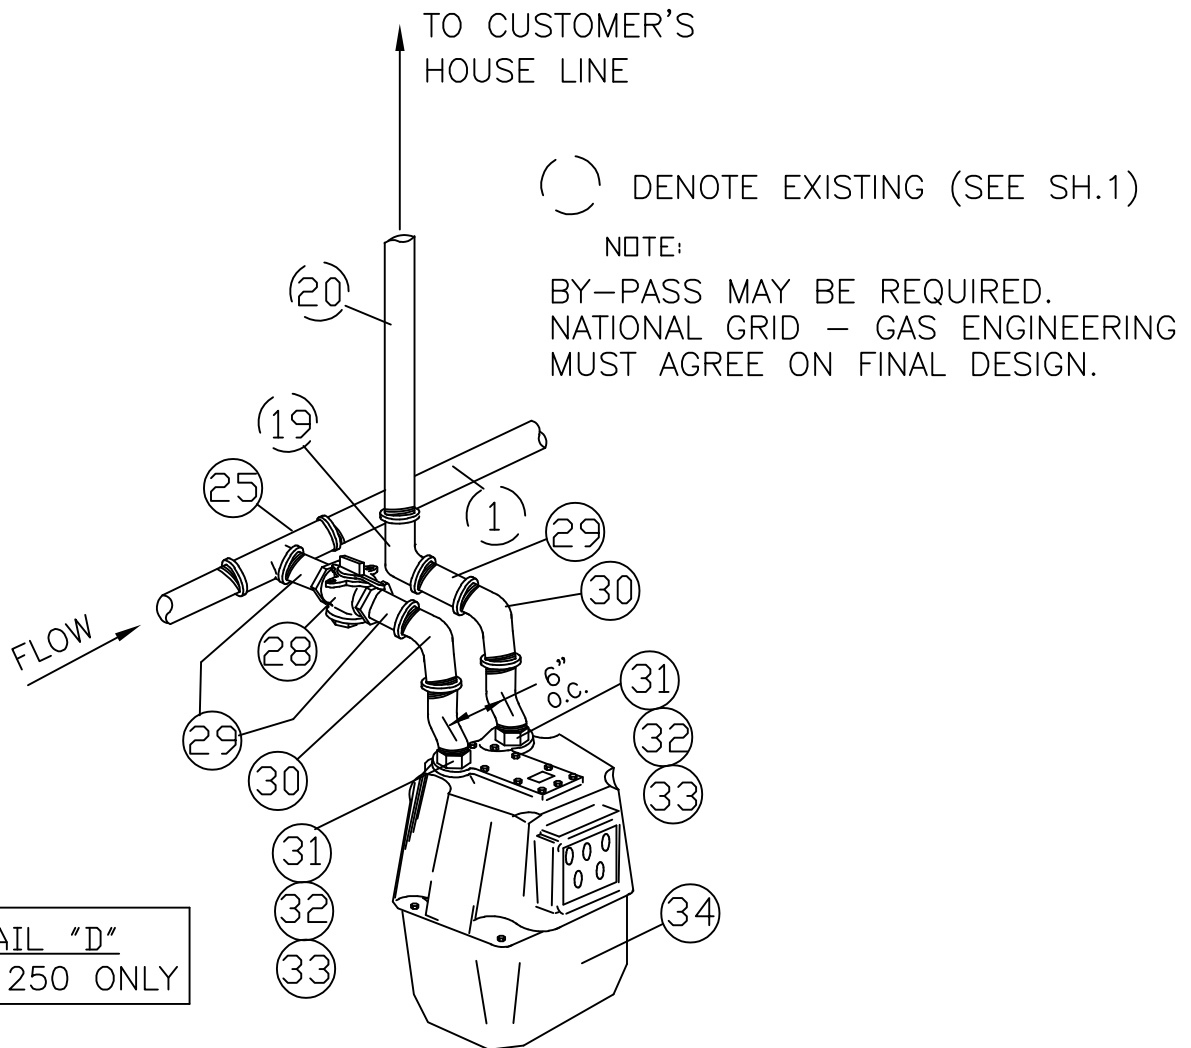


ITEM NO.	DESCRIPTION	QUANTITY	ITEM ID
25	TEE : REDUCER, SIZE AS REQUIRED (USE BULL TEE IF NECESSARY)	1	**
28	VALVE - LOCKWING - 1"	1	**
29	NIPPLE 1"	+	**
30	ELBOW 90° DEGREES- 1"	2	**
31	SWIVEL - METER - 1"X 20 LIGHT	2	9383109
32	NUT - METER - 20 LIGHT	2	9340787
33	WASHER - METER NUT - 20 LIGHT	2	9312524
34	METER - CLASS - 250 CFH	1	++

NOTE: NATIONAL GRID WILL INSTALL AND SUPPLY ITEMS 31 THRU 34

**NOTES**

- A. IT IS PREFERRED TO HAVE THE LARGEST METER PLACED CLOSEST TO THE REGULATOR OUTLET AS SHOWN ON SHEET 1. HOWEVER, THE DETAILS OF EACH METER CAN BE REARRANGED IF THE FIELD CONDITIONS WARRANT IT.
- B. FOR ADDITIONAL METER SET LAYOUTS, SEE DETAIL "A", "B", "C" AND "D".
- C. FOR ANY MANIFOLD PIPE SIZE, THE ALLOWABLE MAXIMUM LOAD IS SHOWN ON SHEET 3.
- D. THIS CONSTRUCTION STANDARD SHALL ONLY BE USED FOR OUTSIDE METER SETS.
- E. METERS CAN BE INSTALLED EITHER TO THE RIGHT OR THE LEFT OF THE SERVICE RISER.
- F. THE METER PIPING SHALL BE INSTALLED SO THAT THE TOP OF THE METERS IS NO HIGHER THAN 6 FEET ABOVE FINISH GRADE. THE PURGE SHALL ALSO BE NO LOWER THAN 6 INCHES FROM FINISH GRADE.
- G. CONTRACTORS TO COMPLY WITH ADDITIONAL HEADER DIMENSIONS.
- H. APPROPRIATE APARTMENT NUMBERS, STORE NUMBERS, ADDRESS OR NAME SHALL ENGRAVED OR STAMPED ON A PERMANENT BRASS OR ALUMINUM TAG AND ATTACHED TO THE METER OUTLET PIPING.
- I. USE GALVANIZED PIPING FOR OUTSIDE METER SETS.
- J. CUSTOMER PIPING WHICH IS NOT READY FOR SERVICE WHEN HEADER IS FABRICATED SHALL BE FITTED AT THE RISER WITH A LOCKWING VALVE, AND THE LINE PLUGGED.
- K. REFER TO THE SERVICES SECTION FOR SERVICE INSTALLATION. REGULATORS SHALL BE SIZED PROPERLY.
- L. SERVICE RISER, METER HEADER AND METER SHALL BE LOCATED TO PREVENT DAMAGE CAUSED BY VEHICLES OR MECHANICAL EQUIPMENT.
- M. THE CONTRACTOR SHALL BE RESPONSIBLE FOR INSTALLATION OF ANY REQUIRED VENT PIPING. PIPE SIZE AND VENT TERMINATION LOCATION SHALL BE AGREED TO BY BEFORE STARTING WORK.
- N. ALL BY-PASS VALVES SHALL BE LOCKED BY NATIONAL GRID.
- O. SERVICE RISER SHALL NOT BE ENCASED IN CONCRETE, BLACKTOP OR ANY PAVEMENT MATERIALS.
- P. UNLESS OTHERWISE SPECIFIED, ALL CUSTOMER OWNED PIPING MUST BE IN COMPLIANCE WITH NFPA-54 AND SPECIFICATIONS AND REQUIREMENTS FOR GAS INSTALLATIONS.
- Q. THE GAS SERVICE LOCATION TAG SHALL BE INSTALLED BY NATIONAL GRID PER [SERV-6035](#).
- R. ALL PIPING, FITTINGS, ETC. SHALL BE INSPECTED FOR DEFECTED AND THOROUGHLY CLEANED OF ALL FOREIGN MATTER BEFORE BEING INSTALLED.
- S. PIPE STRAPS OR HANGERS SHALL BE USED FOR SUPPORT. THE PLACEMENT OF THE SUPPORTS DEPENDS ON THE CONFIGURATION OF THE METER SET AND CUSTOMER'S HOUSE LINE.
- T. THE METER VALVE SHALL FACE FORWARD FROM THE WALL FOR EASY ACCESSIBILITY, WHENEVER POSSIBLE.
- U. THE INSULATED FLANGE KIT, WHEN USED, SHALL BE INSTALLED ON THE SERVICE LINE VALVE BY NATIONAL GRID.
- V. AT TIMES OF INSTALLATION ALL SERVICE LINES SHALL BE PLUMB AND LEVEL.
- W. WHERE VEHICLE TRAFFIC HAS POTENTIAL TO DAMAGE THE RISER/METER, INSTALL PROTECTION POSTS PER [MTRS-6060](#).

<b>No.</b>	<b>ITEM</b>	<b>NATIONAL GRID CODE No.</b>
<b>BILL OF MATERIAL</b>		

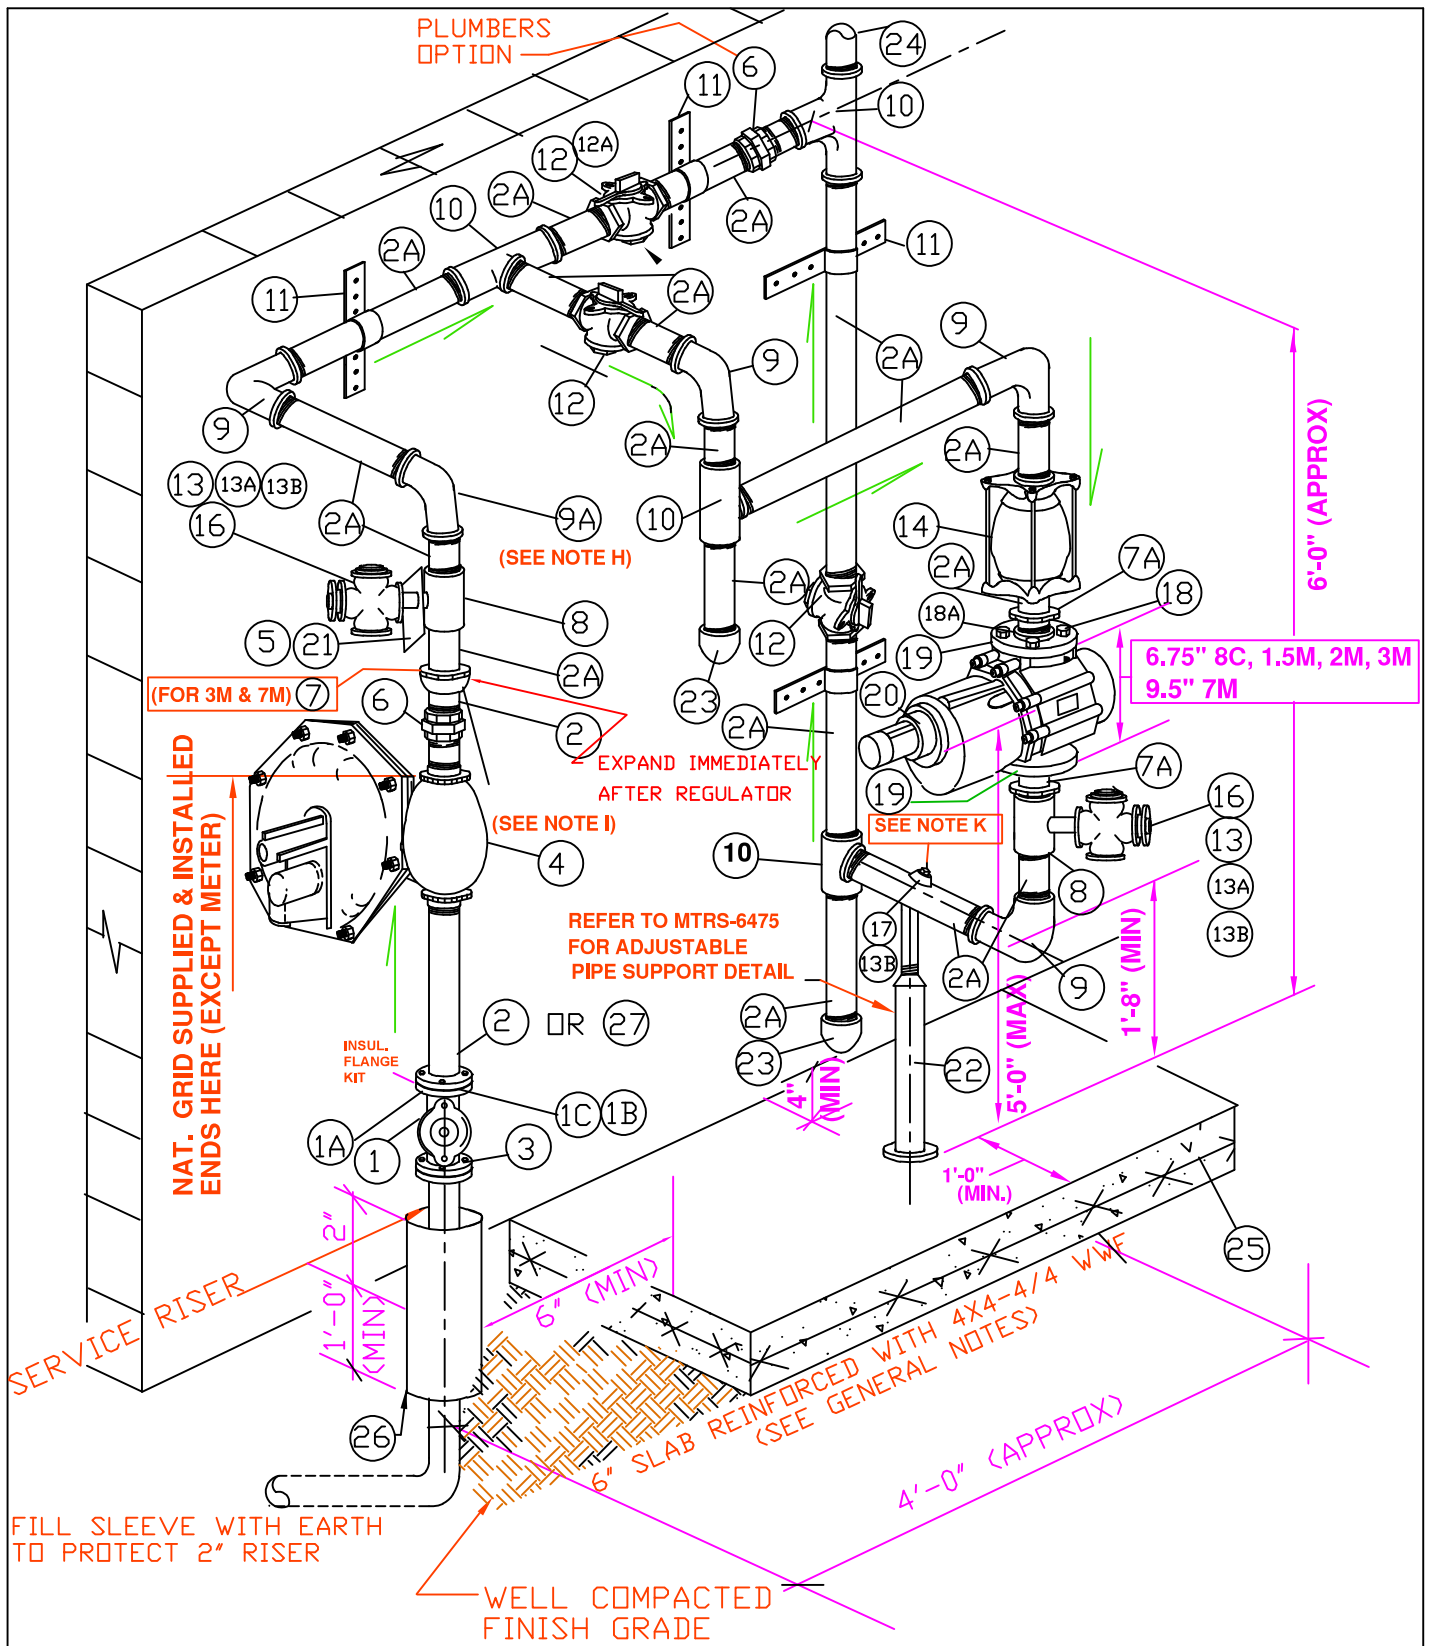

**nationalgrid**

LONG ISLAND

**HP MAIN / LP, 14" W.C. METERING  
FOR 8C, 1.5M, 2M, 3M OR 7M  
VERTICAL-ROTARY GAS METER**

**REVISIONS: UPDATED SAP ITEM ID'S AND LINKS**

DATE: 07/01/2003

EFFECTIVE DATE: 05/07/2025

DESIGN: JAL

STD. DWG.

DRAWN: HF

NO. **MTRS-6255**



**NOTES**

- A. SEE GENERAL NOTES [MTRS – 6545](#)
- B. ALL THREADED TYPE PIPE AND FITTINGS TO BE HOT DIPPED GALVANIZED
- C. ALL FITTING SHALL BE MALLEABLE IRON CLASS 150, ANSI B 16.3
- D. CINCH ANCHORS OR EQUIVALENT TO BE INSTALLED IN FLOOR FLANGES (ITEM 21) BY CUSTOMER.
- E. FOR UNDERGROUND CUSTOMER'S HOUSE PIPING REFER TO DESIGN SECTION
- F. NATIONAL GRID WILL SUPPLY AND INSTALL ALL ITEMS UP TO THE NATIONAL GRID'S SERVICE REGULATOR. NATIONAL GRID WILL SUPPLY THE METER.
- G. THE CUSTOMER MAY AT HIS OPTION INSTALL A VERTICAL PRESSURE TAP AT ITEM 9A IF A HEEL TEE IS USED.
- H. FOR LOADS UPTO 1500 CFH 2" PIPING CAN BE USED AFTER THE REGULATOR.
- I. FOR 99 PSIG AND 124 PSIG INLETS, THE ITRON B34IMRV MUST HAVE THE ORIFICE CHANGED TO 3/8". ITRON B34SR REQUIRES 5/32"x3/16" ORIFICE FOR 99/124 PSIG INLETS. THE FISHER 806 WITH STANDARD 1/2" ORIFICE HAS MAOP OF 100 PSIG. FOR 124 PSIG, USE 3/8" ORIFICE.
- J. **METERS OPERATING AT 14" W.C. WILL BE TEMPERATURE CORRECTED AND FIXED FACTORED. TAG METER WITH 14" W.C. STICKER/TAG AND NOTIFY METER OPS VIA FORM THAT CUSTOMER IS USING ELEVATED PRESSURE. FOR METERS OPERATING >14" W.C., A VOLUME CORRECTOR IS REQUIRED.**
- M. SEE NATIONAL GRID DRAWING [020013-CS](#) FOR REGULATOR VENT GUIDELINES.
- N. 2M METERS WITH  $\leq 1,500$  CFH CAN USE 2" PIPING, FOR 2M METERS  $> 1,500$  CFH USE 3" PIPING

**LEGEND:** X X SUPPLIED BY CUSTOMER \* SEE FOR PROPER DESIGN SECTION REGULATOR SELECTING AND SIZING

+ AS REQUIRED \*\* TO BE SUPPLIED BY NATIONAL GRID

27	2" THREADED NIPPLE X 2" 150# FALT FACE FLANGE	1	9383856
26	SLEEVE – 4" PIPE – PLASTIC OR EQUIVALENT	1	NAT. GRID
25	SLAB REINF – 4X4 – 4/4 WIRE WELDED FABRIC	1	X X
24	PIPE – HOUSE LINE	+	X X
23	CAP – 2" - THREADED	2	X X
22	PIPE SUPPORT 12" TO 24" HEIGHT 9391870 PIPE SUPPORT 23" TO 35" HEIGHT 9391559	1	X X X X
21	SYSTEM PRESSURE TAG	1	9346233
20	METER – LINE MOUNTED ROTARY – 8C, 1.5M, 2M 125 – 2" INLET / OUTLET	1	**
19	GASKET RING - METER	2	9341161
18A	BOLT FOR METER 5/8" X 1-1/2" LONG - ASTM B7	8	9304789
18	FLANGE – 2" FF – COMPANION – ANSI CLASS 125 – THREADED OUTLET	2	X X
17	THREDOLET 2" X 3/4"	1	X X
16	GAS SNAP LOCK	2	9330915
14	COUPLING – 2" – COMPRESSION – DRESSER STYLE 90 – LOCK TYPE	1	X X
13B	PLUG – 3/4" - THREADED	2	X X
13A	NIPPLE – 3/4" X 3" - THREADED	2	X X
13	COCK – 3/4" - LOCKWING	2	X X
12A	LOCKING DEVICE	1	9330859
12	VALVE – 2" - THREADED	3	X X
11	CHANNEL – 1- 5/8" - UNISTRUT W / CLAMP	+	X X
10	TEE – 2" - THREADED	4	X X
9,9A	ELBOW – 2" – 90 DEGREE - THREADED	5	X X
8	TEE – 2" X 3/4" X 2" - THREADED	2	X X
6	UNION – 2"	2	X X
5	TAG – GAS SERVICE LOCATION	1	9340255
4	REGULATOR – 2" TRON B34SR (1,100 CFH MAX) 60 PSIG MAX (5/32"x3/16" ON 99/124 PSIG SYSTEM) REGULATOR - 2" ITRON B34IMRV - THREADED - 1/2" ORIFICE – 60 PSIG MAX (3/8" REQ'D ON 99/124 SYS.) REGULATOR - 2" FISHER CS-806 IR THREADED 1/2" ORIFICE – 100 PSIG MAX. (3/8" REQ'D ON 99/124 SYS.) REGULATOR - 2" FISHER CS-803 IT THREADED 5/8" ORIFICE – 60 PSIG MAX. (1/4" REQ'D ON 99/124 SYS.) REGAULTOR - 2" FISHER CS-400IR THREADED 7/32"x1/4" ORIF 60 PSIG MAX – 1,400 SCFH MAX CAP. AT 60 REGULATOR - 2" FISHER CS-400IR THREADED 11/64" ORIF. 124 PSIG MAX. – 2,500 SCFH CAPACITY REGULATOR - 1-1/2" FISHER CS-400IR THREADED 3/8" ORIFICE – 15 PSIG MAX. 1.400 SCFH CAPACITY	1	9342660 9342684 9386776 9386778 9388985 9388995 9388986
3	GASKET RING – 2" FLEXITALLIC SIGMA 588	1	9341161
2A	PIPE – 2"	+	X X
2	PIPE- 2"	+	9312351
1C	FLANGE – 2" – WELDED NECK	2	9314322
1B	<b>BOLTS STUD 5/8" X 5" LONG WITH NUTS – CORROSION RESISTANT – PREFERRED MATERIAL</b> BOLTS – 5/8" X 2-3/4" LONG MACHINE WITH NUT	8 OR 8	9392186 9339766
1A	GASKET 2" – RING TYPE -	1	9340992
1	VALVE – 2" FLANGED	1	9341980
<b>No.</b>	<b>ITEM</b>	<b>ITEM ID</b>	

**BILL OF MATERIAL – 8C & 1.5M AND 2M METERS  $\leq 1,500$  SCF**

**NOTES**

- A. SEE GENERAL NOTES [MTRS – 6545](#)
- B. ALL THREADED TYPE PIPE AND FITTINGS TO BE HOT DIPPED GALVANIZED
- C. ALL FITTING SHALL BE MALLEABLE IRON CLASS 150, ANSI B 16.3
- D. CINCH ANCHORS OR EQUIVALENT TO BE INSTALLED IN FLOOR FLANGES (ITEM 21) BY CUSTOMER.
- E. FOR UNDERGROUND CUSTOMER'S HOUSE PIPING REFER TO DESIGN SECTION
- F. NATIONAL GRID WILL SUPPLY AND INSTALL ALL ITEMS UP TO THE NATIONAL GRID'S SERVICE REGULATOR. NATIONAL GRID WILL ALSO SUPPLY AND INSTALL THE GAS METER.
- G. ITEM 4 AND 20 CAN BE ROTATED TO FIT FIELD CONDITIONS
- H. THE CUSTOMER MAY AT HIS OPTION INSTALL A VERTICAL PRESSURE TAP AT ITEM 9A IF A HEEL TEE IS USED.
- I. FOR LOADS UPTO 1500 CFH 2" PIPING CAN BE USED AFTER THE REGULATOR.
- J. FOR 99 PSIG AND 124 PSIG INLETS, THE ITRON B34IMRV MUST HAVE THE ORIFICE CHANGED TO 3/8". FOR 99/124 PSIG INLETS, ITRON B34SR REQUIRES 5/32"X3/16" ORIFICE. THE FISHER 806 WITH STANDARD 1/2" ORIFICE HAS MAOP OF 100 PSIG. FOR 124 PSIG, USE 3/8" ORIFICE.
- K. METERS OPERATING AT 14" W.C. WILL BE TEMPERATURE CORRECTED AND FIXED FACTORED. TAG METER WITH 14" W.C. STICKER/TAG AND NOTIFY METER OPS VIA FORM THAT CUSTOMER IS USING ELEVATED PRESSURE. FOR METERS OPERATING >14" W.C., A VOLUME CORRECTOR IS REQUIRED.
- M. SEE NATIONAL GRID DRAWING [020013-CS](#) FOR REGULATOR VENT GUIDELINES.
- N. 2M METERS WITH ≤ 1,500 CFH CAN USE 2" PIPING, FOR 2M METERS > 1,500 CFH USE 3" PIPING

**LEGEND:** X X SUPPLIED BY CUSTOMER \* SEE FOR PROPER DESIGN SECTION REGULATOR SELECTING AND SIZING  
 + AS REQUIRED \*\* TO BE SUPPLIED BY NATIONAL GRID

27	2" THREADED NIPPLE X 2" 150# FLAT FACE FLANGE	1	9383856
26	SLEEVE – 4" PIPE – PLASTIC OR EQUIVALENT	1	NAT. GRID
25	SLAB REINF – 4X4 – 4/4 WIRE WELDED FABRIC	1	X X
24	PIPE – HOUSE LINE	+	X X
23	CAP – 3" - THREADED	2	X X
22	PIPE SUPPORT – 12" TO 24" HEIGHT 9391870 PIPE SUPPORTS 24" TO 35" HEIGHT 9391559	1	X X X X
21	SYSTEM PRESSURE TAG	1	9346233
20	METER – LINE MOUNTED ROTARY – 2M OR 3M 125 – 2" INLET / OUTLET	1	**
19	GASKET RING - METER	2	9341161
18A	BOLT – 5/8" X 1-1/2 FOR METER ASTM B7	8	9304789
18	FLANGE – 2" FF – COMPANION – ANSI CLASS 125 – THREADED OUTLET	2	X X
17	THREDOLET 3" X 3/4" SEE NOTE K	1	X X
16	GAS SNAP LOCK	2	9330915
14	COUPLING – 3" – COMPRESSION – DRESSER STYLE 90 LOCK TYPE	1	X X
13B	PLUG – 3/4" - THREADED	3	X X
13A	NIPPLE – 3/4" X 3" - THREADED	2	X X
13	COCK – 3/4" - LOCKWING	2	X X
12A	LOCKING DEVICE	1	9330859
12	VALVE – 3" - THREADED	3	X X
11	CHANNEL – 1 5/8" - UNISTRUT W / CLAMP	+	X X
10	TEE – 3" - THREADED	4	X X
9,9A	ELBOW – 3" – 90 DEGREE - THREADED	5	X X
8	TEE – 3" X 3/4" X 3" - THREADED	2	X X
7,7A	REDUCER – 2" X 3" - THREADED	3	X X
6	UNION – 3"	2	X X
5	TAG – GAS SERVICE LOCATION	1	9340255
4	REGULATOR - 2" ITRON B34IMRV - THREADED - 1/2" ORIFICE – 60 PSIG MAX (3/8" REQ'D ON 99/124 SYS.) REGULATOR - 2" FISHER CS-806 IR THREADED 1/2" ORIFICE – 100 PSIG MAX. (3/8" REQ'D ON 99/124 SYS.) REGULATOR - 2" FISHER CS-803 IT THREADED 5/8" ORIFICE – 60 PSIG MAX. (1/4" REQ'D ON 99/124 SYS.) 2" FISHER CS400IR 11/64" ORIFICE FOR 99/124PSIG SYSTEMS - 2,550 SCFH	1	9342684 9386776 9386778 9388995
3	GASKET RING – 2"	1	9341161
2A	PIPE – 3"	+	X X
2	PIPE- 2"	+	9312351
1C	FLANGE – 2" – WELDED NECK	2	9314322
1B	BOLTS – STUD 5/8" X 5" LONG WITH NUTS – CORROSION RESISTANT – PREFERRED MATERIAL OR BOLTS – 5/8" X 2 3/4" MACHINE	8	9392186 9339766
1A	GASKET – 2"	1	9340992
1	VALVE – 2" FLANGED	1	9341980
<b>No.</b>	<b>ITEM</b>	<b>NAT. GRID ITEM ID</b>	

**BILL OF MATERIAL – 2M (> 1,500 CFH) AND 3M METER**


**NOTES**

- A. SEE GENERAL NOTES [MTRS – 6545](#)
- B. ALL THREADED TYPE PIPE AND FITTINGS TO BE HOT DIPPED GALVANIZED
- C. ALL FITTING SHALL BE MALLEABLE IRON CLASS 150, ANSI B 16.3
- D. CINCH ANCHORS OR EQUIVALENT TO BE INSTALLED IN FLOOR FLANGES (ITEM 21) BY CUSTOMER.
- E. FOR UNDERGROUND CUSTOMER'S HOUSE PIPING REFER TO DESIGN SECTION
- F. NATIONAL GRID WILL SUPPLY AND INSTALL ALL ITEMS UP TO THE NATIONAL GRID'S SERVICE REGULATOR. NATIONAL GRID WILL ALSO SUPPLY AND INSTALL THE GAS METER.
- G. ITEM 4 AND 20 CAN BE ROTATED TO FIT FIELD CONDITIONS
- H. THE CUSTOMER MAY AT HIS OPTION INSTALL A VERTICAL PRESSURE TAP AT ITEM 9A IF A HEEL TEE IS USED.
- I. FOR LOADS UPTO 1500 CFH 2" PIPING CAN BE USED AFTER THE REGULATOR.
- J. FOR 99 PSIG AND 124 PSIG INLETS, THE ITRON B34IMRV MUST HAVE THE ORIFICE CHANGED TO 3/8". THE FISHER 806 WITH STANDARD 1/2" ORIFICE HAS MAOP OF 100 PSIG. FOR 124 PSIG, USE 3/8" ORIFICE.
- K. METERS OPERATING AT 14" W.C. WILL BE TEMPERATURE CORRECTED AND FIXED FACTORED. TAG METER WITH 14" W.C. STICKER/TAG AND NOTIFY METER OPS VIA FORM THAT CUSTOMER IS USING ELEVATED PRESSURE. FOR METERS OPERATING >14" W.C., A VOLUME CORRECTOR IS REQUIRED.
- M. SEE NATIONAL GRID DRAWING [020013-CS](#) FOR REGULATOR VENT GUIDELINES.

**LEGEND:** X X SUPPLIED BY CUSTOMER \* SEE FOR PROPER DESIGN SECTION REGULATOR SELECTING AND SIZING  
 + AS REQUIRED \*\* TO BE SUPPLIED BY NATIONAL GRID

27	2" THREADED NIPPLE X 2" 150# FLAT FACE FLANGE	1	9383856
26	SLEEVE – 4" PIPE – PLASTIC OR EQUIVALENT	1	NAT. GRID
25	SLAB REINF – 4X 4 – 4/4 WIRE WELDED FABRIC	1	X X
24	PIPE – HOUSE LINE	+	X X
23	CAP –4" - THREADED	2	X X
22	PIPE SUPPORT – 12" TO 24" HEIGHT 9391870 PIPE SUPPORT – 23" TO 35" HEIGHT 9391559	1	X X X X
21	SYSTEM PRESSURE TAG	1	9346233
20	METER – LINE MOUNTED ROTARY – 7M 125 –3" INLET / OUTLET	1	**
19	GASKET RING - METER	2	9341162
18A	BOLT FOR METER – 5/8" X 2" ASTM B7	8	9342411
18	FLANGE – 3" FF – COMPANION – ANSI CLASS 125 – THREADED OUTLET	2	X X
17	THREADOLET 4" X 3/4" SEE NOTE K	1	X X
16	GAS SNAP LOCK	2	9330915
14	COUPLING – 4" – COMPRESSION – DRESSER STYLE 90 LOCK TYPE	1	X X
13B	PLUG – 3/4" - THREADED	2	X X
13A	NIPPLE – 3 /4" X 3" - THREADED	2	X X
13	COCK – 3/4" - LOCKWING	2	X X
12A	LOCKING DEVICE	1	9330859
12	VALVE – 4" - THREADED	3	X X
11	CHANNEL – 1 5/8" – UNISTRUT W / CLAMP	+	X X
10	TEE – 4" - THREADED	4	X X
9,9A	ELBOW – 4" – 90 DEGREE - THREADED	5	X X
8	TEE – 4"X 3 / 4" X 4" - THREADED	2	X X
7A	REDUCER – 3" X 4" - THREADED	2	X X
7	REDUCER – 2" X 4" - THREADED	1	X X
6	UNION – 4"	2	X X
5	TAG – GAS SERVICE LOCATION	1	9340255
4	REGULATOR - 2" ITRON B34IMRV - THREADED - 1/2" ORIFICE – 60 PSIG MAX (3/8" REQ'D ON 99/124 SYS.) REGULATOR - 2" FISHER CS-806 IR THREADED 1/2" ORIFICE – 100 PSIG MAX. (3/8" REQ'D ON 99/124 SYS.) REGULATOR - 2" FISHER CS-803 IT THREADED 5/8" ORIFICE – 60 PSIG MAX. (1/4" REQ'D ON 99/124 SYS.)	1	9342684 9386776 9386778
3	GASKET RING - 2"	1	9341161
2A	PIPE – 4"	+	X X
2	PIPE – 2"	+	9312351
1C	FLANGE – 2" – WELDED NECK	2	9314322
1B	BOLTS 5/8" X 4" LONG WITH 2 HEX NUTS – CORROSION RESISTANT – PREFERRED MATERIAL OR BOLTS – 5 /8" X 2- 3/4" LONG, MACHINE	8	9392186 9339766
1A	GASKET 2" – FLANGED – INSULATED FLANGE KIT	1	9340992
1	VALVE – 2" - FLANGED	1	9341980

No.	BILL OF MATERIAL ITEM – 7M	NAT. GRID CODE No.
-----	----------------------------	--------------------

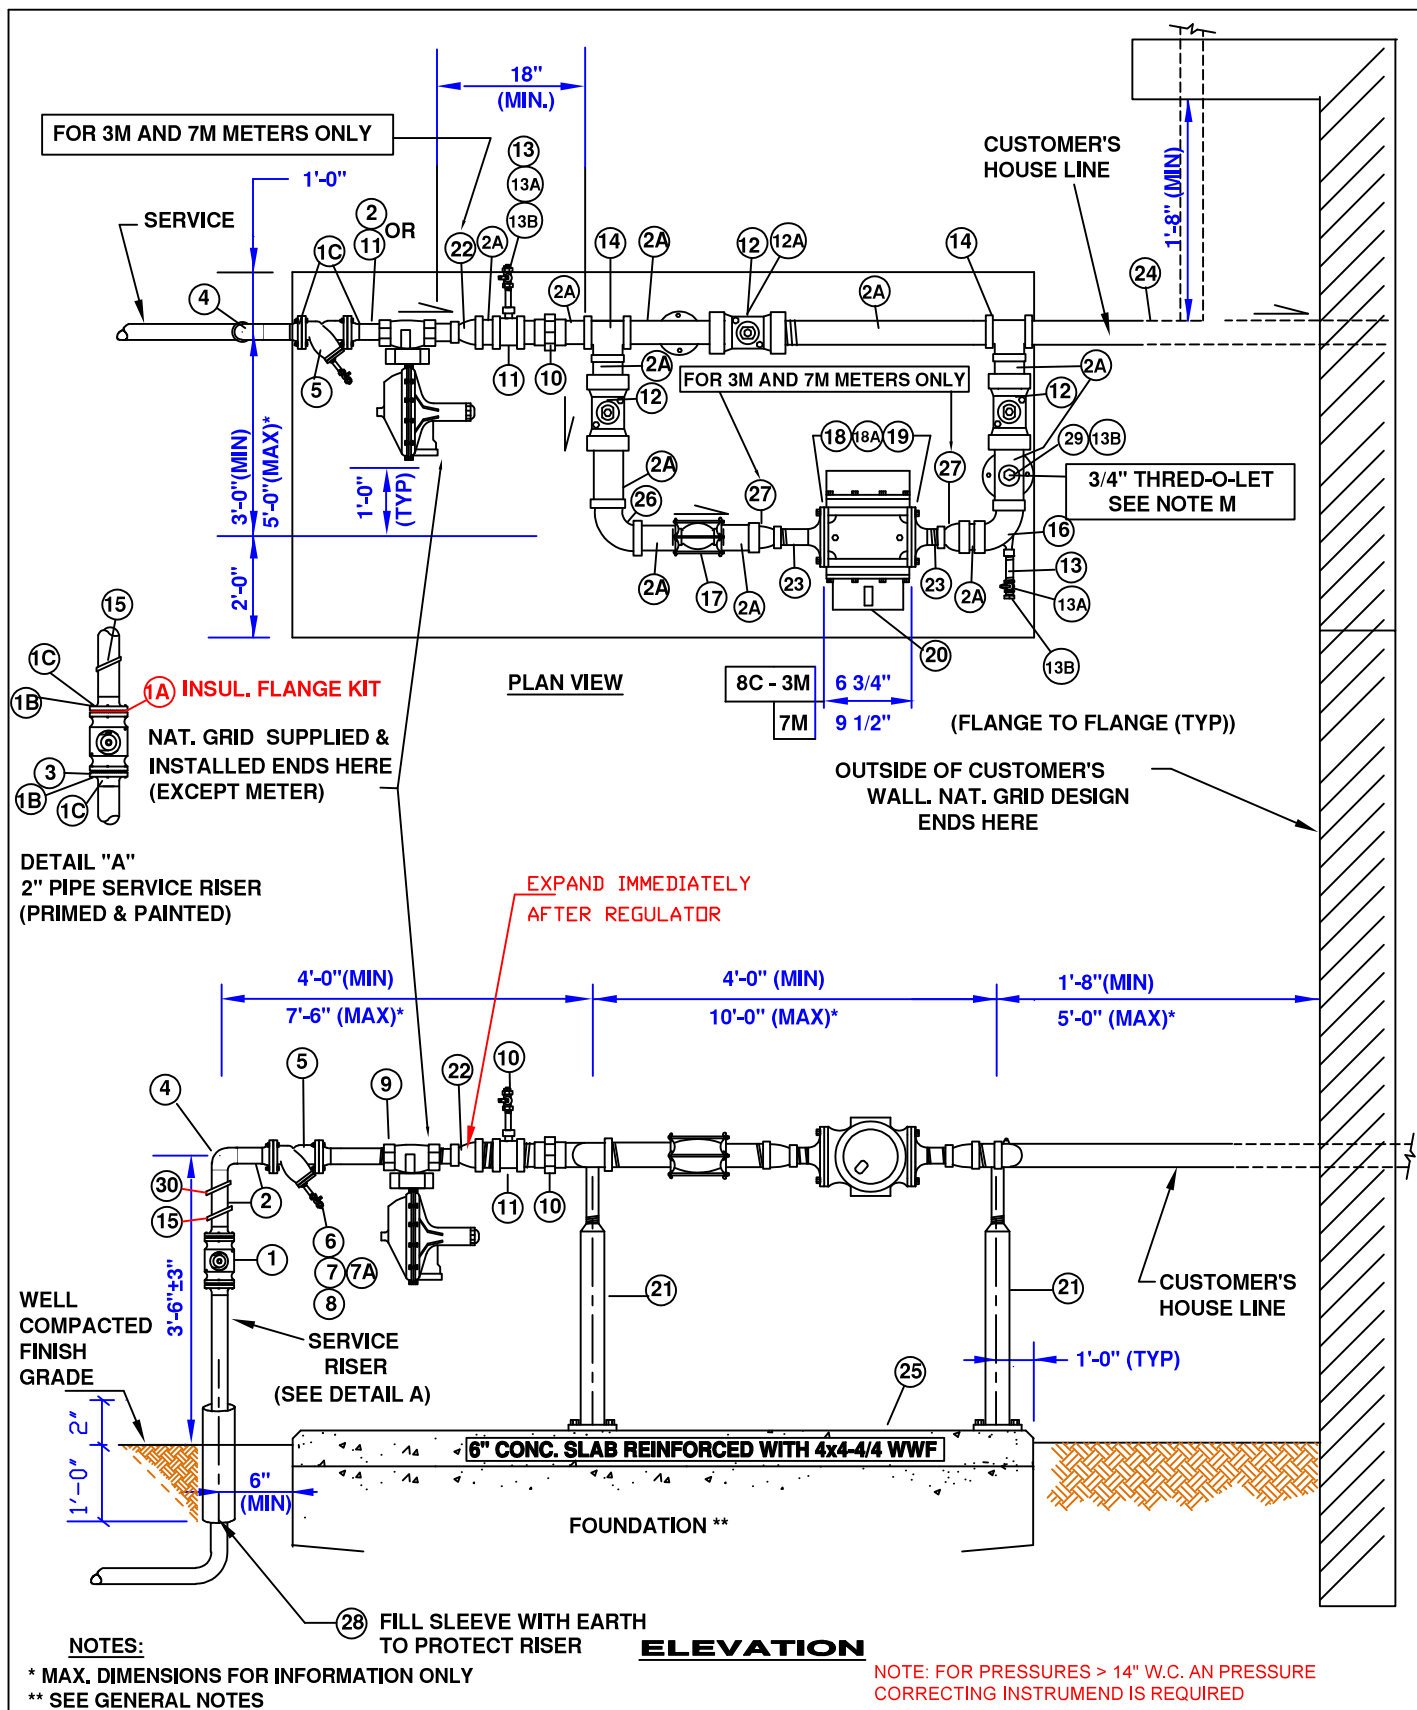

**nationalgrid**

LONG ISLAND

**HP MAIN / LP OR 14" W.C. METERING  
FOR 8C, 1.5M, 2M, 3M OR 7M  
HORIZONTAL - ROTARY GAS METER  
OUTSIDE LOCATIONS**

**REVISIONS:** UPDATED SAP IDs AND LINKS

DATE: 07/01/2003

EFFECTIVE DATE: 05/27/2025

DESIGN: P.GUGLIOTTA

STD. DWG.

DRAWN: P.GUGLIOTTA

NO. **MTRS-6265**

## NOTES

- A. SEE GENERAL NOTES [MTRS-6545](#)
- B. ALL SCREW TYPE PIPE FITTINGS TO BE HOT DIPPED GALVANIZED
- C. ALL FITTINGS SHALL BE MALLEABLE IRON CLASS 150, ANSI B 16.3
- D. ALL EXPOSED UNCOATED PIPING SHALL BE COATED IN ACCORDANCE WITH [030031-CS](#)
- E. CINCH ANCHORS TO BE INSTALLED IN FLOOR FLANGES (ITEM 21) BY CUSTOMER
- F. FOR UNDERGROUND CUSTOMER'S HOUSE PIPING REFER TO DESIGN SECTION
- G. FOR VEHICULAR DAMAGE PROTECTION SEE [MTRS – 6060](#)
- H. A METER SHALL NEVER BE INSTALLED LOWER THAN EITHER SIDE OF PIPE RUNS
- I. NAT. GRID WILL SUPPLY AND INSTALL ITEMS EXCEPT WHERE NOTED.
- J. THE CAPACITY OF THE B34SR WITH THE 7/32"X1/4" ORIFICE ON THE 60 PSIG SYSTEM IS 1,100 CFH. ON THE 99/124 PSIG SYSTEM, A 5/32" X 3/16" ORIFICE IS NEEDED AND THE CAPACITY IS 2,400 CFH AND CAN BE USED FOR 1.5 AND 2M INSTALLATIONS. FOR 3M AND 7M INSTALLATIONS USE 2" ACTARIS B34IMRV OR FISHER CS-806.
- K. **THE ACTARIS B-34IMRV HAS A MAXIMUM INLET PRESSURE OF 60 PSIG. FOR 99 PSIG AND 124 PSIG SYSTEMS, A 3/8" ORIFICE MUST BE INSTALLED. THE FISHER CS 803 AND CS806 HAVE A MAX. ONLET PRESSURE OF 100 PSIG WITH STANDARD 1/2" ORIFICE.**
- L. **FOR METERS OPERATING AT 14" W.C., TAG METER WITH 14" W.C. STICKER/TAG AND NOTIFY METER OPS VIA FORM THAT CUSTOMER IS USING ELEVATED PRESSURE. FOR METERS OPERATING >14" W.C., A VOLUME CORRECTOR IS REQUIRED.**
- M. FOR T.C. RATE INSTALLATIONS AND METERING PRESSURES > 14" W.C., A 3/4 THRED-O-LET IS NEEDED FOR A THERMOWELL. THIS MUST BE DRILLED OUT TO 7/8" DIAMETER. AN ALTERNATE TO A THREDOLET IS A 2" X 3/4" THREADED TEE FOR THE 8C AND 1.5M OR A 3" X 2" THREADED TEE FOR 3M INSTALLATIONS OR A 4" X 2" TEE FOR 7M INSTALLATIONS, THEN INSTALL A 2" X 3/4" BUSHING INTO THE TEE FOR THE THERMOWELL.
- N. SEE NATIONAL GRID DRAWING [020013-CS](#) FOR REGULATOR VENTING GUIDELINES.

LEGEND: \*\* SUPPLIED BY CUSTOMER

XX TO BE SUPPLIED BY METER OPERATIONS DEPARTMENT

+ AS REQUIRED

30	SYSTEM PRESSURE TAG	1	9346233	9346233	9346233
29	THREDOLET 3/4" - SEE NOTE M	1	**	**	**
28	SLEEVE – 4" PIPE PLASTIC OR EQUIVALENT	1	NAT. GRID	NAT. GRID	NAT. GRID
27	REDUCER <b>(NOT NEEDED FOR 8C AND 1.5M)</b> . FOR 3M USE 3" X 2" , FOR 7M USE 4" X 3"	2	**	**	**
26	ELBOW – 90 3" (8C, 1.5M OR 3M) - OR 4" (7M) -	1	**	**	**
25	SLAB REINF 4 X4 – 4/4 WWF	1	**	**	**
24	PIPE – HOUSE LINE	+	**	**	**
23	PIPE 2" FOR 8C, 1.5M OR 3M, 3" FOR 7M	2	**	**	**
22	REDUCER <b>(NOT NEEDED FOR 8C AND 1.5M)</b> 3" X 2" FOR 3M, 4" X 2" FOR 7M	1	**	**	**
21	SADDLE – PIPE STANCHION – ADJUSTABLE	2	**	**	**
20	METER LINE MOUNTED ROTARY 8C, 1.5M, 3M OR 7M	1	XX	XX	XX
19	GASKET RING - METER	2	9341161	9341161	9341162
18A	BOLT, 5/8 – 11 X 2 ASTM GRADE B7 – FOR METER	8	9342411	9342411	9342411
18	FLANGE – COMPANION , ANSI CLASS 125 (2" FF FOR 8C, 1.5M OR 3M) OR (3" FF FOR 7M)	2	**	**	**
17	COUPLING COMPRESSION DRESSER STYLE 38 (2" FOR 8C & 1.5M, 3" FOR 3M, 4" FOR 7M)	1	**	**	**
16	HEEL TEE (2"X3/4"X2" FOR 8C & 1.5M, 3"X3/4"X3" FOR 3M OR (4" X 3/4" X 4" FOR 7M)	1	**	**	**
15	TAG CPR - GAS SERVICE LOCATION	1	9340255	9340255	9340255
14	TEE (2" FOR 8C & 1.5M, 3" FOR 3M OR 4" FOR 7M)	2	**	**	**
13B	PLUG, SOLID 3/4" NPT	3	**	**	**
13A	COCK, LOCKWING 3/4"	2	**	**	**
13	NIPPLE, 3/4" X 3" LONG	2	**	**	**
12A	LOCKING DEVICE	1	NAT. GRID	NAT. GRID	NAT. GRID
12	VALVE – (2" FOR 8C & 1.5M, 3" FOR 3M OR 4" FOR 7M)	3	**	**	**
11	TEE (8C, 1.5M) 2"X2"X3/4", (3M) 3" X 2" OR (7M) - 4" X 4" X 2" USE 2" X 3/4" BUSHING	1	**	**	**
10	UNION 2" FOR 8C AND 1.5M, 3" FOR 3M OR 4" FOR 7M	1	**	**	**
9	2" ACTARIS B34IMRV SEE NOTE K	1	9381875	9381875	9381875
	2" B34SR REGULATOR (8C ONLY) SEE NOTE J & K	1	9342684	9342684	9342684
	2" FISHER 806IR 100 PSIG MAX WITH 1/2" ORIFICE (3/8" ORIF NEEDED FOR 124 PSIG INLETS)	1	9342660	9342660	N/A
	FOR 15 PSIG SYSTEMS USE 3/4" ORIFICE 4,410 SCFH MAX	1	9386776	9386776	9386776
	2" FISHER CS400IR 7/32"X1/4" ORIFICE 60 PSIG MAX – 1,500 SCFH MAX	1	9388985	-	-
	2" FISHER CS400IR 11/64" ORIFICE FOR 99/124PSIG SYSTEMS - 2,550 SCFH MAX	1	9388995	9388995	-
8	PLUG, SOLID 3/8" NPT	1	9339874	9339874	9339874
7A	GAS SNAP LOCK	1	9330915	9330915	9330915
7	COCK, DRAIN 3/8" BRASS	1	9339655	9339655	9339655
6	NIPPLE, 3/8" X 3" LONG - GALVANIZED	1	9340616	9340616	9340616
5	STRAINER – CAST IRON, FLANGED END "Y" 100 MESH SCREEN W / BOLTS	1	9340158	9340158	9340158
4	ELBOW – 90 DEGREE – 2" LONG RADIUS, STEEL WELD END STD. WALL A234 WPB	1	9315522	9315522	9315522
3	GASKET – RING – 2"	3	9341161	9341161	9341161
2A	PIPE – (2" FOR 8C & 1.5M, 3" FOR 3M OR 4" FOR 7M)	+	**	**	**
2	PIPE – 2"	+	9312351	9312351	9312351
1C	FLANGE 2" WELDED NECK	4	9314322	9314322	9314322
1B	BOLTS MACHINE 5/ 8 X 2 3/4 GRADE B7 OR BOLTS – STUD 5/8" X 4" WITH 2 HEX NUTS – CORROSION RESISTANT (PREFERRED)	8	9339766 9392186	9339766 9392186	9339766 9392186
1A	GASKET FLANGED INSULATED, 2"	1	9340992	9340992	9340992
1	VALVE – FLANGE 2"	1	9341980	9341980	9341980

## BILL OF MATERIAL

No.	ITEM	QTY	8C OR 1.5M	2M & 3M	7M
			NAT. GRID CODE No.		


# CLASS 400 C.F.H. WITH BYPASS

## LOW PRESSURE

FROM NEW 1 1/4" PLASTIC GAS SERVICE

## HIGH PRESSURE

FROM NEW 1" PLASTIC GAS SERVICE

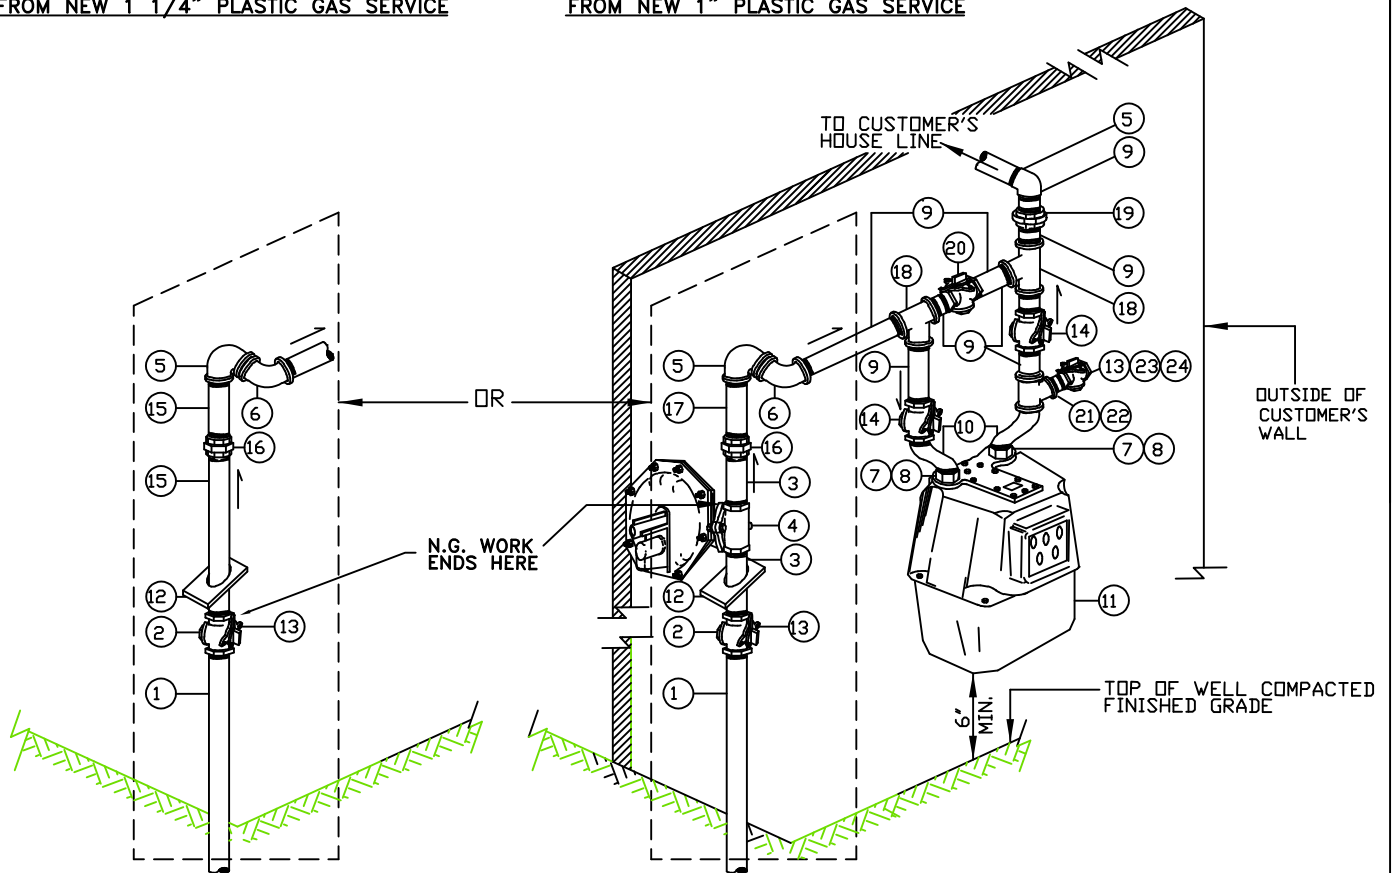

**nationalgrid**

LONG ISLAND

## OUTDOOR GAS METER CLASS 250 & 400 C.F.H. WITH BYPASS

REVISIONS: REVISED SAP ITEM ID#'S AND NOTES

DATE: 07/01/2003

DESIGN: JAL

DRAWN: MLoP

EFFECTIVE DATE: 06/05/2025

STD. DWG.

NO.

**MTRS-6335**



## NOTES

- A. THIS CONSTRUCTION STANDARD SHALL BE USED WHEN AN OUTDOOR METER SET IS SPECIFIED ON A WORK ORDER. METER SETS SHALL BE DESIGNED IN ACCORDANCE WITH THE CUSTOMER'S LOAD, SERVICE LENGTH AND SIZE AS OUTLINED IN DESIGN SECTION.
- B. A 3/4 INCH OR 1-1/4 INCH OUTLET RISER IS USED FOR THE METERS SHOWN.
- C. FOR SERVICE INSTALLATION REQUIREMENTS, REFER TO THE SERVICES SECTION STANDARDS. THE RISER SHALL BE LOCATED A MINIMUM OF 12 INCHES FROM THE OUTSIDE BUILDING FOUNDATION WALL.
- D. ALL EXPOSED PIPING AND THREADED FITTINGS SHALL BE GALVANIZED OR BLACK PRIMED AND PAINTED.
- E. AFTER PURGING THE SERVICE AND BEFORE INSTALLING THE METER. THE METER VALVE ON THE RISER AND THE BYPASS IF USED, SHALL BE CLOSED AND LOCKED WITH A GAS SNAP LOCK DEVICE.
- F. MAINTAIN 1/2 INCH MINIMUM CLEARANCE BETWEEN THE REGULATOR AND METER CASE OR ANY OTHER FOREIGN STRUCTURE. SWING REGULATOR, IF NECESSARY TO OBTAIN CLEARANCE.
- G. SERVICE RISER, METER HEADER AND METER SHALL BE LOCATED TO PREVENT DAMAGE BY VEHICLES AND MECHANICAL EQUIPMENT. WHERE A PROTECTED LOCATION IS NOT AVAILABLE, ADD ADDITIONAL PROTECTION BY USE OF CONCRETE FILLED STEEL POSTS. POST SHALL BE FURNISHED AND INSTALLED BY CONTRACTOR, PER [NATIONAL GRID](#) STANDARD [MTRS-6060](#).
- H. THE METER AND ASSOCIATED PIPING SHALL BE PLUMB AND LEVEL FROM BOTH THE FRONT AND SIDE AS SHOWN IN THE DRAWINGS.
- I. A STEEL PROTECTIVE SLEEVE SHALL BE USED AS A CASING FOR THE SERVICE PIPE WHEN INSTALLING THE SERVICE ABOVE GROUND THROUGH CONCRETE AND BLOCK WALLS. REFER TO [SERV-6205](#) FOR LOCATIONS OF BUILDING ENTRY POINTS [AND EXCEPTIONS](#).
- J. UNLESS OTHERWISE SPECIFIED, ALL PIPING SHALL BE IN COMPLIANCE WITH N.F.P.A.-54 AND NATIONAL GRID'S SPECIFICATIONS AND REQUIREMENTS FOR GAS INSTALLATIONS.

A/R AS REQUIRED

N/R NOT REQUIRED

\* SUPPLIED BY KED

\*\* SUPPLIED AND INSTALLED BY CUSTOMER

CLASS 400 CFH <b>WITH</b> BYPASS		HIGH PRESSURE		LOW PRESSURE	
		QTY.	ITEM ID	QTY.	ITEM ID
24	PLUG 3/4" STEEL SOLID	1	**	1	**
23	VALVE 3/4" LOCKWING, GALVANIZED	1	**	1	**
22	NIPPLE 3/4" X 2" LONG, SCH. 40, GALVANIZED	1	**	1	**
21	TEE 1-1/4" X 3/4", THREADED, GALVANIZED	1	**	1	**
20	METER VALVE - LOCKWING	1	**	1	**
19	UNION - 1 1/4" - NON- INSULATED	1	**	1	**
18	TEE - 1 1/4"	2	**	2	**
17	PIPE - 1 1/4" - STEEL - GALV.	A / R	**	A / R	**
16	UNION - 1 1/4" - INSULATING	1	9341691**	1	9341691**
15	NIPPLE - 1 1/4" X 12"	-	N / R	2	9340657**
14	VALVE - METER - 1 1/4"	2	**	2	**
13	GAS SNAP LOCK	1	9330915*	1	9330915*
12	TAG - GAS SERVICE LOCATION	1	9340255*	1	9340255*
11	METER - TEMPERATURE COMPENSATED	1	*	1	*
10	SWIVEL - METER - 1 1/4"	2	9342425*	2	9342425*
9	NIPPLE - 1 1/4" X LENGTH AS REQUIRED	7	**	7	**
8	SWIVEL WASHER - RUBBER	2	9310300*	2	9310300*
7	NUT - METER - 45 LIGHT	2	9340788*	2	9340788*
6	ELBOW - 1 1/4" - STREET	1	**	1	**
5	ELBOW - 1 1/4" - SCREW	2	**	2	**
4	REGULATOR - 1 1/4" FOR 60 PSIG SYSTEM MAXIMUM 3/8" ORIFICE REGULATOR - 1 1/4" FOR 99 PSIG AND 124 PSIG SYSTEMS 1/2" ORIFICE	1	9342206* 9383127*	-	N / R
3	NIPPLE - 1 1/4" X 4"	2	9340652**	-	N / R
2	METER VALVE- 1 1/4" - LOCKING	1	9339609*	1	9339609*
1	RISER - 1" CTS X 1- 1/4" OUTLET RISER - 1-1/4" IPS X 1-1/4" OUTLET	1 -	9340874* -	- 1	- 9340941*
No.	ITEM	SAP ITEM ID			

## BILL OF MATERIAL


## CLASS 250 C.F.H. WITH BYPASS

### LOW PRESSURE

FROM NEW 1 1/4" PLASTIC GAS SERVICE

### HIGH PRESSURE

FROM NEW 1/2" OR 1" PLASTIC GAS SERVICE

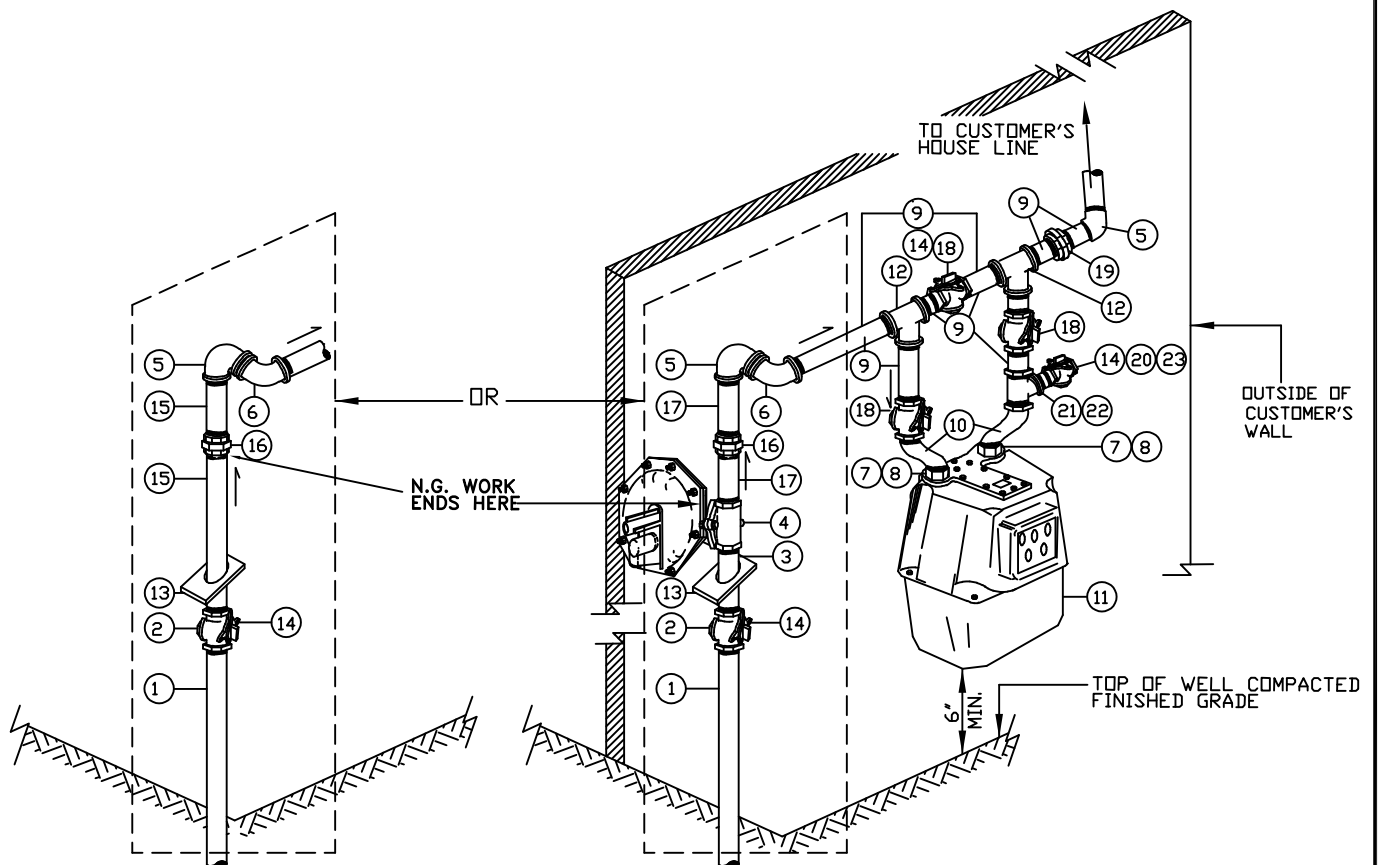



**NOTES**

- A. THIS CONSTRUCTION STANDARD SHALL BE USED WHEN AN OUTDOOR METER SET IS SPECIFIED ON A WORK ORDER. METER SETS SHALL BE DESIGNED IN ACCORDANCE WITH THE CUSTOMER'S LOAD, SERVICE LENGTH AND SIZE AS OUTLINED IN DESIGN SECTION.
- B. A 3/4 INCH OR 1-1/4 INCH OUTLET RISER IS USED FOR THE METERS SHOWN.
- C. FOR SERVICE INSTALLATION REQUIREMENTS, REFER TO THE SERVICES SECTION STANDARDS. THE RISER SHALL BE LOCATED A MINIMUM OF 12 INCHES FROM THE OUTSIDE BUILDING FOUNDATION WALL.
- D. ALL EXPOSED PIPING AND THREADED FITTINGS SHALL BE GALVANIZED OR BLACK AND PRIMED AND PAINTED.
- E. AFTER PURGING THE SERVICE AND BEFORE INSTALLING THE METER. THE METER VALVE ON THE RISER AND THE BYPASS IF USED, SHALL BE CLOSED AND LOCKED WITH A GAS SNAP LOCK DEVICE.
- F. MAINTAIN 1/2 INCH MINIMUM CLEARANCE BETWEEN THE REGULATOR AND METER CASE OR ANY OTHER FOREIGN STRUCTURE. SWING REGULATOR, IF NECESSARY TO OBTAIN CLEARANCE.
- G. SERVICE RISER, METER HEADER AND METER SHALL BE LOCATED TO PREVENT DAMAGE BY VEHICLES AND MECHANICAL EQUIPMENT. WHERE A PROTECTED LOCATION IS NOT AVAILABLE, ADD ADDITIONAL PROTECTION BY USE OF CONCRETE FILLED STEEL POSTS. POST SHALL BE FURNISHED AND INSTALLED BY CONTRACTOR, PER [NATIONAL GRID STANDARD MTRS-6060](#).
- H. THE METER AND ASSOCIATED PIPING SHALL BE PLUMB AND LEVEL FROM BOTH THE FRONT AND SIDE AS SHOWN IN THE DRAWINGS.
- I. A STEEL PROTECTIVE SLEEVE SHALL BE USED AS A CASING FOR THE SERVICE PIPE WHEN INSTALLING THE SERVICE ABOVE GROUND THROUGH CONCRETE AND BLOCK WALLS. REFER TO [SERV-6205](#) FOR LOCATIONS OF BUILDING ENTRY POINTS [AND EXCEPTIONS](#).
- J. UNLESS OTHERWISE SPECIFIED, ALL PIPING SHALL BE IN COMPLIANCE WITH N.F.P.A.-54 AND NATIONAL GRID'S SPECIFICATIONS AND REQUIREMENTS FOR GAS INSTALLATIONS.


A/R AS REQUIRED

N/R NOT REQUIRED

\* SUPPLIED BY KED

\*\* SUPPLIED BY CUSTOMER

CLASS 250 <b>WITH</b> BYPASS		HIGH PRESSURE		LOW PRESSURE	
		QTY.	ITEM ID	QTY.	ITEM ID
23	PLUG,3/4" STEEL SOLID	1	**	1	**
22	TEE 1" X ¾", THREADED, GALVANIZED	1	**	1	**
21	NIPPLE ¾" X 2" LONG GALVANIZED, SCH. 40	1	**	1	**
20	VALVE ¾" LOCK WING, GALVANIZED	1	**	1	**
19	UNION – INSULATING 1"	1	**	-	-
	UNION – INSULATING 1-1/4"	-	-	1	**
18	VALVE 1" LOCKWING, GALVANIZED	3	**	2	**
	VALVE 1-1/4" LOCKWING, GALVANIZED	-	-	1	**
17	NIPPLE 1" X 6"	2	**	-	**
16	UNION – INSULATING 1"	1	9341690**	-	-
	UNION – INSULATING 1-1/4"	-	-	1	9341685**
15	NIPPLE -1 1/4" X LENGTH AS REQUIRED	3	N/R	1	9341197**
14	GAS SNAP LOCK	2	9330915**	2	9330915**
13	TAG-GAS SERVICE LOCATION	1	9340255*	1	9340255*
12	TEE 1" X 1" X 1" GALV. SCREW	2	**	-	-
	TEE 1-1/4"X 1-1/4" X 1" GALV. SCREW	-	-	2	**
11	METER-TEMPERATURE COMPENSATED	1	*	1	*
10	SWIVEL-METER-1" X 20 LT WITH 1 5/8" OFFSET	2	9383109*	2	9383109*
9	NIPPLE-1" X LENGTH AS REQUIRED	7	**	-	**
	NIPPLE – 1-1/4" X LENGTH AS REQUIRED	-	**	7	**
8	WASHER-METER NUT	2	9312524	2	9312524
7	NUT-METER – 20 LIGHT	2	9340787	2	9340787
6	ELBOW – 1" – STREET	1	9341192**	-	-
	ELBOW – 1-1/4" - STREET	-	-	1	9341193**
5	ELBOW – 1" – SCREW	2	9341181**	-	-
	ELBOW 1-1/4" - SCREW	-	-	2	9341185**
4	REGULATOR – ¾" X 1"	1	9383047*	-	N/R
3	NIPPLE – ¾" X 4"	1	9340633*	-	N/R
2	METER VALVE – ¾" – LOCKING	1	9339593*	-	-
	METER VALVE – 1-1/4" - LOCKING	-	-	1	9339609*
1	RISER PIPE ½" MEDIUM DENSITY X ¾" STEEL	1	9340875*	-	-
	RISER PIPE ½" HIGH DENSITY X ¾" STEEL	1	9340852*	-	-
	RISER 1-1/4" IPS MEDIUM DENSITY X 1-1/4" STEEL	-	-	1	9340941*
No.	ITEM	SAP ITEM ID			
BILL OF MATERIAL					

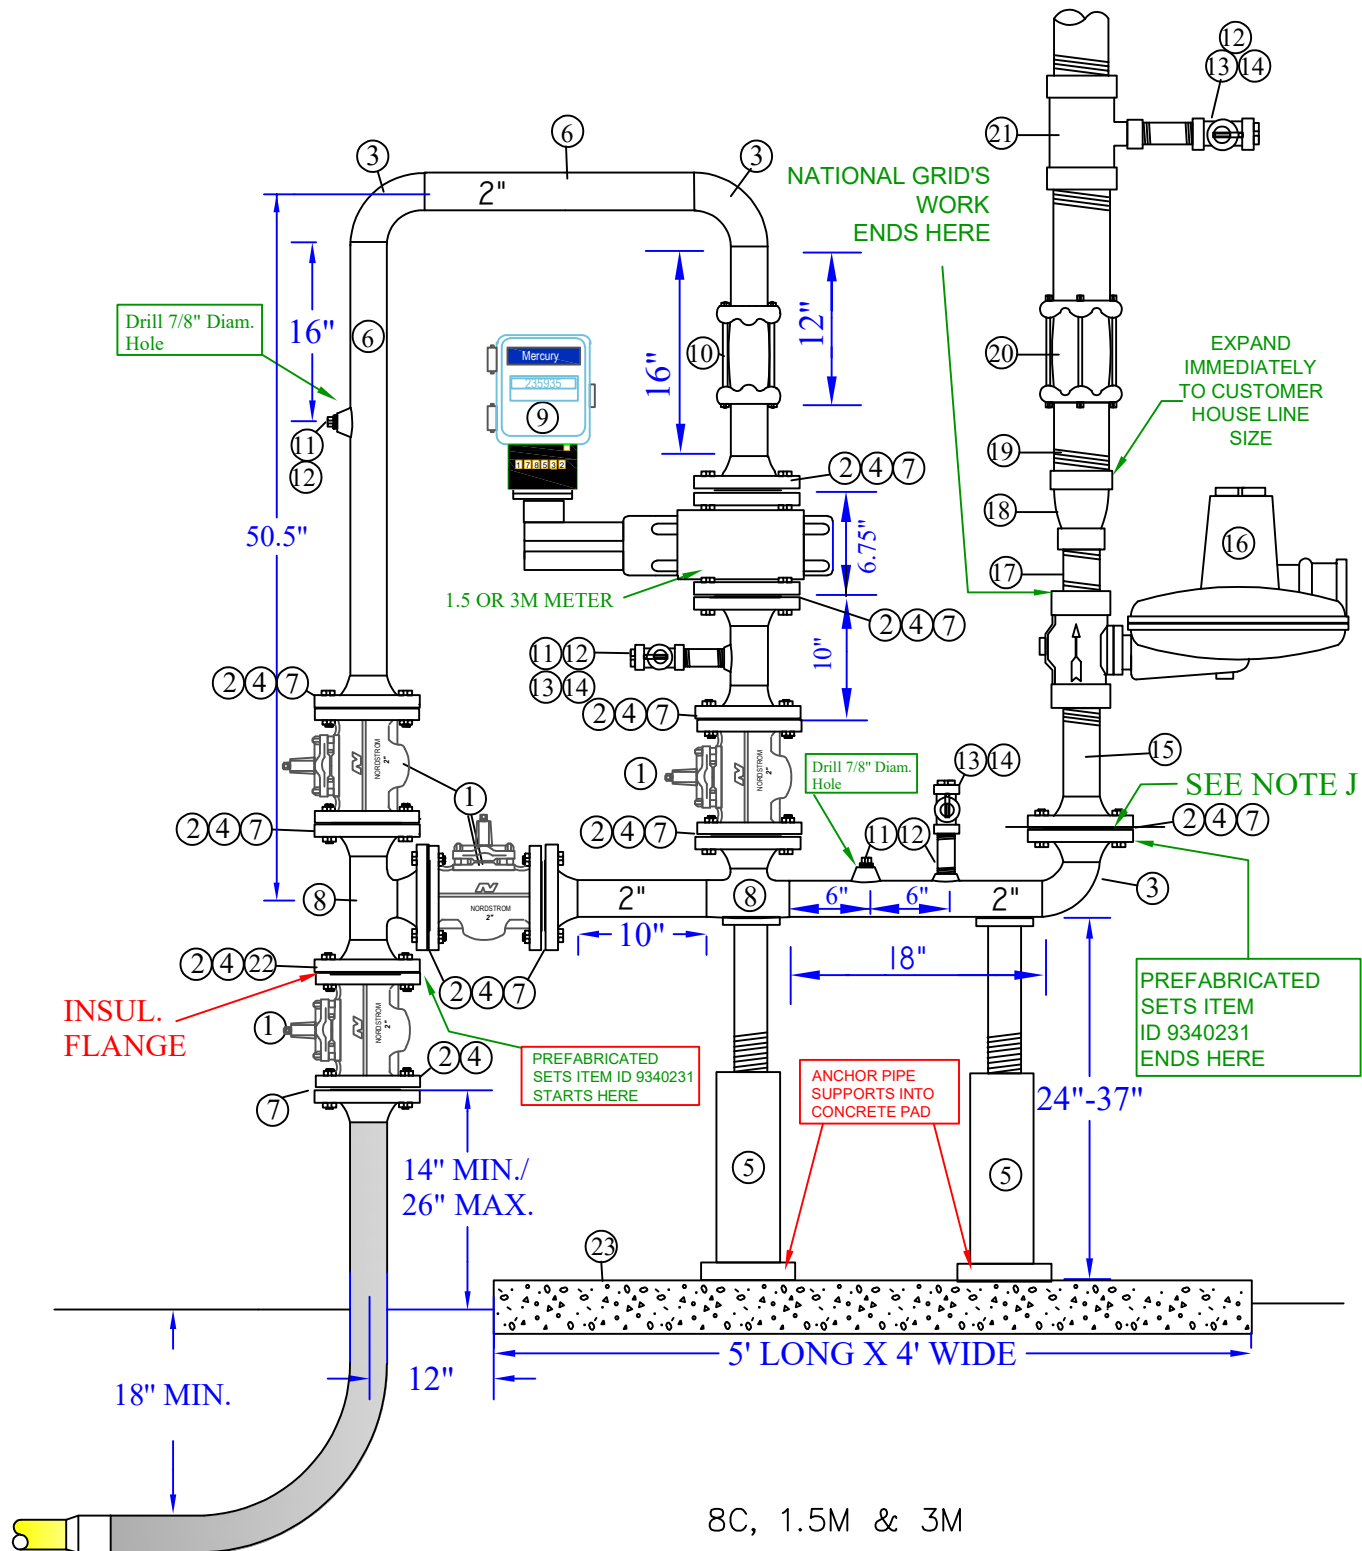

**nationalgrid**

LONG ISLAND

8C, 1.5, 3M & 7M HIGH PRESSURE  
ROTARY METER, VERTICAL POSITION

REVISIONS: UPDATED ITEM ID'S AND LINKS

DATE: 07/01/2003

DESIGN: P.GUGLIOTTA

DRAWN: P.GUGLIOTTA

EFFECTIVE DATE: 05/27/2025

STD. DWG.

NO. MTRS-6385


# **INSTALLATION NOTES**

- A. THE ITRON B-34 IMRV COMES STOCK WITH A 1/2" ORIFICE AND IS RATED FOR 60 PSIG MAX. THE FISHER CS803/804/806 COMES WITH A 1/2" ORIFICE AND IS RATED FOR 100 PSIG MAX. THE ITRON B34IMRV AND FISHER CS803/806 REGULATOR HAVE INTERNAL MONITORS WHICH SERVE AS OVER PRESSURE PROTECTION. ALL OTHER REGULATORS (SUCH FISHER 133 SERIES) MUST HAVE SEPARATE RELIEF VALVES FOR OVER PROTECTION. FISHER 133 REGULATORS REQUIRE DOWNSTREAM CONTROL LINESS. FOR THESE AND OTHER REMOTE MONITORING REGULATORS, INSTALL 3/4" STEEL CONTROL LINE 10 PIPE DIAMETERS OF CUSTOMER'S HOUSE LINE (10 PIPE DIAMETER STARTS AFTER THE REDUCER - ITEM 18). MAXIMUM CAPACITY OF A FISHER CS400 IS 1500 CFH ON THE 60 SYSTEM/2500 SCFH ON 99/124 PSIG SYSTEM.
- B. GALVANIZED PIPE AND FITTINGS ARE THE PREFERRED MATERIALS OF CHOICE. BLACK PIPE, PRIMED AND PAINTED IS ALSO ACCEPTABLE.
- C. WHERE VEHICLE TRAFFIC IS A CONCERN, PROTECTION POST ARE REQUIRED. [SEE MTRS-6060](#)
- D. DO NOT WELD METER IN PLACE. USE A SPOOL PIECE.
- E. ALL WELDING MUST CONFORM TO API-1104 PROCEDURES. ALL PIPING SHALL BE TESTED AT 1.5 MAOP OF INLET SERVICE PRESSURE FOR 30 MINUTES.
- F. PREFABRICATED METER SETS COME WITH 2" X 6-3/4" LONG SPOOL PIECE IN PLACE OF METER.
- G. 2" STRAINERS (ITEM ID 9340258) AND FILTERS (ITEM ID 9341258) CAN BE USED TO PROTECT EQUIPMENT FROM IN LINE DEBRIS. FOR PREFABRICATED SETS USE A FLANGED ELBOW (ITEM ID 9383780) AND ROTATE FLANGED TEE AFTER INLET VALVE FOR STRAINER/FILTER INSTALLATION. SEE FIGURE 2 ON PAGE 9.
- H. FOR PREFABRICATED SETS THAT REQUIRE DUAL RATES, INSTALL FLANGED TEE ON THE RISER VALVE AND THEN ROTATE FLANGED TEE ON THE PREFABRICATED SET FOR THE SECOND METER HEADER. SEE FIG 1 ON PAGE 9.
- I. ELEVATED PRESSURE SHALL BE ONLY USED IF CUSTOMER'S EQUIPMENT REQUIRES IT. IT WILL NOT BE APPROVED TO DOWNSIZE HOUSE LINE.
- J. THIS FLANGE SET IS ONLY FOR PREFABRIACTED METER HEADERS. IF THIS HEADER IS BEING BUILT NEW, THESE TWO FLANGES ARE NOT NEEDED.

## **BILL OF MATERIAL**

ITEM	DESCRIPTION	ITEM I.D	QTY	MATERIAL NOTES
1	VALVE – 2" PLUG NORDSTROM FIG 143	9341980	4	FLANGED ENDS
2	FLANGE 2" WELD NECK FLAT FACE	9314622	11	PER ASTM A-105 GR. B OR A-350 LF-2
3	ELBOW 2" WELD END 90 DEG. LONG RADIUS	9315522	3	STD. WALL PER A-234 WPB
4	<b>BOLTS STUD W/ NUTS – 5/8" X 4" OR</b>	<b>9392186</b>	44	CORROSION RESISTANT
5	BOLTS MACHINE – 5/8" X 2-3/4" W/2H HEX NUT	9339766	44	INCLUDED IN PREFABRICATED SET
	PIPE SUPPORT BASE 12"-24" HEIGHT	9391870	2	<a href="#">SEE MTRS-6475 FOR PIPE SUPPORTS</a>
	PIPE SUPPORT BASE 23"-35" HEIGHT	9391559	2	
6	PIPE 2" STD. WALL (SCH. 40)	<b>9312351</b>	15'	PER A-106 GR. B
7	GASKET 2" FULL FACE FOR 150# FF FLANGE	9341161	10	FLEXITALLIC SIGMA 588
8	TEE 2", WELD END STD. WALL PER A-234 WPB	9315625	2	<a href="#">ALT. IN 1 LOC., USE FLANGED TEE 9387245</a>
9	METER 8C, 1.5M OR 3M TEMPERATURE CORRECTED	+	1	
10	COUPLING 2" LOCK TYPE	9341621	1	
11	THRED-O-LET 3/4" X 2" PIPE	9341652	4	PER A-105 GRADE B
12	PLUG 3/4" SOLID STEEL	<b>9312288</b>	4	3 BY NAT. GRID/1 BY CUSTOMER
13	NIPPLE 3/4" X 3" LONG, GALVANIZED	9340631	3	2 BY NAT. GRID/1 BY CUSTOMER
14	VALVE 3/4" LOCKWING, GALVANIZED TAMPER PROOF	9339593	3	2 BY NAT GRID/1 BY CUST. AY McDONALD 525B
15	THREADED 2" NIPPLE X 2" FLAT FACE 150# FLANGE	9383856	1	ALT USE ITEM 2 AND 6 AND THREAD ONE END
16	2" FISHER B34SR (1,100 CFH MAX) OR 2" FISHER CS400IR 7/32" X 1/4" ORIFICE 1,400 CFH MAX 2" FISHER CS400IR 11/64" ORIFICE 2,500 CFH MAX 2" B34IMRV RELIEF / MONITOR REGULATOR 2" FISHER CS-806IR 1/2" ORIF. (100 PSIG MAX WITH 1/2" ORIF, FOR 124 PSIG INLET 3/8" ORIF. REQ'D) 2" FISHER CS-803IR 3/4" ORIF. 60. PSIG MAX 2" FISHER CS-806IR 7/8" ORIF. 50 PSIG MAX. 2" FISHER FLANGED CS804 1" ORIF 15 PSIG MAX  <a href="#">SPRING FOR ITRON B34IMRV – 14" AND 28" SET POINT 15" – 28" SP. RANGE – BLUE) ITEM ID 9308097</a> <a href="#">SPRING FOR FISHER CS-806 14" – 30" GREEN 9386657</a> <a href="#">SPRING FOR FISHER CS-806 1 PSIG – 2.25 PSIG BLUE 9386658</a> <a href="#">SPRING FOR FISHER CS-806 2.5 PSIG – 5.5 PSIG YELLOW 9386658</a>	9342660 9388985 9388995 9342684 9386776  9386778 9386779 9389727	1	<b>60 PSIG MAXSEE NOTE A</b> <b>60 PSIG MAX WITH 1/2' ORIFICE</b> <b>FOR 99/124 PSIG SERVICES</b>  <b>FISHER CS804 REQUIRED CONTROL LINE TO OPSO</b>
17	NIPPLE 2" X 4" LONG GALVANIZED STD. WT	BY CUST.	1	
18	REDUCER 2" X CUST. HOUSE LINE SIZE GLAV.	BY CUST.	1	
19	PIPE – CUST. HOUSE LINE SIZE. GALVANIZED	BY CUST	A/R	
20	COUPLING CUSTOMER HOUSE LINE SIZE LOCK TYPE	BY CUST	1	
21	TEE CUST. HOUSE LINE SIZE X 3/4", THREADED, GALV.	BY CUST.	1	
22	INSULATING FLANGE KIT	9340992	1	
23	METER PAD 5' LONG X 4' WIDE X 6" THICK	BY CUST.	1	


## **BILL OF MATERIAL**

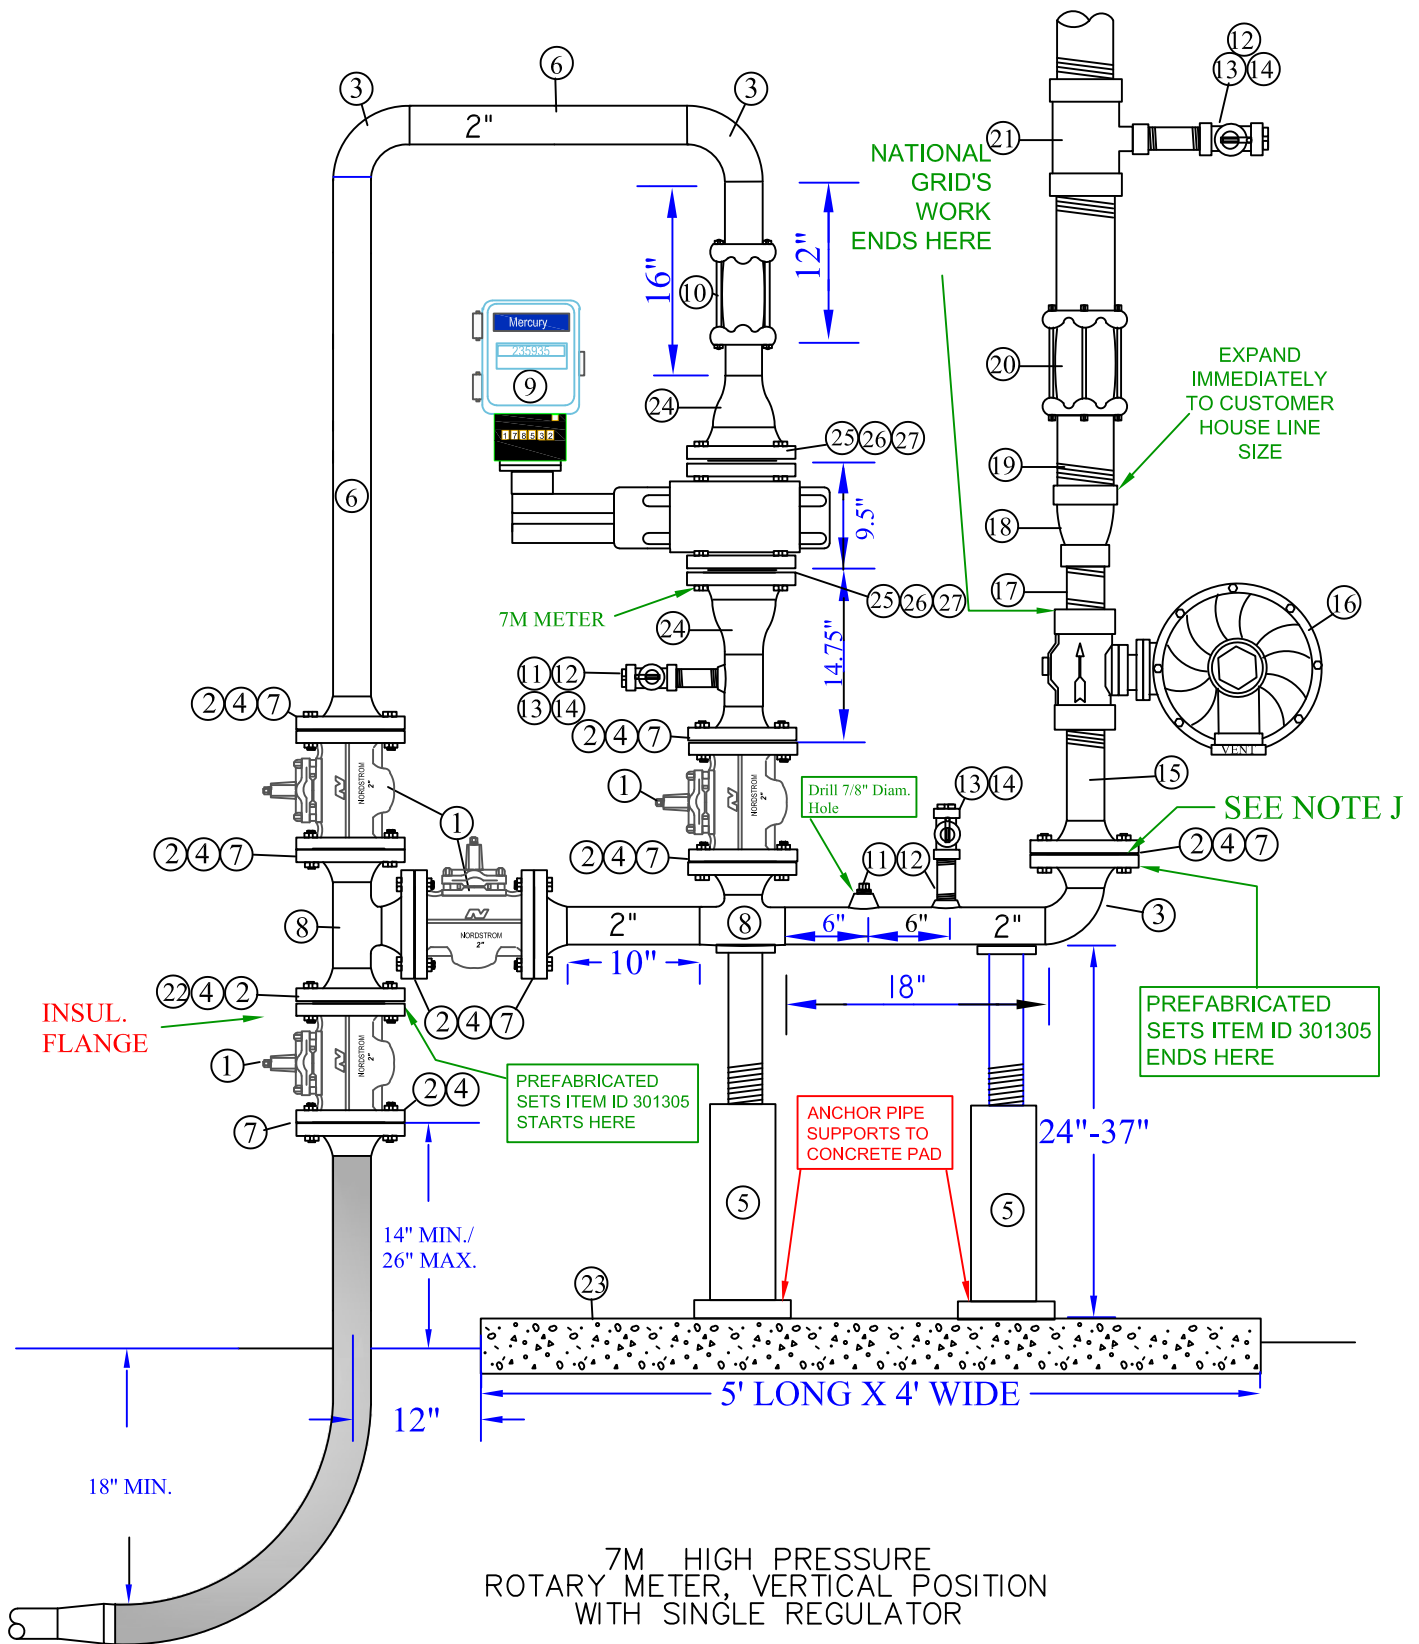

**INSTALLATION NOTES**

- A. FOR 99 AND 124 PSIG SERVICES, THE ITRON B-34 IMRV REGULATOR MUST HAVE THE ORIFICE CHANGED TO 3/8". FOR 124 PSIG, THE FISHER CS806 AND CS803 MUST HAVE ORIFICE CHANGED TO 3/8". THE ITRON B34IMRV AND FISHER CS803/CS806 REGULATOR HAVE INTERNAL MONITORS WHICH SERVE AS OVER PRESSURE PROTECTION. ALL OTHER REGULATORS (SUCH AS ITRON B34N AND FISHER 133 SERIES) MUST USE SEPARATE RELIEF VALVES FOR OVER PROTECTION. FISHER 133 REQUIRES DOWNSTREAM CONTROLS. FOR THESE AND OTHER REMOTE MONITORING REGULATORS, INSTALL 3/4" STEEL CONTROL LINE 10 PIPE DIAMETERS OF CUSTOMER'S HOUSE LINE (10 PIPE DIAMETER STARTS AFTER THE REDUCER - ITEM 18).
- B. GALVANIZED PIPE AND FITTINGS ARE THE PREFERRED MATERIALS OF CHOICE. BLACK PIPE, PRIMED AND PAINTED IS ALSO ACCEPTABLE.
- C. WHERE VEHICLE TRAFFIC IS A CONCERN, PROTECTION POST ARE REQUIRED. REFER TO APPROVED NATIONAL GRID PROTECTION POST STANDARDS [MTRS-6060](#).
- D. **DO NOT WELD OR PRESSURE TEST METER OR REGULATOR.** USE A SPOOL PIECE.
- E. ALL WELDING MUST CONFORM TO API-1104 PROCEDURES. ALL PIPING SHALL BE TESTED AT 1.5 MAOP OF INLET SERVICE PRESSURE FOR 30 MINUTES.
- F. PREFABRICATED METER SETS COME WITH 2" X 6-3/4" LONG SPOOL PIECE IN PLACE OF METER.
- G. 2" STRAINERS (ITEM ID 9340158) AND FILTERS (ITEM ID 9341258) CAN BE USED TO PROTECT EQUIPMENT FROM IN LINE DEBRIS. FOR PREFABRICATED SETS USE A FLANGED ELBOW (ITEM ID 9383780) AND ROTATE FLANGED TEE AFTER INLET VALVE FOR STRAINER/FILTER INSTALLATION. SEE FIGURE 2 ON PAGE 9.
- H. FOR PREFABRICATED SETS THAT REQUIRE DUAL RATES, INSTALL FLANGED TEE ON THE RISER VALVE AND THEN ROTATE FLANGED TEE ON THE PREFABRICATED SET FOR THE SECOND METER HEADER. SEE FIG 1 ON PAGE 9.
- I. ELEVATED PRESSURE SHALL BE ONLY USED IF CUSTOMER'S EQUIPMENT REQUIRES IT. IT WILL NOT BE APPROVED TO DOWNSIZE HOUSE LINE.
- J. THIS FLANGE SET IS ONLY FOR PREFABRIACTED METER HEADERS. IF THIS HEADER IS BEING BUILT NEW, THESE TWO FLANGES ARE NOT NEEDED.
- K. **NOTE: ALL METERS RUNNING AT 14" W.C. (1/2 PSIG) WILL BE TEMP. CORRECTED AND FIXED FACTORED. ALL METERS RUNNING > 14" W.C. WILL BE NON TEMPERATURE CORRECTED AND USE A CORRECTOR.**

ITEM	DESCRIPTION	ITEM I.D	QTY	MATERIAL NOTES
1	VALVE – 2" PLUG NODSTROM FIG 143	9341980	4	FLANGED ENDS PER ASTM A-105 GR. B OR A-350 LF-2 STD. WALL PER A-234 WPB PREFERRED MATERIAL  INCLUDED IN PREFABRICATED SET
2	FLANGE 2" WELD NECK FLAT FACE	9314322	11	
3	ELBOW 2" WELD END 90 DEG. LONG RADIUS	9315522	3	
4	BOLTS STUD 5/8"X4" W/NUTS CORROSION RESISTANT	9392186	44	
5	ALT - BOLTS MACHINE – 5/8" X 2-3/4" W/2H HEX NUT	9339766	44	
	PIPE SUPPORTS 23"-35" HEIGHT WITH SADDLE OR PIPE SUPPORTGS 12"-24" HEIGHT WITH SADDLE	9391559 9391870	2 OR 2	
6	PIPE 2" STD. WALL (SCH. 40)	<a href="#">9312351</a>	15'	PER A-106 GR. B FLEXITALLIC 511 OR 588 (NEW) ALT. IN 1 LOC., USE FLANGED TEE 9387245
7	GASKET 2" FULL FACE FOR 150# FF FLANGE	9341161	10	
8	TEE 2", WELD END STD. WALL PER A-234 WPB	<a href="#">9315625</a>	2	
9	METER 7M	+	1	
10	COUPLING 2" LOCK TYPE	9341621	1	
11	THRED-O-LET 3/4"X 2" PIPE	9341652	3	PER A-105 GRADE B 2 BY NAT. GRID/1 BY CUSTOMER 2 BY NAT. GRID/1 BY CUSTOMER 2 BY N.G. /1 BY CUST. – AY McDONALD 525B ALT USE ITEM 2 AND 6 AND THREAD ONE END
12	PLUG 3/4" SOLID STEEL	9312288	3	
13	NIPPLE 3/4" X 3" LONG, GALVANIZED	9340631	3	
14	VALVE 3/4" LOCKWING, GALVANIZED TAMPER PROOF	9339593	3	
15	THREADED 2" NIPPLE X 2" FLAT FACE 150# FLANGE	9383856	1	
16	2" B34IMRV RELIEF / MONITOR REGULATOR 2" FISHER CS-806IR 1/2" ORIF. (100 PSIG MAX WITH 1/2" ORIF, FOR 124 PSIG INLET 3/8" ORIF, REQ'D) 2" FISHER CS-803IT 3/4" ORIF. 60 PSIG MAX 2" FISHER CS-806IR 7/8" ORIF. 50 PSIG MAX.  (14" – 30" DARK GREEN) ITEM ID 9342194 <a href="#">SPRING FOR ACTARIS B34IMRV – 14" AND 28" SET POINT 15" – 28" SP. RANGE – BLUE) ITEM ID 9308097</a> SPRING FOR FISHER CS-806 14" – 30" GREEN 9386657 SPRING FOR FISHER CS-806 1 PSIG – 2.25 PSIG BLUE 9386658 SPRING FOR FISHER CS-806 2.5 PSIG – 5.5 PSIG YELLOW 9386658	9342684 9386776  9386778 9386779	1	
17	NIPPLE 2" X 4" LONG GALVANIZED STD. WT	BY CUST.	1	
18	REDUCER 2" X CUST. HOUSE LINE SIZE GLAV.	BY CUST.	1	
19	PIPE – CUST. HOUSE LINE SIZE. GALVANIZED	BY CUST.	1	
20	COUPLING CUSTOMER HOUSE LINE SIZE LOCK TYPE	BY CUST.	1	
21	TEE CUST. HOUSE LINE SIZE X 3/4", THREADED, GALV.	BY CUST.	1	
22	INSULATING FLANGE KIT 2" CLASS 150#	9340992	1	ZINC COATED
23	METER PAD 5' LONG X 4' WIDE X 6" THICK	BY CUST.	1	
24	REDUCER 3" X 2" CONCENTRIC, WELD END	<a href="#">9315489</a>	2	
25	FLANGE 3" WELD NECK FLAT FACE 150# STD.BORE	<a href="#">9314431</a>	2	
26	GASKET 3" FULL FACE 1/16" THICK	9341158	2	
27	BOLTS – MACHINE 5/8" X 2" LONG FOR 7M METER	9342411	8	

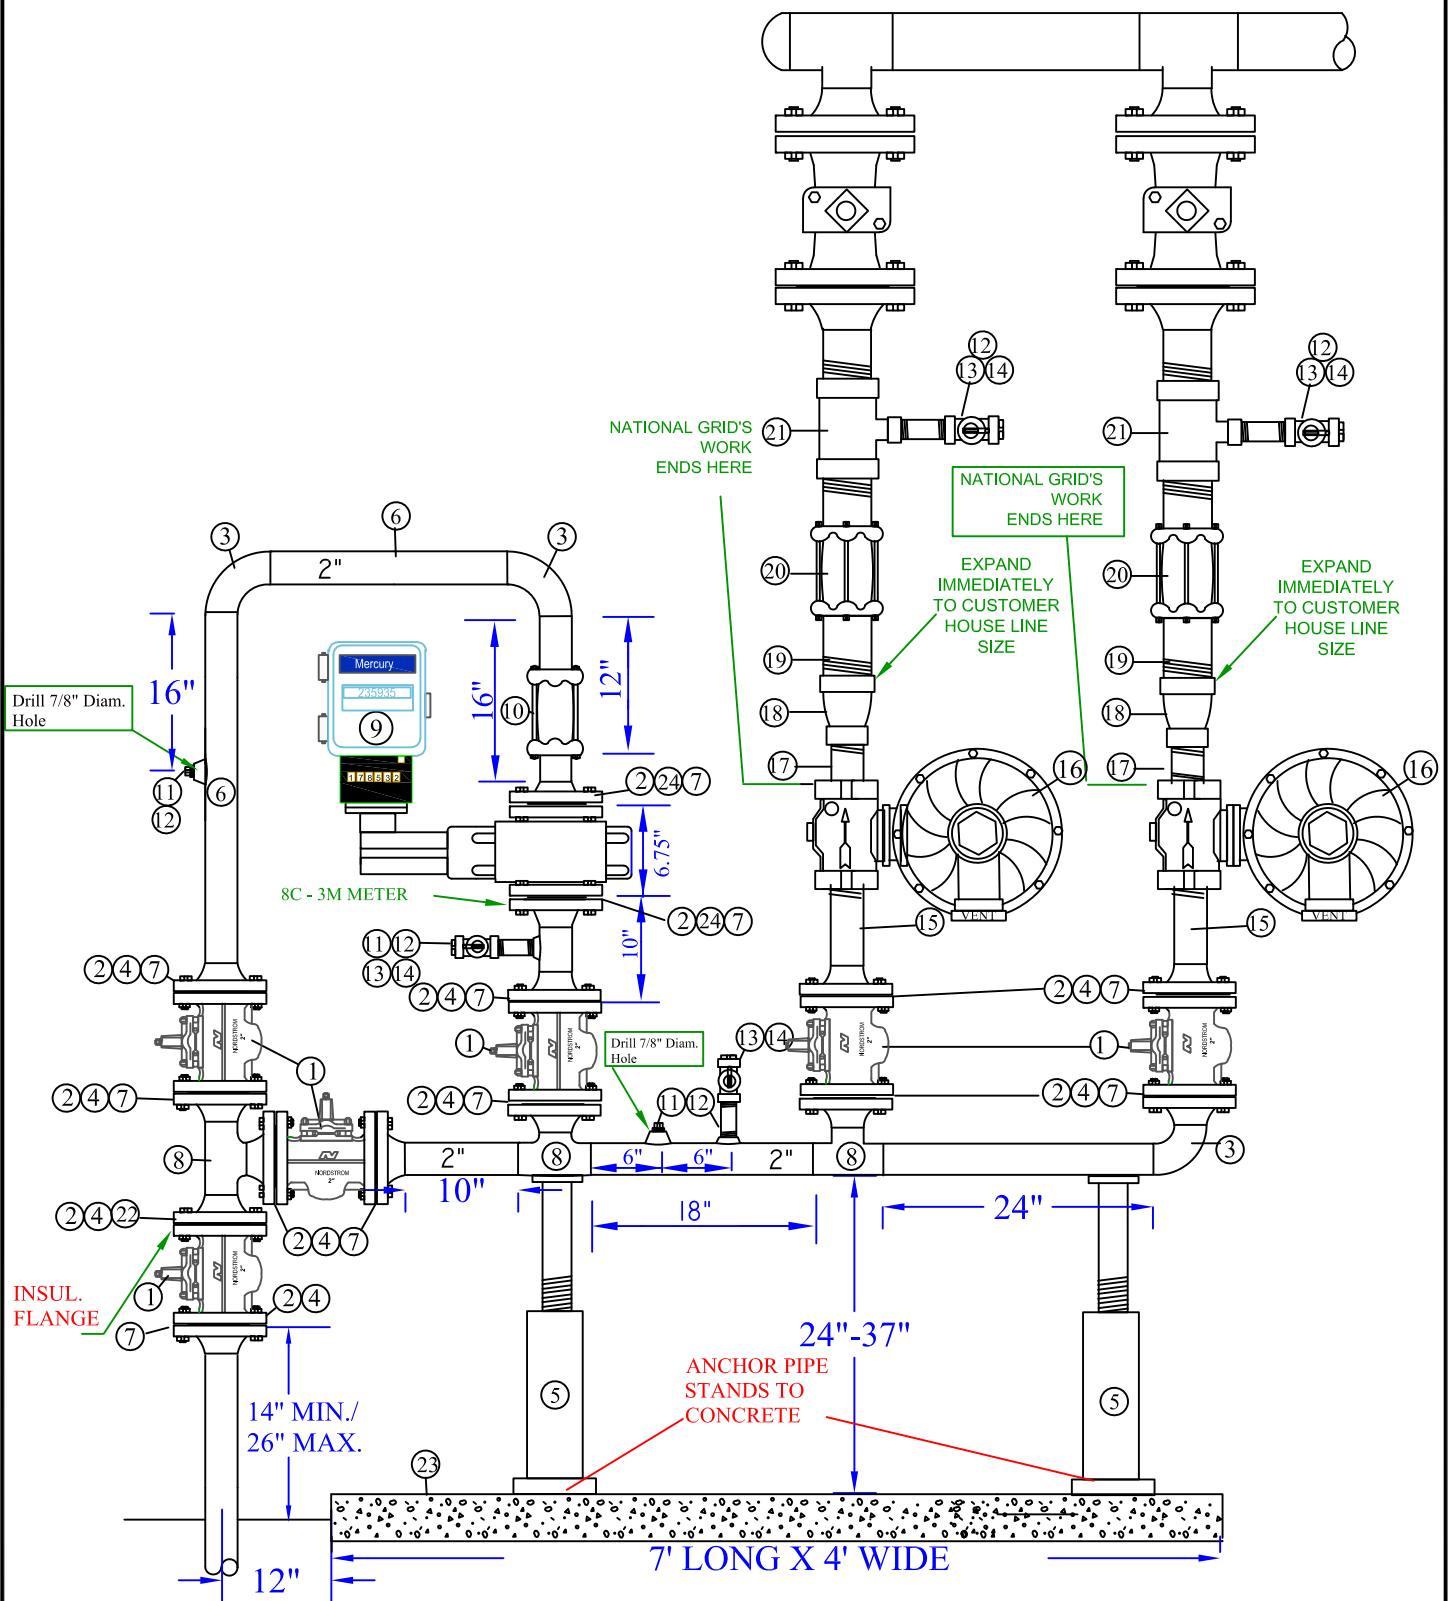

8C, 1.5M OR 3M HIGH PRESSURE  
ROTARY METER, VERTICAL POSITION  
WITH DUAL REGULATORS




**INSTALLATION NOTES**

- A. FOR 99 AND 124 PSIG SERVICES, THE ITRON B-34 IMRV REGULATOR MUST HAVE THE ORIFICE CHANGED TO 3/8". FOR 124 PSIG, THE FISHER CS806 AND CS803 MUST HAVE ORIFICE CHANGED TO 3/8". THE ITRON B34IMRV AND FISHER CS803/CS806 REGULATOR HAVE INTERNAL MONITORS WHICH SERVE AS OVER PRESSURE PROTECTION. ALL OTHER REGULATORS (SUCH AS ITRON B34N AND FISHER 133 SERIES) MUST USE SEPARATE RELIEF VALVES FOR OVER PROTECTION. FISHER 133 REQUIRES DOWNSTREAM CONTROLS. FOR THESE AND OTHER REMOTE MONITORING REGULATORS, INSTALL 3/4" STEEL CONTROL LINE 10 PIPE DIAMETERS OF CUSTOMER'S HOUSE LINE (10 PIPE DIAMETER STARTS AFTER THE REDUCER - ITEM 18).
- B. DIAMETERS OF CUSTOMER'S HOUSE LINE (10 PIPE DIAMETER STARTS AFTER THE REDUCER - ITEM 18).
- C. GALVANIZED PIPE AND FITTINGS ARE THE PREFERRED MATERIALS OF CHOICE. BLACK PIPE, PRIMED AND PAINTED IS ALSO ACCEPTABLE.
- D. WHERE VEHICLE TRAFFIC IS A CONCERN, PROTECTION POST ARE REQUIRED. REFER TO APPROVED NATIONAL GRID PROTECTION POST [STANDARDS MTRS-6060](#).
- E. **DO NOT WELD OR PRESSURE METER OR REGULATORS.** USE A SPOOL PIECE.
- F. ALL WELDING MUST CONFORM TO API-1104 PROCEDURES. ALL PIPING SHALL BE TESTED AT 1.5 MAOP OF INLET SERVICE PRESSURE FOR 30 MINUTES.
- G. PREFABRICATED METER SETS COME WITH 2" X 6-3/4" LONG SPOOL PIECE IN PLACE OF METER.
- H. 2" STRAINERS (ITEM ID 9340158) AND FILTERS (ITEM ID 9341258) CAN BE USED TO PROTECT EQUIPMENT FROM IN LINE DEBRIS. FOR PREFABRICATED SETS USE A FLANGED ELBOW (ITEM ID 9383780) AND ROTATE FLANGED TEE AFTER INLET VALVE FOR STRAINER/FILTER INSTALLATION. SEE FIGURE 2 ON PAGE 9.
- I. FOR PREFABRICATED SETS THAT REQUIRE DUAL RATES, INSTALL FLANGED TEE ON THE RISER VALVE AND THEN ROTATE FLANGED TEE ON THE PREFABRICATED SET FOR THE SECOND METER HEADER. SEE FIG 1 ON PAGE 9.
- J. ELEVATED PRESSURE SHALL BE ONLY USED IF CUSTOMER'S EQUIPMENT REQUIRES IT. IT WILL NOT BE APPROVED TO DOWNSIZE HOUSE LINE.
- K. **NOTE: ALL METERS RUNNING AT 14" W.C. (1/2 PSIG) WILL BE TEMP. CORRECTED AND FIXED FACTORED. ALL METERS RUNNING > 14" W.C. WILL BE NON TEMPERATURE CORRECTED AND USE A CORRECTOR.**
- L.

ITEM	DESCRIPTION	ITEM I.D	QTY	MATERIAL NOTES
1	VALVE – 2" PLUG NORDSTROM FIG 143	9341980	6	FLANGED ENDS
2	FLANGE 2" WELD NECK FLAT FACE	9314322	12	PER ASTM A-105 GR. B OR A-350 LF-2
3	ELBOW 2" WELD END 90 DEG. LONG RADIUS	9315522	3	STD. WALL PER A-234 WPB
4	BOLTS – STUD 5/8" X 5" WITH NUTS CORROSION RESIST	9392186	56	<b>PREFERRED MATERIAL</b>
5	BOLTS MACHINE – 5/8" X 2-3/4" W/2H HEX NUT	9339766	56	INCLUDED IN PREFABRICATED SET
	PIPE SUPPORTS 23" – 35" HEIGHT WITH SADDLE	9391559	2 OR	
	PIPE SUPPORTS 12" – 14" HEIGHT WITH SADDLE	9391870	2	
6	PIPE 2" STD. WALL (SCH. 40)	<a href="#">9312351</a>	15'	PER A-106 GR. B
7	GASKET 2" FULL FACE FOR 150# FF FLANGE	9341161	13	FLEXITALLIC 511 OR 588
8	TEE 2", WELD END STD. WALL PER A-234 WPB	<a href="#">9315625</a>	3	<a href="#">ALT. IN 1 LOC, USE FLANGED TEE 9387245</a>
9	METER 8C, 1.5M, 2M OR 3M	+	1	
10	COUPLING 2" LOCK TYPE	9341621	1	
11	THRED-O-LET 3/4" X 2" PIPE	9341652	3	PER A-105 GRADE B
12	PLUG 3/4" SOLID STEEL	9312288	4	2BY NAT. GRID/2 BY CUSTOMER
13	NIPPLE 3/4" X 3" LONG, GALVANIZED	9340631	4	2 BY NAT. GRID/2 BY CUSTOMER
14	VALVE 3/4" LOCKWING, GALVANIZED TAMPER PROOF	9339593	4	2 BY N.G./2 BY CUST. – AY McDONALD 525B
15	THREADED 2" NIPPLE X 2" FLAT FACE 150# FLANGE	9383856	2	ALT USE ITEM 2 & 6 AND THREAD ONE END
16	2" B34IMRV RELIEF / MONITOR REGULATOR 2" FISHER CS-806IR 1/2" ORIF. (100 PSIG MAX WITH 1/2" ORIF, FOR 124 PSIG INLET 3/8" ORIF. REQ'D) 2" FISHER CS-803IT 3/4" ORIF. 60 PSIG MAX 2" FISHER CS-806IR 7/8" ORIF. 50 PSIG MAX.  (14" – 30" DARK GREEN) ITEM ID 9342194 <a href="#">SPRING FOR ITRON B34IMRV – 14" AND 28" SET POINT 15" – 28" SP. RANGE – BLUE</a> ITEM ID 9308097 SPRING FOR FISHER CS-806 14" – 30" GREEN 9386657 SPRING FOR FISHER CS-806 1 PSIG – 2.25 PSIG BLUE 9386658 SPRING FOR FISHER CS-806 2.5 PSIG – 5.5 PSIG YELLOW 9386658	9342684 9386776  9386778 9386779	2	
17	NIPPLE 2" X 4" LONG GALVANIZED STD. WT	BY CUST.	2	
18	REDUCER 2" X CUST. HOUSE LINE SIZE GLAV.	BY CUST.	2	
19	PIPE – CUST. HOUSE LINE SIZE. GALVANIZED	BY CUST.	A/R	
20	COUPLING CUSTOMER HOUSE LINE SIZE LOCK TYPE	BY CUST.	2	
21	TEE CUST. HOUSE LINE SIZE X 3/4", THREADED, GALV.	BY CUST.	2	
22	INSULATING FLANGE KIT	9340992	2	
23	METER PAD 7" LONG X 4' WIDE X 6" THICK	BY CUST.	1	
24	BOLTS – MACHINE 5/8" X 1.5" LONG ZINC COATED	9304789	16	FOR 8C-3M METERS

**BILL OF MATERIAL**

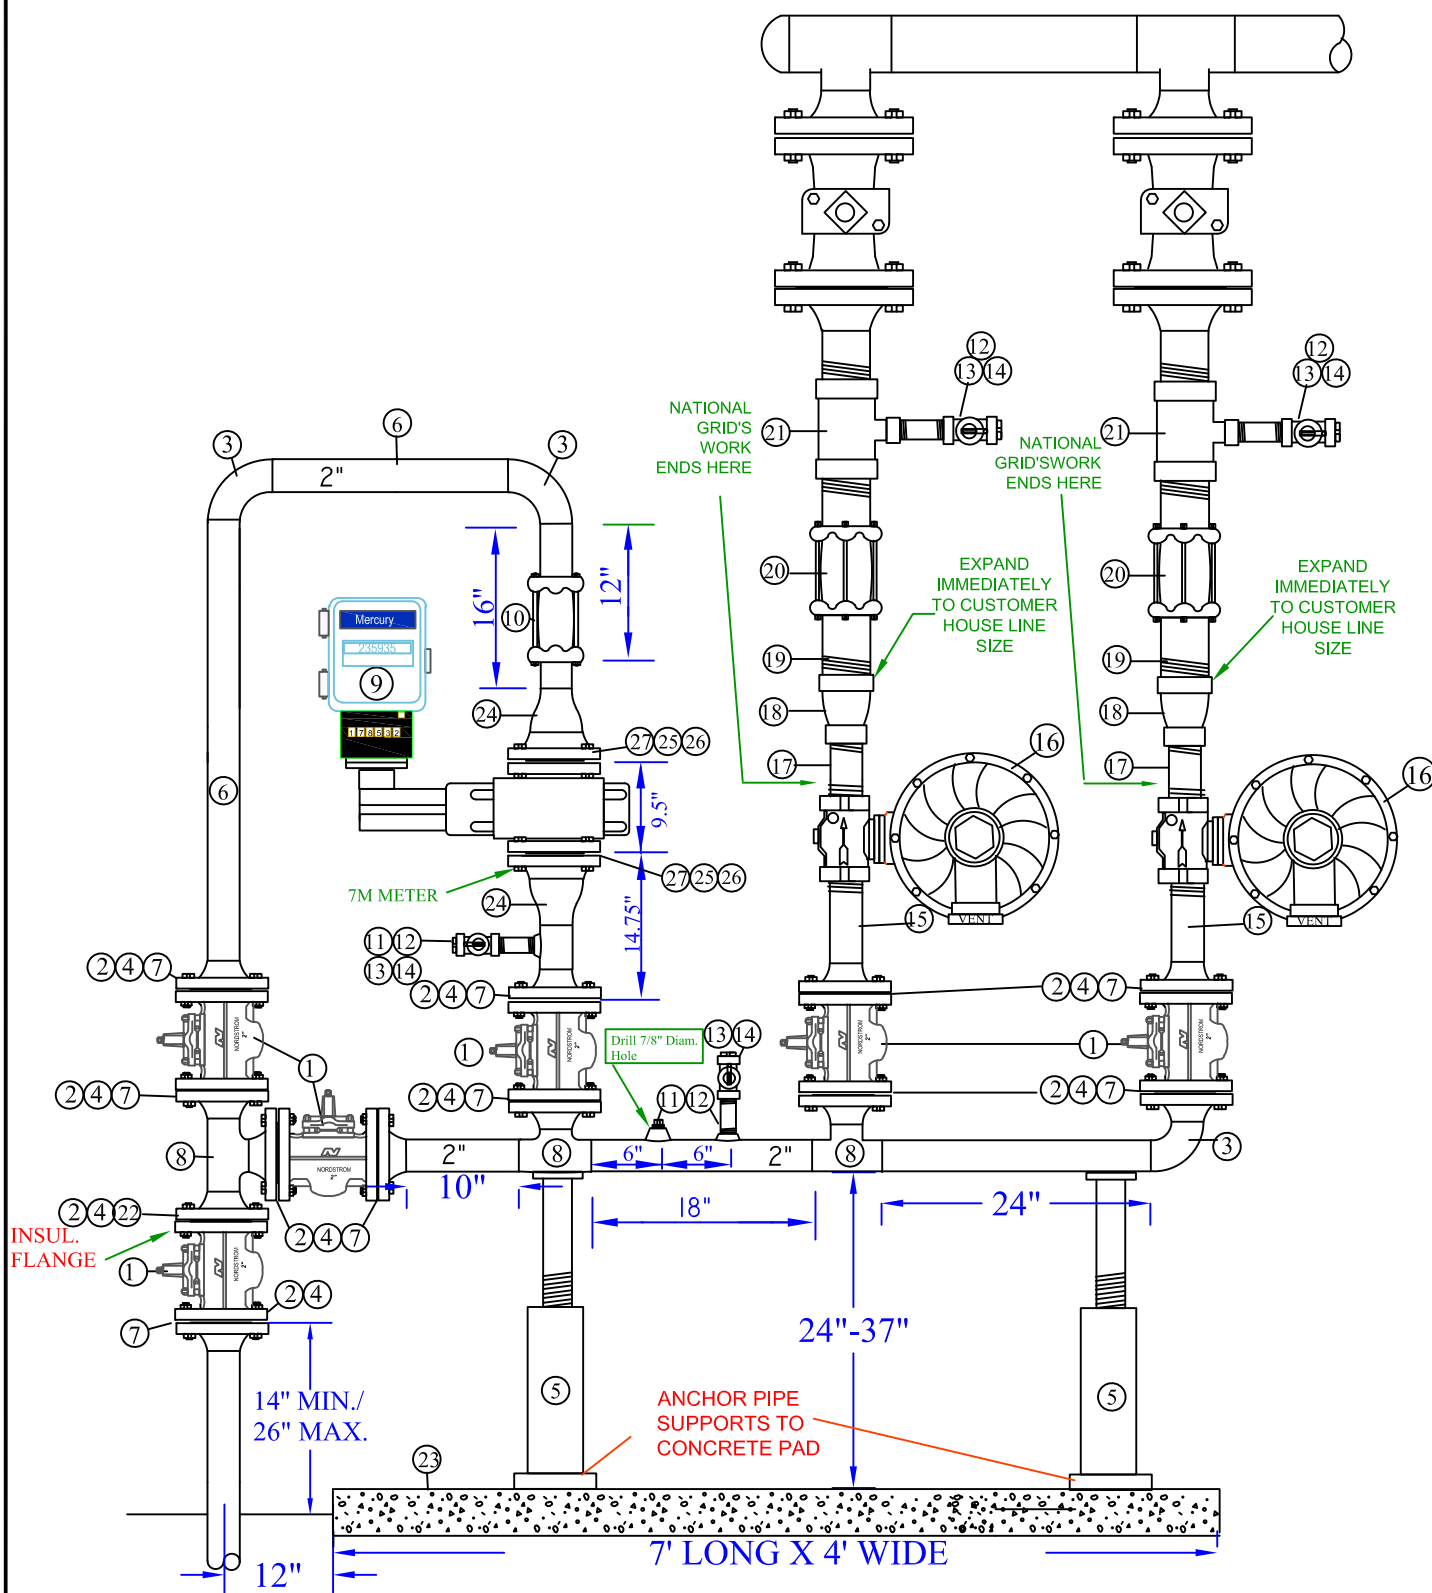

7M HIGH PRESSURE  
ROTARY METER, VERTICAL POSITION  
WITH DUAL REGULATORS



**INSTALLATION NOTES**

- A. FOR 99 AND 124 PSIG SERVICES, THE ITRON B-34 IMRV REGULATOR MUST HAVE THE ORIFICE CHANGED TO 3/8". FOR 124 PSIG, THE FISHER CS806 AND CS803 MUST HAVE ORIFICE CHANGED TO 3/8". THE ITRON B34IMRV AND FISHER CS803/CS806 REGULATOR HAVE INTERNAL MONITORS WHICH SERVE AS OVER PRESSURE PROTECTION. ALL OTHER REGULATORS (SUCH AS ITRON B34N AND FISHER 133 SERIES) MUST USE SEPARATE RELIEF VALVES FOR OVER PROTECTION. FISHER 133 REQUIRES DOWNSTREAM CONTROLS. FOR THESE AND OTHER REMOTE MONITORING REGULATORS, INSTALL 3/4" STEEL CONTROL LINE 10 PIPE DIAMETERS OF CUSTOMER'S HOUSE LINE (10 PIPE DIAMETER STARTS AFTER THE REDUCER - ITEM 18).
- B. GALVANIZED PIPE AND FITTINGS ARE THE PREFERRED MATERIALS OF CHOICE. BLACK PIPE, PRIMED AND PAINTED IS ALSO ACCEPTABLE.
- C. WHERE VEHICLE TRAFFIC IS A CONCERN, PROTECTION POST ARE REQUIRED. REFER TO APPROVED NATIONAL GRID PROTECTION POST STANDARDS [MRTS-6060](#).
- D. DO NOT WELD OR PRESSURE METER OR REGULATORS. USE A SPOOL PIECE.**
- E. ALL WELDING MUST CONFORM TO API-1104 PROCEDURES. ALL PIPING SHALL BE TESTED AT 1.5 MAOP OF INLET SERVICE PRESSURE FOR 30 MINUTES.
- F. PREFABRICATED METER SETS COME WITH 2" X 6-3/4" LONG SPOOL PIECE IN PLACE OF METER.
- G. 2" STRAINERS (ITEM ID 9340158) AND FILTERS (ITEM ID 9341258) CAN BE USED TO PROTECT EQUIPMENT FROM IN LINE DEBRIS. FOR PREFABRICATED SETS USE A FLANGED ELBOW (ITEM ID 9383780) AND ROTATE FLANGED TEE AFTER INLET VALVE FOR STRAINER/FILTER INSTALLATION. SEE FIGURE 2 ON PAGE 9.
- H. FOR PREFABRICATED SETS THAT REQUIRE DUAL RATES, INSTALL FLANGED TEE ON THE RISER VALVE AND THEN ROTATE FLANGED TEE ON THE PREFABRICATED SET FOR THE SECOND METER HEADER. SEE FIG 1 ON PAGE 9.
- I. ELEVATED PRESSURE SHALL BE ONLY USED IF CUSTOMER'S EQUIPMENT REQUIRES IT. IT WILL NOT BE APPROVED TO DOWNSIZE HOUSE LINE.
- J. NOTE: ALL METERS RUNNING AT 14" W.C. (1/2 PSIG) WILL BE TEMP. CORRECTED AND FIXED FACTORED. ALL METERS RUNNING > 14" W.C. WILL BE NON TEMPERATURE CORRECTED AND USE A CORRECTOR.**

ITEM	DESCRIPTION	ITEM I.D	QTY	MATERIAL NOTES
1	VALVE – 2" PLUG NODSTROM FIG 143	9341980	6	FLANGED ENDS
2	FLANGE 2" WELD NECK FLAT FACE	9314322	12	PER ASTM A-105 GR. B OR A-350 LF-2
3	ELBOW 2" WELD END 90 DEG. LONG RADIUS	9315522	3	STD. WALL PER A-234 WPB
4	BOLTS 5/8" X 5" LONG W/NUTS CORROSION RESIST.	9392186	56	<b>PREFERRED MATERIAL</b>
5	BOLTS MACHINE – 5/8" X 2-3/4" W/2H HEX NUT	9339766		
	PIPE SUPPORTS 23" - 35" HEIGHT WITH SADDLE	9391559	2 OR	INCLUDED IN THE PREFABRICATED SET
	PIPE SUPPORTS 12" – 24" HEIGHT WITH SADDLE	9391870	2	
6	PIPE 2" STD. WALL (SCH. 40)	9312351	15'	PER A-106 GR. B
7	GASKET 2" FULL FACE FOR 150# FF FLANGE	9341161	11	FLEXITALLIC 511 OR 588 (NEW)
8	TEE 2", WELD END STD. WALL PER A-234 WPB	9315625	3	ALT. IN 1 LOC., USE FLANGED TEE 9387245
9	METER 7M	+	1	
10	COUPLING 2" LOCK TYPE	9341621	1	
11	THRED-O-LET 3/4" X 2" PIPE	9341652	3	PER A-105 GRADE B
12	PLUG 3/4" SOLID STEEL	9312288	5	3 BY NAT. GRID/2 BY CUSTOMER
13	NIPPLE 3/4" X 3" LONG, GALVANIZED	9340631	4	2 BY NAT. GRID/2 BY CUSTOMER
14	VALVE 3/4" LOCKWING, GALVANIZED TAMPER PROOF	9339593	4	2 BY NG/1 BY CUST. – AY McDONALD 525B
15	THREADED 2" NIPPLE X 2" FLAT FACE 150# FLANGE	9383856	2	ALT USE ITEM 2 AND 6 AND THREAD ONE END
16	2" B34IMRV RELIEF / MONITOR REGULATOR 2" FISHER CS-806IR 1/2" ORIF. (100 PSIG MAX WITH 1/2" ORIF, FOR 124 PSIG INLET 3/8" ORIF. REQ'D) 2" FISHER CS-803IR 3/4" ORIF. 60 PSIG MAX 2" FISHER CS-806IR 7/8" ORIF. 50 PSIG MAX.  SPRING FOR ITRON B34IMRV – 14" AND 28" SET POINT 5" – 28" SP. RANGE – BLUE) ITEM ID 9308097 SPRING FOR FISHER CS-806 14" – 30" GREEN 9386657 SPRING FOR FISHER CS-806 1 PSIG – 2.25 PSIG BLUE 9386658 SPRING FOR FISHER CS-806 2.5 PSIG – 5.5 PSIG YELLOW 9386658	9342684 9386776  9386778 9386779	2	<b>SEE NOTE A</b>
17	NIPPLE 2" X 4" LONG GALVANIZED STD. WT	BY CUST.	2	
18	REDUCER 2" X CUST. HOUSE LINE SIZE GLAV.	BY CUST.	2	
19	PIPE – CUST. HOUSE LINE SIZE. GALVANIZED	BY CUST.	2	
20	COUPLING CUSTOMER HOUSE LINE SIZE LOCK TYPE	BY CUST.	2	
21	TEE CUST. HOUSE LINE SIZE X 3/4", THREADED, GALV.	BY CUST.	2	
22	INSULATING FLANGE KIT 2" CLASS 150#	9340992	1	
23	METER PAD 7' LONG X 4' WIDE X 6" THICK	BY CUST.	1	
24	REDUCER 3" X 2" CONCENTRIC, WELD END	9315489	2	
25	FLANGE 3" WELD END FLAT FACE	9314431	2	PER ASTM A-105 GR. B
26	GASKET 3" FULL FACE	9341162	2	
27	BOLTS 5/8" X 2" LONG ZINC COATED FOR 7m METER	9342411	8	

**BILL OF MATERIAL**

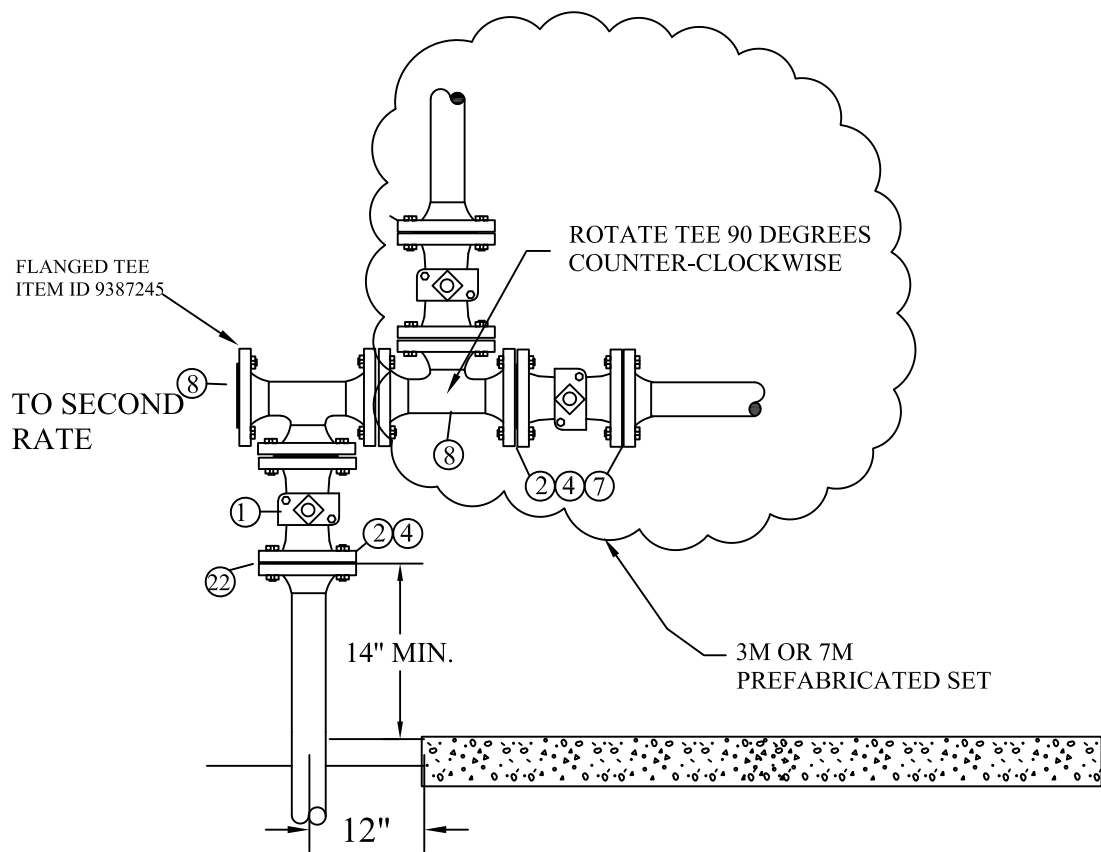


FIGURE 1 - FOR DUAL RATES


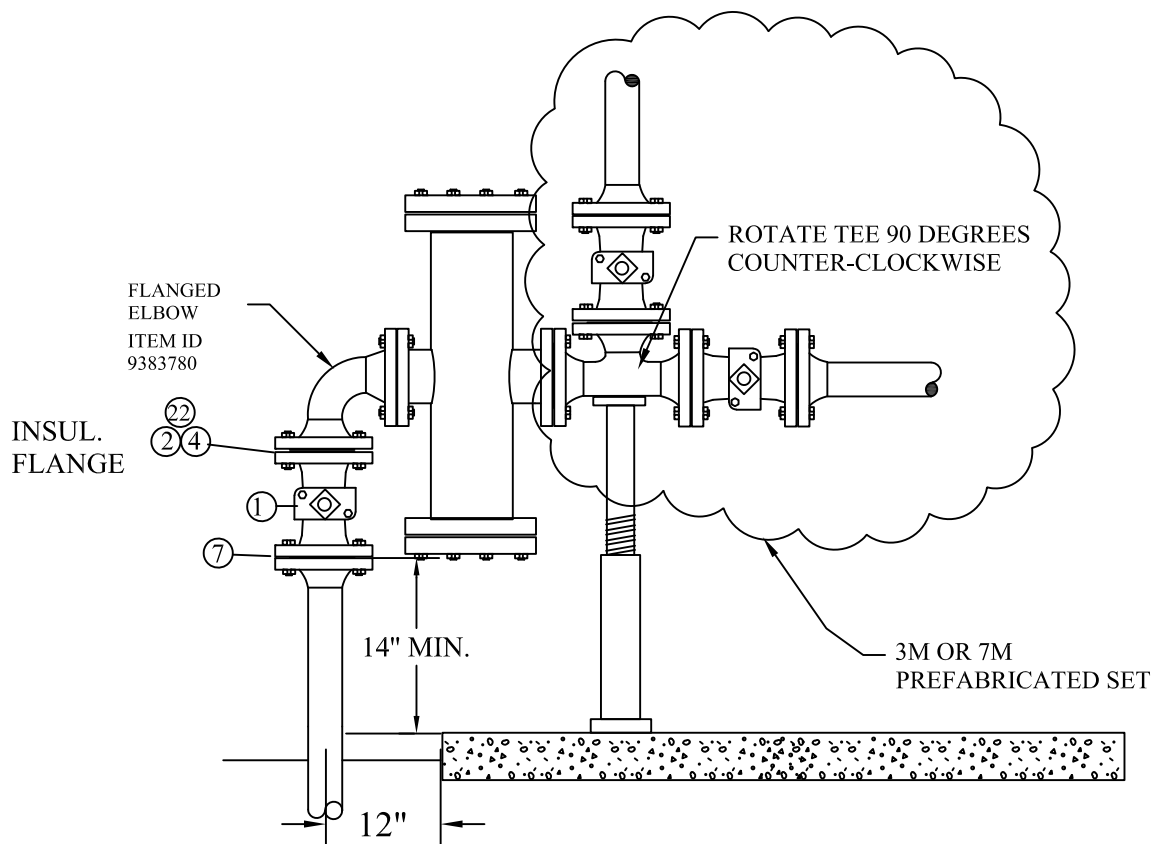


FIGURE 2 - FOR  
FILTER/STRAINER  
INSTALLATIONS

**PREFERRED FOOTING CONSTRUCTION FOR SUPPORTING GAS METER HEADERS  
WHOSE CONFIGURATIONS CONTAIN MORE THAN ONE PIPE SUPPORT**

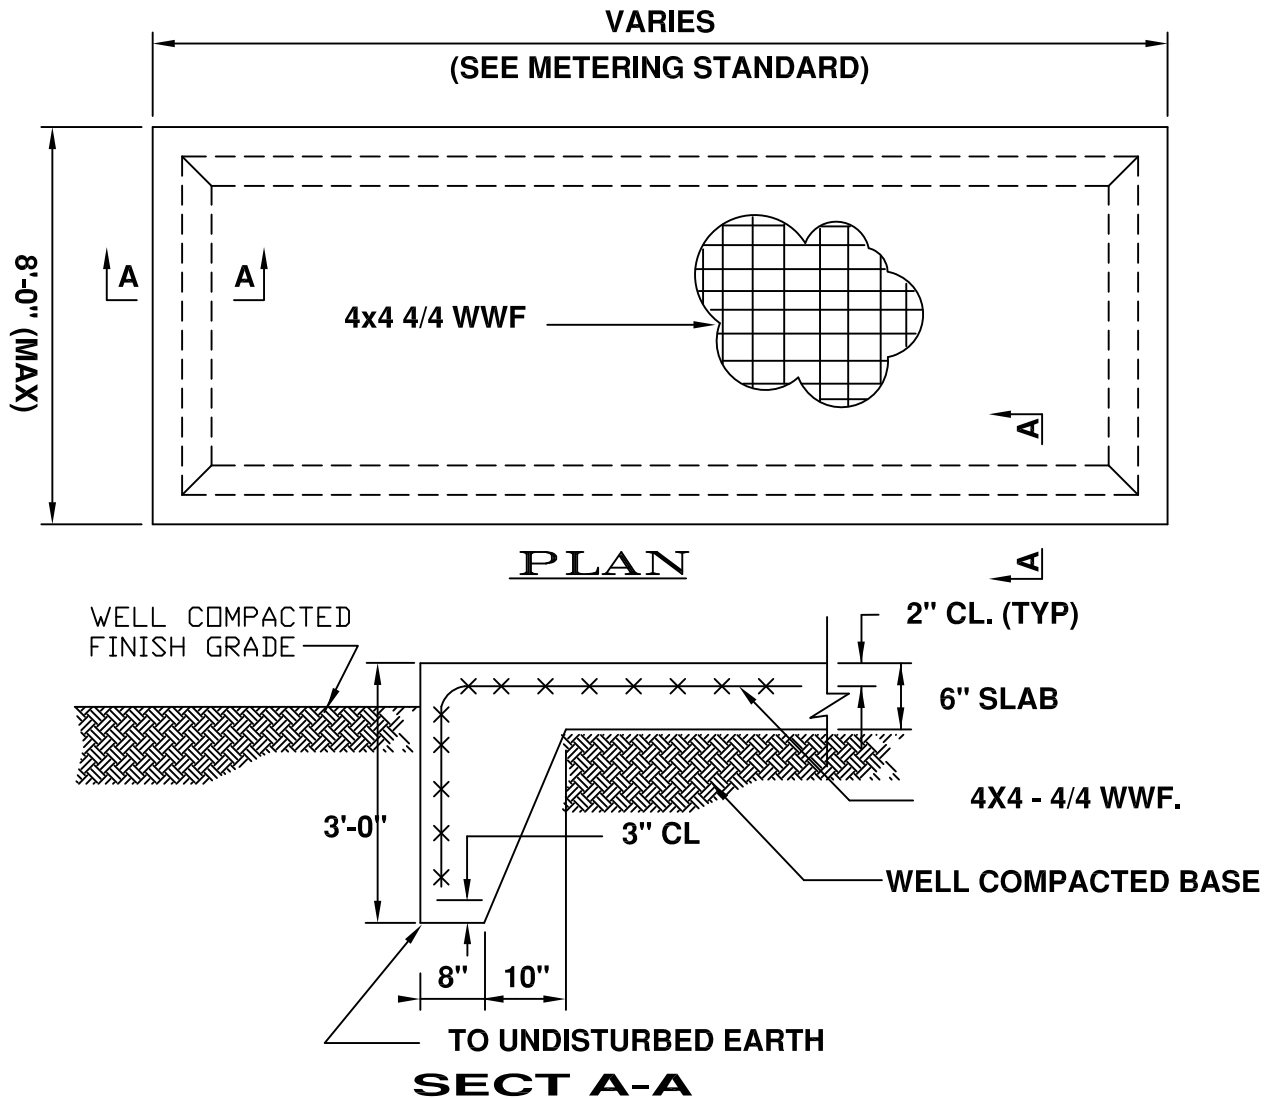

**NOTES**

1. THIS CONSTRUCTION STANDARD SHALL BE USED FOR SUPPORTING GAS METER SETS
2. ALL CONCRETE IS TO DEVELOP TO A MINIMUM COMPRESSIVE STRENGTH OF  $F_c=3000$  psi AT THE TIME OF USE.
3. REINFORCING STEEL SHALL CONFORM TO APPLICABLE ASTM STANDARDS UP TO GRADE 60.
4. CONCRETE DESIGN AND CONSTRUCTION SHALL CONFORM TO ACI STANDARD "BUILDING CODE REQUIREMENTS" FOR REINFORCED CONCRETE (ACI).
5. FOUNDATION (FOOTING) SIZE AND LOCATION WILL BE AGREED UPON BY NATIONAL GRID PRIOR TO WORK ORDER APPROVAL.
6. CONCRETE FOUNDATION OR FOOTING SHALL BE INSTALLED BY THE CUSTOMER BEFORE THE SERVICE IS INSTALLED BY NATIONAL GRID

**nationalgrid**

LI, MA, NH, NYC

**CONCRETE FOUNDATION AND/OR  
FOOTINGS FOR ROTARY GAS METER  
OUTSIDE LOCATIONS**

**REVISIONS:** MADE APPLICABLE FOR ALL REGIONS

DATE: 07/01/2003

DESIGN: GJK

DRAWN: HF


EFFECTIVE DATE: 05/15/2007

STD. DWG.

NO. **MTRS-6505**

### ALTERNATE CONSTRUCTION METHOD

CONCRETE FILLED SONO-TUBE FOOTING MAY BE USED TO SUPPORT GAS METER HEADER CONFIGURATIONS REQUIRING ONE (1) PIPE SUPPORT

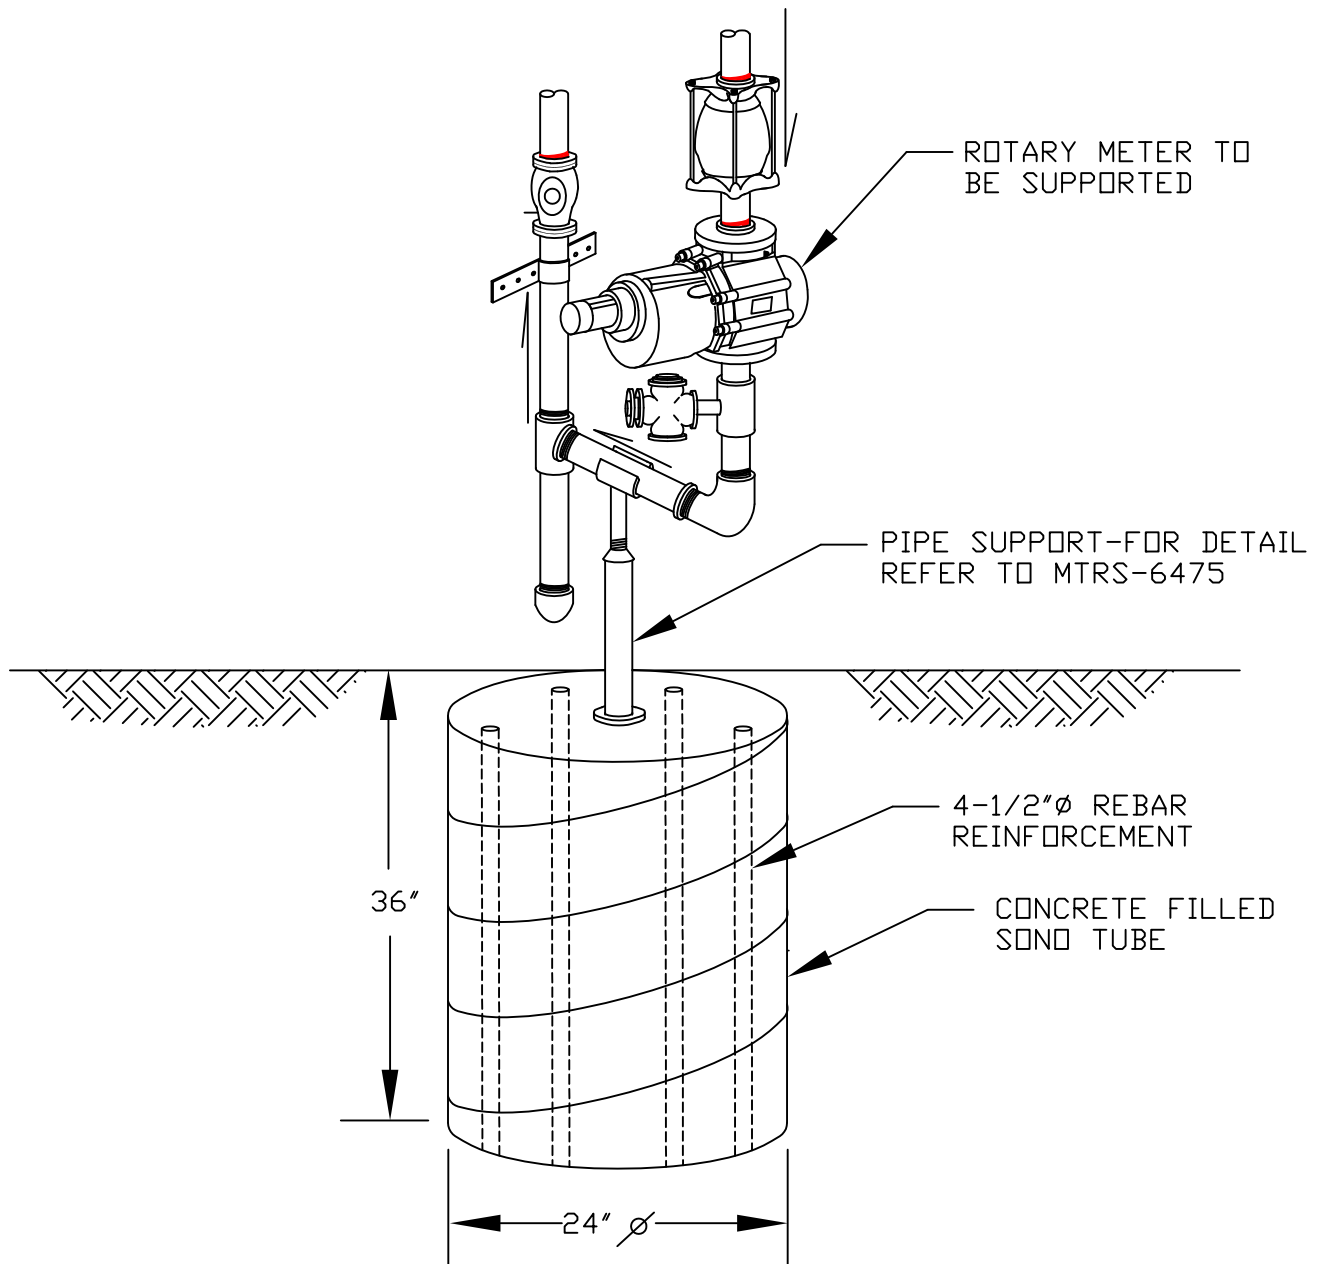

NOTE: THIS APPLICATION REQUIRES 10 BAGS OF CONCRETE MIX.  
(1 BAG = 1 CU. FT. = 60 LB.)


## REMOTE WALL FOR SUPPORT OF ROTARY AND MULTI METER HEADERS

### FRONT VIEW


KED DOES NOT ACCEPT LIABILITY FOR THE CONSTRUCTION OF THE WALL BUILT BY THE CUSTOMER.

### NOTES:


1. REMOTE WALL AND SLAB TO BE CONSTRUCTED BY THE CUSTOMER.
2. WALL MAY BE CONSTRUCTED WITH EITHER CEMENT BLOCK OR POURED CONCRETE.
3. WALL IS USED FOR SUPPORT OF METER HEADER.
4. LENGTH OF WALL WILL VARY WITH SIZE OF HEADER, AND WILL BE SPECIFIED BY CONSTRUCTION LEAD PERSON.

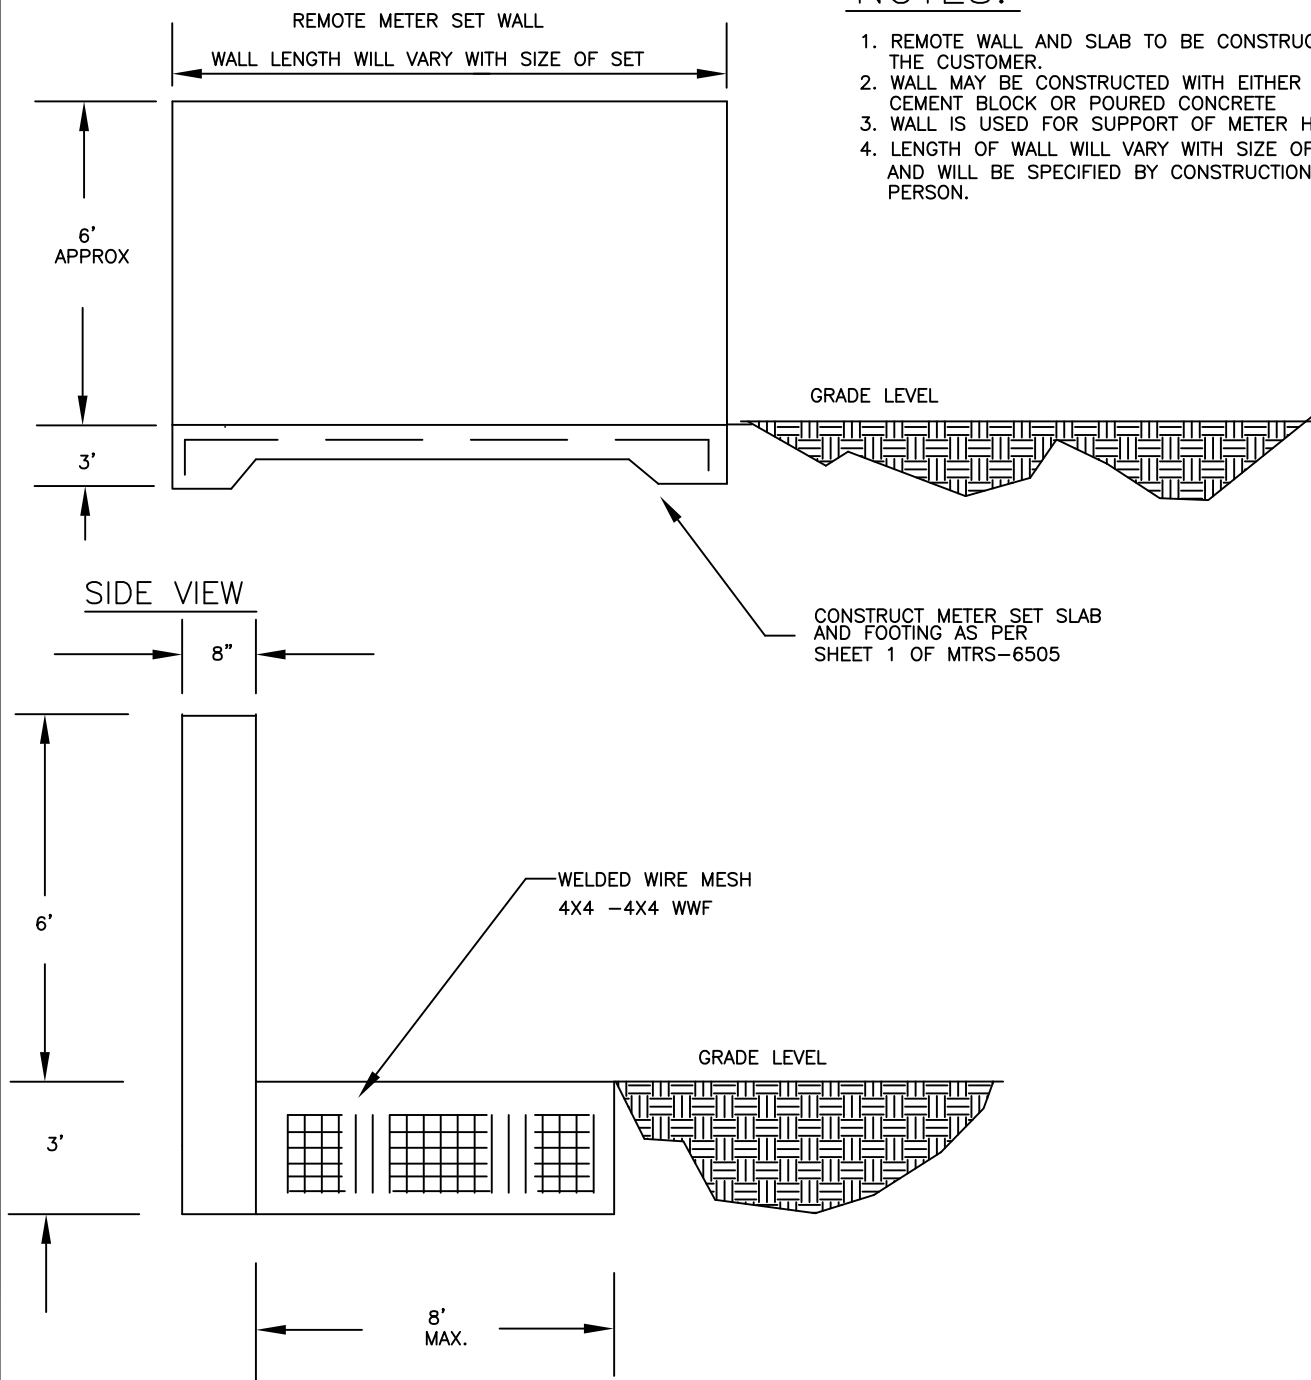


**TOP VIEW**  
(SHOWN WITH DOOR OPEN)

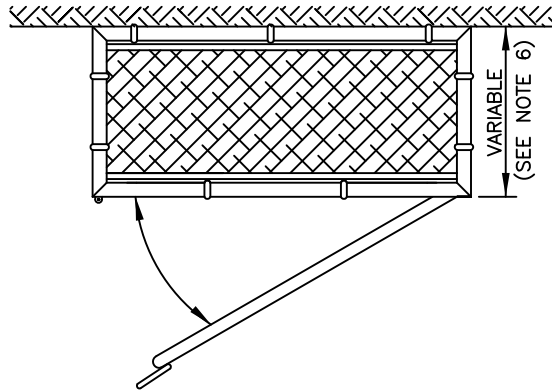


**FRONT VIEW**  
(SINGLE DOOR ARRANGEMENT)

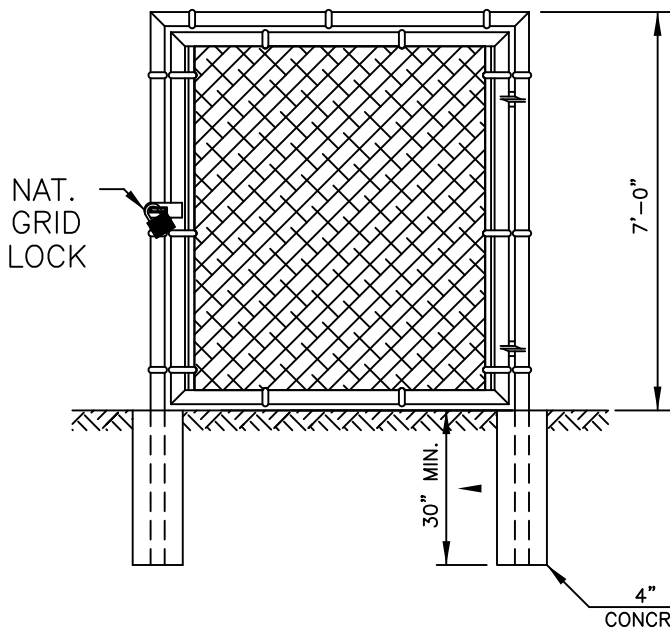

**TOP VIEW**  
(SHOWN WITH DOORS OPEN)

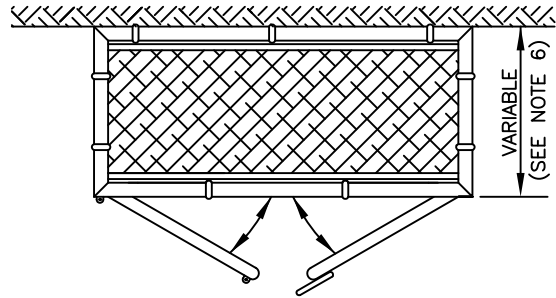

**FRONT VIEW**  
(DUAL DOOR ARRANGEMENT)

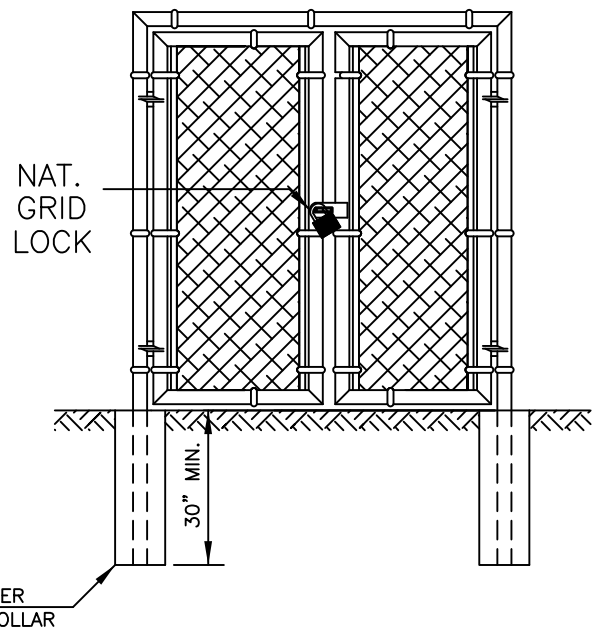

**NOTES:**

1. ENCLOSURES SHOULD BE INSTALLED AT ANY LOCATION WHERE THE POSSIBILITY OF TAMPERING OR VANDALISM EXISTS, SUCH AS IN SCHOOL YARDS.
2. FRAMES AND DOORS MAY BE CONSTRUCTED USING EITHER WELDED OR SCREWED PIPE (1" MINIMUM). IF BLACK PIPE IS USED, PRIME WITH RED LEAD AND COVER WITH GRAY PAINT.
3. FRAMES AND DOOR(S) SHALL BE COVERED WITH CHAIN LINK FENCING, GALVANIZED, NO. 9 WOVEN WIRE, MESH OPENING NOT GREATER THAN 2".
4. NATIONAL GRID TO REVIEW PLAN PRIOR TO CONSTRUCTION OF ENCLOSURE.
5. CUSTOMER WILL INSTALL ENCLOSURE AS DIRECTED BY NATIONAL GRID.
6. THE FENCE SHALL BE 2'-0" ± CLEARANCE ALL AROUND AND 7'-0" HIGH, WITH A FOUR FOOT STANDARD GATE AND APPROPRIATE LOCKING HARDWARE. A PADLOCK WILL BE FURNISHED BY NATIONAL GRID (ITEM ID 136512).

**nationalgrid**

LONG ISLAND

**ABOVE GRADE ENCLOSURE FOR  
METER AND REGULATOR INSTALLATIONS  
TYPICAL PROVISIONS**

**REVISIONS:** REDRAWN AND REPLACES 14950

DATE: 07/01/2003

DESIGN: MLoP

DRAWN: MLoP


EFFECTIVE DATE: 07/01/2003


STD. DWG.


NO. **MTRS-6525**

## GENERAL NOTES

- A. THESE GENERAL NOTES APPLY TO ALL ROTARY GAS METER CONSTRUCTION STANDARDS.
- B. FOR TYPICAL L.P BOOSTER LAYOUT BY THE CUSTOMER, SEE MTRS-6535-LI.
- C. FLOW DIRECTION OF FILTER, REGULATOR AND METER SHALL BE IN ACCORDANCE WITH ARROW INDICATOR ON BODY PARTS.
- D. BYPASS VALVE SHALL BE CLOSED AND LOCKED BY NATIONAL GRID.
- E. RISER PIPE SHALL BE COVERED OR IN CONTACT WITH CONCRETE.
- F. PIPING TO SCHOOL BLDG. MUST COMPLY WITH THE CODE REQUIREMENT OF THE "NEW YORK STATE MANUAL OF PLANNING STANDARDS FOR SCHOOL BUILDINGS". WHICH STATES THAT WELDED CONSTRUCTION IS REQUIRED FOR PIPE SIZES 3" IN DIAMETER AND OVER. SECTION 709-F-1.
- G. CONTRACTOR SHALL INSTALL VENT PIPING WHEN SPECIFIED. THE SIZE AND LOCATION TO BE DETERMINED BY NATIONAL GRID. SEE 020013-CS.
- H. UNLESS OTHERWISE SPECIFIED, ALL PIPING MUST BE IN COMPLIANCE WITH NFPA-54 AND NATIONAL GRID SPECIFICATIONS AND REQUIREMENTS FOR GAS INSTALLATIONS. WELDED CONSTRUCTION IS REQUIRED AS PER NFPA SEC. 2.6.8 d1.
- I. A SINGLE REGULATOR AND ASSOCIATED PIPING INSTALLATION IS MOST ACCEPTABLE, AND, PARALLEL REGULATORS ARE INSTALLED ONLY WHEN CONTINUITY OF SUPPLY TO THE CUSTOMER IS A PRIORITY. NATIONAL GRID MUST AGREE ON FINAL DESIGN.
- J. WHERE SOIL IS OR WILL BE DISTURBED, A CONCRETE SLAB (FOUNDATION) FOR FOOTING SHALL BE USED AND PROVIDED BY THE CUSTOMER. SIZE AND LOCATION WILL BE AGREED UPON BY NATIONAL GRID. (USE THE MINIMUM ACCEPTABLE SIZE) SEE MTRS-6505-LI.
- K. ALL UNCOATED WELDED PIPING ON METER HEADERS SHALL BE PRIMED WITH A RUST INHIBITING PRIMER, AND PAINTED WITH AN OIL BASED, ALKYD RUSTOLEUM PRODUCT, OR EQUAL. FOR METER SETS WHICH USE GALVANIZED SCREWED PIPING, PAINTING IS NOT REQUIRED. ALL UNPAINTED METER HEADERS 2" AND ABOVE INSTALLED BY NATIONAL GRID SHALL BE COATED PER 030030-TI.
- L. THE GAS SERVICE LOCATION TAG SHALL BE INSTALLED PER SERV-6305-LI
- M. ALL FITTING AND MATERIALS, LOCATED DOWNSTREAM OF THE METER SHALL BE DESIGNED AND RATED FOR NATURAL GAS. THIS INCLUDES BUT IS NOT LIMITED TO VALVES, COUPLINGS AND APPLIANCES.
- N. A METER BYPASS SHOULD BE INSTALLED IN ACCORDANCE WITH THE METERING STANDARD DRAWING AND WHERE IT WOULD BE DIFFICULT OR COSTLY TO INTERRUPT SERVICE TO THE CUSTOMER.
- O. AFTER PURGING THE SERVICE, AND BEFORE INSTALLING THE METER, THE LOCKWING METER VALVE ON THE RISER PIPE, AND ON THE BYPASS, SHALL BE LOCKED BY NATIONAL GRID
- P. SERVICE RISER, METER HEADER AND METER SHALL BE LOCATED TO PREVENT DAMAGE CAUSED BY VEHICLES AND MECHANICAL EQUIPMENT. PROTECTION SHALL BE INSTALLED IN ACCORDANCE WITH MTRS-6060-LI.
- Q. THE METER SHALL BE PLUMB AND LEVEL
- R. ALL EXPOSED THREADED PIPING AND FITTINGS SHALL BE GALVANIZED.
- S. ALL PIPING, FITTING, ETC. SHALL BE THOROUGHLY CLEANED OF ALL FOREIGN MATTER BEFORE BEING INSTALLED.
- T. PIPE STRAPS OR HANGERS ARE TO BE USED FOR SUPPORT. THE PLACEMENT OF THE SUPPORT DEPENDS ON THE CONFIGURATION OF THE METER SET AND CUSTOMER'S HOUSE LINE.
- U. THE METER VALVES SHOULD FACE FORWARD FROM THE WALL FOR EASY ACCESSIBILITY.
- V. NO CLOSE (FULLY THREADED) NIPPLES SHALL BE INSTALLED ON METER SETS.
- W. REGULATOR AND METER CAN BE ROTATED TO FIT FIELD CONDITIONS. IF NECESSARY, SWING REGULATOR OR METER TO OBTAIN CLEARANCE.
- X. THESE STANDARDS REFLECT THREADED PIPING FOR SYSTEMS THAT OPERATE AT ½ PSIG OR LESS AND HAVE 4" DIAMETER OR SMALLER PIPING. FOR HIGHER PRESSURE AND OR LARGER DIAMETER PIPE, THE STANDARD REFLECTS USE OF WELDED CONSTRUCTION. THIS IS IN ACCORDANCE WITH THE NATIONAL FUEL GAS CODE..
- Y. THE INSULATED FLANGE KIT SHALL BE INSTALLED AT THE SAME TIME THAT THE SERVICE LINE VALVE IS INSTALLED.
- Z. NATIONAL GRID WILL SUPPLY ONLY THE NUMBER OF PIPE SUPPORTS LISTED ON THE BILL OF MATERIAL IN THE APPLICABLE METERING STANDARD. FOR INSTALLATION BY THE CUSTOMER OR HIS CONTRACTOR DETAILS OF THE PIPE SUPPORT ARE PROVIDED IN MTRS-6475-LI

 LONG ISLAND	<b>GENERAL NOTES FOR ROTARY GAS METERS</b>	
REVISIONS:	DATE: 07/01/2003	EFFECTIVE DATE: 07/01/2003
	DESIGN: ML	STD. DWG.
	DRAWN: ML	No. <b>MTRS-6545</b>

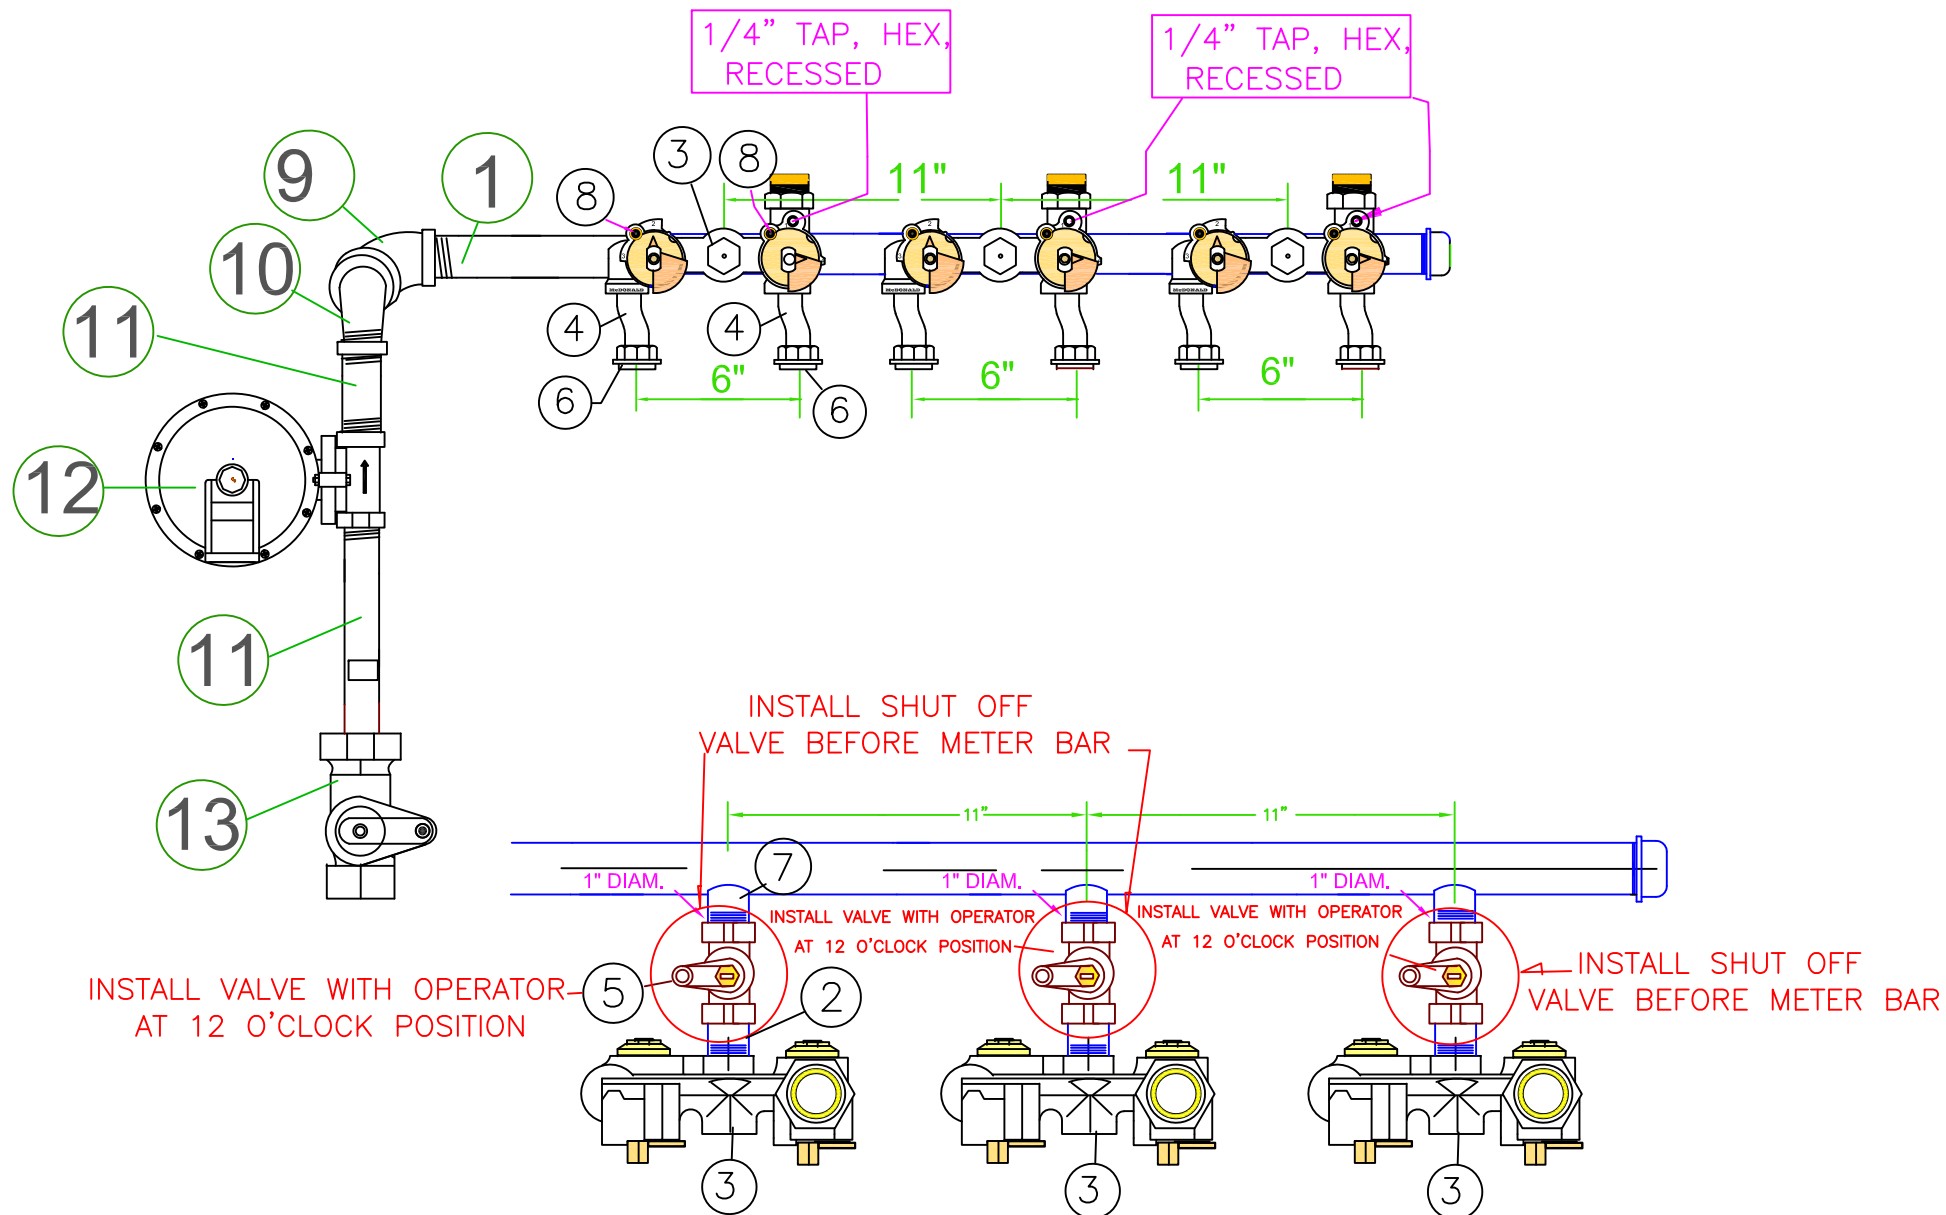

	<b>TYPICAL MANIFOLD 250 METER SET WITH REAR ENTRY BYPASS METER BAR - LOW PRESSURE</b>	
	DATE: 10/03/2023	EFFECTIVE DATE: 10/03/2023
	DESIGN: PAUL GUGLIOTTA	STD. DWG. NO. <b>MTRS-6627</b>




**NOTES:**

1. BYPASS METER BARS SHALL HAVE 1" SHUTOFF BEFORE THEM.
2. STAINLESS STEEL BULLET LOCKS ARE PREFERRED

ITEM	DESCRIPTION	SIZE	ITEM ID
1	MANIFOLD, SCHEDULE 40, API 5L GRADE B, CARBON STEEL,		
2	NIPPLE 1" X 3"LONG SCH 40 GALVANIZED	1"X3"	9340641
3	METER BAR WITH BYPASS, AY MCDONALD – 1" INLET X1" OUTLET X 1" METER CONNECTIONS, REAR ENTRY WITH BYPASS AND TOP OUTLET, ¼" RECESSED HEX HEAD PLUG, INSULATED UNION OUTLET WITH FLAT WASHER <b>GALVANIZED</b> MODEL AY MCDONALD 6312-GFFD-1X1X1	1" X 1" X 1"	9394905
4	SWIVEL 1" X 20LT GALVANIZED	1X20LT	9342451
5	LOCK WING METER VALVE 1" GALVANIZED	1"	9323164
6	NUT 20 LT GALVANIZED	20 LT	9340787
7	NIPPLE, <b>SCHEDULE 80</b> , API-5L, GRADE B, CARBON STEEL, 1" DIAM. X 2" LONG, MALE THREADS ONE END.	1"	---
8	LOCKS – BULLET #6	-	9330890
9	ELBOW – GALVANIZED 90 DEGREE SIZE - AS REQUIRED		
10	STREET ELBOW – GALVANIZED SIZE - AS REQUIRED		
11	NIPPLE – SIZE - AS REQUIRED		
12	REGULATOR – SIZE - AS REQUIRED		
13	SHUT OFF VALVE - SIZE - AS REQUIRED		
No.	ITEM	NGG CODE No.	

**BILL OF MATERIAL**

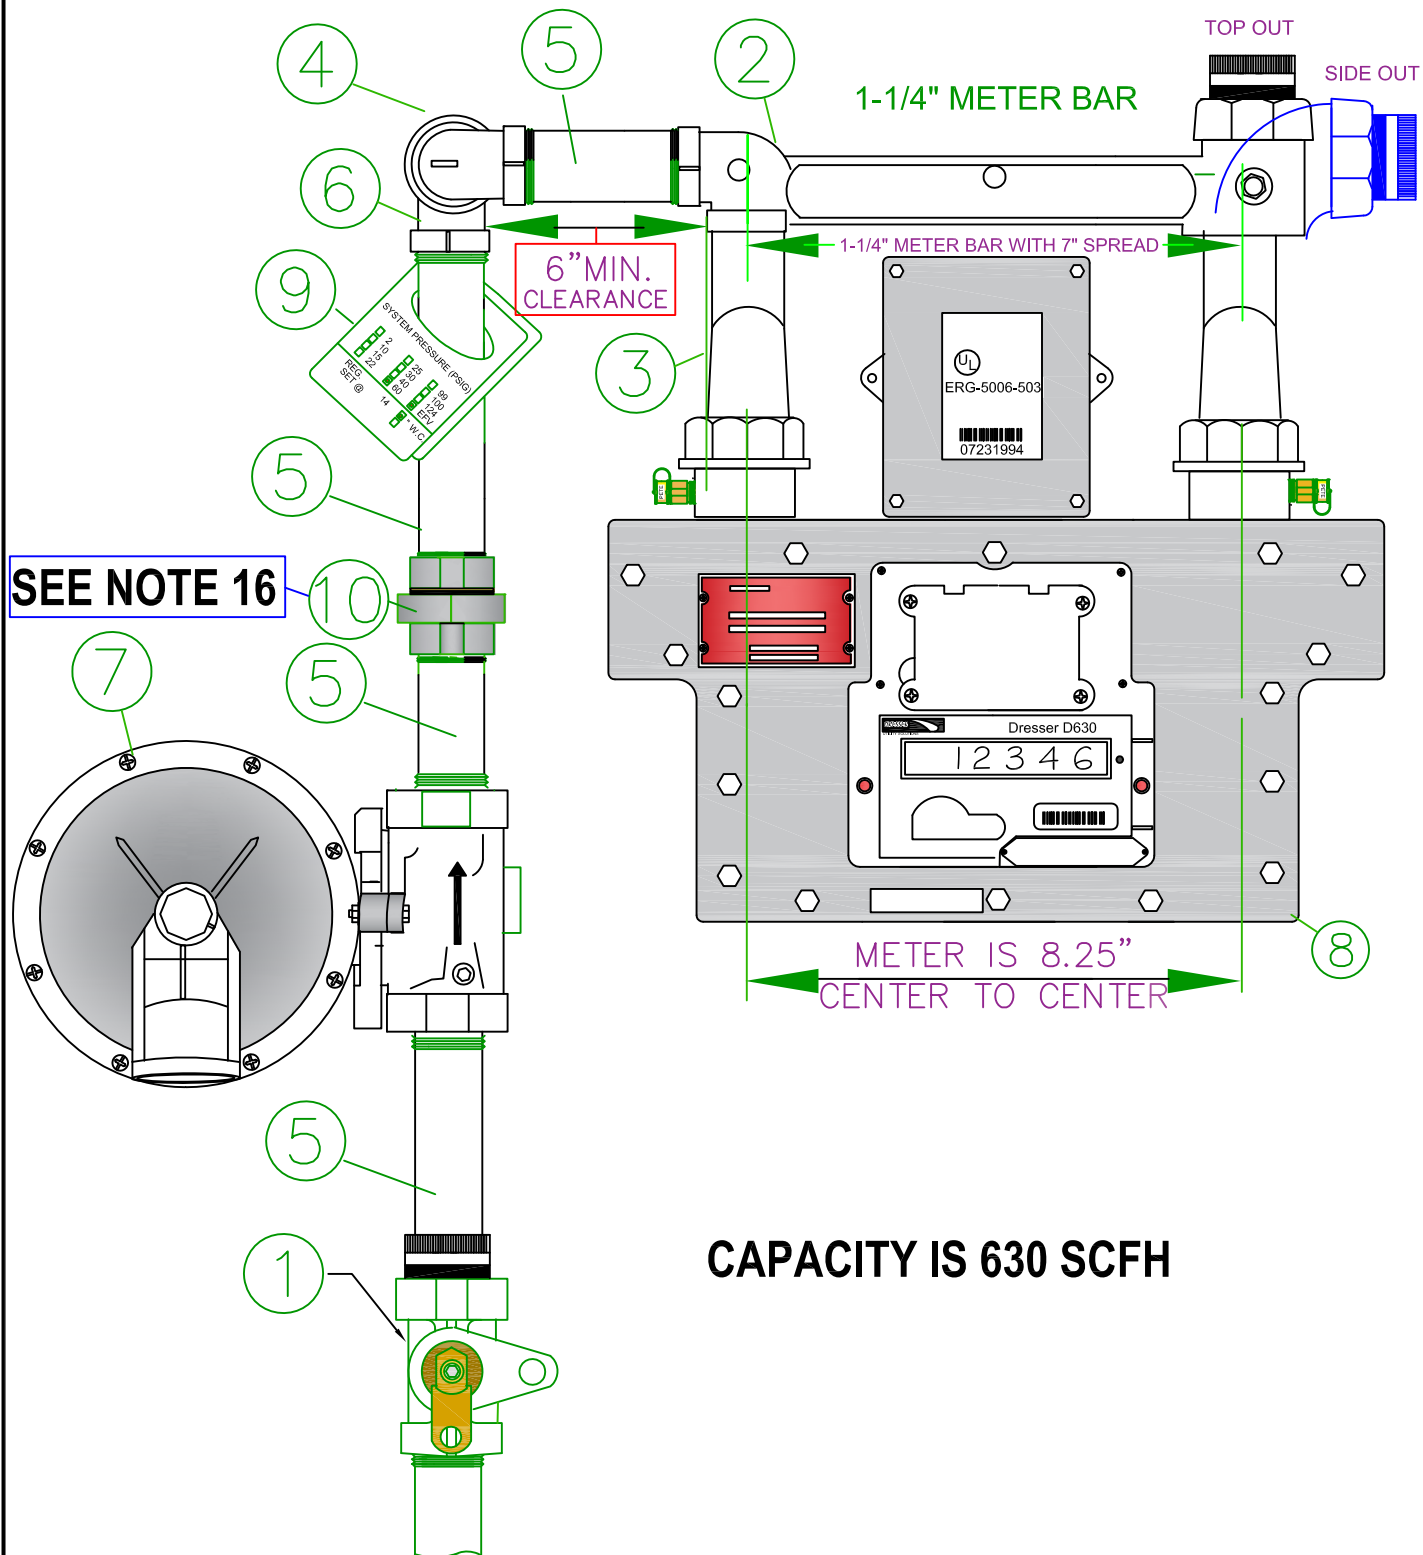

**nationalgrid**

L.I., MASS., N.Y.C.

## DRESSER ROTARY D630 METERS OUTSET SET INSTALLATIONS

**REVISIONS:** REVISED NOTE 16

DATE: 02/15/2024

EFFECTIVE DATE: 07/10/2024

DESIGN: PAUL GUGLIOTTA

STD. DWG.

DRAWN: PAUL GUGLIOTTA


NO.

**MTRS-6628**

**NOTES:**

1. THE DRESSER D-630 METER HAS A 8.25" SPREAD. **NOTE: IN MASSACHUSETTS THE DRESSER 630 METERS HAVE 30 LT CONNECTIONS. IN NYC/LI, MOST 630 METERS HAVE 45 LT CONNECTIONS, HOWEVER, SOME 30 LT METERS ARE IN THE SYSTEM**
2. WHEN UPGRADING FROM A 250 METER WITH 6" SPREAD, THE METER BAR NEEDS TO BE CHANGED TO AN 1-1/4" METER BAR WITH 8.25" SPREAD. RE-WORK TO TIE INTO THE CUSTOMER'S HOUSELINE IS REQUIRED ON UPGRADES.
3. REFER TO [CMS03002](#) FOR METER SIZING AND SYSTEM PRESSURE TAG.
4. AFTER PURGING THE SERVICE AND BEFORE INSTALLING THE METER, THE LOCK WING METER VALVE (ITEM 1) SHALL BE LOCKED WITH A GAS SNAP LOCK.
5. THE PIPING SHALL BE SIZED SO THAT THE TOP OF THE METER IS NOT OVER 6 FEET ABOVE THE FLOOR. THE BOTTOM OF THE METER SHOULD NOT BE LESS THAN 6 INCHES FROM THE FLOOR/GROUND.
6. FOR METER PROTECTION SEE [MTRS-6060](#).
7. METER AND REGULATOR SHALL BE PROTECTED FROM DAMAGE DURING THE SERVICE PRESSURE TEST.
8. AT 630 SCFH, THE PRESSURE DROP ACROSS THE METER IS .5" W.C.
9. REGULATOR VENT MUST FACE DOWN AND BE EQUIPPED WITH A RAIN AND INSECT RESISTANT SCREEN. FOR NEW CONSTRUCTION OR ALTERATIONS SEE 020013-CS VENT PIPING LOCATION. IT IS PREFERRED THAT REGULATOR VENTS BE INSTALLED AT A HEIGHT 18 INCHES ABOVE GRADE, HOWEVER, THE MINIMUM ALLOWABLE VENT HEIGHT SHALL BE 12 INCHES ABOVE FINAL GRADE. IN CASES OF KNOWN FLOOD LOCATIONS, THE PREFERRED REGULATOR VENT HEIGHT ABOVE THE FLOOD HEIGHT IS 18" (12" MINIMUM). THE REGULATOR VENT SHALL BE 18" (WHERE PRACTICAL) FROM ANY OPENING WHICH COULD ALLOW VENTED GAS TO ENTER.
10. SERVICE VALVE MUST BE PAINTED RED (**IN NEW YORK CITY ONLY**).
11. IF USING A 2" SERVICE OR A 2" REGULATOR, REDUCE TO 1-1/4" AFTER THE REGULATOR.
12. COAT ALL OUTDOOR BLACK PIPE PER CORROSION COATING GUIDE [030031-CS](#).
13. THIS IS A ROTARY METER; HOWEVER, IT DOES NOT REQUIRE OIL TO BE ADDED TO IT.
14. THIS METER IS TEMPERATURE CORRECTED. IT IS NOT PRESSURE CORRECTED METER. IF RUNNING AT PRESSURES GREATER THAN 7" W.C. IT MUST BE SET UP AS A FIXED FACTOR INSTALLATION. CONSULT [CMS03002](#) AND ELEVATED PRESSURE METERING POLICY [CMS04005-MA \(MASS.\)](#), [CMS04006 \(UNY\)](#), [CMS04007 \(L.I.\)](#), [CMS04008 \(NYC\)](#)
15. THIS METER HAS NO MEANS OF DOING A DIAL TEST. HOUSE LINE PRESSURE TEST MUST USE A MANOMETER OR GAUGE ON THE PETE'S PLUG ON THE METER.
16. UNION IS OPTIONAL FOR PLASTIC SERVICES. INSULATING UNION IS REQUIRED ON ALL STEEL SERVICES. UNION IS NOT NEEDED IF THE RISER VALVE HAS A UNION OUTLET.

ITEM	DESCRIPTION	ITEM ID	QTY
10	UNION – 1-1/4" INSULATED M.I. 150# CLASS BLACK (MASS. AND NEW YORK CITY) UNION – 1-1/4" INSULATED M.I. 150# CLASS GALVANIZED (LONG ISLAND) UNION – 1" INSULATING (IF REQUIRED AND USING 1" RISER)	9307643 9341691 9307643	1
9	SYSTEM PRESSURE TAG (ALL REGIONS) CPR TAG	9346233 9340255	1 1
8	METER - DRESSER D630	METER SHOP	1
7	REGULATORS MOST COMMONLY USED - OTHER REGULATORS MAY BE USED – CHECK WITH ENGINEERING REGULATOR 1" 3/16" ORIFICE – SET AT 7" 7.C. (60 PSIG MAX) MASS ONLY REGULATOR 1-1/4" 1/4" ORIFICE –SET AT 7" W.C., 1" VENT POSITION 5 (USE FOR 15 PSIG SYSTEMS) 830 SFCH MAX NYC REGULATOR 1-1/4" 3/16" ORIFICE –SET AT 7" W.C., 1" VENT POSITION 5 (USE FOR 30-60 PSIG SYSTEMS) LI/NYC ONLY REGULATOR 1-1/4" 1/8" ORIFICE –SET AT 7" W.C., 1" VENT POSITION 5 (USE FOR 99/124 PSIG SYSTEMS) LI/NYC ONLY REGULATOR 1-1/4" B31-IMR ITRON/DRESSER 3/16" ORIFICE –SET AT 7" W.C. MASS ONLY 60 PSIG MAX REGULATOR 1-1/4" B31-R ITRON/DRESSER 1/2" ORIFICE –SET AT 7" W.C. MASS ONLY 2 PSIG MAX REGULATOR 1-1/2" FISHER CS-400IR WITH 3/8" ORIFICE (USE FOR 15 PSIG SYSTEMS) LI/NYC ONLY REGULATOR 2" FISHER CS-400IR WITH 7/32"X1/4" ORIFICE (USE FOR 60 PSIG SYSTEMS) REDUCER REQ'D ALL REGIONS REGULATOR 2" FISHER CS-400IR WITH 11/64" ORIFICE (USE FOR 99/124 PSIG SYSTEMS) REDUCER REQ'D LI ONLY	9307967 9342623 9342206 9383127 9383860 9323251 9388986 9388985 9388995	1
6	ELBOW 1-1/4" 90 DEGREE – BLACK MI – THREADED (NEW YORK CITY) ELBOW 1-1/4" 90 DEGREE – GALVANIZED MI – THREADED (LONG ISLAND) IF USING 1" REGULATOR USE 1 "X 1-1/4" REDUCING ELBOW BLACK	9307799 9341182 9341229	1
5	NIPPLE, SCHEDULE 40, API-5L GRADE B, CARBON STEEL 1" OR 1-1/4" X LENGTH AS REQUIRED GALVANIZED IN LONG ISLAND/ BLACK IN NYC/MASS	A/R	4
4	STREET ELBOW 1-1/4" BLACK (NEW YORK CITY) STREET ELBOW 1-1/4" GALVANIZED (LONG ISLAND)	9307798 9341193	1
3	SWIVEL, 1-1/4" X 3-3/4" X 45 LT 1-5/8" OFFSET BLACK (NEW YORK CITY) NUT 45 LT – BLACK MI (NEW YORK CITY) SWIVEL, 1-1/4" X 3-3/4" X 45 LT 1-5/8" OFFSET GALVANIZED (LONG ISLAND) NUT 45 LT – GALVANIZED MI (LONG ISLAND) SWIVEL, 1-1/4" X 30 LT BLACK MASS ONLY NUT 30 LT BLACK MASS ONLY	9386167 9322652 9342425 9340788 9342456 9312381	2
2	METER BAR BLACK – INSULATED OUTLET 1-1/4" X 1-1/4" X 1-1/4" TOP OUT (MASS AND NEW YORK CITY) METER BAR GALVANIZED – INSULATED OUTLET 1-1/4" X 1-1/4" X 1-1/4" SIDE OUT (LONG ISLAND)	9311172 9383209	1
1	LOCK WING METER VALVE 1-1/4" BLACK (MASS AND NEW YORK CITY) LOCK WING METER VALVE 1-1/4" GALVANIZED IN LONG ISLAND LOCK WING METER VALVE 1" BLACK WITH OUTLET UNION MASS ONLY (FOR 1" RISERS) LOCK WING METER VALVE 1-1/4" BLACK WITHOUTLET UNION MASS ONLY (FOR 1-1/4" RISERS)	9308487 9339609 9393773 9314067	1
NO.	ITEM DRESSER D630 METER		
BILL OF MATERIAL			

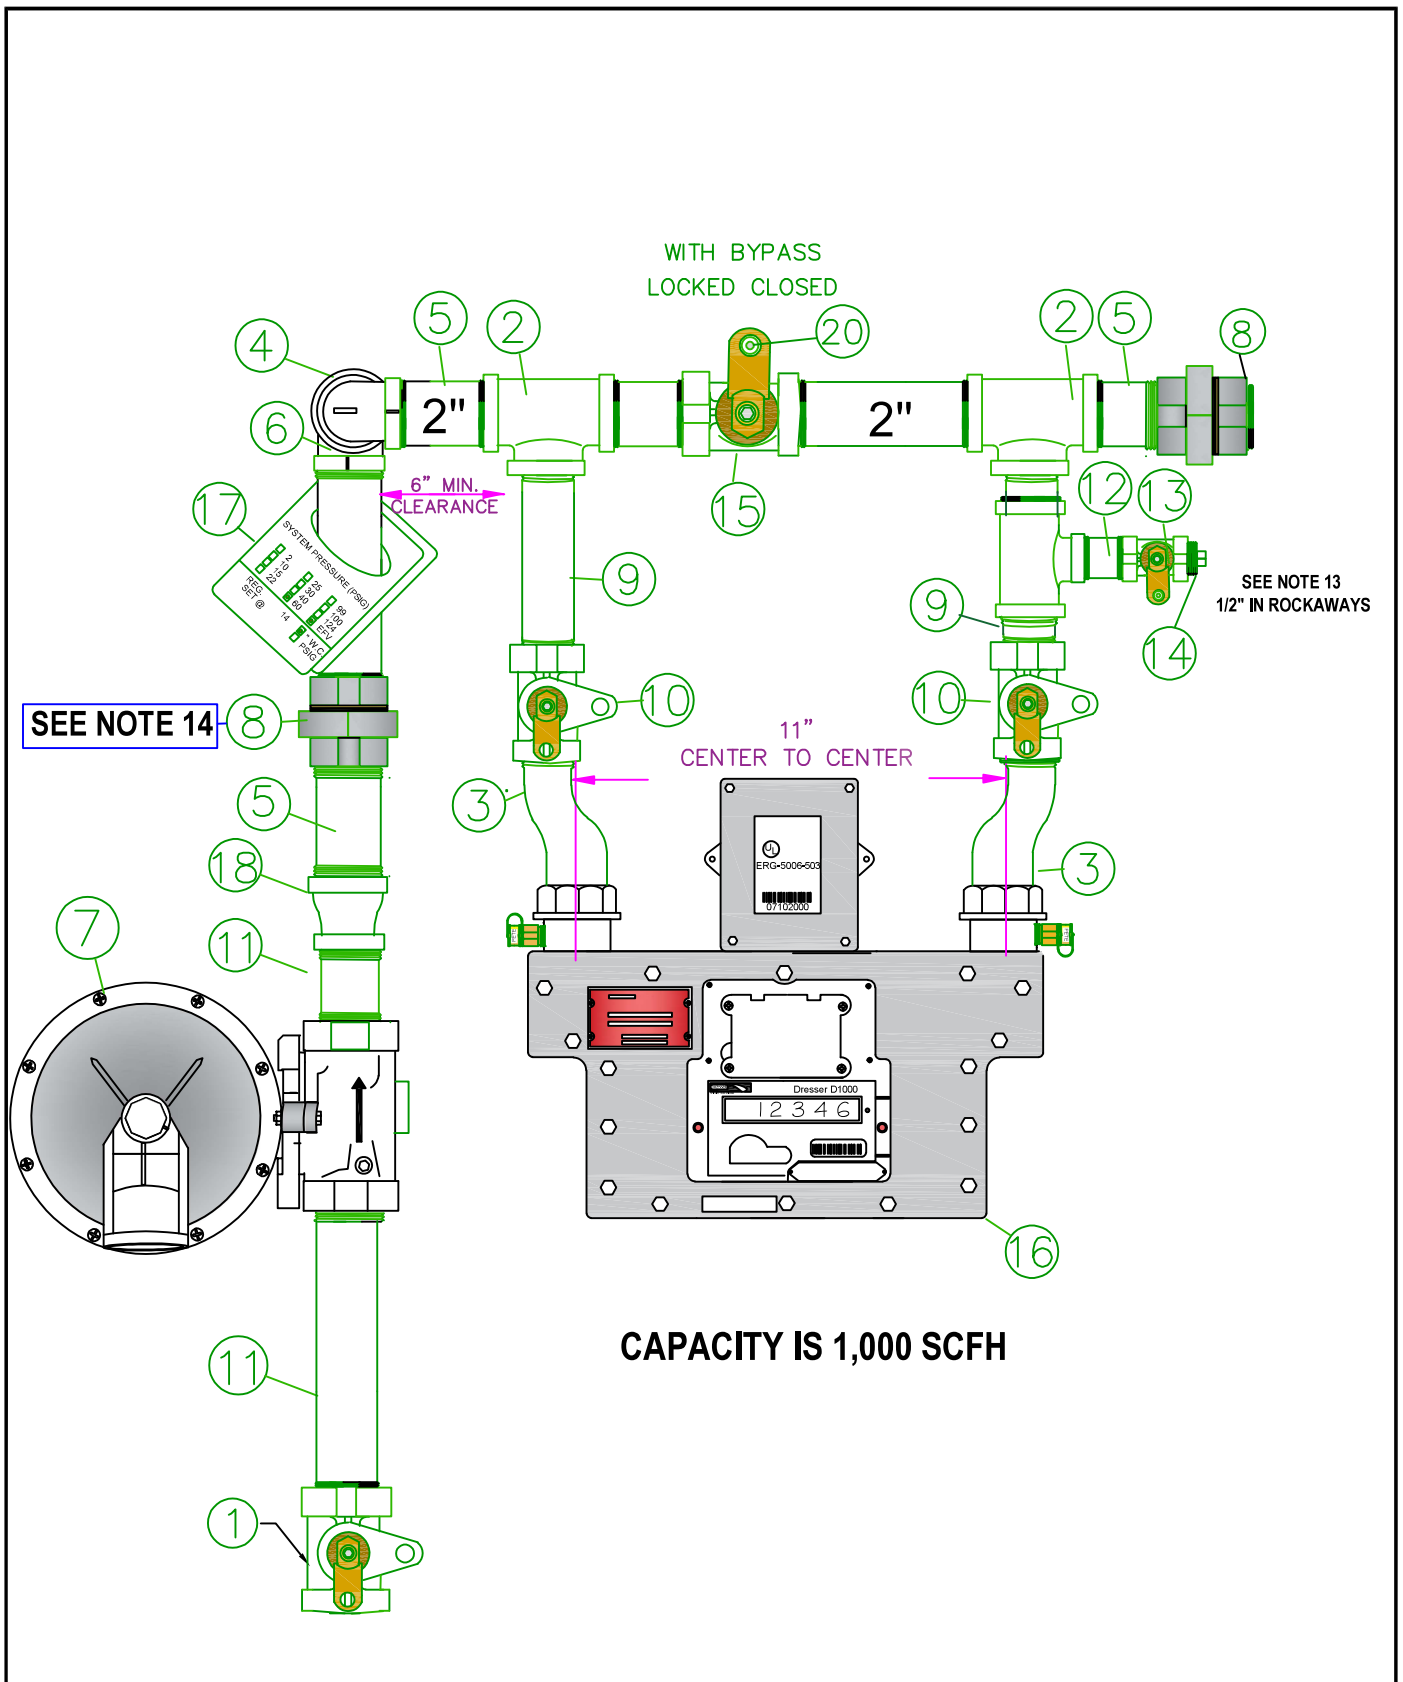

<p><b>nationalgrid</b></p> <p>LONG ISLAND</p>	<p><b>DRESSER ROTARY D1000 METERS WITH BYPASS FOR OUTDOOR INSTALLATIONS</b></p>	
<p><b>REVISIONS:</b> UPDATED LINKS</p>	<p>DATE: 02/15/2024</p>	<p>EFFECTIVE DATE: 05/28/2025</p>
	<p>DESIGN: PAUL GUGLIOTTA</p>	<p>STD. DWG.</p>
	<p>DRAWN: PAUL GUGLIOTTA</p>	<p>NO. <b>MTRS-6629</b></p>

**NOTES:**


**THIS STANDARD IS A FOR THE OUTDOOR D1000 METERS WITH A BYPASS. BYPASSES SHALL ONLY BE USED IN CONMMERCIAL AND INDUSTRIAL INSTALLATIONS.**

1. THE DRESSER D-1000 METER HAS A 11" SPREAD.
2. REFER TO [CMS03002](#) FOR METER SIZING AND SYSTEM PRESSURE TAG.
3. THE LOCK WING METER VALVE (ITEM 13) SHALL BE LOCKED CLOSED WITH A GAS SNAP LOCK.
4. THE PIPING SHALL BE SIZED SO THAT THE TOP OF THE METER IS NOT OVER 6' ABOVE THE FLOOR. THE BOTTOM OF THE METER SHOULD NOT BE LESS THAN 6" FROM THE FLOOR/GROUND.
5. FOR METER PROTECTION SEE [MTRS-6060](#).
6. METER AND REGULATOR SHALL BE PROTECTED FROM DAMAGE DURING THE SERVICE PRESSURE TEST.
7. AT 1000 SCFH, THE PRESSURE DROP ACROSS THE METER IS .5" W.C.
8. REGULATOR VENT MUST FACE DOWN AND BE EQUIPPED WITH A RAIN AND INSECT RESISTANT SCREEN. FOR NEW CONSTRUCTION OR ALTERATIONS SEE [020013-CS](#) VENT PIPING LOCATION. IT IS PREFERRED THAT REGULATOR VENTS BE INSTALLED AT A HEIGHT 18 INCHES ABOVE GRADE, HOWEVER, THE MINIMUM ALLOWABLE VENT HEIGHT SHALL BE 12 INCHES ABOVE FINAL GRADE. IN CASES OF KNOWN FLOOD LOCATIONS, THE PREFERRED REGULATOR VENT HEIGHT ABOVE THE FLOOD HEIGHT IS 18" (12" MINIMUM). THE REGULATOR VENT SHALL BE 18" (WHERE PRACTICAL) FROM ANY OPENING WHICH COULD ALLOW VENTED GAS TO ENTER.
9. COAT ALL OUTDOOR BLACK PIPE PER CORROSION COATING GUIDE [030031-CS](#).
10. THIS IS A ROTARY METER; HOWEVER, IT DOES NOT REQUIRE OIL TO BE ADDED TO IT.
11. THIS METET IS TEMPERATURE CORRECTED. IT IS NOT PRESSURE CORRECTED METER. IF RUNNING AT PRESSURES GREATER THAN 7" W.C. IT MUST BE SET UP AS A FIXED FACTOR INSTALLATION. CONSULT [CMS03002](#) AND ELEVATED PRESSURE METERING POLICY [CMS04005-MA \(MASS.\)](#), [CMS04006 \(UNY\)](#), [CMS04007 \(L.I.\)](#), [CMS04008 \(NYC\)](#)
12. THIS METER HAS NO MEANS OF DOING A DIAL TEST. HOUSE LINE PRESSURE TEST MUST USE A MANOMETER OR GAUGE ON THE PETE'S PLUG ON THE METER.
13. PURGE MUST BE 1/2" IN ROCKAWAYS AREA.
14. UNION IS OPTIONAL FOR PLASTIC SERVICES. INSULATING UNION IS REQUIRED ON ALL STEEL SERVICES. UNION IS NOT NEEDED IF THE RISER VALVE HAS A UNION OUTLET.

ITEM	DESCRIPTION	ITEM ID	QTY
20	LOCK	9386820	1
19A	TEE – REDUCUNG 1-1/4" X 3/4" THREADED <b>GALVANIZED</b>	9342373	
19B	TEE – REDUCUNG 1-1/4" X 1/2" THREADED <b>GALVANIZED</b> ROCKAWAYS (ALT USE USE 19A AND 3/4" X 1/2" BUSHING)	NON STOCK	
18	REDUCER (IF REQUIRED) REGULATOR SIZE X 2" <b>GALVANIZED</b>		1
17	SYSTEM PRESSURE TAG CPR TAG	9346233 9340255	1 1
16	METER DRESSER D1000 ROTARY TYPE WITH 45 LT CONNECTIONS	METER SHOP	1
15	VALVE – 2" LOCKWING <b>GALVANIZED</b>	9339610	1
14	PLUG – THREADED 3/4" BLACK MI PLUG – THREADED 1/2" BLACK MI <b>ROCKAWAYS</b>	9312288 9340911	1
13	VALVE – 3/4" LOCKWING LOCKED CLOSED <b>GALVANIZED</b> VALVE – 1/2" LOCKWING LOCKED CLOSED <b>GALVANIZED</b> <b>ROCKAWAYS</b>	9339593 NON STOCK	1
12	NIPPLE 3/4" X 3" <b>GALVANIZED</b> NIPPLE 1/2" X 3" <b>GALVANIZED</b> <b>ROCKAWAYS</b>	9340631 9340621	1
11	NIPPLE RISER SIZE X LENGTH AS REQUIRED <b>GALVANIZED</b>		2
10	VALVE 1-1/4" LOCK WING = <b>GALVANIZED</b>	9339609	1
9	NIPPLE, SCHEDULE 40, API-5L GRADE B, CARBON STEEL 1-1/4" X LENGTH AS REQUIRED <b>GALVANIZED</b>	A/R	2
8	UNION 2" THREADED <b>GALVANIZED</b> M.I.	9341692	2
7	<b>REGULATORS MOST COMMONLY USED - OTHER REGULATORS MAY BE USED – CHECK WITH ENGINEERING</b> <b>REGULATOR 1-1/4" 1/4" ORIFICE –SET AT 7" W.C., 1" VENT POSITION 5 (USE FOR 15 PSIG SYSTEMS) 830 SFCH MAX</b> <b>REGULATOR 1-1/4" 3/16" ORIFICE –SET AT 7" W.C., 1" VENT POSITION 5 (USE FOR 30-60 PSIG SYSTEMS)</b> <b>REGULATOR 1-1/4" 1/8" ORIFICE –SET AT 7" W.C., 1" VENT POSITION 5 (USE FOR 99/124 PSIG SYSTEMS)</b> <b>REGULATOR 1-1/2" FISHER CS-400IR WITH 3/8" ORIFICE (USE FOR 15 PSIG SYSTEMS)</b> <b>REGULATOR 2" FISHER CS-400IR WITH 7/32"X1/4" ORIFICE (USE FOR 60 PSIG SYSTEMS)</b> <b>REGULATOR 2" FISHER CS-400IR WITH 11/64" ORIFICE (USE FOR 99/124 PSIG SYSTEMS)</b>	9342623 9342206 9383127 9388986 9388985 9388995	1
6	ELBOW 2" 90 DEGREE – <b>GALVANIZED</b> M.I. – THREADED	9341183	1
5	NIPPLE 2" X LENGTH AS REQUIRED <b>GALVANIZED</b>	A/R	8
4	STREET ELBOW 2" <b>GALVANIZED</b>	9341194	1
3	SWIVEL, 1-1/4" X 3-3/4" X 45 LT 1-5/8" OFFSET <b>GALVANIZED</b> NUT 45 LT – <b>GALVANIZED</b> M..I	9342425 9340788	2
2	TEE- 2" x 2" x 1-1/4" THREADED M.I. <b>GALVANIZED</b>	9342375	2
1	RISER VALVE <b>GALVANIZED</b>	A/R	1

**NO. ITEM – D1000 WITH BYPASS**

**BILL OF MATERIAL**

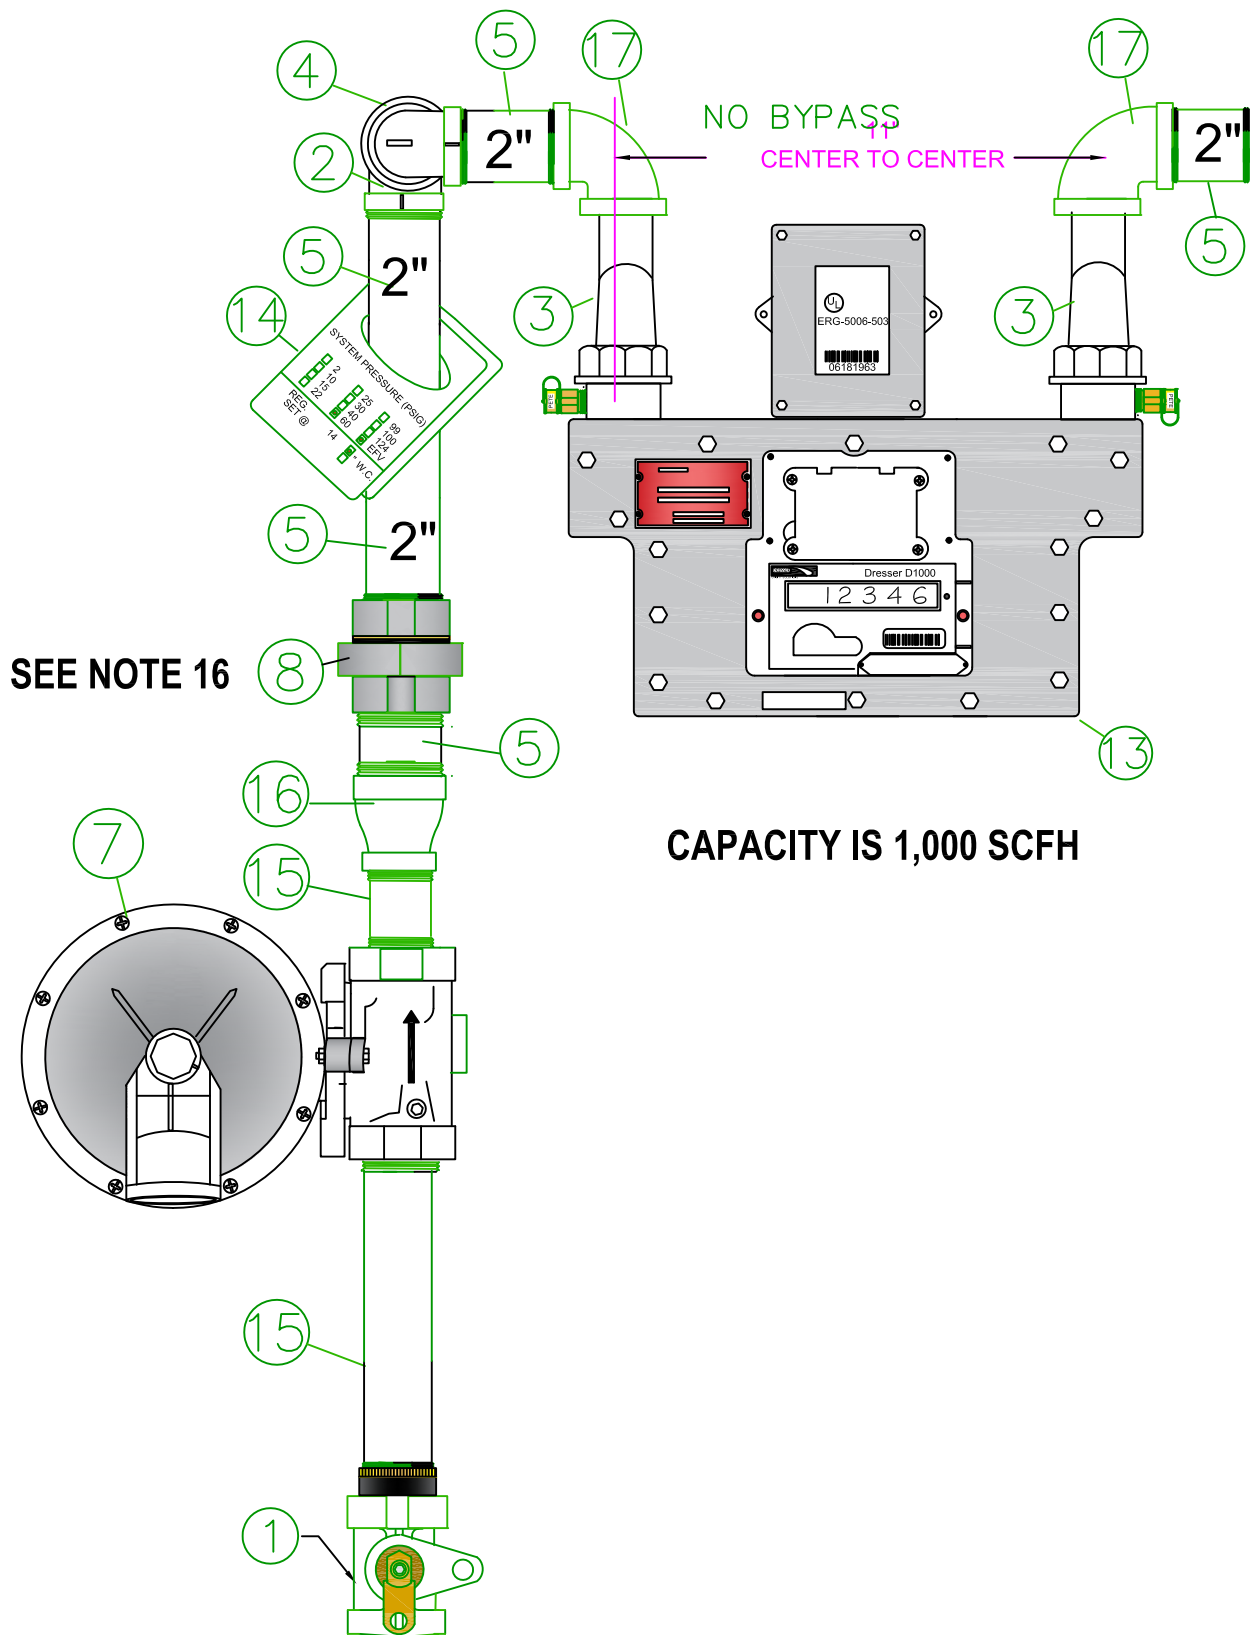

**nationalgrid**

LONG ISLAND, MASS. AND N.Y.C.

## DRESSER ROTARY D1000 METERS NO BYPASS

**REVISIONS:** REVISED PIPING LAYOUT AND NOTES

DATE: 02/15/2024

DESIGN: PAUL GUGLIOTTA

DRAWN: PAUL GUGLIOTTA

EFFECTIVE DATE: 03/15/2024

STD. DWG.

NO.


**MTRS-6630**

**NOTES:**


1. THE DRESSER D-1000 METER HAS A 11" SPREAD.
2. REFER TO [CMS03002](#) FOR METER SIZING AND SYSTEM PRESSURE TAG.
3. THE LOCK WING METER VALVE (ITEM 10) SHALL BE LOCKED CLOSED WITH A GAS SNAP LOCK.
4. THE PIPING SHALL BE SIZED SO THAT THE TOP OF THE METER IS NOT OVER 6' ABOVE THE FLOOR. THE BOTTOM OF THE METER SHOULD NOT BE LESS THAN 6" FROM THE FLOOR/GROUND.
5. FOR METER PROTECTION SEE [MTRS-6060](#).
6. METER AND REGULATOR SHALL BE PROTECTED FROM DAMAGE DURING THE SERVICE PRESSURE TEST.
7. AT 1000 SCFH, THE PRESSURE DROP ACROSS THE METER IS .5" W.C.
8. REGULATOR VENT MUST FACE DOWN AND BE EQUIPPED WITH A RAIN AND INSECT RESISTANT SCREEN. FOR NEW CONSTRUCTION OR ALTERATIONS SEE [020013-CS](#) VENT PIPING LOCATION. IT IS PREFERRED THAT REGULATOR VENTS BE INSTALLED AT A HEIGHT 18 INCHES ABOVE GRADE, HOWEVER, THE MINIMUM ALLOWABLE VENT HEIGHT SHALL BE 12 INCHES ABOVE FINAL GRADE. IN CASES OF KNOWN FLOOD LOCATIONS, THE PREFERRED REGULATOR VENT HEIGHT ABOVE THE FLOOD HEIGHT IS 18" (12" MINIMUM). THE REGULATOR VENT SHALL BE 18" (WHERE PRACTICAL) FROM ANY OPENING WHICH COULD ALLOW VENTED GAS TO ENTER.
9. SERVICE VALVE MUST BE PAINTED RED (IN NEW YORK CITY ONLY).
10. 2" PIPING IS STRONGLY RECOMMENDED FOR FLOWS APPROACHING 1000 SCFH.
11. THIS PIPING LAYOUT ON PAGE 1 IS A GENERAL INSTALLATION GUIDELINE. ALTERNATE PIPING CONFIGURATIONS MAY BE CONSIDERED IF APPROVED BY CMS AND ENGINEERING.
12. COAT ALL OUTDOOR BLACK PIPE PER CORROSION COATING GUIDE [030031-CS](#).
13. THIS IS A ROTARY METER; HOWEVER, IT DOES NOT REQUIRE OIL TO BE ADDED TO IT.
14. THIS METET IS TEMPERATURE CORRECTED. IT IS NOT PRESSURE CORRECTED METER. IF RUNNING AT PRESSURES GREATER THAN 7" W.C. IT MUST BE SET UP AS A FIXED FACTOR INSTALLATION. CONSULT [CMS03002](#) AND ELEVATED PRESSURE METERING POLICY [CMS04005-MA \(MASS.\)](#), [CMS04006 \(UNY\)](#), [CMS04007 \(L.I.\)](#), [CMS04008 \(NYC\)](#)
15. THIS METER HAS NO MEANS OF DOING A DIAL TEST. HOUSE LINE PRESSURE TEST MUST USE A MANOMETER OR GAUGE ON THE PETE'S PLUG ON THE METER.
16. UNION REQUIRED FOR REGULATOR REMOVAL. IT IS NOT NEEDED IF USING A UNION ON THE RISER VALVE.

ITEM	DESCRIPTION	ITEM ID	QTY
17	ELBOW – REDUCING 2" X 1-1/4" M.I. 90 DEGREES M.I. BLACK (MASS. AND NEW YORK CITY)	9306531	2
	ELBOW – REDUCING 2" X 1-1/4" M.I. 90 DEGREES M.I. GALVANIZED (LONG ISLAND)	9341201	2
16	REDUCER (IF REQUIRED) REGULATOR SIZE X 2"		1
15	NIPPLE DETERMINED BY RISER SIZE		2
14	SYSTEM PRESSURE TAG (ALL REGIONS)	9346233	1
	CPR TAG (LONG IALND ONLY)	9340255	1
13	METER DRESSER D1000 ROTARY TYPE WITH 45 LT CONNECTIONS	METER SHOP	1
12	PLUG – THREADED ¾" BLACK MI (ALL REGIONS)	9312288	1
11	VALVE – 2" LOCKWING BLACK (MASS. AND NEW YORK CITY)	9312254	1
	VALVE – 2" LOCKWING GALVANIZED (LONG ISLAND)	9339610	
10	VALVE – ¾" LOCKWING LOCKED CLOSED BLACK (MASS. AND NEW YORK CITY)	9312257	1
	VALVE – ¾" LOCKWING LOCKED CLOSED GALVANIZED (LONG ISLAND)	9339593	
9	NIPPLE ¾" X 3" BLACK MI (MASS. AND NEW YORK CITY)	9315390	1
	NIPPLE ¾" X 3" GALVANIZED (LONG ISLAND)	9340631	
8	UNION 2" INSULATING THREADED BLACK MI (MASS. AND NEW YORK CITY)	9315856	1
	UNION 2" INSULATING THREADED M.I. GALVANIZED (LONG ISLAND)	9341692	
7	REGULATORS MOST COMMONLY USED - OTHER REGULATORS MAY BE USED – CHECK WITH ENGINEERING REGULATOR 1" 3/16" ORIFICE – SET AT 7" W.C. (60 PSIG MAX) (MASS ONLY) REGULATOR 1-1/4" 1/4" ORIFICE –SET AT 7" W.C., 1" VENT POSITION 5 (USE FOR 15 PSIG SYSTEMS) 830 SFCH MAX LI/NYC ONLY REGULATOR 1-1/4" 3/16" ORIFICE –SET AT 7" W.C., 1" VENT POSITION 5 (USE FOR 30-60 PSIG SYSTEMS) LI/NYC ONLY REGULATOR 1-1/4" 1/8" ORIFICE –SET AT 7" W.C., 1" VENT POSITION 5 (USE FOR 99/124 PSIG SYSTEMS) LI/NYC ONLY REGULATOR 1-1/4" B31IMR 3/16" ORIFICE SET AT " W.C. 60 PSIG MAX. (MASS ONLY) REGULATOR 1-1/2" FISHER CS-400IR WITH 3/8" ORIFICE (USE FOR 15 PSIG SYSTEMS) LI/NYC ONLY REGULATOR 2" FISHER CS-400IR WITH 7/32"X1/4" ORIFICE (USE FOR 60 PSIG SYSTEMS) ALL REGIONS REGULATOR 2" FISHER CS-400IR WITH 11/64" ORIFICE (USE FOR 99/124 PSIG SYSTEMS) LI/NYC ONLY	9307967 9342623  9342206 9383127 9384860 9388986 9388985 9388995	1
6	TEE- REDUCING - 2" X 3/4" X 2" BLACK MI (MASS. AND NEW YORK CITY)	9308466	1
	TEE- REDUCING - 2" X 3/4" X 2" GALVANIZED (LONG ISLAND)	NON STOCK	
5	NIPPLE 2" X LENGTH AS REQUIRED GALVANIZED IN LONG ISLAND / BLACK IN MASS. AND NYC	A/R	6
4	STREET ELBOW 2" BLACK (MASS. AND NEW YORK CITY)	9315442	1
	STREET ELBOW 2" GALVANIZED (LONG ISLAND)	9341194	
3	SWIVEL, 1-1/4" X 3-3/4" X 45 LT 1-5/8" OFFSET BLACK (MASS AND NEW YORK CITY)	9386167	2
	NUT 45 LT – BLACK MI (NEW YORK CITY)	9339623	
	NUT 45 LT – BLACK MI (MASS)	9322652	
	SWIVEL, 1-1/4" X 3-3/4" X 45 LT 1-5/8" OFFSET GALVANIZED (LONG ISLAND)	9342425	
	NUT 45 LT – GALVANIZED M.I. (LONG ISLAND)	9340788	
2	ELBOW 2" 90 DEGREE –M.I. – THREADED BLACK (MASS. AND NEW YORK CITY)	9315416	2
	ELBOW 2" 90 DEGREE –M.I. – THREADED GALVANIZED (LONG ISLAND)	9341183	
1	RISER VALVE – SIZE AS REQUIRED	--	1
NO.	ITEM D1000 WITH NO BYPASS		
BILL OF MATERIAL			




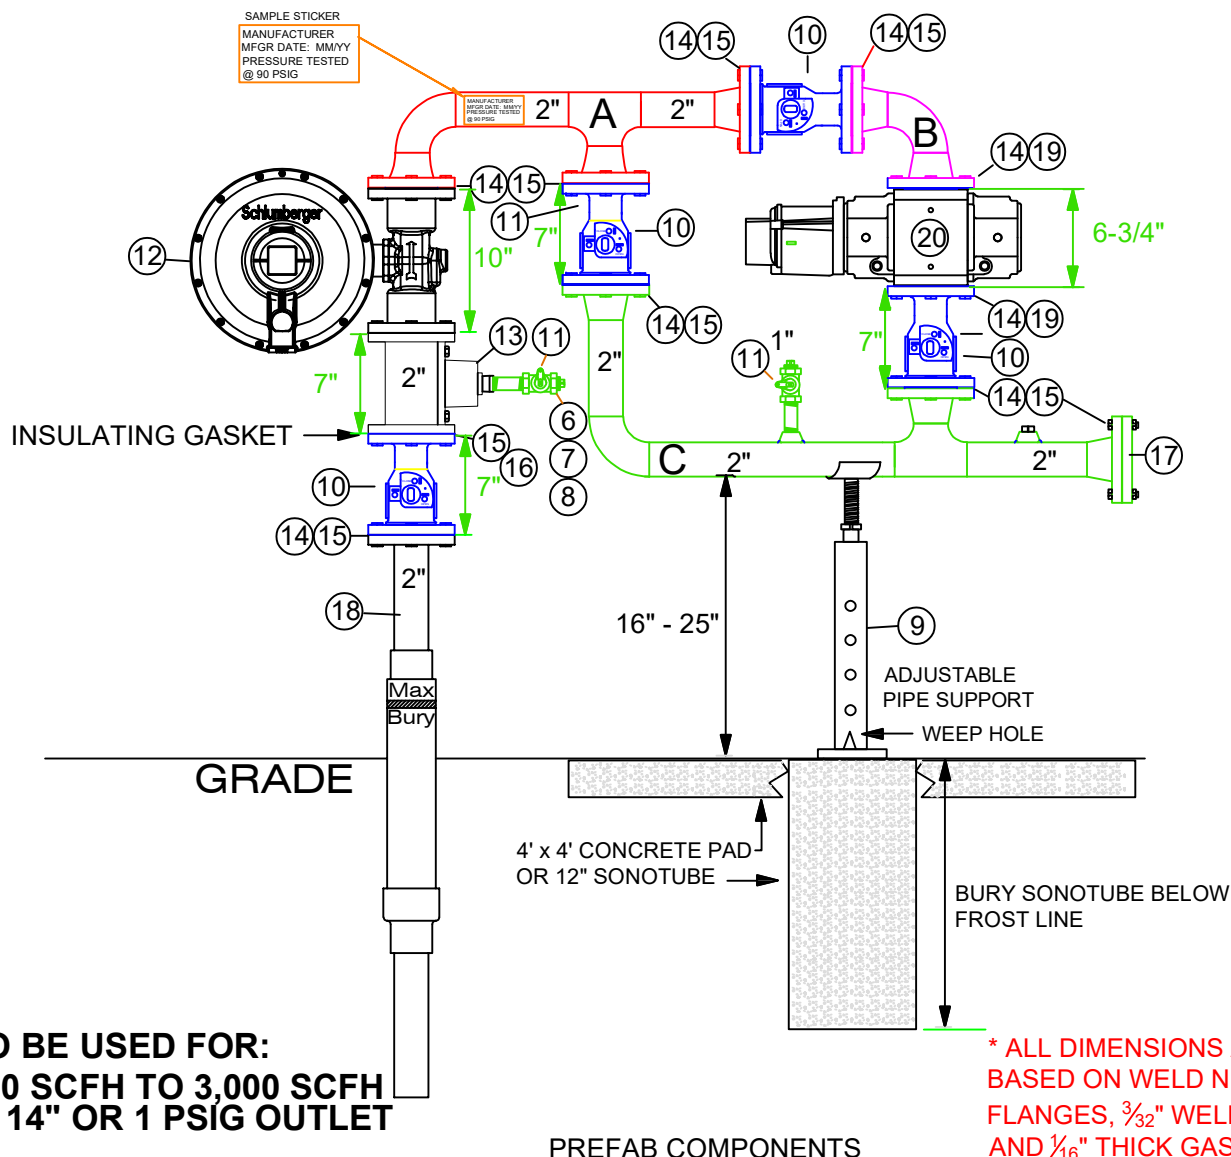

#### PREFAB COMPONENTS

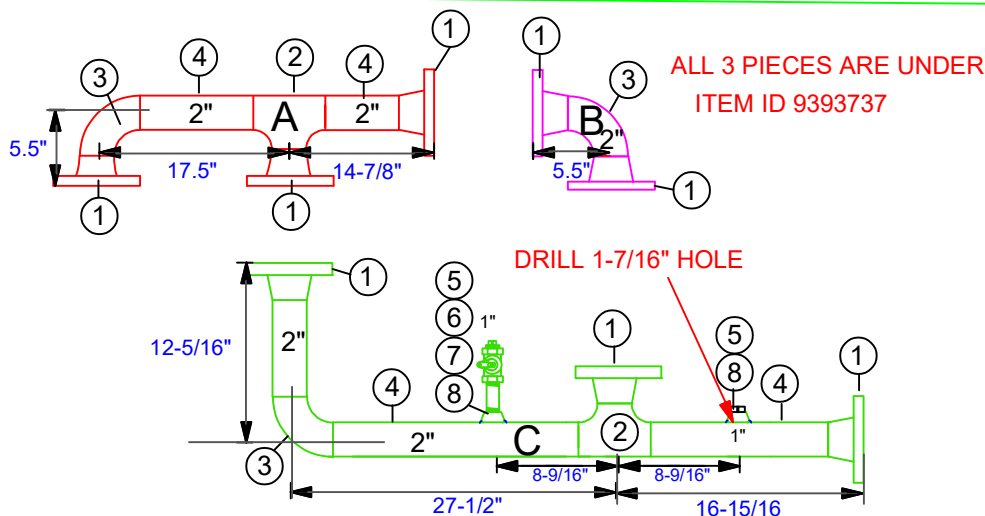

**METER SPOOL PIECE**  
NY/LI ID 9352024

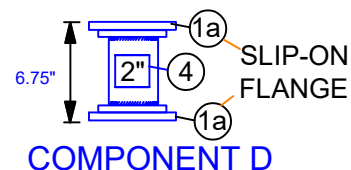

**nationalgrid**

MA, UNY, LI

## 8C - 3M PREFAB METER HEADER

**REVISIONS:** MADE FOR MA, UNY, AND LI ONLY

DATE: 03/26/2010

DESIGN: B. FOSTER/P. GUGLIOTTA

DRAWN: B. FOSTER/P. GUGLIOTTA

EFFECTIVE DATE: 06/10/2025

STD. DWG.

NO.

**020010-CS**



**FIELD INSTALLATION NOTES**


- A. CONTACT ENGINEERING FOR REGULATOR SIZING.
- B. WHERE VEHICLE TRAFFIC IS A CONCERN, PROTECTION POST ARE REQUIRED. NATIONAL GRID PROTECTION POST STANDARDS [MTRS-6060](#) CAN BE USED AS A GUIDELINE.
- C. DO NOT WELD METER OR REGULATOR IN PLACE.
- D. DO NOT PRESSURE TEST WITH METER OR REGULATOR IN PLACE. THIS CAN DAMAGE THE METER OR REGULATOR. USE A SPOOL PIECE.
- E. ALL PREFAB PIPING SHALL SURFACE PREPARATION, PRIMING AND PAINTING SPECIFICATION: ALL SURFACES SHALL BE SOLVENT CLEANED IN ACCORDANCE WITH SSPC SP#1 STANDARD TO REMOVE ALL SOLUBLE SURFACE CONTAMINATES. APPLICATION SHALL BE ONE COAT OF SOLVENT BASED GRAY PRIMER MINIMUM OF 2-3 MILS, FOLLOWED BY ONE COAT OF SOLVENT-BASED ASA #49 GRAY ACRYLIC ENAMEL MINIMUM OF 2-3 MILS, OR EQUIVALENT AS APPROVED BY NATIONAL GRID ENGINEERING.
- F. THIS PREFAB CAN BE USED FOR LOW PRESSURE INSTALLATIONS; HOWEVER, METER RATING IS REDUCED FOR LOW PRESSURE (2,580 SCFH FOR 3m) PER [CMS03002](#)

**PREFABRICATION NOTES FOR ITEMS 1- 9**

- G. ALL WELDING MUST CONFORM TO API-1104 PROCEDURES.
- H. RADIOGRAPH SHALL BE 10% OF ALL WELDS OR PER NATIONAL GRID'S WELDING POLICY PROCEDURE. [N.D.E. REPORT ACCOMPANY EACH SHIPMENT.](#)
- I. ALL FLANGE OPENINGS SHALL BE COVERED WITH PLASTIC CAPS.
- J. ASSEMBLY SHALL BE SUPPLIED IN 4 PIECES (3 PIPING & 1 FOR SUPPORT).
- K. FITTINGS SHALL CONFORM TO ASTM A-234 WPB STD. WALL AND ASTM A-105.
- L. PIPING SHALL CONFORM TO NATIONAL GRID SPEC. [120020-MS.](#)
- M. ALL PIPING SHALL BE PRESSURE TESTED TO 90 PSIG FOR 5 MINUTES OR PER NATIONAL GRID'S PRESSURE TESTING PROCEDURE. [MANUFACTURER SHALL PLACE STICKER ON COMPLETED PRFAB STATING 1. MANUFACTURER'S NAME, 2. DATE OF MANUFACTURER AND 3. "PRESSURE TESTED AT 90 PSIG"](#)
- N. **ALL DIMENSIONS OF PREFABRICATED PIECES MUST BE +/- .10 INCH. FLANGES MUST BE SQUARE/PARALLEL TO +/- .10 INCH AND BOLT HOLES MUST ALLIGN.**


**BILL OF MATERIAL**

ITEM	DESCRIPTION	SAP ITEM ID MASS/LI	SAP ITEM ID UNY	QTY	MATERIAL NOTES
<b>PREFABRICATED ITEMS 1 – 8 LISTED BELOW</b>					
1	FLANGE 2" WELD NECK FLAT FACE CLASS 150#	9314322	9314322	10	PER ASTM A-105 GR. B OR A-350 LF-2 FOR SPOOL PIECE ONLY
1A	FLANGE 2" SLIP-ON STEEL CLASS 150 FLAT FACE	9316460	<a href="#">9316460</a>	2	
2	TEE 2", WELD END STD. WALL PER A-234 WPB	9315625	9315625	2	PER A-106 GR. B OR API 5L GR. B PER A-105 GRADE B
3	ELBOW 2" WELD END 90 DEG. LONG RADIUS	9315522	9315522	3	
4	PIPE 2" STEEL, STD. WALL (SCH. 40)	<a href="#">9312351</a>	9312351	6'	
5	THRED-O-LET 1"X 2" PIPE 3000#	9342081	9307678	2	
6	NIPPLE 1" X 3" LONG	9315974	9315974	2	
7	VALVE 1" LOCKWING, TAMPER PROOF	9312256	9312256	2	
8	PLUG 1" SOLID STEEL OR CI	9312287	9312287	3	
A, B, C	OR PREFABRICATED COMPLETED COMPONENTS:				
D	PREFAB ASSEMBLY 8C-3M (3 PIECES)	9393737	9393737	1	
	SPOOL PIECE 8C, 1.5M OR 3M METER 2" X 6.75"	9352024	N/A	1	
<b>REMAINING ITEMS 9 – 20</b>					
9	PIPE SUPPORT ADJUSTABLE		-		FOR ADDITIONAL SUPPORTS SEE <a href="#">MTRS-6475</a>
	SUPPORT ADJUSTABLE FROM 18" – 39"	9314079	9314079	1	
10	VALVE – 2" BALL VALVE CLASS 150# FLANGED ENDS	9306256	9306256	4	
11	LOCK – BARREL FOR MASSACHUSSETS	9322647		3	FOR REGULATORS MUST BE SIZED FOR THE FULL CAPACITY AT MINIMAL OPERATING PRESSURES AND MUST BE RATED FOR THE MAX OPERATING PRESSURE. CONTACT ENGINEERING.
	LOCK – BARREL FOR LI	9386820			
	LOCK – BARREL FOR UPSTATE NEW YORK		9312477		
12	REGULATOR 2" ITRON B34IMRV FLANGED ENDS 3/8"	9307971 MA	9307971	1	
	ORIFICE GREEN/WHITE SPRING 5.5" – 7.2" W.C. SET AT 7" W.C. (100 PSIG MAX INLET) <b>OR</b>	-	-		
	ITRON B38 IMRV 3/8" ORIF 100 PSIG MAX	9307989 MA	9307989		
	ITRON B38 IMR 3/8" ORIF 100 PSIG MAX	9324887 MA	-		
	AMERICAN 1843 WITH OPSO ½" ORIF 100 PSIG MAX	9323055 MA	-		
	FISHER CS-800-IQ ½" ORIF 60 PSIG MAX	9391005 MA	-		
	FISHER CS-806-IQ 3/8" ORIF 100 PSIG MAX	9393158 MA	-		
	FISHER CS-804 WITH OPSO 100 PSIG MAX ½" ORIF	9392300 MA	-		
	AMERICAN 1813B ¾" ORIF 60 PSIG MAX	-	9307401		
13	STRAINER 2" FLANGED	9340158	9306282	1	FLEXITALLIC SIGMA 588 ALT. 9306269 FOR BOLT / 9310614 FOR NUT
14	GASKET 2" FOR 150# FF FLANGE	9341161	9315688	11	
15	BOLTS STUD – 5/8" X 4" W/2H HEX NUT	9392186	9392186	48	
16	INSULATING FLANGE KIT / GASKET 150#	9340992	9312579	1	ALT. 9310616 FOR BOLT / 9310614 FOR NUT
17	FLANGE, BLIND 2", CLASS 150# FF	9382074	9308662	1	
18	RISER 2"	Field	Field	1	
19	BOLTS FOR METER 5/8" X 1.5" LONG	9342412	Meter Ops.	8	
20	METER 8C, 1.5M OR 3M TEMPERATURE CORRECTED	Meter Ops.	Meter Ops.	1	

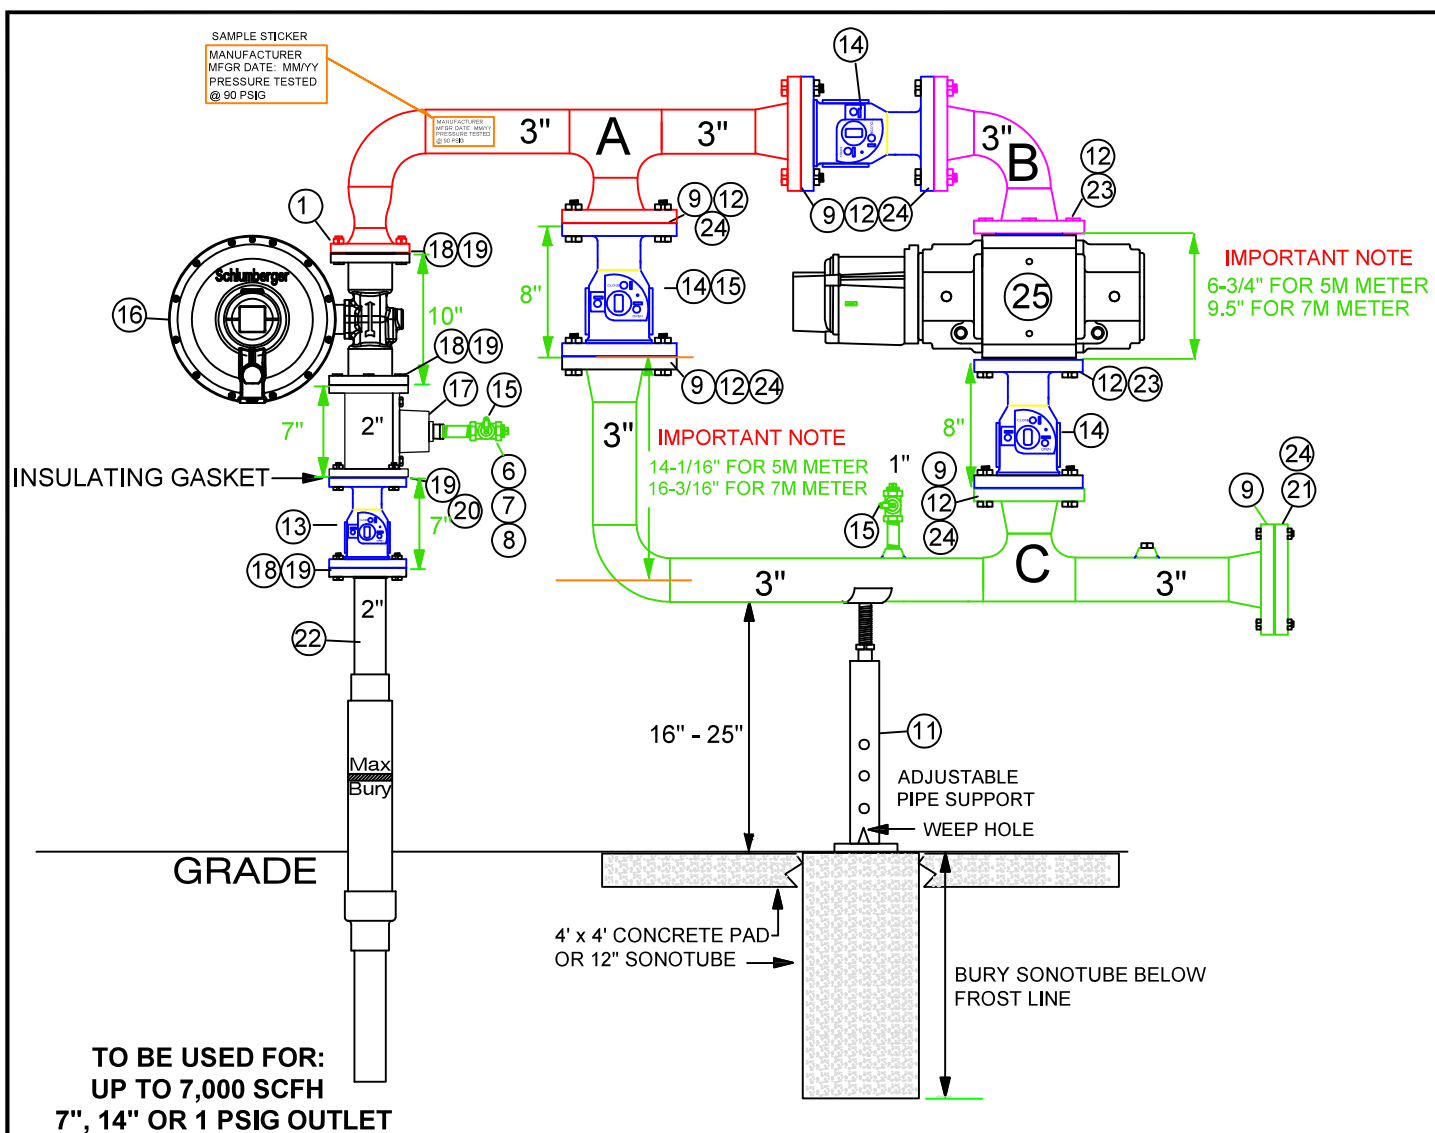


### PREFAB COMPONENTS

#### COMPONENT A

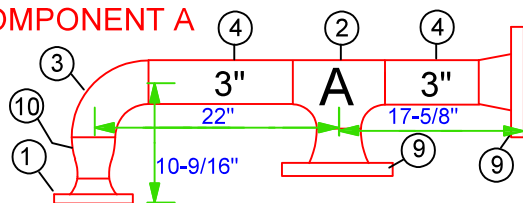


**IMPORTANT NOTE**  
14-1/16" FOR 5M METER  
16-3/16" FOR 7M METER  
5M ID 9393736  
7M ID 9393735

#### COMPONENT C

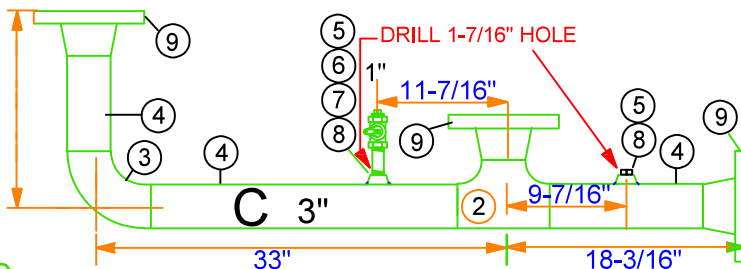


#### COMPONENT B



### 5M AND 7M METER SPOOL PIECE COMPONENT D

SLIP ON FLANGES

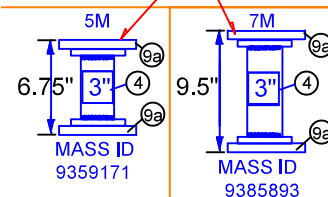

**\* ALL DIMENSIONS  
ARE BASED ON WELD  
NECK FLANGES, 3/32"  
WELD GAP AND 1/16"  
THICK GASKETS**

**nationalgrid**

MA, UNY, LI

## 5M AND 7M PREFAB METER HEADER

**REVISIONS:** MADE FOR MA, UNY, AND LI ONLY

DATE: 03/26/2010

EFFECTIVE DATE: 06/10/2025

DESIGN: B. FOSTER/P. GUGLIOTTA

STD. DWG.

DRAWN: B. FOSTER/P. GUGLIOTTA

NO.

**020011-CS**

**INSTALLATION NOTES**

- A. CONTACT ENGINEERING FOR PROPER REGULATOR SIZING
- B. WHERE VEHICLE TRAFFIC IS A CONCERN, PROTECTION POSTS ARE REQUIRED. NATIONAL GRID PROTECTION POST STANDARDS [MTRS-6060](#) CAN BE USED AS A GUIDELINE.
- C. DO NOT WELD METER IN PLACE. USE A SPOOL PIECE.
- D. ALL PREFAB PIPING SHALL SURFACE PREPARATION, PRIMING AND PAINTING SPECIFICATION: ALL SURFACES SHALL BE SOLVENT CLEANED IN ACCORDANCE WITH SSPC SP#1 STANDARD TO REMOVE ALL SOLUBLE SURFACE CONTAMINATES. APPLICATION SHALL BE ONE COAT OF SOLVENT BASED GRAY PRIMER MINIMUM OF 2-3 MILS, FOLLOWED BY ONE COAT OF SOLVENT-BASED ASA #49 GRAY ACRYLIC ENAMEL MINIMUM OF 2-3 MILS, OR EQUIVALENT AS APPROVED BY NATIONAL GRID ENGINEERING.


**PREFABRICATION NOTES FOR ITEMS 1- 11**

- E. ALL WELDING MUST CONFORM TO API-1104 PROCEDURES.
- F. 10% OF THE WELDS SHALL BE RADIOGRAPHED PER API-1104 OR PER NATIONAL GRID'S WELDING POLICY PROCEDURES. [N.D.E. REPORT ACCOMPANY EACH SHIPMENT.](#)
- G. ALL OPEN END FLANGE OPENINGS SHALL BE COVERED WITH PLASTIC CAPS.
- H. ASSEMBLY SHALL BE SUPPLIED IN 4 PIECES (3 PIPING & 1 FOR SUPPORT).
- I. FITTINGS SHALL CONFORM TO ASTM A-234 WPB STD. WALL AND ASTM A-105.
- J. PIPING SHALL CONFORM TO NATIONAL GRID SPECIFICATION [120020-MS](#).
- K. **ALL DIMESIONS OF PREFABRICATED PIECES MUST BE +/- .10 INCH. FLANGES MUST BE SQUARE/PARALLEL TO +/- .10 INCH AND BOLT HOLES MUST ALIGN.**
- L. ALL PIPING SHALL BE PRESSURE TESTED TO 90 PSIG FOR 5 MINUTES OR PER NATIONAL GRID'S PRESSURE TESTING PROCEDURE. [MANUFACTURER SHALL PLACE STICKER ON COMPLETED PRFAB STATING 1. MANUFACTURER'S NAME, 2. DATE OF MANUFACTURER AND 3. "PRESSURE TESTED AT 90 PSIG"](#)

ITEM	DESCRIPTION	SAP ITEM ID MASS/LI	SAP ITEM ID UNY	QTY	MATERIAL NOTES
<b>PREFABRICATED ITEMS 1 – 10 LISTED BELOW</b>					
1	FLANGE 2" WELD NECK FLAT FACE CLASS 150#	9314322	9314322	1	PER ASTM A-105 GR. B OR A-350 LF-2
2	TEE 3", WELD END STD. WALL PER A-234 WPB	9307680	9307680	2	
3	ELBOW 3" WELD END 90 DEG. LONG RADIUS	9315471	9315471	3	STANDARD WALL, PER A-234 WPB
4	PIPE 3" STEEL, STD. WALL (SCH. 40)	<a href="#">9310244</a>	9310244	5'	PER A-106 GR. B
5	THRED-O-LET 1" X 3" PIPE 3000#	9342081	9307678	3	PER A-105 GRADE B
6	NIPPLE 1" X 3" LONG	9315974	9315974	2	
7	VALVE 1" LOCKWING, TAMPER PROOF	9312256	9312256	2	
8	PLUG 1" SOLID STEEL OR C.I.	9312287	9312287	3	
9	FLANGE 3" WELD NECK FLAT FACE CLASS 150#	9314431	9314431	9	PER ASTM A-105 GR. B OR A-350 LF-2
9a	FLANGE 3" SLIP ON FLAT FACE CLASS 150#	9316472	9316472	2	FOR SPOOL PIECES ONLY
10	REDUCER 3" X 2" CONC., STD. WALL, WELD END	9315489	9315489	1	PER ASTM A234-WPB
	<a href="#">OR PREFABRICATED COMPLETED COMPONENTS</a>				
	COMPONENTS A, B, C ARE UNDER ONE ITEM ID	-	-		
	<b>5M PREFAB KIT (COMPONENTS A, B, C)</b>	<b>9393736</b>	<b>9393736</b>	1	
	<b>7M PREFAB KIT (COMPONENTS A, B, C)</b>	<b>9393735</b>	<b>9393735</b>	1	
A	2" X 3" FLANGED REGULATOR OUTLET				
B	3" FLANGED ELBOW				
C	5M OR 7M FLANGED METER OUTLET	9359171	NA		
D	5M OR 7M FLANGED SPOOL PIECE	9385893	NA		
<b>REMAINING ITEMS 11 - 25</b>					
11	PIPE SUPPORT ADJUSTABLE or PPE SUPPORT 18" – 39"	9323920 MA --	9314079 9341080	1	FOR ADDITIONAL SUPPORTS SEE <a href="#">MTRS-6475</a>
12	GASKET 3" CLASS 150# RING TYPE	9341162	9312067	8	FLEXITALLIC SIGMA 588 WHITE OR APPROVED EQ.
13	VALVE – 2" BALL VALVE CLASS 150# FLANGED ENDS	9306256	9306256	1	
14	VALVE - 3" BALL VALVE CLASS 150# FLANGED ENDS	9306255	9306255	3	
15	LOCK - BARREL – MASSACHUSETTS REGION	9322647 MA	9312477	3	
16	REGULATOR 2" FLANGED ENDS	AS REQ'D	AS REQ'D	1	
	ITRON B34 IMRV 3/8" ORIF. 100 PSIG MAX 7" SET	9381875 MA	9307971		
	ITRON B38 IMRV 3/8" ORIF. 100 PSIG MAX 7" SET	9307989 MA	9307989		
	ITRON B38 IMR 3/8" ORIF. 100 PSIG MAX 7" SET	9324887 MA	-		SEVERAL MODELS LISTED HERE: ENG OR CUSTOMER SERVICE TO SPECIFY REGULATOR.
	AMERICAN 1843 WITH OPSO ½" ORIF 100 PSIG MAX	9323055 MA	-		REGULATORS MUST BE SIZED FOR THE FULL CAPACITY AT MINIMAL OPERATING MAIN PRESSURES AND MUST BE RATED FOR MAXIMUM OPERATING PRESSURES. CONTACT ENGINEERING.
	FISHER CS-806 IQ 3/8" ORIF 100 PSIG MAX 7" SET	9393158 MA	-		
	FISHER CS-804 WITH VSX SLAM SHUT 100 PSIG MAX	9392300 MA	-		
	FISHER CS-800 IQ 1/2" ORIF. 60 PSIG MAX	9391005 MA	-		
	AMERICAN 1813B ¾" ORIF 60 PSIG MAX	-	9307401		
17	STRAINER 2" FLANGED	9340158	9306282	1	
18	GASKET 2" RING FOR 150# FF FLANGE	9341161	9315688	3	
19	BOLTS STUD – 5/8" X 4" LONG WITH 2 HEX NUT	<b>9392186</b>	9392186	16	ALT. 9306269 FOR BOLT / 9310614 FOR NUT
20	INSULATING FLANGE KIT / GASKET 150#	9340992	9312579 UNY	1	
21	FLANGE BLIND 3"	9307751	9307751	1	
22	RISER 2"	BY FIELD	BY FIELD	1	
23	BOLTS FOR METER 5/8" X 1.5" LONG	9342412	METER OPS	8	ALT. 9310616 FOR BOLT / 9310614 FOR NUT
24	MACHINE STUD, 5/8" X 4" LONG WITH HEX NUT	9392186	9392186	32	
25	METER 5M OR 7M TEMPERATURE CORRECTED	METER OPS	METER OPS	1	

**BILL OF MATERIAL**

THIS DRAWING ONLY APPLIES TO THE VENT TERMINUS:  
VENT TERMINUS SHALL NOT BE WITHIN SHADED AREA  
SEE PAGE 2 FOR RESTRICTIONS.

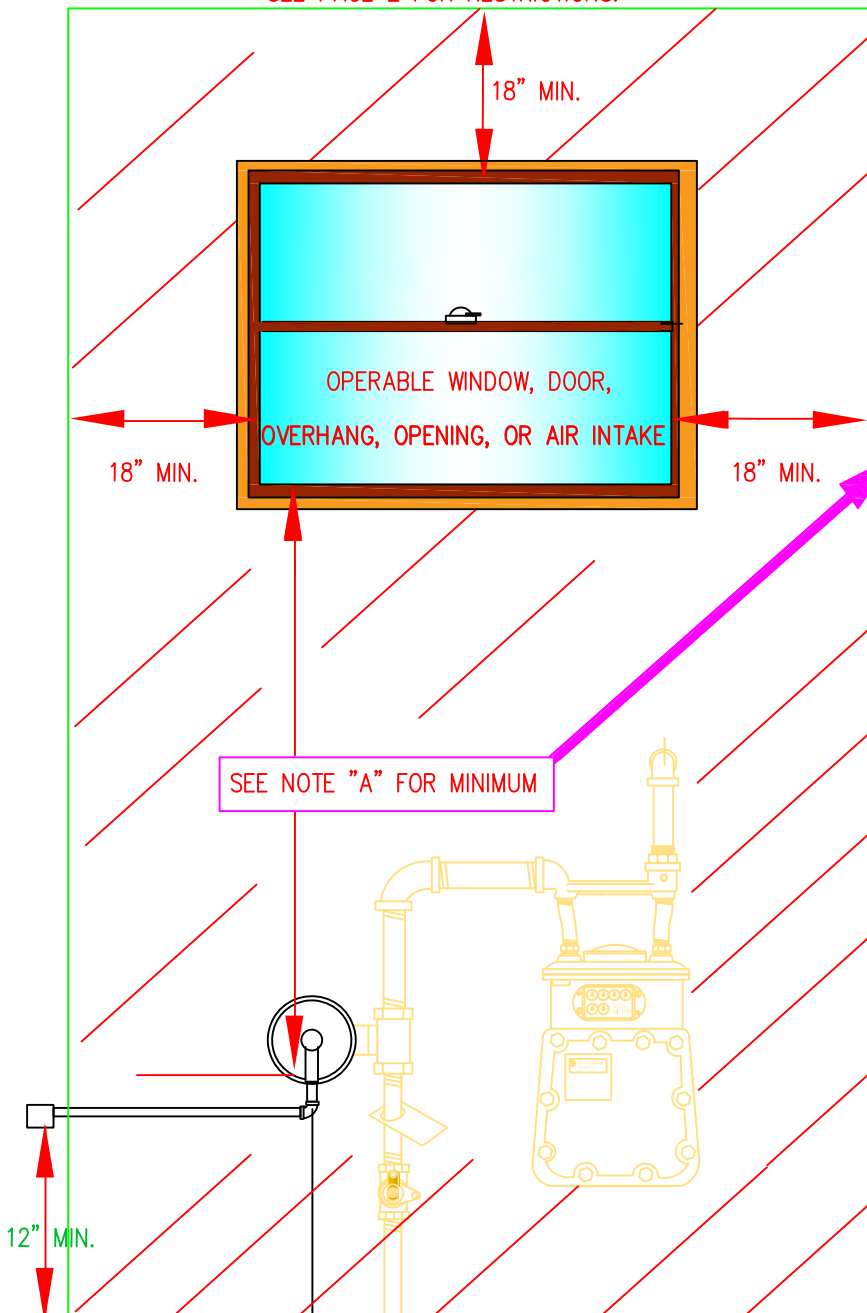


ONE OF THE FOLLOWING MINIMUM  
DISTANCES FROM A REGULATOR VENT TO  
AN OPERABLE WINDOW (ACTUAL OPENING -  
NOT TO WINDOW TRIM), DOOR, OVERHANG,  
OPENING, OR AIR INTAKE SHALL BE MET

18" HORIZONTAL OR  
18" ABOVE OR  
VERTICAL DISTANCE PER NOTE "A"

NOTE "A" - MINIMUM VERTICAL DISTANCES  
IF 18" HORIZONTAL CAN'T BE MET

OPERABLE WINDOW / DOOR: 6 FEET  
OVERHANG PROTRUDES GREATER THAN 24": 6 FEET  
ANY EXHAUST OPENING: 6 FEET  
AIR INTAKE: 10 FEET

### ELECTRIC METER

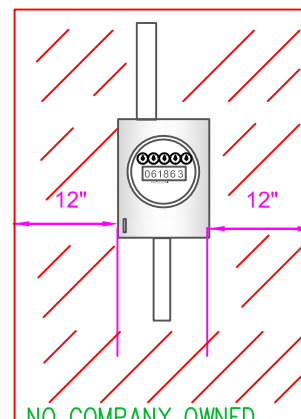

NO COMPANY OWNED  
GAS PIPING (EXCEPT VENT PIPING)  
ALLOWED UNDER ELECTRIC METER

OR WITHIN 12" OF  
OF ELECTRIC METER  
FOR NEW CONSTRUCTION

**nationalgrid**

NEW YORK

### REGULATOR VENT CLEARANCES FOR RESIDENTIAL OUTDOOR LOCATION

Key Changes: MADE APPLICABLE TO NEW YORK STATE ONLY

DATE: 11/15/2021

DESIGN: B. FOSTER

DRAWN: PAUL GUGLIOTTA

EFFECTIVE DATE: 02/12/2025

STD. DWG.

NO. 020013-CS

## DEFINITIONS:


- SHALL – Indicates a mandatory requirement
- SHOULD - Indicates best practice and is the action that is expected to be performed as described unless there is a compelling reason not to do so.

**NOTES:** For all new installations effective with the implementation of this standard, the following applies.

1. The minimum regulator vent height above Final Grade SHALL be 12 inches.
2. Regulators SHALL be installed with the regulator vent port pointing down. If the minimum vent height of 12 inches above final grade cannot be achieved, the vent SHALL be piped to at least the minimum height specified. (mulch, vegetation and loose impediments do not constitute final grade and are not part of the 12 inch clearance criteria)
3. Regulator vent piping SHALL be standard wall steel piping. Fittings such as elbows, tees and caps may be malleable iron.
4. Regulator vent piping SHALL be wrench tight and thread sealant SHALL be used during assembly.
5. Regulator vent piping SHALL be of the proper size. See [CMS03002](#) for sizing.
6. Regulator vent piping SHOULD contain a fitting (e.g., Lock Type Dresser Style 90, insulated union, etc.) to facilitate disassembly of the vent piping and regulator replacement on OUTDOOR regulator installations where the vent piping exceeds approximately 6 feet (72 inches) in length.
7. Regulator vent piping in the excess of 36 inch total length SHALL be supported with at least one support.
8. When vent pipe exceeds lengths given below, additional support is required. For guidance on support requirements see [NFPA 54: section 7.2.5.1](#) and [NFPA Table: 7.2.5.2](#) this guidance is also available in the [Gas Pipeline Technical Committee \(GPTC\) guidance 192.353](#)

TABLE FOR PIPE SUPPORT SPACING			
STEEL PIPE - NOMINAL SIZE IN INCHES	SPACING SUPPORT IN FEET	TUBING – NOMINAL SIZE IN INCHES	SPACING SUPPORT IN FEET
1/2	6	1/2	4
3/4 or 1	8	5/8 or 3/4	6
1-1/4 or larger (horizontal)	10	7/8 or 1 (horizontal)	8
1-1/4 or larger (vertical)	every floor	1 or larger (vertical)	every floor

9. Regulator vent terminus SHALL contain a weather-insect resistant fitting
10. Regulator vent terminus SHALL be marked as a VENT
11. Regulator vent terminus SHALL be located where gas from the vent can escape freely into the atmosphere and SHALL meets the requirements shown on page 1 of 2.
12. Regulator vent terminus SHALL be protected from damage caused by submergence in area where flood and ice accumulation may occur.
13. For existing installations, any substandard condition SHOULD be brought into compliance, at the time of discovery, or referred to the appropriate CMS or Field Operations department for remediation in accordance with [Handling Gas Facilities Found in Substandard Locations CMS05001](#)
14. If an overhang protrudes less than 24 inches, there are no minimum distances.

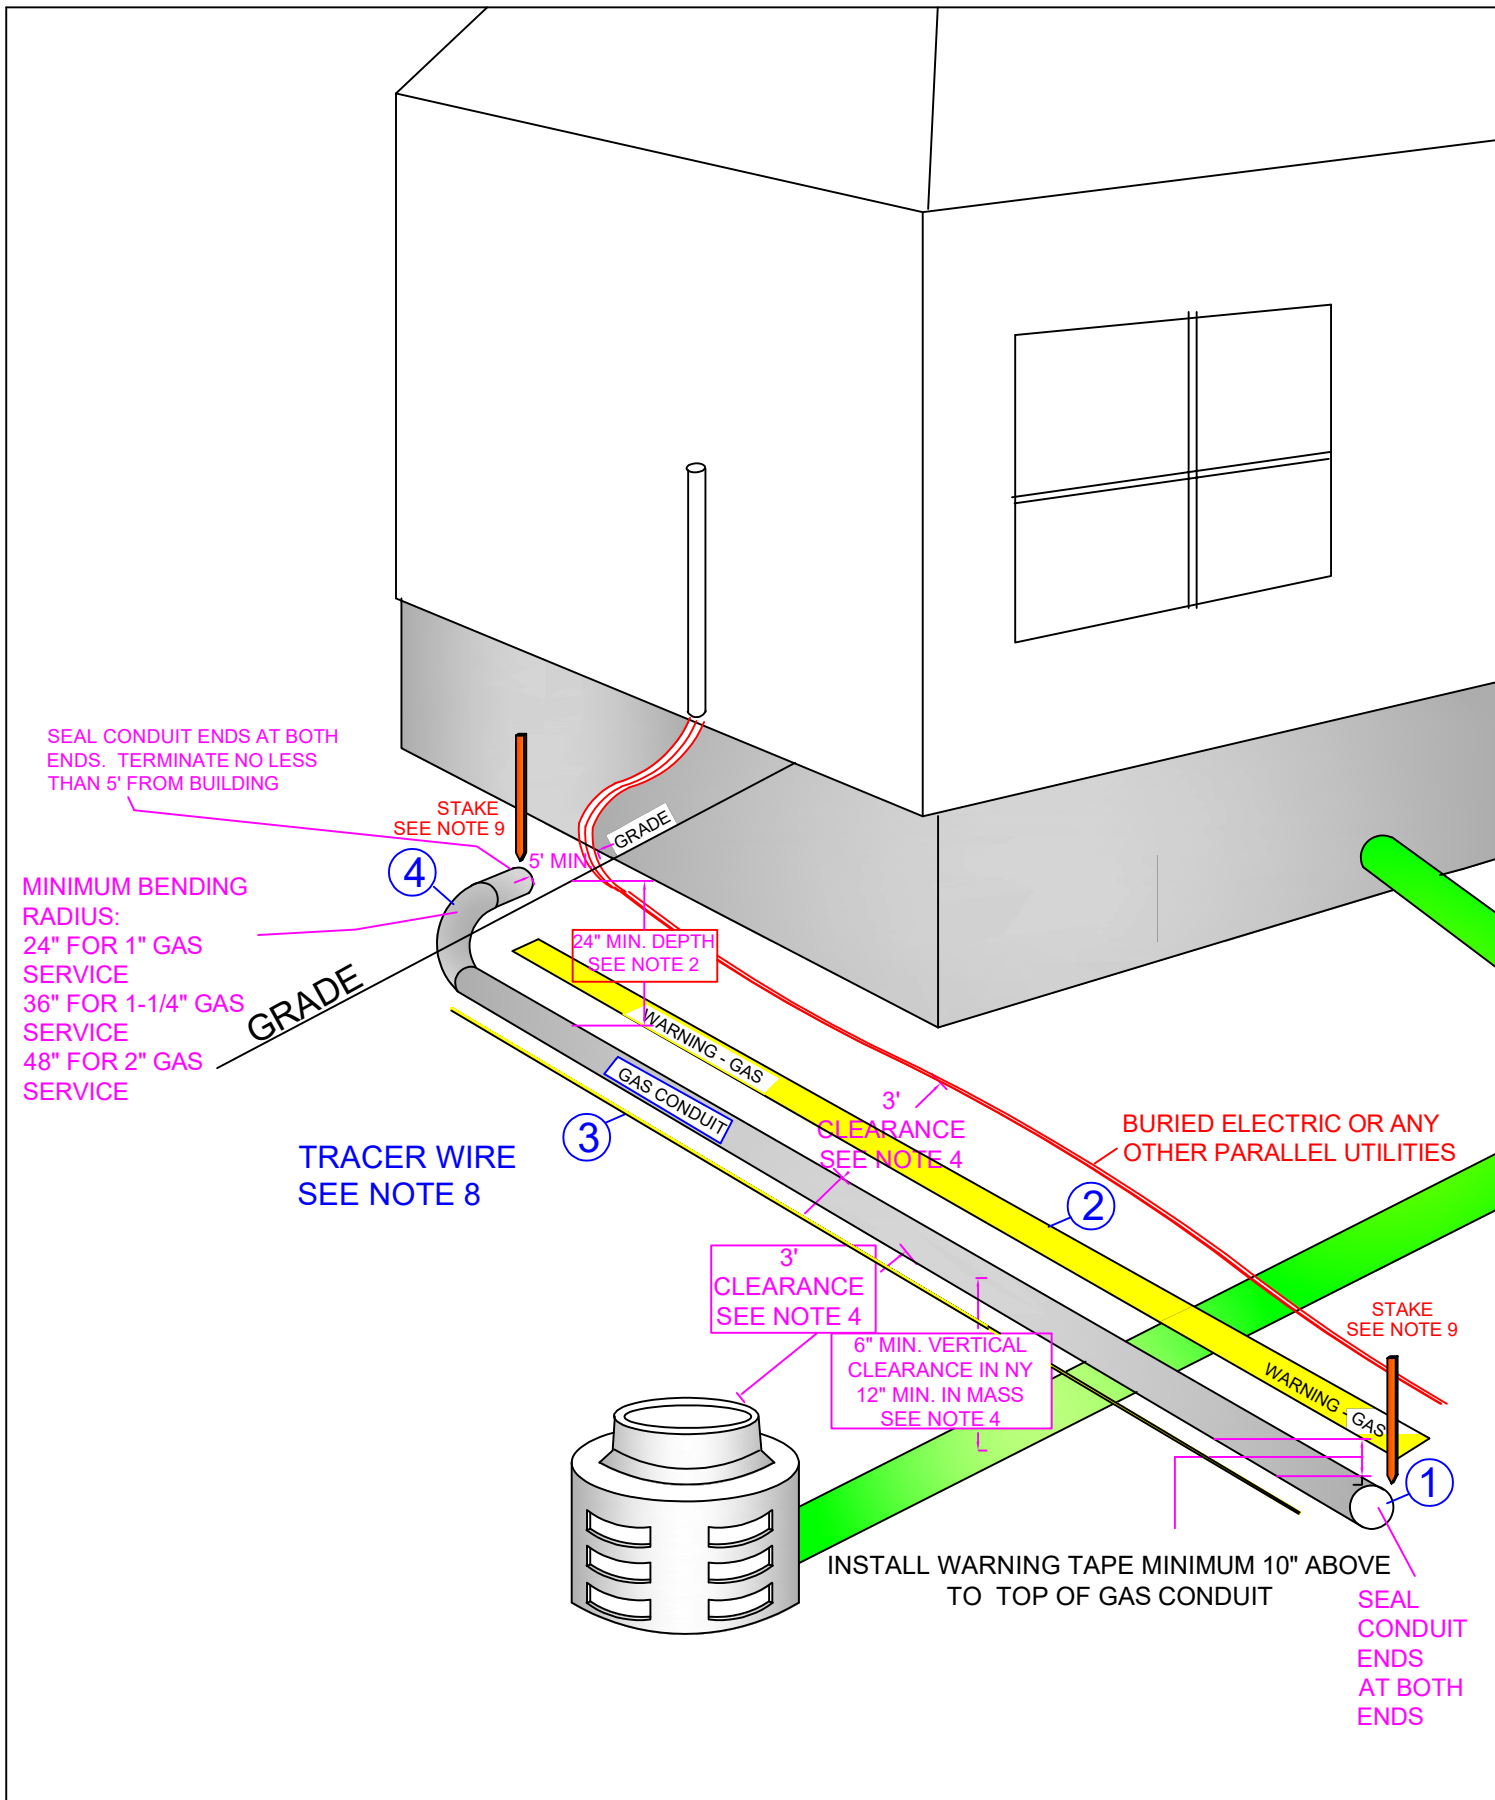

**nationalgrid**

LI, NYC, UNY

## CONDUIT INSTALLATION GUIDELINES FOR GAS SERVICE INSERTION

**Key Changes:** REMOVED RHODE ISLAND

DATE: 09/01/2017

EFFECTIVE DATE: 12/04/2024

DESIGN: PAUL G./ E. MARIAN

STD. DWG.

DRAWN: PAUL GUGLIOTTA

NO.

**CS-CNST004**




## NOTES

National Grid has developed the following guidelines to allow a potential future customer, contractor and/or developer to install a dedicated conduit underneath proposed landscaping and paved areas during construction today to facilitate a future gas service installation. This conduit will be used as a sleeve to minimize excavation activities associated with a new service installation at a later date.

**Conduit installations do not guarantee future service installation. National Grid reserves the right to refuse using the conduit if any of the requirements below are not met or we deem the conduit to be unfit for service at our discretion.**

1. The conduit shall be installed entirely on private property from the road towards the proposed meter location in as straight a line as possible, ending a minimum of 5-feet from the building. Meter location shall be in accordance with current National Grid selection standards.
2. The entire length of the installation must maintain minimum 24-inches of depth below final grade.
3. The trench shall be backfilled with clean compacted fill to support and prevent damage to the conduit.
4. Conduit shall maintain minimum 3-feet of separation from other utilities in parallel runs and a minimum of 6-inches separation for perpendicular crossings.
5. Conduit shall not be installed under any buildings, sheds, porches, or decks.
6. The homeowner / developer is responsible for taking and maintaining accurate records of the conduit installation and location to enable National Grid to expose the ends and utilize as a sleeve at a future date.
7. The conduit shall be a minimum 2-inch IPS diameter, rigid, non-metallic, continuous sleeve with sealed joints. (i.e., PVC / PE.)
8. Tracer wire must be installed outside the conduit. Marker ball or marker tape with warning lettering may be used where regionally applicable.
9. After conduit is installed, to prevent entry of dirt or water in the conduit, it should be capped with a temporary plug. There should be stake at each end to identify entry and exit. The entry and exist area should not be paved over.

ITEM	DESCRIPTION	
1	CONDUIT – PVC 2" IPS MINIMUM – RIGID –NON-METALLIC, CONTINUOUS, SEALED JOINTS	
2	WARNING TAPE	
3	TRACER WIRE – MINIMUM 14 GAUGE COPPER WITH PE JACKET – STRANDED OR SOLID	
4	CONDUIT BEND – 24" BEND RADIUS FOR 1" GAS SERVICE 36" BEND RADIUS FOR 1-1/4" GAS SERVICE 48" BEND RADIUS FOR 2" GAS SERVICE	

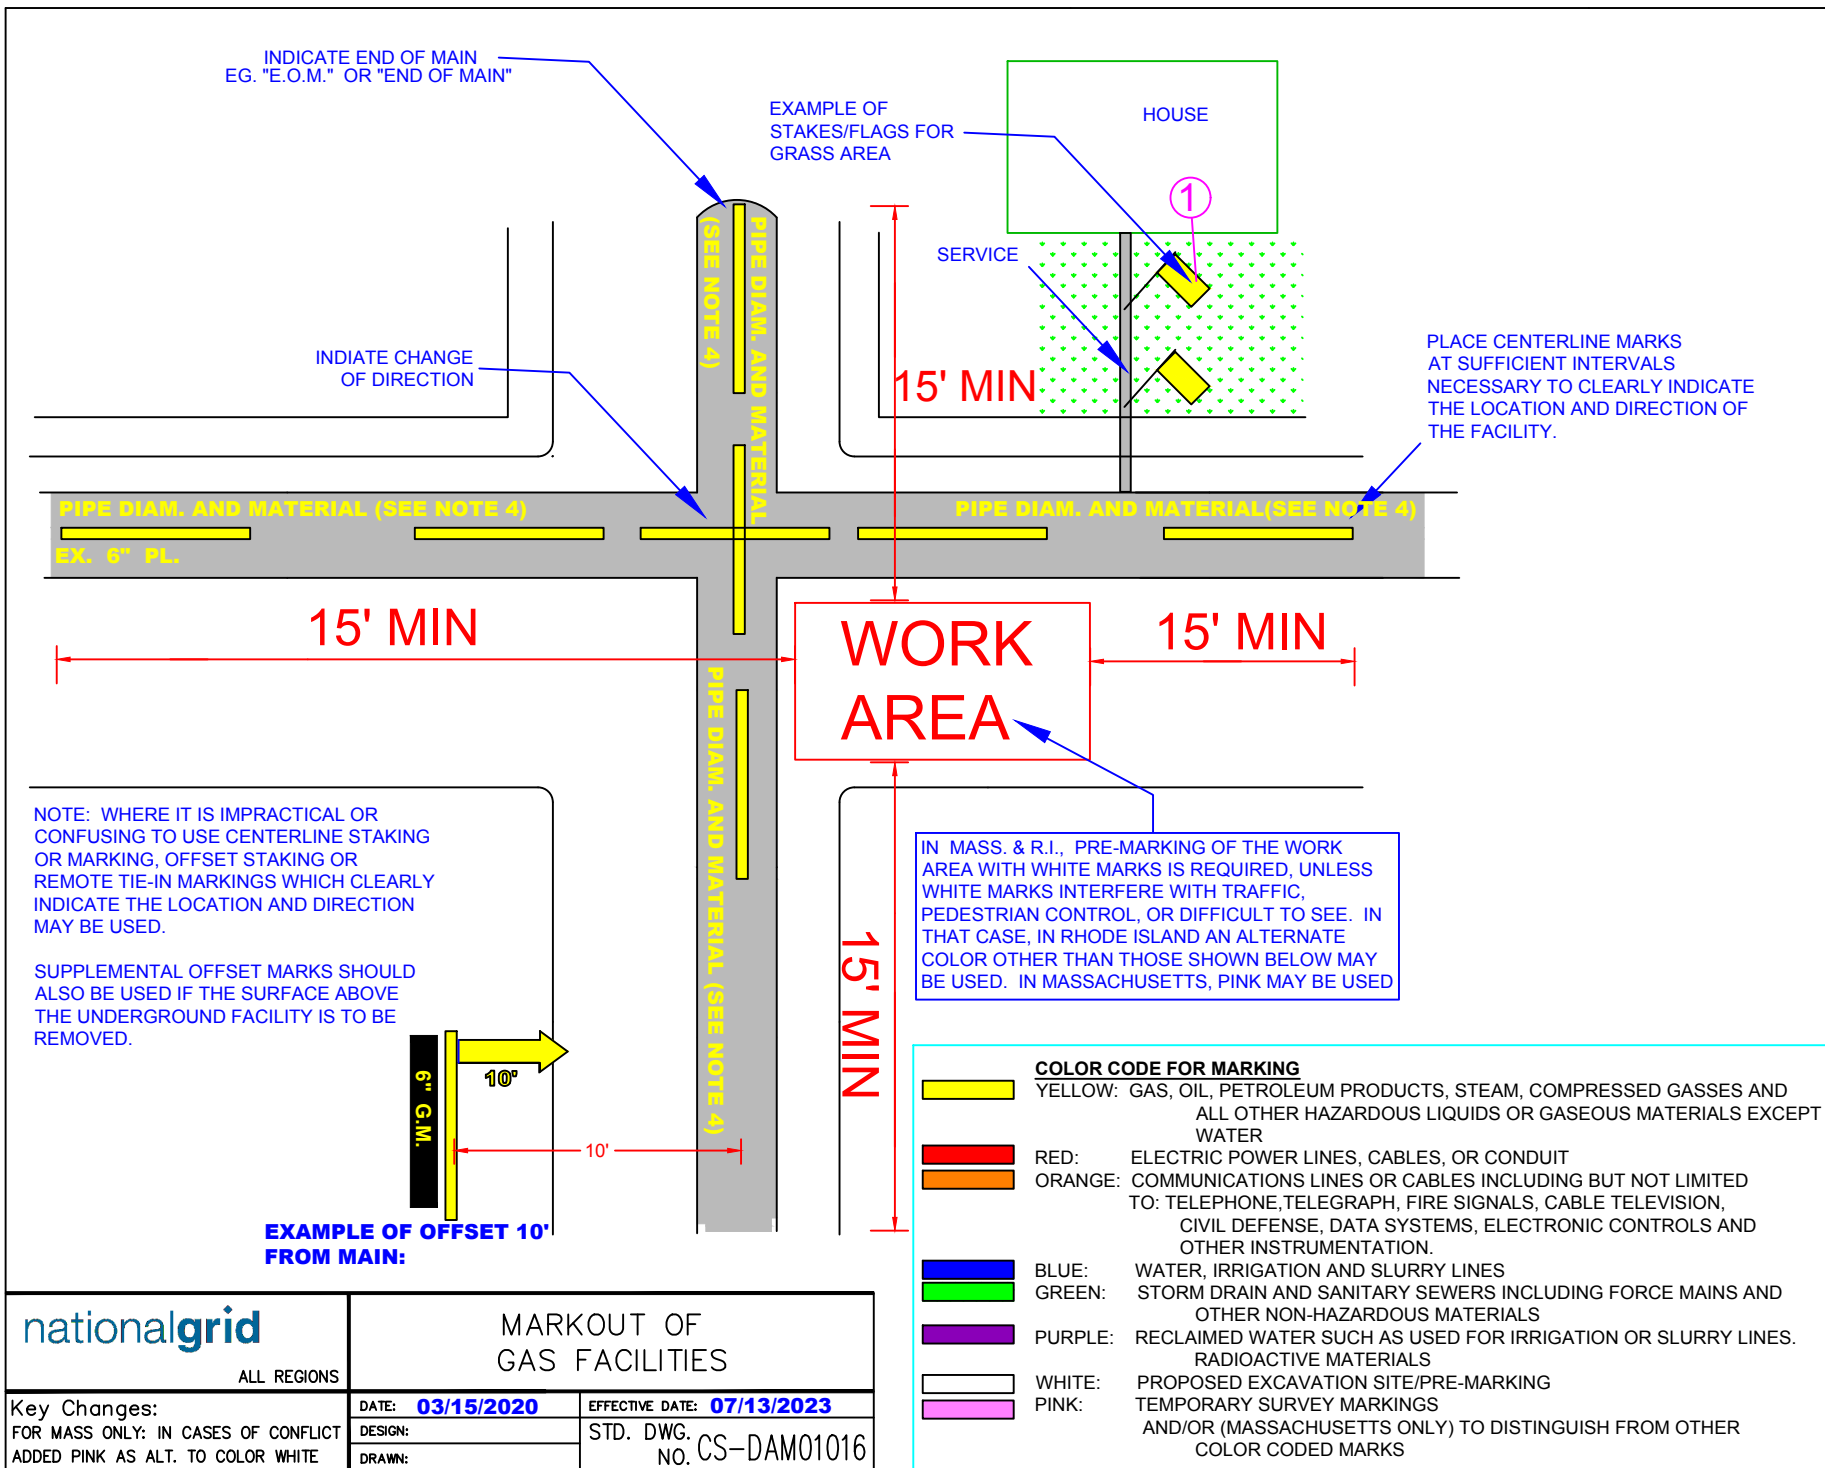



## NOTES


1. A GAS FACILITY THAT IS IN OR WITHIN 15 FEET OF A WORK AREA SHALL BE LOCATED ACCURATELY AND WITH DUE CARE BE MEANS OF STAKING, MARKING OR OTHER DESIGNATION IN ACCORDANCE WITH THIS DRAWING. MARKING SHALL EXTEND AT LEAST 15 FEET BEYOND THE BOUNDARIES OF A PRE-MARKED AREA / WORK ZONE.

NOTE: IN MASSACHUSETTS, THE UNDERGROUND FACILITY SHALL BE COMPLETELY LOCATED WITHIN A SAFETY ZONE OF NO MORE THAN 18 INCHES PLUS THE WIDTH OF THE FACILITY FROM THE DESIGNATED CENTERLINE. IN CENTERLINE MARKING, ONLY THE CENTER OF THE FACILITY IS MARKED. A "SAFETY ZONE" IS IMPLIED AND THEREFORE IS NOT SHOWN, REGARDLESS OF WHETHER PAINT, FLAGS, OR STAKING IS USED TO DENOTE THE FACILITIES.


2. **IN MASSACHUSETTS ONLY:** IN A PAVED AREA DESIGNATED AS A HISTORICAL LOCATION, CHALK, STAKES, FLAGS, BRUSH-TYPE MARKERS OR OTHER SUITABLE DEVICES WITH THE APPROPRIATE COLOR-CODING AFFIXED OR ATTACHED MAY BE USED INSTEAD OF FLUID MARKING.
3. **IN MASSACHUSETTS ONLY:** THE SIZE OR DIAMETER OF THE FACILITY IS ONLY REQUIRED TO BE MARKED IF IT IS GREATER THAN 2 INCHES.
4. **IN NEW YORK STATE ONLY:** WHERE KNOWN, STAKES AND SURFACE MARKINGS SHALL INDICATE THE DEPTH OF THE FACILITY IN INCHES. FACILITY DEPTH IS CONSIDERED KNOWN WHEN THE FACILITY HAS BEEN VISUALLY VERIFIED AND FOUND TO BE CONSISTENT ALONG THE ENTIRE MARKED OUT FACILITY.
5. **IN NEW YORK STATE ONLY:** STAKES AND SURFACE MARKINGS SHALL INDICATE IN INCHES THE SIZE OR DIAMETER OF THE UNDERGROUND FACILITY OR ITS INCASEMENT, IF KNOWN.
6. **IN NEW YORK STATE ONLY:** WHEN AN INCORRECT MARK IS DISCOVERED IN THE FIELD, PAINT AN "X" IN YELLOW OVER THE INCORRECT MARK AND THEN (IN STREET ONLY) THE MARK SHOULD BE BLACKENED OUT. IF THE MARK IS IN THE SIDEWALK, ONLY THE "X" IN YELLOW SHOULD BE DONE (NOT PAINTED OVER IN BLACK).
  - THE RESPONSIBLE PARTY WHO ORIGINALLY PLACED THE INCORRECT MARKS IN THE FIELD (EITHER NATIONAL GRID EMPLOYEE OR LOCATING COMPANY STAFF) SHOULD BE THE ONE WHO GOES BACK TO THE SITE TO PERFORM THIS.

ITEM	DESCRIPTION	SAP ITEM I.D NYC / LI / MASS	SAP ITEM I.D UNY	SAP ITEM I.D RI
1	FLAG – CAUTION - GAS	9310364	9310364	9310364
2	PAINT – MARKING WHITE	9332474	9332474	9332474
3	PAINT – MARKING YELLOW	9340907	9340907	9340907
4	PAINT – MARKING BLACK	9381794		9310315


## MAIN TRENCH

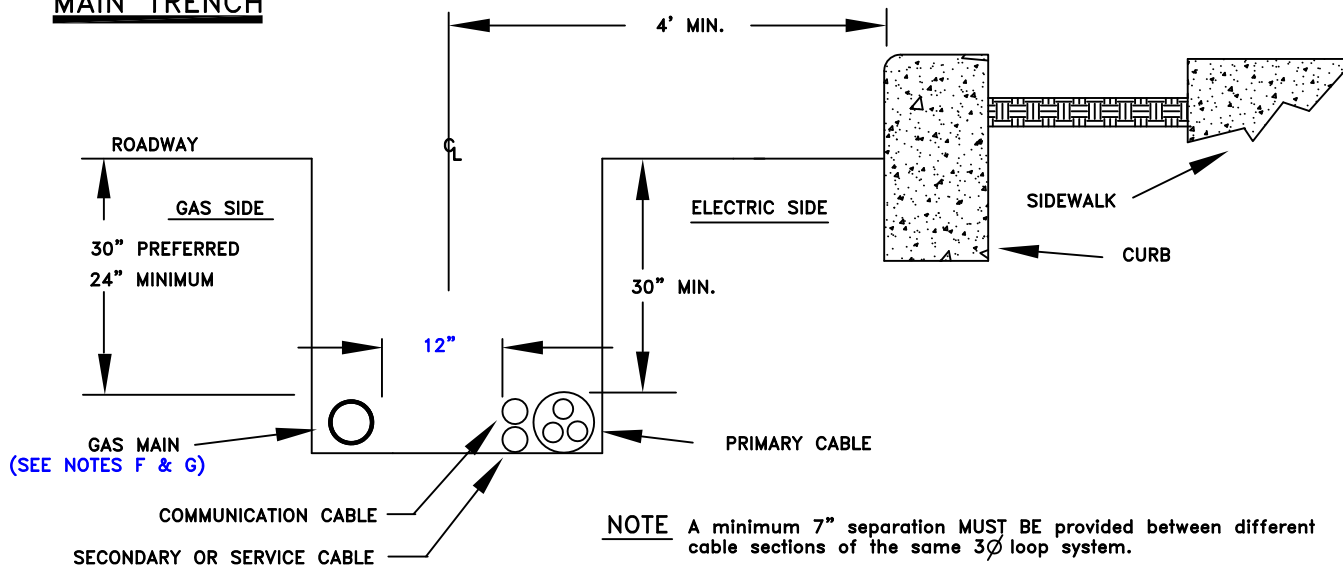

## SERVICE TRENCH

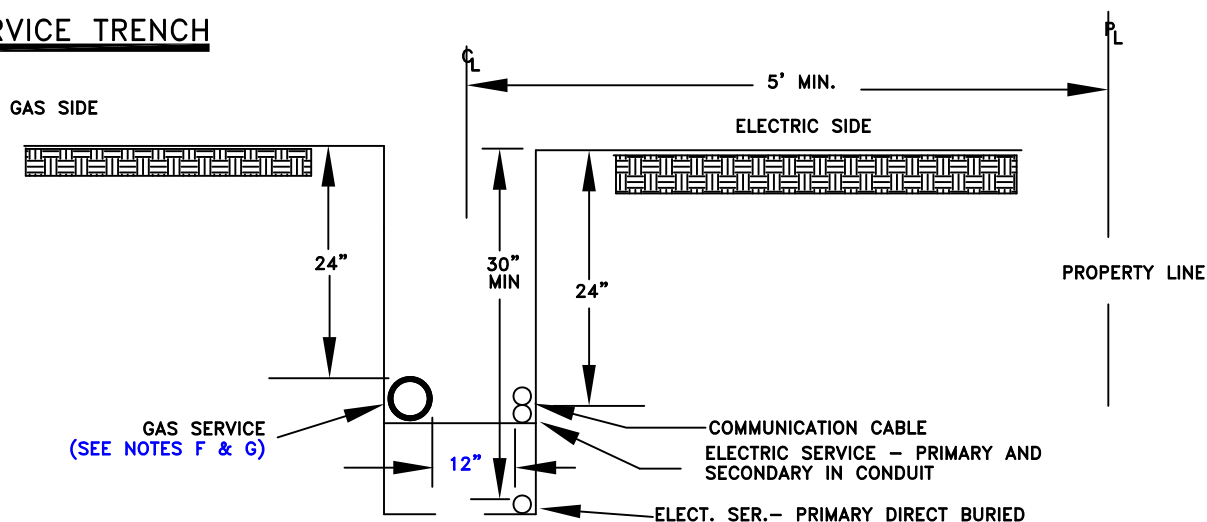

## CIPUD SERVICE TRENCH

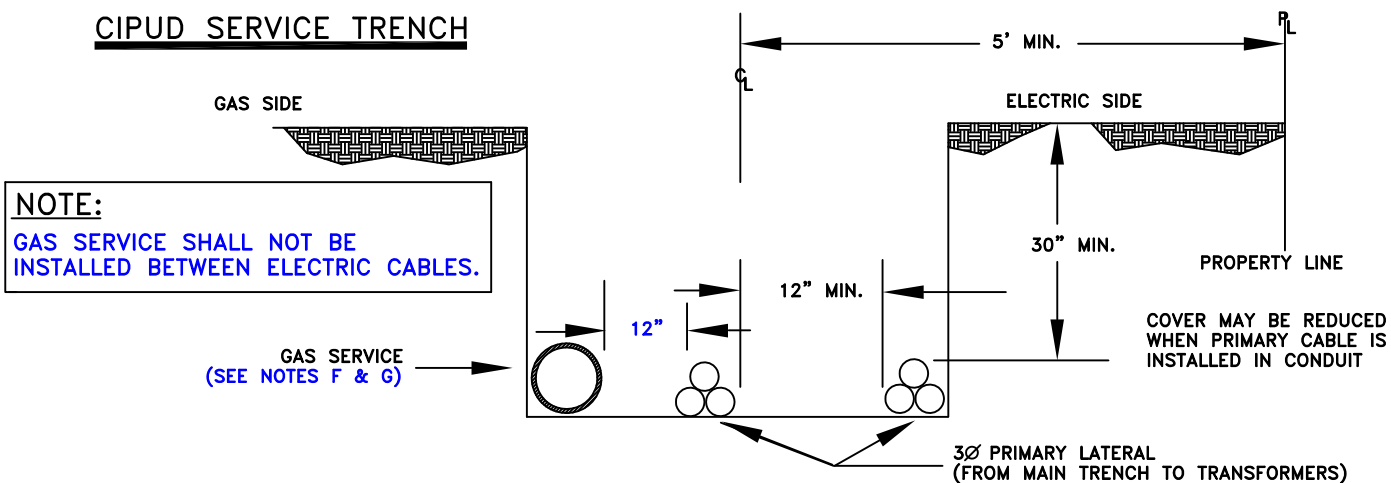

**nationalgrid**

LONG ISLAND

## CLEARANCES OF GAS AND ELECTRIC IN RUD AND CIPUD AREAS

**REVISIONS:** REVISED USING SAP ITEM ID'S

DATE: 7/01/2003

DESIGN: GJK / M. MATASSA

DRAWN: GJK

EFFECTIVE DATE: 09/15/2013

STD. DWG.  
NO.


**CNST-6015**




**NOTES:**

- A. BACKFILL AND BOTTOM OF TRENCH ARE TO BE FREE OF MATERIALS WHICH MAY DAMAGE THE GAS PIPING OR THE PROTECTIVE JACKET ON THE ELECTRIC CABLES.
- B. 1) DIRECT BURIED PRIMARY CABLE SHALL BE INSTALLED BETWEEN 30" AND 36" BELOW FINAL GRADE.  
2) PRIMARY CABLE IN CONDUIT SHALL BE INSTALLED BETWEEN 24" AND 36" BELOW FINAL GRADE. ONLY SCHEDULE 40 UL APPROVED GALVANIZED RIGID METAL CONDUIT OR PLASTIC CONDUIT IS ACCEPTABLE  
3) SECONDARY CABLE SHALL BE INSTALLED BETWEEN 24" AND 36" BELOW FINAL GRADE.
- C. WHEN PLASTIC GAS SERVICE TUBING IS INSTALLED IN A COMMON TRENCH WITH SECONDARY ELECTRIC CABLE, BOTH FACILITIES SHALL BE INSTALLED 24" BELOW FINAL GRADE.
- D. TO AVOID BREAKING AND RESTORING ROADWAYS, INSTALL CABLE CONDUIT AND STEEL SLEEVE WHEN IT IS ANTICIPATED THAT A GAS MAIN AND CABLE CROSSING WILL BE REQUIRED IN THE NEAR FUTURE. PLUG CONDUIT AND SLEEVE ENDS TO PREVENT DEBRIS AND WATER FROM ENTERING.
- E. EXCEPT WHERE PREVENTED BY UNDERGROUND STRUCTURES, PLASTIC DISTRIBUTION GAS MAINS WILL BE INSTALLED WITH A PREFERRED COVER OF 30". HOWEVER THIS COVER MAY BE REDUCED TO A MINIMUM OF 24" TO MEET FIELD CONDITIONS. WHERE THIS MINIMUM CONDITION CANNOT BE MET, OR WHERE EXTERNAL LOADS MAY BE EXCESSIVE, OR WHERE FUTURE GRADING IS LIKELY, ADDITIONAL PROTECTION SHALL BE PROVIDED. CONTACT GAS ENGINEERING FOR DESIGN CRITERIA.
- F. ALL DISTRIBUTION GAS MAINS AND SERVICE LINES SHALL HAVE A PREFERRED **PARALLEL** FINAL CLEARANCE OF NOT LESS THAN 12" FROM ANY RUD SUBSURFACE STRUCTURE NOT DIRECTLY ASSOCIATED WITH THE GAS MAIN. WHERE THE 12" CLEARANCE CAN NOT BE MET, A MINIMUM CLEARANCE OF 4" SHALL BE MAINTAINED. FOR CLEARANCES LESS THAN 12", THE GAS LINE SHALL BE PROTECTED FROM POSSIBLE DAMAGE WHICH MAY RESULT FROM THE PROXIMITY TO THE OTHER STRUCTURE USING FIBERGLASS PIPE SHIELD SPACERS.
- G. ALL DISTRIBUTION GAS MAINS AND SERVICE LINES SHALL HAVE A PREFERRED FINAL CLEARANCE OF 6" FROM ALL SUBSURFACE FACILITIES **CROSSING** THE GAS FACILITIES. WHERE THE 6" CAN NOT BE MET, A MINIMUM OF CLEARANCE OF 4" SHALL BE MAINTAINED. FOR CLEARANCES LESS THAN 6" THE GAS LINE SHALL BE PROTECTED FROM POSSIBLE DAMAGE WHICH MAY RESULT FROM THE PROXIMITY TO THE OTHER STRUCTURE USING FIBERGLASS PIPE SHIELD SPACERS.
- H. GAS SERVICE PIPES SHALL NOT BE USED AS A GROUNDING ELECTRODE. WIRES INTENDED TO BE USED FOR BONDING SHALL NOT BE PLACED IN CONTACT WITH ANY GAS SERVICE.
- I. GROUNDING SHALL BE IN ACCORDANCE WITH THE APPLICABLE SECTIONS OF ARTICLE 250 OF THE NATIONAL ELECTRIC CODE. GROUND CONDUCTOR SIZING SHALL BE IN CONFORMANCE WITH SECTION 250-94 OF THE NATIONAL ELECTRIC CODE.
- J. CONDUIT SHALL EITHER BE RIGID GALVANIZED STEEL OR SCHEDULE 80 POLYVINYL CHLORIDE(PVC)
- K. A MINIMUM OF FOUR FOOT HORIZONTAL CLEARANCE FROM FLOOR TO CEILING SHALL BE MAINTAINED IN FRONT OF THE METER ENCLOSURE FOR SAFE ACCESS.
- L. IN ADDITION TO COMPANY REQUIREMENTS, INSTALLATION MAY BE SUBJECT TO THE APPROVAL OF A CERTIFIED INSPECTION AGENCY AS WELL AS LOCAL MUNICIPALITIES.
- M. A MINIMUM HORIZONTAL SEPARATION OF 1'-0" MUST BE MAINTAINED BETWEEN THE ABOVE GRADE GAS AND ELECTRIC SERVICE FACILITIES OR STRUCTURES.
- N. SEPARATION OF GAS SERVICE PIPE OR TUBING AND ALL OTHER UNDERGROUND FACILITIES OR STRUCTURES SHALL BE MAINTAINED IN ACCORDANCE WITH APPROPRIATE CONSTRUCTION STANDARDS.
- O. NO ELECTRIC METER ENCLOSURE SHALL BE INSTALLED DIRECTLY ABOVE THE GAS METER.
- P. NO PROTECTION BOLLARDS SHALL BE PLACED IN FRONT OF THE ELECTRIC METER.
- Q. GAS REGULATOR VENTS SHALL BE A MINIMUM HORIZONTAL DISTANCE OF 1'-0" FROM THE NEAREST PART OF THE ELECTRIC METER INSTALLATION.

	FIBERGLASS REINFORCED (FRP) SPACERS	2" 4" 6" 8" 12" 9341930 00301096 ONM 00301099 ONM 9340227 9340228
No.	ITEM	CODE No.
BILL OF MATERIAL		

# LOCATION AND CLEARANCES FOR ELECTRIC AND GAS METERS

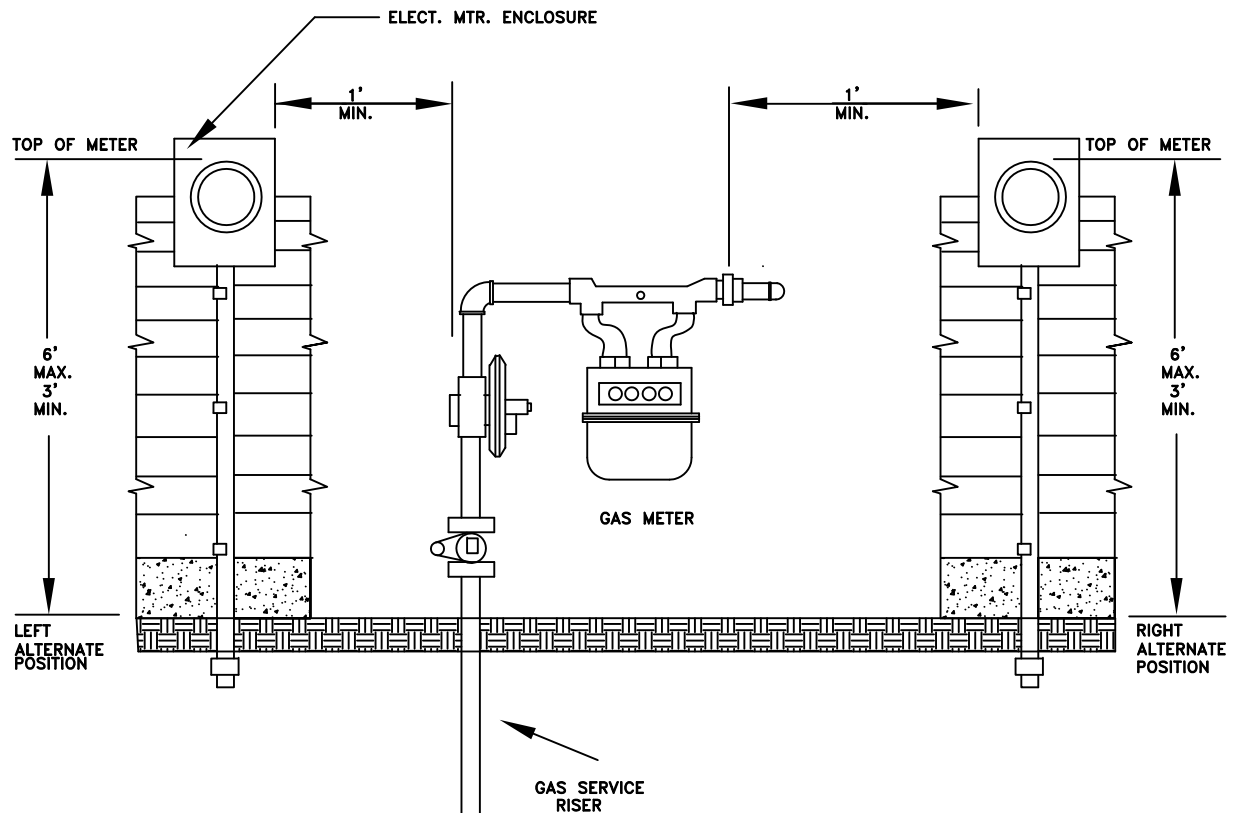

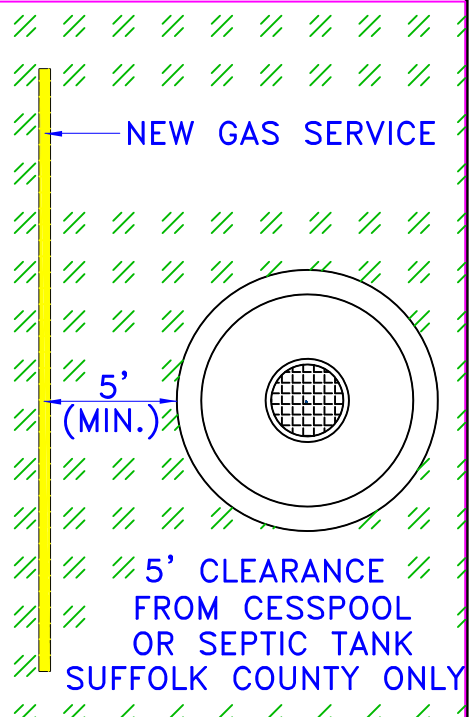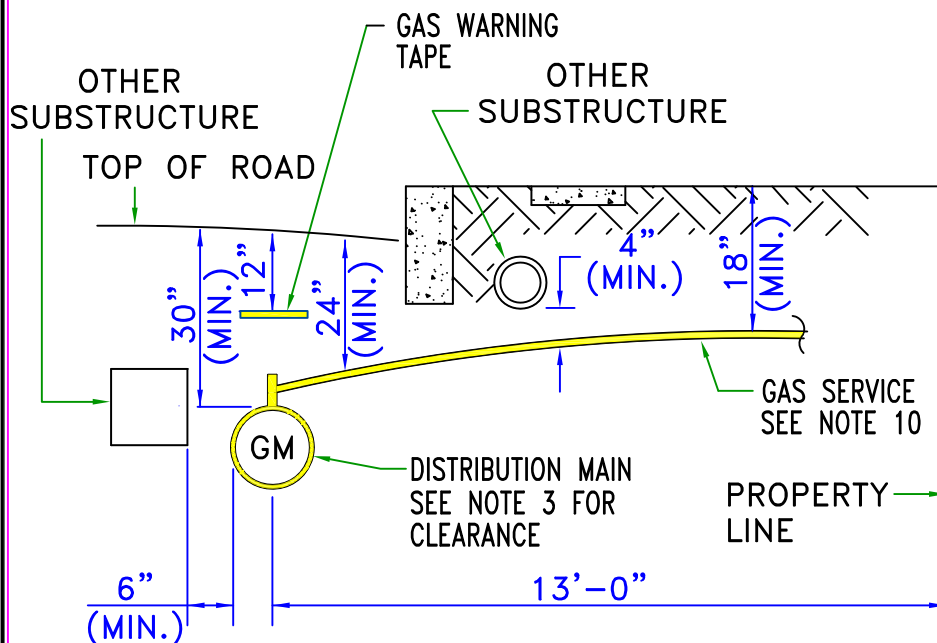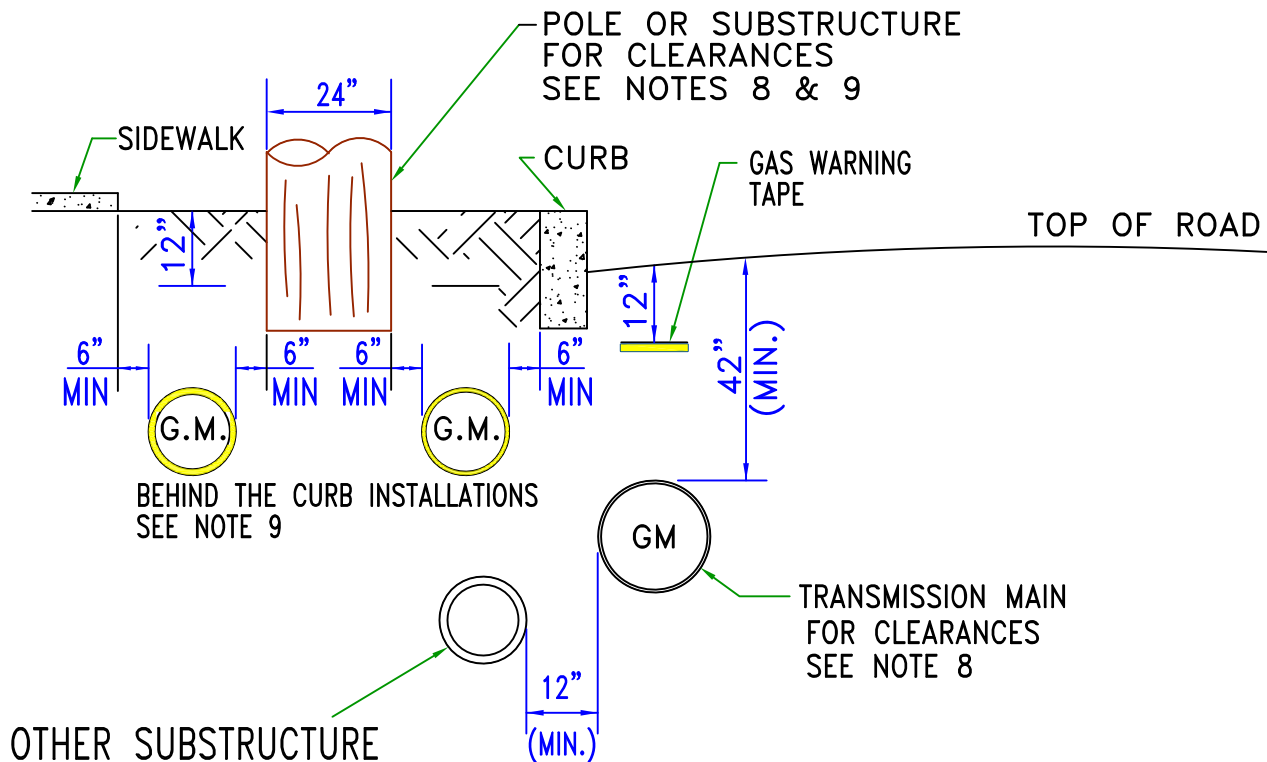

**nationalgrid**

LONG ISLAND

**MAINS / SERVICES: PLACEMENT  
DEPTH OF COVER AND CLEARANCES  
GAS MAINS AND SERVICES**

**REVISIONS:** UPDATE SAP ID NUMBERS

DATE: 07/01/2003

EFFECTIVE DATE: 12/15/2017

DESIGN: AHC

STD. DWG.

DRAWN: AHC

NO.

**CNST-6025**

## NOTES

1. THIS CONSTRUCTION STANDARD SETS FORTH THE MINIMUM COVER AND CLEARANCE REQUIREMENTS FOR GAS TRANSMISSION, DISTRIBUTION AND SERVICE PIPING.

2. ALL GAS FACILITIES SHALL BE INSTALLED WITH THE FOLLOWING MINIMUM COVER:

TRANSMISSION MAINS	42"
DISTRIBUTION MAINS	30"
SERVICES ON PUBLIC ROADS	24"
SERVICES ON PRIVATE PROPERTY	18"

(a) WARNING TAPE (ITEM 9341904) SHALL BE INSTALLED APPROXIMATELY ONE (1) FOOT BELOW GRADE ABOVE THE MAIN OR SERVICE ON ALL OPEN TRENCHES.

3. ONLY WHERE AN UNDERGROUND STRUCTURE PREVENTS THE INSTALLATION OF GAS FACILITIES WITH THIS MINIMUM COVER MAY IT BE REDUCED TO THE FOLLOWING EXCEPTION:

TRANSMISSION MAINS	36"
DISTRIBUTION MAINS	24"
SERVICES	18"

4. LESS COVER THAN THE EXCEPTION SPECIFIED IN NOTE 3 ABOVE IS NOT PERMITTED UNLESS THE FOLLOWING IS APPLIED:

- (a) TRANSMISSION MAINS: GAS ENGINEERING HAS APPROVED ADDITIONAL PROTECTION TO WITHSTAND THE ANTICIPATED EXTERNAL LOADS.
- (b) DISTRIBUTION MAINS: WHERE AN EXISTING MAIN IS BEING TUBED/INSERTED AND THE OPEN SECTIONS ARE PROPERLY BRIDGED WITH A SLEEVE, THE DEPTH OF COVER MAY BE 18". THE ENDS OF THE NEW MAIN THAT EXIT AND ENTER THE EXISTING GAS MAIN (SLEEVE) SHALL ALSO HAVE END SEALS INSTALLED TO PROTECT THE MAINS
- (c) SERVICES: A NEW SERVICE MAY BE INSERTED INTO AN EXISTING SERVICE AT ITS EXISTING DEPTH.
- (d) GAS PIPE MAY BE INSTALLED THROUGH CULVERTS, LEACHING FIELDS AND CATCH BASINS, PROVIDED THE CARRIER PIPE IS INSTALLED IN A SLEEVE.

5. ALL GAS PIPING THAT IS TO BE INSTALLED ON LAND THAT HAS BEEN FARMED AT ANY TIME, OR IN A NAVIGABLE RIVER, STREAM OR HARBOR, OR WILL BE SUSPENDED FROM ANY BRIDGE SHALL BE REVIEWED AND APPROVED BY GAS ENGINEERING.

6. PLASTIC PIPE SHALL NEVER BE INSTALLED ABOVE GROUND.

7. FOR CASING AND VENT REQUIREMENTS FOR MAINS AND SERVICES REFER TO MAIN-6060.

8. ALL TRANSMISSION MAINS SHALL BE INSTALLED WITH A MINIMUM CLEARANCE OF 12" FROM ANY OTHER SUBSTRUCTURE NOT ASSOCIATED WITH THE MAIN. WHEN THIS CLEARANCE CANNOT BE OBTAINED, CONTACT GAS ENGINEERING FOR ADDITIONAL REQUIREMENTS. AT NO TIME SHALL THE CLEARANCE BE LESS THAN 4".

9. ALL DISTRIBUTION MAINS SHALL BE INSTALLED WITH A MINIMUM CLEARANCE OF 6" FROM ANY OTHER SUBSTRUCTURE NOT ASSOCIATED WITH THE MAIN. FOR ADDITIONAL INFORMATION SEE "PLACEMENT OF GAS DISTRIBUTION FACILITIES IN ROAD AND SIDEWALK AREAS AND CLEARANCES FROM OTHER SUBSURFACE STRUCTURES" SERVICE INSTALLATIONS REQUIRE A 4" MINIMUM CLEARANCE. WHEN THIS CLEARANCE CANNOT BE OBTAINED. FIBERGLASS PIPE SHIELD (4" 120 DEG, ITEM ID 9341931; 6" 120 DEG, ITEM ID 9341932; 8" 240 DEG, ITEM ID 9340227; 8" 120 DEG, ITEM ID 9341933; 12" 120 DEG, 9341954; 12" 240 DEG, 9340228), A PLASTIC SLEEVE, ROCKSHIELD (ITEM ID 9340226), TARA SHIELD, CUT BUCKET LINERS, OTHER APPROVED MATERIAL SHALL BE USED TO PROTECT THE MAIN AND ITS COATING FROM DAMAGE OR ELECTRICAL CONTINUITY. AT NO TIME SHALL THE CLEARANCE BE LESS THAN 4".

10. GAS WARNING TAPE SHALL BE INSTALLED 12" BELOW GRADE, ABOVE THE MAIN & SERVICE ON ALL OPEN TRENCHING.

11. IN SUFFOLK COUNTY, ALL NEW SERVICES SHALL HAVE A MINIMUM CLEARANCE OF 5' FROM ALL CESSPOOLS OR SEPTIC TANKS.

## Below Grade (In order of Preference)

Type of Facility	<u>Required Coating Factory Applied</u>	<u>Girth Weld Joint 6" and Smaller</u>	<u>Girth Weld Joint 8" and Larger</u>	<u>Holiday's &amp; Damaged Coatings</u>	<u>Valves &amp; Large Diameter Fittings*</u>	<u>Small Diameter Fittings &amp; Services*</u>
<b><u>New Distribution &amp; Temporary Pipelines</u></b> (direct bury or bores/missile)	PE Coating (40 mils minimum)	1. Cold Applied Tape 2. Shrink Sleeves 3. Wax Tape (wet conditions)	1. Shrink Sleeves 2. Cold Applied Tape 3. Wax Tape (wet conditions)	1. Cold Applied Tape 2. Repair Patch 3. Wax Tape (wet conditions)	1. Wax Tape 2. Cold Applied Tape	1. Moldable Tape 2. Cold Applied
<b><u>New Transmission</u></b>	Fusion Bonded Epoxy 16 mils minimum <b>or</b> PE Coating – 40 mils minimum	Two Part Epoxy <b>or</b> 1. Cold Applied Tape 2. Shrink Sleeves 3. Wax Tape (wet conditions)	Two Part Epoxy <b>or</b> 1. Shrink Sleeves 2. Cold Applied Tape 3. Wax Tape (wet conditions)	Two Part Epoxy <b>or</b> 1. Cold Applied Tape 2. Wax Tape (wet conditions)	Two Part Epoxy <b>or</b> 1. Cold Applied Tape 2. Wax Tape (for Valves)	Two Part Epoxy <b>or</b> 1. Moldable Tape 2. Cold Applied
<b><u>Directional Drill</u></b>	FBE 16 mils minimum plus minimum of 40 mils of Abrasion resistant Epoxy	1. Abrasion Resistant Epoxy 2. Directional Drill Shrink Sleeve	1. Abrasion Resistant Epoxy 2. Directional Drill Shrink Sleeve	1. Abrasion Resistant Epoxy 2. Directional Drill 3. Shrink Sleeve	N/A	N/A
	PE Coating – 80 mils minimum	Direction Drill Shrink Sleeve	Direction Drill Shrink Sleeve	Direction Drill Shrink Sleeve		N/A
<b><u>Existing PE Coating</u></b>	Not Applicable – Existing	1. Cold Applied Tape 2. Shrink Sleeves 3. Wax Tape (wet conditions)	1. Shrink Sleeves 2. Cold Applied Tape 3. Wax Tape (wet conditions)	1. Cold Applied Tape 2. Wax Tape (wet conditions)	1. Wax Tape 2. Cold Applied Tape	1. Wax Tape 2. Moldable Tape
<b><u>Existing Coal Tar</u></b>	Not Applicable – Existing	Wax Tape	Wax Tape	Wax Tape	Wax Tape	Wax Tape
<b><u>Existing FBE (Fusion Bonded Epoxy)</u></b>	Not Applicable – Existing	1. Two Part Epoxy 2. Cold Applied Tape 3. Wax Tape (wet conditions)	1. Two Part Epoxy 2. Shrink Sleeves 3. Wax Tape (wet conditions)	1. Two Part Epoxy 2. Cold Applied Tape 3. Wax Tape (wet conditions)	1. Two Part Epoxy 2. Wax Tape 3. Cold Applied Tape	1. Two Part Epoxy 2. Moldable Tape 3. Wax Tape
<b><u>Existing Bare</u></b>	Not Applicable – Existing	Coat Cleaned area with Wax Tape	Coat Cleaned area with Wax Tape	Coat Cleaned area with Wax Tape	Coat Cleaned area with Wax Tape	Coat Cleaned area with Wax Tape
<b><u>Key Hole/Coring Technology</u></b>	Not Applicable – Existing	1. Wax Tape Patch 2. Mastic	1. Wax Tape Patch 2. Mastic	1. Wax Tape Patch 2. Mastic	1. Wax Tape Patch 2. Mastic	1. Wax Tape Patch 2. Mastic

\* Factory applied shop primer shall be considered bare and must be field coated.

\* Epoxy coated fittings shall have damaged coating repaired.

\* Surface Preparation shall be completed per manufacturer's instructions and COR02001.

**nationalgrid**

ALL REGIONS

### Facility Coating Guide

REVISIONS:

Removed RI items, 9386395 extended to all regions, 9325566  
added and extended to all regions

DATE: 04/15/ 2010

DESIGN: CS

APPROVED: PS

EFFECTIVE DATE: 01/22/2024

STD. DWG.

Pg 1 of 3

**030031-CS**

### Above Grade ( In order of Preference)

Type of Facility	<u>Required Coating</u>	<u>Joints 6" and Smaller</u>	<u>Joints 8" and Larger</u>	<u>Holiday's &amp; Damaged Coatings</u>	<u>Valves &amp; Large Diameter Fittings*</u>	<u>Small Diameter Fittings &amp; Services*</u>	<u>Meter Piping</u>
<b>New Bare</b> (plant, regulator, pits, facility)	1. Epoxy 2. Rust Protective Enamel	1. Epoxy 2. Rust Protective Enamel	1. Epoxy 2. Rust Protective Enamel	1. Epoxy 2. Rust Protective Enamel	1. Epoxy 2. Rust Protective Enamel	1. Epoxy 2. Rust Protective Enamel	1. Epoxy 2. Rust Protective Enamel
<b>New Bridges, Culverts &amp; Temporary Pipelines</b>	1. FBE 16 mils minimum plus minimum of 25 mils of Abrasion resistant Epoxy 2. PE Coating – 65 mils minimum	1. Epoxy 2. Shrink Sleeves 3. Cold Applied Tape 4. #2 or #2A Wax Tape	1. Epoxy 2. Shrink Sleeves 3. Cold Applied Tape 4. #2 or #2A Wax Tape	1. Epoxy 2. Shrink Sleeves 3. Cold Applied Tape 4. #2 or #2A Wax Tape	1. Epoxy 2. #2 or #2A Wax Tape 3. Cold Applied Tape	1. Epoxy 2. #2 or #2A Wax Tape 3. Cold Applied Tape	N/A
<b>Transition Zone (New and Existing)</b>	1. Cold Applied Tape 2. #2 or #2A Wax Tape (Apply minimum 3" over sound coating)	N/A	N/A	1. Cold Applied Tape 2. #2 or #2A Wax Tape (Apply minimum 3" over sound coating)	N/A	1. Cold Applied Tape 2. #2 or #2A Wax Tape (Apply minimum 3" over sound coating)	1. Cold Applied Tape 2. #2 or #2A Wax Tape (Apply minimum 3" over sound coating)
<b>Existing PE Coating</b>	Not Applicable – Existing PE coated	1. Shrink Sleeves 2. Cold Applied Tape 3. #2 or #2A Wax Tape	1. Shrink Sleeves 2. Cold Applied Tape 3. #2 or #2A Wax Tape	1. Shrink Sleeves 2. Cold Applied Tape 3. #2 or #2A Wax Tape	1. Epoxy 2. Rust Protective Enamel 3. #2 or #2A Wax Tape	1. Epoxy 2. Rust Protective Enamel 3. #2 or #2A Wax Tape	1. Rust Protective Enamel 2. #2 or #2A Wax Tape 3. Epoxy
<b>Existing Coal Tar</b>	Not Applicable – Existing Coal Tar Coated	#2 or #2A Wax Tape	#2 or #2A Wax Tape	#2 or #2A Wax Tape	n/a	n/a	1. Rust Protective Enamel 2. #2 or #2A Wax Tape
<b>Existing Abrasion resistant Epoxy with Fusion Bonded Epoxy</b>	Not Applicable – Existing FBE coated	1. Epoxy 2. Cold Applied Tape 3. #2 or #2A Wax Tape	1. Epoxy 2. Shrink Sleeves 3. Cold Applied Tape 4. #2 or #2A Wax Tape	1. Epoxy 2. Cold Applied Tape 3. #2 or #2A Wax Tape	1. Epoxy 2. Rust Protective Enamel 3. #2 or #2A Wax Tape	1. Epoxy 2. Rust Protective Enamel 3. #2 or #2A Wax Tape	1. Epoxy 2. Rust Protective Enamel 3. #2 or #2A Wax Tape
<b>Existing Wax Tape</b>	n/a	#2 or #2A Wax Tape	#2 or #2A Wax Tape	#2 or #2A Wax Tape	#2 or #2A Wax Tape	#2 or #2A Wax Tape	#2 or #2A Wax Tape
<b>Existing Paint</b> (regulator, pit)	n/a	1. Epoxy 2. #2 or #2A Wax Tape	1. Epoxy 2. #2 or #2A Wax Tape	1. Epoxy 2. #2 or #2A Wax Tape	1. Epoxy 2. #2 or #2A Wax Tape	1. Epoxy 2. #2 or #2A Wax Tape	1. Epoxy 2. #2 or #2A Wax Tape
<b>Existing Paint</b> (non regulator pit)	n/a	1. Rust Protective Enamel 2. #2 or #2A Wax Tape 3. Epoxy	1. Rust Protective Enamel 2. #2 or #2A Wax Tape 3. Epoxy	1. Rust Protective Enamel 2. #2 or #2A Wax Tape 3. Epoxy	1. Rust Protective Enamel 2. #2 or #2A Wax Tape 3. Epoxy	1. Rust Protective Enamel 2. #2 or #2A Wax Tape 3. Epoxy	1. Rust Protective Enamel 2. #2 or #2A Wax Tape 3. Epoxy

\* Factory applied shop primer shall be considered bare and must be field coated.

\* Epoxy coated fittings shall have damaged coating repaired.

\* Surface Preparation shall be completed per manufacturer's instructions and COR02001.



## Material List \*

### Coating Systems for New Construction and Maintenance

\* All materials must be approved by Corrosion Control Section of System Integrity and Materials and Standards section of Standards and Policies

#### Cold Applied Tape, Primer & Repair Pads

DESCRIPTION	Downstate NY Item I.D.	Upstate NY Item I.D.	New England Item I.D.	MATERIAL NOTES
Primer	9384297	<a href="#">9384297</a>	9384297	Gallon, Above/Below Grade
2" moldable Tape	9384295	<a href="#">9384295</a>	9384295	25 ft roll, Below Grade
2" Tape	9315630	9315630	9315630	75 f t roll, Above/Below Grade
4" Tape	9315629	9315629	9315629	75 f t roll, Above/Below Grade
6" Tape	9314898	9314898	9314898	75 f t roll, Above/Below Grade
Repair Patch	9308094	9308094	9308094	6" x 6" Pad, Below Grade

#### Wax Tape

DESCRIPTION	Downstate NY Item I.D.	Upstate NY Item I.D.	New England Item I.D.	MATERIAL NOTES
#1 Primer	9314352	9314352	9314352	Gallon, Below Grade
#2a Primer (white)	9332480	9314354	9332480	Gallon, Above Grade, Temp-Coat 3000
<a href="#">#2 Primer (brown)</a>	<a href="#">Non-Stock</a>	<a href="#">Non-Stock</a>	<a href="#">Non-Stock</a>	<a href="#">Gallon, Above Grade</a>
#1 tape (brown) 4" in NYC/LI/MA: 6" in RI	4" 9341928	6" 9314336	4" 9341928	9 ft roll, Below Grade
#2a tape (grey) 4" in NYC/LI/MA: 6" in RI	4" 9341927	6" 9314335	4" 9341927	9 ft roll, Above Grade
<a href="#">#2 tape (brown)</a>	<a href="#">Non-Stock</a>	<a href="#">Non-Stock</a>	<a href="#">Non-Stock</a>	<a href="#">Above Grade</a>
6" Overwrap	9386395	<a href="#">9386395</a>	<a href="#">9386395</a>	50 ft roll, Below Grade
<a href="#">20" Overwrap</a>	<a href="#">9325566</a>	<a href="#">9325566</a>	<a href="#">9325566</a>	<a href="#">1000 ft roll, Below Grade</a>

#### Rust Protective Enamel

DESCRIPTION	Downstate NY Item I.D.	Upstate NY Item I.D.	New England Item I.D.	MATERIAL NOTES
Brush-on Enamel Above Grade ONLY	9324504	9314485	9324504	Gallon, Grey
Aerosol	9325991	Non-Stock	9325991	Aerosol, Above Grade

#### Epoxy Brush Applied

DESCRIPTION	Downstate NY Item I.D.	Upstate NY Item I.D.	New England Item I.D.	MATERIAL NOTES
FBE Touch-up Epoxy	Non-Stock	Non-Stock	Non-Stock	Below Grade Only R95 or equivalent
2-Part Epoxy (Below Grade ONLY, abrasion resistant)	Non-Stock	Non-Stock	Non-Stock	Below Grade R95 or equivalent
2-Part Epoxy (Above Grade ONLY)	<a href="#">9390147</a>	<a href="#">9390147</a>	<a href="#">9390147</a>	Above Grade Only <a href="#">Approved 2-part epoxy</a>

#### KeyHole Coating

DESCRIPTION	Downstate NY Item I.D.	Upstate NY Item I.D.	New England Item I.D.	MATERIAL NOTES
Keyhole Patch Pad	Non-Stock	Non-Stock	Non-Stock	Purchase from UPSCO
Keyhole Applicator Tool	Non-Stock	Non-Stock	Non-Stock	Purchase from UPSCO
Keyhole Finishing Tool	Non-Stock	Non-Stock	Non-Stock	Purchase from UPSCO
Mastic, Brush Applied	Non-Stock	Non-Stock	Non-Stock	TC Mastic (Tapecoat)



**INSTALLATION NOTES**

- A. GALVANIZED PIPE AND FITTINGS ARE THE PREFERRED MATERIALS OF CHOICE.
- B. WHERE VEHICLE TRAFFIC IS A CONCERN, PROTECTION POSTS ARE REQUIRED. REFER TO APPROVED NATIONAL GRID PROTECTION POST STANDARDS [MTRS6060](#).
- C. FOR METER AND REGULATOR LOCATIONS SEE [020013-CS](#)

**BILL OF MATERIAL**

ITEM	DESCRIPTION	ITEM I.D.	QTY	MATERIAL NOTES
1	VALVE – 2" PLUG NODSTROM FIG 143 FLANGED	9341980	1 OR	FOR 2" FLANGED RISERS
1A	VALVE PLUG – NORDSTROM THREADED	9341953	1	FOR 2" THREADED RISERS
2	FLANGE 2" THREADED FLAT FACE PER ASTM A-105	CUSTOMER	4	(6 IF USING THREADED VALVES)
3	GASKETS – 2" RING TYPE – FLEXITALLIC SIGMA 588	9341161	1	
4	BOLTS STUD – 5/8" X 4" W/2H HEX NUT – GRADE B7	9392186	8	
5	PIPE SUPPORTS	CUSTOMER	1	
6	ELBOW 2" THREADED 90 DEGREE – GALVANIZED	CUSTOMER	1	
7	INSULATING FLANGE KIT 2"	9312579	1	
8	<b>-REGULATOR FISHER CS-806 1/2" ORIFICE 100 PSIG MAX</b>	9386777	1 OR	3,000 SCFH MAX, USE 3/8" ORIF. FOR 124#
	<b>-REGULATOR FISHER CS-400 7/32"X1/4" ORIFICE 60 PSIG</b>	9388985	1 OR	
	<b>MAX FOR LOADS UP TO 1,400 SCFH</b>	-		
	<b>-REGULATOR FISHER CS-400 11/64" ORIFICE FOR 99/124</b>	9388995	1 OR	
	<b>PSIG SYSTEMS FOR LOADS UP TO 2,500 SCFH</b>			
	<b>-REGULATOR ITRON B34IMRV 1/2" ORIF. 60 PSIG MAX</b>	9342684	1 OR	CHANGE ORIFICE TO 3/8" FOR 99/124 PSIG
	<b>3,000 SCFH MAX</b>			
9	METER 8C - 3M TEMPERATURE CORRECTED			
10	COUPLING 2" LOCK TYPE DRESSER STYLE 711	CUSTOMER	1	
11	VALVE – LOCKWING AY MCDONALD 560G - GALVANIZED	CUSTOMER	2	
12	PLUG 3/4" SOLID STEEL	CUSTOMER	1	
13	METER PAD 5' LONG X 4' WIDE X 6" THICK	CUSTOMER	1	
14	VALVE 2" FLANGED OR PLUG	CUSTOMER	1	
15	NIPPLE 2" FLANGED X 2" THREADED	9383856	1	
16	CAP SCREWS FOR METER 5/8" X 1.5" LONG	9304789	8	
17	NIPPLE 2" SCH. 40 GALVANIZED	CUSTOMER	A/R	
18	GASKETS – 2" FULL FACE – FLEXITALLIC SIGMA 588	CUSTOMER	2	
19	BOLTS MACHINE – 5/8" X 2-3/4" LONG W/2H NUT – B7	CUSTOMER	8	
20	UNION GALVANIZED	CUSTOMER	1	
21	HEEL TEE 2" X 3/4" GALVANIZED	CUSTOMER	2	

**A/R – AS REQUIRED****BILL OF MATERIAL**

# APPENDIX K

## **LINKS TO VARIOUS MANUFACTURES:**

### **HEATING MANUFACTURERS**

[AMERICAN STANDARD](#)

[AO SMITH](#)

[BAXI BOILERS](#)

[BOSCH](#)

[BUDERUS](#)

[BURNHAM](#)

[CARLIN](#)

[CARRIER](#)

[EMERSON](#)

[HONEYWELL CONTROLS](#)

[MIDCO ECONOMITE](#)

[MODINE](#)

[PEERLESS BOILERS](#)

[POWER FLAME BURNERS](#)

[REZNOR UNIT HEATERS](#)

[RHEEM](#)

[SLANT FIN](#)

[TAKAGI](#)

[TECHTANIUM](#)

[TRANE](#)

[TRIANGLE TUBE BOILERS](#)

[TURBO MAX](#)

[UTICA BOILERS](#)

[WALLHUNG BOILERS](#)

[WEIL-MCLAIN](#)

### **CSST MANUFACTURERS**

[GASTITE](#)

[OMEGAFLEX TRAC PIPE COUNTER STRIKE](#)

[WARDFLEX](#)

# APPENDIX L

## **ODOR FADE:**

There are some important safety precautions that should be taken when working on or near natural gas equipment:

Natural Gas, which is mainly composed from methane, is odorless. Mercaptan used as an odorant, has a distinct rotten egg smell (mercaptan contains sulfur, carbon and hydrogen) and is added to natural gas to assist in the detection of leaks. Sometimes the odorant may not be detected by smell alone. Certain conditions may cause the odor to fade, to the point where it is no longer readily detectable. Odor fade occurs when the odorant in the gas is reduced due to physical and/or chemical processes including adsorption, absorption, and oxidation. Odor fade predominantly occurs with newly installed metal piping, but it can also occur with plastic piping.

Odor fade is a serious concern, because if present, a gas leak would not be able to be detected through the smell of mercaptan.

Other factors that may cause odor fade include the size, length, and configuration of piping; the presence of rust, moisture, liquids or other substances in the pipe during storage and the construction process; gas composition, pressure, and/or flow. Intermittent, little or no flow over an extended period of time may also result in the loss of odorant until gas flow increases or becomes more frequent. These factors need to be considered in the design and construction of gas piping.

While Con Edison will provide adequate odorant up to the gas meter(s) outlet(s), it is the customer's responsibility to ensure odorant up to the end-use equipment. Some things to consider, in order to avoid odor fade, are:

- Installation of equipment that will provide a consistent demand for gas use, particularly in high-rise and larger buildings.
- Use of a consultant experienced in odor fade to provide additional support and guidance on eliminating odor fade.
- Not allowing cutting oil to enter the ID of the pipe during the cutting and threading process.
- Not using excessive pipe dope that can work its way into the ID of the pipe.

### ***Requirements prior to Gassing In.***

***Buildings in excess of 9 stories and or greater than 25,000 square footage and those that have seasonal occupancy are required to adhere to the following conditions prior to gassing in after Gas Authorization has been received***

***Protect and New – Piping to be installed is to be new and protected from foreign material***

***Blowdown- Piping is to be blown clean from any foreign material and debris***

***Purge with Nitrogen – As required by the NYC FGC Section 406***

***Pickle – If Odor Fade is suspected or the building meets the criteria described above then the house piping must be pickled by a professional contractor and in line with the appropriate Building Code requirements. Check with the local AHJ on permit requirements***

***It is recommended that the design of risers seeing minimal natural gas flow incorporate an approved and permitted constant burn appliance at the end to induce flow in otherwise low flow risers.***

When working with Natural Gas the following should be followed:

Customer \_\_\_\_\_ Address \_\_\_\_\_

Account # \_\_\_\_\_

Meter # \_\_\_\_\_ Unlock Index \_\_\_\_\_ Size Code \_\_\_\_\_ Unlock Date \_\_\_\_\_

Does the T.C. meter supply any straight gas equipment? Yes \_\_\_\_\_ No \_\_\_\_\_

If yes, list equipment; inputs and if interlocked \_\_\_\_\_

Gas Used For Heating \_\_\_\_\_ Water Heating \_\_\_\_\_ Cooking \_\_\_\_\_ Other/List \_\_\_\_\_

Service: LP \_\_\_\_\_ LP w/booster \_\_\_\_\_ HP \_\_\_\_\_

If HP, is low gas changeover control installed? Yes \_\_\_\_\_ No \_\_\_\_\_

Number of Boilers \_\_\_\_\_ Boiler # \_\_\_\_\_ Tank Size #1 \_\_\_\_\_ #2 \_\_\_\_\_ (gallons)

Boiler Manufacturer \_\_\_\_\_ Model # \_\_\_\_\_ Boiler Horse Power \_\_\_\_\_

Burner Manufacturer \_\_\_\_\_ Model # \_\_\_\_\_ Serial # \_\_\_\_\_

**Controls**

Is M2M installed and operable? YES \_\_\_\_\_ NO \_\_\_\_\_ If No, why \_\_\_\_\_

Is Burner wired as per the APPROVED National Grid Electrical Prints?

YES \_\_\_\_\_ NO \_\_\_\_\_ No Prints \_\_\_\_\_

**Operation**

1. Does equipment auto switch to alternate fuel? YES \_\_\_\_\_ NO \_\_\_\_\_
2. If Semi Automatic, does alarm operate? YES \_\_\_\_\_ NO \_\_\_\_\_
3. Have all safety controls been tested? YES \_\_\_\_\_ NO \_\_\_\_\_

	Low	High	
Gas Input	_____	_____	CFH
Appliance Train Regulator Set Point	_____	_____	
Left on Gas Dual Fuel Capable	_____	_____	
Left on Gas NOT Dual Fuel Capable	_____	_____	

**Comments**

Burner Start Up Person and Installation Company: \_\_\_\_\_

Serviceperson \_\_\_\_\_ ID# \_\_\_\_\_

Signature \_\_\_\_\_ Name \_\_\_\_\_ Date \_\_\_\_\_

Update July 09



When existing gas piping has been removed from service for repairs or new piping has been installed, the affected section of piping must be cleaned<sup>1</sup> and purged with an inert gas prior to gassing in by Con Edison. All applicable safety and local codes must be followed when purging a line with an inert gas.

DO NOT purge the contents of a gas line into a confined space. Any purging of a gas line with an inert gas or natural gas should be done by venting the contents to the outside atmosphere away from potential ignition sources and people.

Always use gas detection equipment (combustible gas detector) during purging operations or when otherwise working on or around gas piping systems.

DO NOT rely on your sense of smell alone to detect the presence of natural gas.

Consult the National Fuel Gas Code (NFPA, Chapter 8), local Authority Having Jurisdiction codes, New York City Fuel Gas Code in NYC (Section 406 Inspection Testing and Purging), and all applicable laws and regulations for additional purging requirements, when purging a line with natural gas and/or an inert gas.

When installing gas appliances or equipment, the manufacturer's instruction manual should be followed in accordance with the applicable national, state, and local codes.

Please be advised that Con Edison provides this information solely as a service. You are responsible for working safely and understanding and complying with all applicable laws, regulations, and safety provisions when working on or near natural gas piping and equipment.

If an odor fade condition is suspected, call National Grid immediately at 1-800-GAS2001

Important:

- Follow safe and code compliant plumbing practices
- In NYC the purging of piping shall be in accordance with Sections NYC FGC 406.7.1 through 406.7.3

PBPP – Protect, Blowdown, Purge with Nitrogen, Pickle

---

<sup>1</sup> Follow safe and code compliant plumbing practices

**National Grid**

**Blue Book - Part 2**

**TC-2015**

**Requirements for Installation of  
Automatic Dual Fuel Burners and Equipment at  
Temperature Controlled & Temperature Interruptible (TC  
& TI) Sites**

**Blue Book - Part 2**

**TC-2015  
Requirements for Installation of  
Automatic Dual Fuel Burners and Equipment at Temperature Controlled &  
Temperature Interruptible (TC & TI) Sites  
and  
Straight Gas Utilization Equipment of 400,000 Btu/hr and Higher**

**TABLE OF CONTENTS**

<b>16.0</b>	<b>Introduction and Scope for the Installation of Automatic Dual Fuel Burners and Equipment at Temperature Controlled &amp; Temperature Interruptible (TC&amp;TI) Sites</b>
<b>17.0</b>	<b>Gas Service Metering, Piping and Available Pressures</b>
<b>18.0</b>	<b>Appliance Regulators, Gas Train Components and Gas Control Venting</b>
<b>24.0</b>	<b>Outdoor Temperature Controls</b>
<b>25.0</b>	<b>Design and Control of Automatic Changeover Circuits</b>
<b>26.0</b>	<b>Co-generation, Process and Auxiliary Equipment</b>
<b>27.0</b>	<b>Propane as the Alternate Fuel</b>
<b>29.0</b>	<b>Required Site Inspections, Burner Submittals and Start-Up</b>

## **16.0 Introduction and Scope for the Installation of Automatic Dual Fuel Burners and Equipment at Temperature Controlled & Temperature Interruptible (TC & TI) Sites**

### **16.1 Introduction**

The **Blue Book-Part 2, TC-2015** is an update of the National Grid Specification for Installation of Dual Fuel Automatic Temperature Controlled Burners and Equipment at Interruptible Sites in both New York City (Brooklyn, Staten Island, Queens) and Long Island (Nassau, Suffolk, Rockaways). Where installation requirements between New York City (NYC) and Long Island (LI) differ, the specific differences will be explained. **This document replaces and supersedes National Grid's specification TC-2005.**

Burners intended for use under the National Grid Temperature Controlled Rate (Public Service Commission Service Classification No. 6 for New York City and No. 12 for Long Island) must be factory designed and built to this specification to operate automatically via a signal from an outdoor temperature controller. The customer shall install the dual-fuel equipment necessary and at all times maintain a sufficient stand-by alternate fuel to utilize same in the event that transfer of fuel sources is required. Dual-fuel burners wired for manual (gas-off-oil) fuel changeover will not work automatically with an outdoor control and will only be accepted for this rate for facilities manned on a 24 hour per day, 7 day per week basis by personnel who are capable of switching to the alternate fuel. It should be noted that the temperature setting of the FS/AMR for "semi-automatic" control is normally set 5 degrees F higher than for automatic fuel changeover.

All territories supplied by National Grid receive natural gas of approximately 1,000Btu/Ft<sup>3</sup> and a specific gravity of 0.6 delivered from either the low pressure or high pressure system. Where high gas pressure main can be made available to supply the load and where approved by the National Grid Engineering Department, a National Grid service regulator together with other components and vent lines are required to be installed at the site. In these cases, the National Grid service regulator setting will not normally exceed 3 psig in NYC and 5 psig in LI, and is normally set lower. The final setting will depend on the firing rate and total load of the equipment at the site. Prior to proceeding with the installation of a gas service off a high pressure main or booster elevated service off a low pressure main, installers must obtain the meter regulator/header or booster layout prepared by the National Grid Engineering Area. All questions regarding available gas pressure supply and meter layouts must be referred to the National Grid Project Manager for the location involved.

Confirmation of approval that a contract is acceptable and a gas supply is available must be obtained from Gas Sales and Marketing of NYC or LI before proceeding with a sale or installation of any equipment under this rate.

**16.2 Scope**

All gas and oil utilization equipment must be installed per the manufacturer's recommendations and be built to comply with the applicable performance standard of The American National Standard Institute (ANSI). In some cases this may require that the supplied equipment be constructed and installed to standards more stringent than those contained in this specification however, the requirements of this specification must always be adhered to as the minimum standard for the equipment.

All burners, components and equipment must be listed by Underwriters Laboratory (UL), Factory Mutual (FM), IAS International (AGA,CGA) with US indicator, or other nationally recognized testing agency and by the City of New York or the local municipality having jurisdiction. Further, all boilers and pressure vessels require American Society of Mechanical Engineers (ASME) certification.

Where Factory Mutual (FM), Industrial Risk Insurers (IRI), or other carrier safety requirements govern customer's insurance coverage, these must be complied with, but in all cases the requirements of this specification must be adhered to as the minimum standard for equipment construction and installation.

All installations in NYC and LI shall comply with the most stringent and latest version of all applicable state, federal and local municipality codes, rules and regulations in addition to The Fuel Gas Code of New York State and The New York State Industrial Code Rule 4 and 14 for Construction and Installation of High and Low Pressure Boilers. Public schools must conform to the standards of the School Construction Authority (SCA). New York City installations must further comply with The National Fuel Gas Code (NFPA54, ANSI Z223.1), Department of Air Resources Engineering Criteria for Fuel Burning Equipment and the New York City Administrative Code. Long Island propane installations must be built to conform to the standards of the LP-Gas Code NFPA58 and The Fuel Gas Code of New York State.

Equipment design, construction and function must conform to the requirements of the following applicable national standards; The National Fire Protection Association (NFPA) Standard for the Installation of Oil Burning Equipment NFPA 31, The American National Standard Institute (ANSI) for Gas Utilization Equipment in Large Boilers ANSI Z83.3 or Gas Fired Low Pressure Steam and Hot Water Boilers ANSI Z21.13, Standard for Single Burner Boiler Operation NFPA85, The American Society of Mechanical Engineers (ASME) Controls and Safety Devices for Automatically Fired Boilers ASME-CSD-1, Underwriters Laboratory Commercial & Industrial Standards UL795 for gas burners and UL296 (ANSI Z96.2) for oil burners, Standard for the Installation and use of Stationary Combustion Engines and Gas Turbines NFPA37, Standard for Oven and Furnaces NFPA86.

## **17.0 Gas Service Metering, Piping and Available Pressures**

### **17.1 General**

Customer shall submit a gas load letter to the Gas Sales Area for review and processing. The load letter shall detail the manufacturer, model number, firing rate, pressure required and service classification of all equipment proposed to be installed at the site. Engineering will analyze the request to determine the impact of the additional load on the National Grid system and determine if the new load can be supplied by high pressure service, low pressure service or low pressure service with a booster.

### **17.2 Main Gas to the Burner**

Metering equipment and associated house piping for a commercial, industrial or governmental location shall be installed in accordance with The National Fuel Gas Code for NYC, The Fuel Gas Code of New York State for LI, the local municipality having jurisdiction and National Grid requirements as detailed in **The National Grid Blue Book-Part 1**. A separate meter will be supplied for the Automatic and Semi-Automatic Temperature Controlled Rate, Public Service Commission Service Classification No. 6 for New York City and No. 12 for Long Island. Only the equipment approved for this rate classification shall be supplied from the Temperature Controlled Interruptable Rate meter. For a general guide of supplied pressure according to firing rate, the design parameters listed in this section can be utilized in determining the approximate inlet pressure that will be available. In order to insure that installations will operate in a satisfactory manner, the customer's equipment must be matched to National Grid's service and metering equipment.

#### **17.2.1 Large Gas Inputs**

It should be noted that some appliance gas pressure regulators (particularly pilot-operated regulators) require substantial gas pressure for operation. National Grid will supply higher pressures above 7" w.c. as described in Section **17.3, 17.5** and Table 1, only where manufacturer's data is received to warrant the higher pressure requirement. This information includes; required burner manifold pressure, expected furnace back pressure, firing rate, model and catalog number of the appliance regulator to be used, and the pressures required before and after the appliance regulator.

<p style="text-align: center;"><b>Table 1</b></p> <p style="text-align: center;"><b>DESIGN &amp; OPERATING RANGE FOR BURNERS ON HIGH PRESSURE SYSTEM</b></p>					
<b>Firing Rate</b>	<b>Nominal Pressure Available at Inlet to Train</b>	<b>Maximum Pressure Drop In House Piping</b>	<b>Pressure Out of Meter</b>	<b>Pressure Drop in Meter</b>	<b>National Grid Regulator Max. Set Point</b>
Up To 4,500 chf	6.2" w.c.	0.3" w.c.	6.5" w.c.	0.5" w.c.	7" w.c.
4,501 cfh to 6300 cfh	11.5" w.c.	0.5" w.c.	12.0" w.c.	2.0" w.c.	14" w.c.
6,301 to 8,400 cfh	23" w.c.	3.0" w.c.	26.0" w.c.	2.0" w.c.	1 psig
8,401 to 12,000 cfh	48" w.c.	6.0" w.c.	54.0" w.c.	2.0" w.c.	2 psig
12,001 to 22,000 cfh	73" w.c.	9.0" w.c.	82.0" w.c.	2.0" w.c.	3 psig

Notes:

1. Burners over 22,000 CFH require special pressure considerations.
2. The maximum pressure drops shown are for the upper range of burner firing rates. Where burner equipment requires less pressure than specified the pressure drop in the house piping will be less.
3. These are general guidelines for equipment with the indicated firing rates. Where manufacturer's/contractor's burner and house piping requirements differ, the National Grid regulator setting will adjusted.

### 17.3 High Pressure Service

Where a high pressure gas main is available and where approved by the National Grid Engineering Department, a National Grid service regulator together with other components and vent lines is required to be installed by the customer/contractor. The National Grid service regulator setting will normally be 7" w.c. unless manufacturer's data is received to warrant higher pressure. Generally, the service regulator setting will not exceed 3 psig in NYC and 5 psig in LI and its final setting will depend on the total load at the site. In NYC where pressure of more than 3 psig is required to fire the burner, special permission must be obtained from the Commissioner of Buildings as per NYC Administrative Code Reference Standard RS-16. In LI where pressure of more than 5 psig is required to fire the burner, the requirements of the local municipality must be followed.

Before proceeding on a high pressure gas service installation, installers must obtain the meter regulator/header layout prepared by the National Grid Engineering Area. All questions regarding available gas pressure must be referred to the National Grid Project Manager for the location involved.

**17.4 Low Pressure Service**

Services off the low pressure distribution system do not require a National Grid service regulator. National Grid provides gas to customers where the meter outlet pressure measured immediately downstream of the gas meter can vary between 4" and 6" w.c. When purchasing gas utilization equipment to operate on the low pressure system it is recommended that the equipment chosen require no more than 3.5" w.c. pressure at the burner head. Also, the house piping shall be so designed for a maximum of 0.2" w.c. pressure drop in piping from the meter to the equipment. Burners being supplied off the low pressure distribution system without a booster will normally have a maximum input of 4,500 CFH.

**17.5 Gas Booster off Low Pressure Services**

Normally, burners with input requirements over 4,500 CFH and/or pressure requirements higher than 6" w.c. will require a gas booster where high pressure main is not available. Depending on the location of the site within the National Grid system an exception to booster use may be made for burner firing rates as high as 5,000 CFH where high flow gas train design and components are utilized to minimize pressure drop.

**17.5.1 General**

1. In all cases, the National Grid Engineering Area determines which system (low or high pressure mains) will provide gas for the approved load and the supply pressure. Where burners require gas pressures higher than that available on the low pressure main a gas booster may be utilized but only as provided in these specifications.
2. Only one gas booster per gas service is allowed. National Grid Engineering must approve exceptions to this.
3. The National Grid Engineering Area must review all gas booster applications, and proposed booster locations before installation.
4. Before proceeding on a booster gas service installation, installers must obtain the meter and booster switch drawing prepared by the National Grid. All questions must be referred to the National Grid for the location involved.
5. Gas boosters shall be installed according to manufactures specifications and local, State and Federal codes.



### 17.5.2 Gas Booster Wiring

1. Gas boosters shall be wired into the burner operating circuits such that they will run only when the burner is firing on gas, and shall not run during the burner off period or when the alternate fuel is being utilized. For sites with multiple burners isolating relays are required for booster control.
2. A general purpose low gas pressure switch shall be connected in series with the booster motor starter coil. In situations where the meter room is classified as a Class 1 Hazardous Area requiring explosion proof equipment, the low gas pressure switch must be located in an appropriate location outside the meter room. When this is not practical and it must be located inside the room. Additionally, if the low gas pressure switch is the only general purpose device that will be located inside the meter room, that meter room must be treated as a Class 1 Hazardous Area.
3. The National Grid low gas pressure switch is independent of the low gas pressure switch supplied on the burner gas train. If the gas booster motor stops or loses the pressure boost, the burners must shut down. The low gas pressure switch on the burner train must be adequate in range and setting to insure such burner shutdown as under firing is not permitted. Therefore all equipment supplied by a booster regardless of the firing rate must be equipped with a low gas pressure switch on the gas train (Refer to drawing CS-MET013).

### 17.5.3 Gas Booster Piping

1. The booster shall not supply pilot gas.
2. The low gas pressure switch shall be installed at the service entrance on a 1" weldolet or welded tee to accommodate the switch. National Grid does not wire or pipe this low gas pressure switch.

## 17.6 Pilot Gas Piping to the Burner

On Temperature Controlled Installations, all pilot gas is to be supplied by a Firm Rate low pressure meter. If the alternate fuel is to be ignited by direct spark ignition (see Section 21.10) or the requirement for a Firm Rate gas pilot is deemed by National Grid to be impractical, on a site specific basis, special permission may be given to take pilot gas from the Interruptable Rate gas meter.

## 18.0 Appliance Regulators, Gas Train Components and Gas Control Venting

### 18.1 General

1. The appliance and pilot regulator shall be rated for the flow and operating pressure requirements for the burner. The regulator spring is not to be bottomed-out or set too low. All such springs should regulate in the active portion of their operating characteristic curve. Regulators must be adjusted for

proper flame characteristics and smooth operation of gas burner trains for the full firing range of the burner.

2. On elevated pressure systems of over 14" w.c., all regulators must be vented outside the building to atmosphere. On services supplying 14" w.c. and less, regulators with valve bodies 1-1/4" and larger must be vented outside the building to atmosphere. Regulators with valve bodies smaller than 1-1/4" and those installed on services supplying 14" w.c. and less may be equipped with approved appliance vent limiters in lieu of outside venting. The Siemens SKP series of combination valve/regulator (with integral vent limiter) or approved equal may be utilized for their rated pressures and body sizes when installed as per this specification.
3. Pilot regulators that conform to the size and pressure limits as detailed in Item 2 above, may be installed with approved vent limiters in lieu of outside venting.
4. Vents are to be a minimum 3/4" pipe size, but in all cases shall be of sufficient size to prevent the restriction of flow due to backpressure. The Vent line from the normally open vent valve (NOVV) is not to be connected into a common header with the gas train regulator vents or other NOVVs. Gas train high and low gas pressure switch vent lines may be connected to the regulator vent lines. All appliance vents are to terminate a minimum of six feet above outside grade at least 18" laterally from any building opening, window or door and shall be equipped with weatherproof insect resistant vent caps or fittings. Vent line sizing for gas pressure regulators, in relation to length of run, shall be in accordance with Table 2, the number of 90 deg. bends should be minimized.
5. For two or more burners operating at the same service pressure, installers may manifold atmospheric vent lines into a common header. Vent lines off normally open vent valves are not to be connected to other type vent lines or manifold into a common header. Bleed lines off regulator/diaphragm gas valves are not to be manifolded into a common header. Manifolded atmospheric vent lines must be connected to a common vent line having a cross sectional area not less than the area of the largest vent plus 50 percent of the combined area of all the additional vents with allowance for length of run and fittings.
6. Vent Sizing table for regulators.

Table 2 Regulator Vent Lines	
Vent Line Size (Inches)	Maximum Length (Equivalent Feet)
3/4	40
1	80
1 1/4	150
1 1/2	225

**18.2 Normally Open Vent Valve (NOVV)**

Where a NOVW is installed between the two main gas valves, the vent valve piping must be run outside the building to atmosphere separately from the regulator vent and all other NOVW lines. Based on site conditions, it may be required for the NOVW piping to be terminated above roof level to allow better dissipation of vented gas. Vent lines for NOVW's shall be sized in accordance with UL Standard 795 (Table 3) as a minimum. Requirements of applicable insurance carriers for sizing vent lines in relation to length of run must also be adhered to.

<b>Table 3</b>	
<b>NOVV Vent Line Sizing</b>	
<b>Fuel Line Size (Inches)</b>	<b>Vent Line Size (Inches)</b>
Up to 1½	¾
2	1
2 ½	1 ¼
3	1 ¼
4	2
5	2
6	2 ½
8	3

**Sections 19.0 – 23.0 have been deleted**

## **24.0 Outdoor Temperature Controls**

### **24.1 General**

FS/AMR controller, outdoor temperature probe and stepdown transformer are supplied by National Grid and are to be installed (Refer to Drawing 1) in this section. The FS/AMR is used to automatically switch the burner to the alternate fuel or in the case where a FS/AMR is not required (Interruptible) sites will receive notification to switch to the alternate fuel. The customer is responsible to properly maintain the FS/AMR, burners and equipment at the site to be fully functional and able to change to the alternate fuel.

The outdoor control and circuit shall not be used to start-up or control auxiliaries, only National Grid controls shall be wired in this circuit

National Grid shall have sole control of adjusting and setting the outdoor changeover control. It shall be installed in a location that is accessible for inspection and calibration. The sensing element of the changeover control shall be securely mounted without touching the building surface. National Grid requires that the outdoor sensor be mounted on the north side or northerly exposure of the building. Location of the outdoor control can be determined during pre-installation site inspection.

Outdoor control sensors are not to be located below grade or in any location that would contradict or interfere with its temperature-sensing function. It shall not be located where it is exposed to direct or reflected sunlight and must be a minimum of three (3) feet above ground level and away from windows, doors, flues, vents, heating devices or openings from the heated area. It shall be located so that it will respond quickly to changes in outdoor temperature.

To obtain the FS/AMR controls, contact National Grid. Only one outdoor control is provided per boiler room or plant. Where there are two or more burners, the outdoor control circuit shall be isolated using suitable magnetic switching relays.

### **24.2 Outdoor Temperature Controller Installation**

Installation of the FS/AMR outdoor temperature control shall be in accordance with the manufacturer's instructions and NFPA70. NYC installations must comply with the New York City Electrical Code

#### **1. Mounting Controller**

- a) The FS/AMR shall be mounted indoors on a 4" square "1900" series electrical box using the two screws provided.
- b) The electrical box with controller must be mounted in a dry location, away from excessive heat or cold and be readily accessible to permit set-up of the "Digi-Span and easy viewing of the display.

2. Installing Stepdown Transformer

- a) The primary circuit for the supplied 120V/24V step-down transformer shall be connected to a separate fused burner control circuit.
- b) The transformer shall be mounted adjacent to the controller “1900” box and properly grounded.
- c) Secondary wires of the transformer are an NEC listed Class 2 circuit. Connection to the FS/AMR terminals shall be made with fork-end solderless connectors.
- d) The transformer is to be used solely for the purpose of supplying power to the FS/AMR and other National Grid equipment. It is not to be used as a power source for any customer equipment or relays.

3. Locating Sensor and Sensor Wire

- a) Sensor shall be located on the north wall. Where site conditions warrant an alternate location, the National Grid Gas Sales Project Manager shall be consulted for approval.
- b) Sensor lead provided by National Grid, may be used outdoors.
- c) The sensor wires can be extended up to 500 feet by splicing #18 gauge shielded wire to the supplied cable. The wire shield must be grounded at a single point inside the building to provide effective protection from electro-magnetic interference. For outside runs, wire suitable for outdoor locations shall be used.
- d) All sensor wire splicing shall be via mechanical means using solderless barrel connectors.
- e) The sensor wire shall be protected from mechanical damage, vandalism and must be run independent of all electric circuits.

4. Completion

- a) When the outdoor control is installed and wired-in, National Grid must be notified in order for the FS/AMR to be set , the switching over of fuels checked out, and the Digi-Span outdoor control sealed.

**24.3 Control and Monitoring of New York City Sites with the Exception of the Rockaways**

For remote control of New York City sites with the exception of the Rockaways, a Fuel Selection Module (FSM) is used. The FSM is supplied and installed by National Grid. For remote monitoring of gas usage, National Grid will install a meter reading device on the gas meter.

**24.3.1 Automatic Sites**

All automatic TC installations require the customer/contractor to install a FS/AMR unit for automatic switching of the equipment based on outside temperature. National Grid will supply drawings for the wiring and layout of this equipment. For remote control capability, National Grid will install and wire the Fuel Selection Module (FSM) into the FS/AMR control unit.

**24.3.2 Semi-Automatic Sites**

The customer must install an alarm panel and bell to signal an operator when switching of fuels is required. The panel must be wired to the FS/AMR and designed to alert plant personnel when both switching to oil is required and back to gas. National Grid will supply drawings for the wiring and layout of this equipment.

**24.4 Control and Monitoring of Long Island Sites Including the Rockaways****24.4.1 Automatic Sites**

All automatic TC installations require the customer/contractor to install a FS/AMR unit for automatic switching of the equipment based on outside temperature. Cabling connecting the FS/AMR, the 12 VDC Power Supply and the Electronic Volume Corrector (EVC) on the meter is also required to be installed by the customer. The EVC/FS/AMR interconnection wiring and a dedicated phone line will allow National Grid to override the temperature control function of the FS/AMR unit, when necessary. National Grid will supply drawings for the wiring and layout of this equipment.

1. Belden cable #8690 (or approved equivalent) is the required cable for the connection between the Digispan, the 12VDC power supply and the EVC (located on the gas meter). This is a three pair cable comprised of 18 gage, stranded conductors. This cable is to be supplied and installed by the customer/contractor. If the length of the Belden Cable will exceed 500', National Grid Engineering must be consulted for the appropriate cable or switching relays needed to be used. National Grid will terminate this cable at the FS/AMR, the power supply and the EVC.
2. The 12 VDC power supply will be supplied by National Grid. This unit must be installed near the FS/AMR and provided with a separate 120 VAC supply.
3. The customer is responsible for installation and maintenance of a dedicated telephone line for connection to the automated meter reading equipment. The telephone line will be installed to a location near the gas meter specified by National Grid.

4. Outdoor gas meters-The Belden cable and the dedicated telephone line must be installed in a  $\frac{3}{4}$ " rigid conduit to outside meter sets (including remote meter pads). A weatherproof box capable of accepting a  $\frac{1}{2}$ " fitting will be installed on the meter end of the conduit. Sufficient lengths of Belden cable and telephone line will be left coiled inside the weatherproof box to reach the EVC. National Grid will install a flexible conduit from the weatherproof box to the EVC, terminate Belden cables at the Digispan and the EVC, and terminate the dedicated telephone line at the EVC.
5. Indoor gas meters-The Belden cable and dedicated telephone line are not required to be installed in conduit. However, these cables should be secured along their routing to the gas meter location to prevent damage from routine activities in the area. Both cables should be left coiled near the gas meter

#### **24.4.2 Semi-Automatic Sites**

1. The customer must install an alarm panel and bell to signal an operator when switching of fuels is required. The panel must be wired to the FS/AMR and designed to alert plant personnel when both switching to oil is required and back to gas. For monitoring, the customer/contractor is responsible for the installation & maintenance of a dedicated telephone line for connection to the automated meter reading equipment. The telephone line will be installed to a location near the gas meter to be specified by National Grid. National Grid will supply drawings for the wiring and layout of this equipment.
2. Outdoor gas meters-The dedicated telephone line must be installed in a  $\frac{3}{4}$ " rigid conduit to outside meter sets (including remote meter pads). A weatherproof box capable of accepting a  $\frac{1}{2}$ " fitting will be installed on the meter end of the conduit. Sufficient lengths of telephone cable will be left coiled inside the weatherproof box to reach the EVC. National Grid will install a flexible conduit from the weatherproof box to the EVC and terminate the dedicated telephone line at the EVC.
3. Indoor gas meters - – The dedicated telephone line is not required to be installed in conduit. However, this cable should be secured along its routing to the gas meter location to prevent damage from routine activities in the area. The telephone cable should be left coiled near the gas meter.

### **25.0 Design and Control of Automatic Changeover Circuits**

#### **25.1 Burner Fuel Changeover Design Requirements**

The following controls are required for automatic fuel switching operation of all dual fuel burners intended for control with the FS/AMR. While the following items will effect automatic switching of fuels, they will not correct improper burner operating sequences, improper combustion characteristics, improper chimney draft or guarantee firing rates. Correct operation of fuel switching and of all these parameters must be demonstrated to

the National Grid Technician and documented during the equipment start-up. Burners for the Temperature Controlled Rate must have;

1. Proper flame safeguard controller and programmer, operating and safety features as required for the burner firing rate.
2. Cross-interlocked UL listed, industrial grade fuel changeover appliance relays wired to break and control the oil and gas operating limits, fuel valves, safety string and required equipment.
3. An individual “Auto-Off-Oil” manual selector switch with positive center off position. A switch with built-in mechanical interlock is required for positive center “Off” delay. When this switch is in the “Auto” position, the FS/AMR is in full control of the switching of fuels. When the switch is in the "Oil" position, the burner must only fire on oil. In the “Off” position the burner must not be firing on any fuel. It should be noted, that it will be required that this switch break the operating limits when in the “Off” position if the changeover relays do not provide that function.
4. Burner fuel changeover relays must be protected by individual gas and oil time delays to insure that upon switching from gas to oil or oil to gas, the burner will not simultaneous fire both fuels and will go through a post-purge and pre-purge period before firing on the new fuel. A fixed time delay of a minimum of 30 seconds for fuel changeover is required. The fuel valve relay logic shall be so designed such that upon fuel switching, the main valves of the alternate fuel are not energized prior to the opening of the burner operating limit and initiation of post-purge. For manual burners the “Auto-Off-Oil” fuel selector switch is to provide these switching functions.

## **25.2 Control Panel and Wiring**

1. The control system shall be furnished in a pre-wired, pre-tested control cabinet and shall contain all the necessary circuit protection, motor starters, switches, combustion safety controls, transformers and relays. The cabinet shall meet the NEMA rating for the area in which it is installed.
2. All wiring is to be color coded and/or numbered and of sufficient gauge to carry the designed load.
3. Fuel transfer relays and fixed time delays shall be provided to accomplish the automatic switching of fuels. These relays are to be activated by the automatic outdoor changeover control. UL listed, industrial grade appliance relays with tinned switching contacts are to be used for this purpose.
4. Two switches are to be provided for all automatic and semi-automatic changeover burners:
  - a) Burner “On-Off” switch to remove power from the operating limit



- b) “Auto-Off-Oil” fuel selector switch wired to open the operating limit circuit when in the “Off” position. A switch with built-in mechanical interlock is required for positive center “Off” delay.
- 5. Marked panel terminals shall be provided on the burner for wiring of the 120VAC switching contacts of the FS/AMR outdoor control.

### **25.3 Master Control of Two or more Burners**

Only one outdoor control is installed in each boiler room. For control of two or more burners the outdoor control must be electrically isolated from the burner control circuits, no burner interlocks are to be wired into this circuit. This isolation is accomplished by using a magnetic switching relay as the master control switch for the automatic burners and equipment at the site.

## **26.0 Co-generation, Process and Auxiliary Equipment**

### **26.1 Co-generation Equipment**

Co-generation equipment, such as prime movers, may be the only equipment wired off the outdoor control, or they may serve as auxiliaries to a boiler of a large dual-fuel installation. The prime movers may change fuels automatically, or the changeover may be done manually by plant operators at sites manned 24 hours/day and 7 days/week. Interlocking with the outdoor control is different, in these cases:

1. Where the Prime mover is the only equipment wired off the outdoor control, its control circuit must be integrated into the outdoor control for automatic fuel changeover. If the changeover is manual, then the outdoor control activates a changeover alarm and panel light.
2. Where Prime movers have manual fuel changeover and serve as auxiliary equipment in a boiler installation with automatic fuel change over them require a separate outdoor control. This second outdoor control is set at a higher temperature than the one serving the boilers.

#### **26.1.1 Low Gas Pressure Switch**

1. Prime Movers Supplied from Low Pressure Mains: A low gas pressure switch shall be installed upstream of the appliance regulator. Switch shall be wired so as to interrupt the prime mover in case of a low gas pressure condition.
2. Prime Movers Supplied From Boosted Lines: A low gas pressure switch shall be installed in the boosted line, and interlocked in series with other gas booster/prime mover safeties so as to interrupt the prime mover in case of a low gas pressure condition. This switch is in addition to the National Grid supplied low gas pressure switch installed at the service entrance.

## **26.2 Hot Water Heaters**

### **26.2.1 Summer Water Heaters**

1. Such hot water heaters may have straight-gas burners or dual-fuel burners but require 120 volt control.
2. Where the boiler supplies hot water in winter only an alternate gas-fired water heater for summer use may be taken off the Temperature Controlled Rate gas meter provided gas flow can be correctly registered. The settings and hand valve operation of existing hot water supply systems remain the responsibility of the building's superintendent.
3. Summer water heater controls shall be interlocked electrically with the heating boiler using a multi-pole, double-throw manual switch, wired into the burner limit circuits such that either the boiler is on, or the summer heater is on not both simultaneously.
4. On existing Temperature Controlled Rate sites water heaters are not to be added to the gas line without permission by National Grid. Consult National Grid Project.

### **26.2.2 Water Heaters with Dual Fuel Burners**

1. If the water heater is for summer use only, then the requirements of Section **26.2.1** for straight gas burners apply.
2. Where the water heater is for year-round use it must be wired and tooled for automatic fuel changeover with the proper programmer and the burner circuit interlocked with the outdoor temperature control.
3. The burners and gas train equipment are to be compatible with the existing boiler gas supply pressures, or the installer must provide suitable protection.

### **26.2.3 Straight Gas Fired Water Heaters of 75,000 Btu/Hr or Less**

1. Burners that do not require electrical power for operating and control shall be fitted with a suitable valve locking device or lockable gas cock.
2. Small Type I gas water heaters (75,000 Btu/Hr. or less) are permitted only when the gas flow can be correctly registered on the Temperature Controlled Rate meter.
3. Water heaters having standard gas trains certified for 14" w.c. maximum, must not be connected to gas supply piping operating at higher pressure unless suitable protection such as a lock-up regulator is provided.
4. Pilot gas for the water heater must be taken off a firm rate supply line.

**26.3 Miscellaneous Process Equipment**

1. All packaged boilers intended for automatic fuel changeover are required to conform to the requirements of this specification. Equipment will not be accepted for automatic changeover where the fuel connections must be broken or burners must be swung in and out by plant operators.
2. Where it is impractical to change fuels automatically, packaged boilers may operate on a "semi-automatic" fuel changeover basis with the approval of National Grid. This written approval requires that the customer sign a "semi-automatic" agreement. In this case, the outdoor control will operate a light and sound an alarm alerting plant operators to change fuels manually. The alarm must sound when changing over from either fuel and be manually reset by the operator. It should be noted that the temperature setting of the FS/AMR for "semi-automatic" control would normally be set 5 degrees F higher than for automatic fuel changeover.
3. Gas dryers, gas-fired oven assemblies, manifold burner systems, metal-melting and annealing furnaces, and large gas engines, may operate on this rate either on an automatic or "semi-automatic" changeover basis.
4. On automatic changeover installations, straight gas-fired equipment would be shut down immediately when the outdoor control drops to the set point. For gas-fired annealing ovens, process assemblies, etc., where immediate shutdown is not acceptable, shutdown can be after a time delay of up to 4 hours, subject to National Grid approval.
5. Where any "semi-automatic" process equipment on this rate supplies all or part of the building heat requirements in winter, the plant operators are responsible to be on site 24 hours a day, 7 days a week to switch to the alternate fuel if necessary. For premises where such equipment does not provide building heat with plants closed at night and weekends, all equipment must be shutoff. Further, a manual switch is required ahead of the outdoor control, to disable the "semi-automatic" alarm when the plant is not manned.

**27.0 Propane as the Alternate Fuel**

Propane may be used as the alternate fuel only in Long Island (Nassau and Suffolk) with the approval of the local municipality having jurisdiction. Long Island propane installations must be built to conform to the standards of the LP-Gas Code NFPA58 and The Fuel Gas Code of New York State.

**27.1 Propane as a Distributed Plant Back-up Fuel**

Vaporized propane as a back-up fuel at TC sites may be connected to the natural gas lines using a manual or automatic three-way valve as described in this section. Customer shall submit to National Grid an itemized list of the BTU ratings of all gas utilization

equipment at the site.

Facilities intending to use an automatic three-way valve for fuel selection must wire the valve control to the FS/AMR outdoor controller. Wiring diagrams detailing the design of this circuit must be submitted. See Section **24.4.1** for control and monitoring requirements of automatic sites.

Facilities intending to use a manual three-way valve for fuel selection must install an alarm panel and bell to signal an operator when switching of fuels is required. The panel must be wired to the FS/AMR and designed to alert plant personnel when both switching to propane is required and back to natural gas. See Section **24.4.2** for control and monitoring requirements of semi-automatic sites.

### **27.1.2 Interconnection for Stand-by Fuels**

Where supplementary propane gas for stand-by use is connected downstream of the National Grid service meter and/or regulator, the customer shall install check valves on both the natural gas and propane piping to prevent back flow. National Grid will provide a piping diagram for location and proper installation of the check valves. A three-way valve installed to admit the stand-by supply, if of the type that completely closes one side before starting to open the other side, shall be permitted for use in place of check valves.

### **27.3 Deleted**

### **28.0 Deleted**

**29.0** Installers of dual-fuel equipment are required to contact National Grid regarding meter and service hardware location and for questions on burner gas train arrangement, support, venting, and Temperature Controlled requirements.

